

D

D

C

B
VER SHEE

B

A

A

SIGNATURE

A

B

B

B

B

B

B

B

B

B

FILE NAME: Y:\OCONUS\~MultipleSites\2026_1783264_P1360_MJMF\B_Design\DWCS\Sheet\01_GEN\PI360-1783264-G-001.dwg
LAYOUT NAME: G-001 COVER SHEET PLOTTED: Friday, January 16, 2026 - 10:03am USER: ann.priest

FILE NAME: Y:\DDONIS\MultipleSta\2026_1783264_P1360_MMF\B_Design\DWGS\Sheet\01_SEM\P1360-1783264-G-007.dwg LAYOUT NAME: G-007 PLOTTED: Monday, January 26, 2026 - 12:32pm USER: rodney.bentley

IBC BUILDING DESCRIPTION	
OCCUPANCY	MIXED, NON-SEPARATED GROUP B WITH ACCESSORY GROUP S-1 & GROUP R-3
TYPE OF CONSTRUCTION	TYPE IIB
NUMBER OF STORIES	1 STORY
HEIGHT	18,567 MM TO ROOF
AREA	1,827.9 SM

IBC ALLOWABLE HEIGHT & AREA			
	GROUP B	GROUP S-1	GROUP R-3
ALLOWABLE HEIGHT (TABLE 504.3)	22,860 MM	22,860 MM	22,860 MM
ALLOWABLE STORIES (TABLE 504.4)	4 STORIES	4 STORIES	5 STORIES
ALLOWABLE AREA (TABLE 506.2)	8,547 SM	6,503 SM	UNLIMITED SM
PER IBC, 508.3.2 FOR NON-SEPARATED OCCUPANCIES, THE ALLOWABLE AREA & HEIGHT OF THE BUILDING ARE BASED ON THE MOST RESTRICTIVE ALLOWANCES OF THE OCCUPANCIES UNDER CONSIDERATION.			
GROUP S-1 IS THE MOST RESTRICTIVE OCCUPANCY AT 4 STORIES, 22860 MM HIGH, AND AN AREA OF 6503 SM. AS DESIGNED, THE BUILDING IS 1 STORIES, 18567 MM HIGH, AND HAS AN AREA OF 1,827.9 SM. TYPE IIB IS ACCEPTABLE.			

IBC FIRE RESISTANCE RATING			
BUILDING ELEMENT / AREA	RATING (HOURS)		REFERENCE
	REQUIRED	PROVIDED	
PRIMARY STRUCTURAL FRAME	0	0	IBC, TABLE 601
EXTERIOR BEARING WALLS	0	0	IBC, TABLE 601
INTERIOR BEARING WALLS	0	0	IBC, TABLE 601
FLOOR CONSTRUCTION	0	0	IBC, TABLE 601
INTERIOR NON-BEARING WALLS	0	0	IBC, TABLE 601
OCCUPANCY SEPARATION	0	0	IBC, 508.3
ROOF CONSTRUCTION	0	0	IBC, TABLE 601
* DENOTES U.S. BUILDING CODE / DOD STANDARDS AND HOST NATION CRITERIA CONFLICTS			

NFPA FIRE RESISTANCE RATING			
BUILDING ELEMENT / AREA	RATING (HOURS)		REFERENCE
	REQUIRED	PROVIDED	
ELECTRICAL (118)	1	1	NFPA 70, 450.21(B)
UPS A (117)	1	1	NFPA 76, 6.10.2
UPS B (119)	1	1	NFPA 76, 6.10.2
OPS EQUIPMENT (116)	1	1	NFPA 76, 6.8.3
GENERATOR (115)	2	2	NFPA 110, 7.2.1
GENERATOR FUEL (114)**	3	3	NFPA 37, 6.3.6
FIRE PUMP (113)	1	1	NFPA 20, 4.14.1.1.2
* DENOTES U.S. BUILDING CODE / DOD STANDARDS AND HOST NATION CRITERIA CONFLICTS			
** CEILING RATING MUST MATCH WHAT IS PROVIDED. SEE FLOOR PLAN FOR MORE INFORMATION			

OPENING PROTECTIVES			
TYPE OF SEPARATION ASSEMBLY	RATING (HOURS)		REFERENCE
	REQUIRED	PROVIDED	
EXTERIOR BEARING WALLS	0	0	IBC, TABLE 705.8
PENETRATIONS IN FIRE BARRIERS	FIRESTOPPING	FIRESTOPPING	NFPA 101, 8.3.5.1

NFPA BUILDING DESCRIPTION	
OCCUPANCY*	MIXED BUSINESS, STORAGE, AND LODGING IN ACCORDANCE WITH NFPA 101 6.1.14.3
* PER NFPA 101, 6.1.14.3.2, THE BUILDING SHALL COMPLY WITH THE MOST RESTRICTIVE REQUIREMENTS OF THE OCCUPANCIES INVOLVED, UNLESS SEPARATE SAFEGUARDS ARE APPROVED.	

OCCUPANT LOAD & EGRESS CAPACITY		
LEVEL	CALCULATED OCCUPANT LOAD	EGRESS CAPACITY PROVIDED
FIRST	51	3178

MEANS OF EGRESS			
	REQUIRED	PROVIDED	REFERENCE
MINIMUM NUMBER OF EXITS	2	4	NFPA 101, 7.4
MINIMUM WIDTH, EXIT ACCESS CORRIDORS	1,120 MM	1,738 MM	NFPA 101, 7.3.4 & 38.2.3.2
MINIMUM WIDTH, EXIT DOORS	810 MM	1,016 MM	NFPA 101, 7.2.1.2.3.2
MINIMUM TOTAL EGRESS CAPACITY	1,620 MM	14,603 MM	NFPA 101, 7.3.3
MAXIMUM COMMON PATH OF TRAVEL			
- BUSINESS	30 M	29.2 M	NFPA 101, TABLE A.7.6
- STORAGE	30 M	9 M	NFPA 101, TABLE A.7.6
- LODGING	NOT REQUIRED	6 M	NFPA 101, TABLE A.7.6
MAXIMUM DEAD END CORRIDOR			
- BUSINESS	NA	NA	NFPA 101, TABLE A.7.6
- STORAGE	NA	NA	NFPA 101, TABLE A.7.6
MAXIMUM TRAVEL DISTANCE			
- BUSINESS	91 M	53.7 M	NFPA 101, TABLE A.7.6
- STORAGE	122 M	8.4 M	NFPA 101, TABLE A.7.6
MEANS OF EGRESS ILLUMINATION	YES	YES	NFPA 101, 7.8/42.2.8
EMERGENCY LIGHTING	YES	YES	NFPA 101, 7.9/42.2.9
EXIT SIGNS	YES	YES	NFPA 101, 7.10/42.2.10
*NA - NOT APPLICABLE			

FIRE PROTECTION			
	REQUIRED	PROVIDED	REFERENCE
FIRE SPRINKLER SYSTEM, WET-PIPE	YES	YES	UFC 3-600-01, 4-15.4 & 9-7.2.1.1 NFPA 76, 8.6.2.2
CLEAN AGENT FIRE EXTINGUISHING SYSTEM	YES	YES	UFC 3-600-01, 4-15.5 NFPA 76, 8.6.2.3
INTERIOR HOSE STATIONS	NO	NO	HOST NATION
FIRE ALARM	YES	YES	UFC 3-600-01, 9-18.1 NFPA 76, 8.4
ABOVE CEILING SMOKE DETECTION	NO	NO	HOST NATION
VERY EARLY WARNING SMOKE DETECTION	YES	YES	UFC 3-600-01, 4-15.3 NFPA 76
MANUAL FIRE EXTINGUISHERS	YES	YES	UFC 3-600-01, 9-17 NFPA 76, 8.6.3

INTERIOR FINISHES*			
	REQUIRED	PROVIDED	REFERENCE
WALL & CEILING FINISHES			
EXITS	CLASS A OR B	N/A	NFPA 101, TABLE A.10.2.2
EXIT ACCESS CORRIDORS	CLASS A OR B	CLASS A	NFPA 101, TABLE A.10.2.2
ALL OTHER AREAS	CLASS A, B, OR C	CLASS A	NFPA 101, TABLE A.10.2.2
FLOOR FINISHES			
EXITS	CLASS I OR II	N/A	NFPA 101, TABLE A.10.2.2
EXIT ACCESS CORRIDORS	NOT REQUIRED	N/A	NFPA 101, TABLE A.10.2.2
ALL OTHER AREAS	N/A	N/A	NFPA 101, TABLE A.10.2.2
* INTERIOR FINISHES BASES ON THE MOST CONSERVATIVE OCCUPANCY - BUSINESS			

APPLICABLE OCCUPANT LOAD FACTOR	
USE	OCCUPANT LOAD FACTOR (SM/PERSON)
BUSINESS	14
STORAGE (IN OTHER THAN STORAGE AND MERCANTILE OCCUPANCIES)	46.5
LODGING	4.6

CALCULATED OCCUPANT LOAD PER LIFE SAFETY CODE				
AREA	OCCUPANCY	APPROX. AREA	OCCUPANT LOAD FACTOR	OCCUPANT LOAD
FIRST FLOOR				
SHOWER, TOILET, BREAK, JANITOR, UNSECURE AND SECURE VESTIBLES	BUSINESS	73 SM	14 SM/PERSON	6
BUNK ROOM 1 & 2	LODGING	19 SM	4.6 SM/PERSON	4
OPEN OFFICE	BUSINESS	50 SM	14 SM/PERSON	4
CORRIDOR	BUSINESS	97 SM	14 SM/PERSON	7
STAGING AREA	STORAGE	134 SM	46.5 SM/PERSON	3
OPS EQUIPMENT	STORAGE	647 SM	46.5 SM/PERSON	14
UPS B	STORAGE	53 SM	46.5 SM/PERSON	2
ELECTRICAL	STORAGE	78 SM	46.5 SM/PERSON	2
UPS A	STORAGE	40 SM	46.5 SM/PERSON	1
GENERATOR ROOM	STORAGE	94 SM	46.5 SM/PERSON	2
GENERATOR FUEL ROOM	STORAGE	67 SM	46.5 SM/PERSON	2
FIRE PUMP	STORAGE	23 SM	46.5 SM/PERSON	1
MECHANICAL	STORAGE	124 SM	46.5 SM/PERSON	3
TOTALS:	---	~1499 SM	---	51


FIRE EXTINGUISHERS	
QUANTITY	TYPE
10	2A:20B:C
2	FK-5-1-12



APPROVED
FOR COMMANDER NAFAC
ACTIVITY
D. EVANS VIA EMAIL
SATISFACTORY TO DATE 01/15/2026
DELS RDB | DRW RDB | CHK MAM
PM/DM MJD/ATP
BRANCH MANAGER DSN
DES PROD DIR WBF
FIRE PROTECTION ENGINEER DSN

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - ATLANTIC
PLANNING, DESIGN AND CONSTRUCTION
VARIOUS LOCATIONS
VARIOUS LOCATIONS
JOINT MARITIME FACILITY
CODE COMPLIANCE SUMMARY
SCALE: AS NOTED
PROJECT NO.: 1838720
CONSTR. CONTR. NO.
NAFAC DRAWING NO. 14157065
SHEET 3 OF 170
G-007

FILE NAME: Y:\OCONUS\Multiplatform\2026_1783264_P1360_MAM\FB_Design\DWG\Sheet\01_GEN\1360-1783264-G-008.dwg LAYOUT NAME: G-008 PLOTTED: Monday, January 26, 2026 - 12:34pm USER: rodrey.bentley

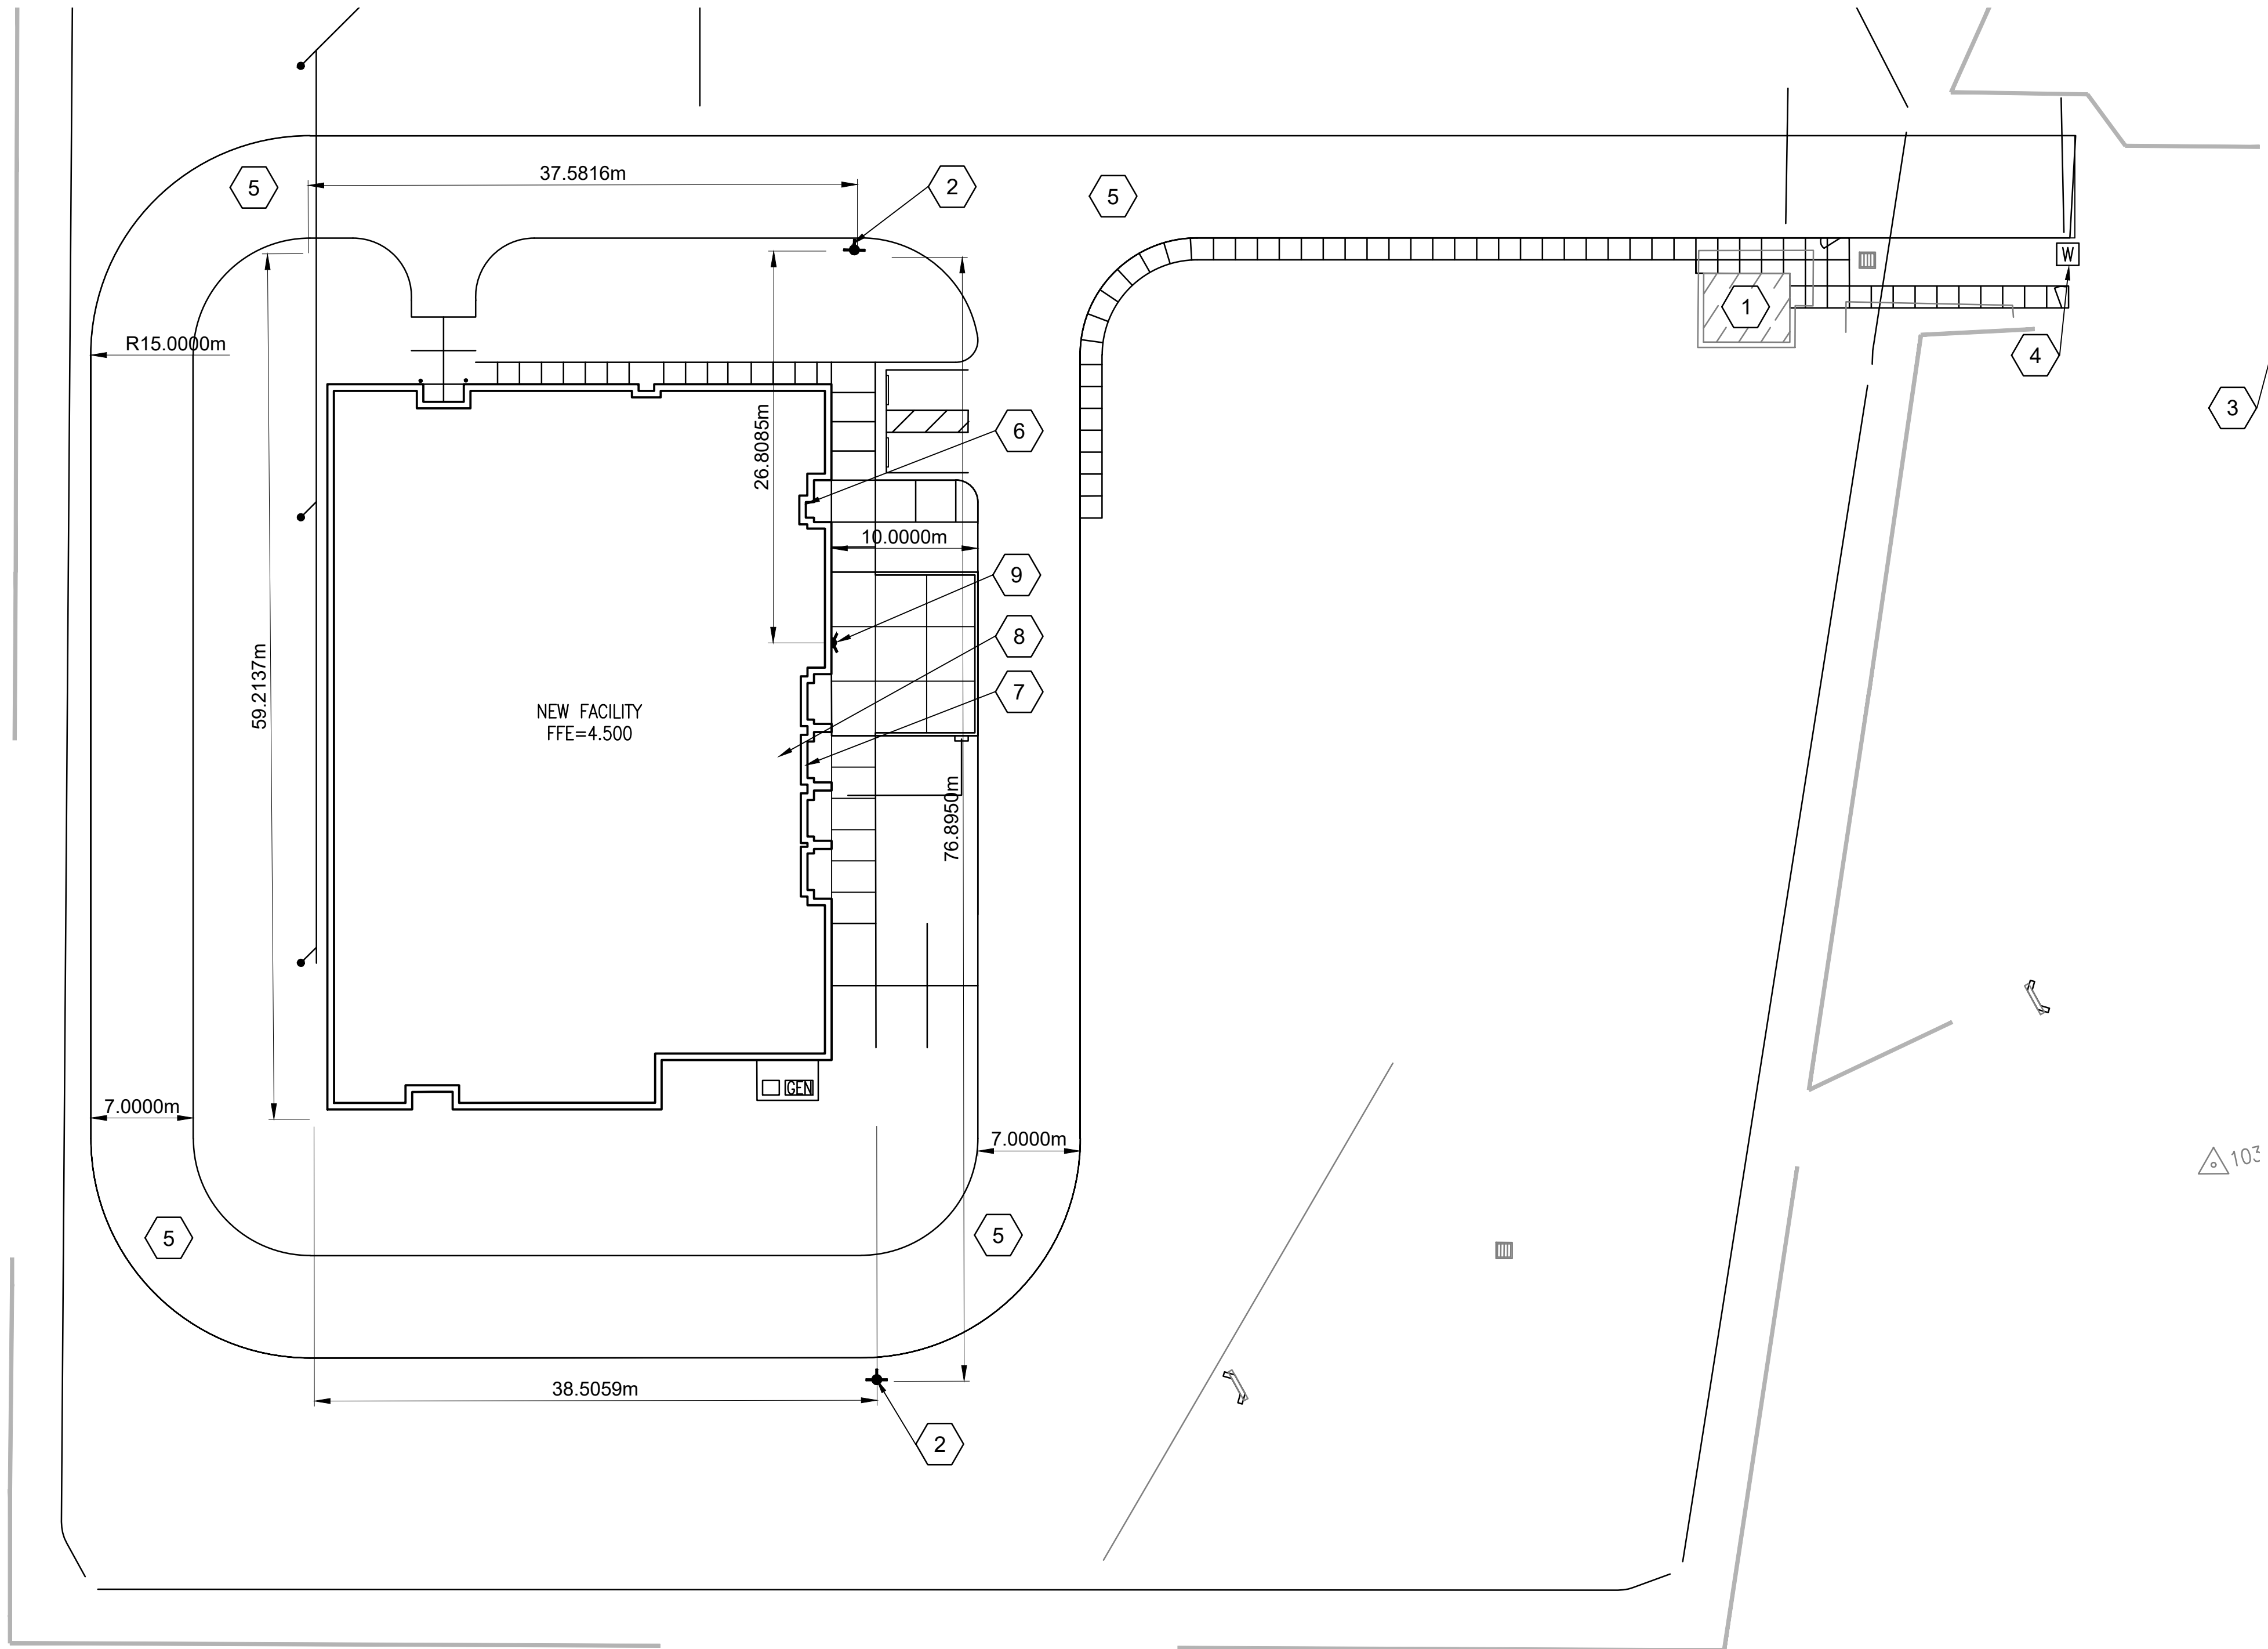


SITE PLAN
SCALE 1:300

GENERAL SHEET NOTES

1. THE EXISTING GUARD SHACK IS MORE THAN 18.3 METERS AWAY FROM THE PROPOSED BUILDING, DEMONSTRATING IT WILL NOT IMPOSE UPON THE PROPERTY LINE OF THE NEW BUILDING.
2. REFER TO CIVIL DRAWINGS FOR MORE INFORMATION.
3. FIRE FLOW FOR THE FACILITY PROVIDES 3550 L/MIN (938 GPM) @ 20PSI. DFPE APPROVED THE REDUCTION IN FIRE FLOW.

SHEET KEYNOTES

- ① EXISTING GUARD BUILDING
- ② NEW FIRE HYDRANT
- ③ EXISTING FIRE HYDRANT
- ④ EMERGENCY KEY BOX LOCATION. REFER TO CIVIL SHEET CU101.
- ⑤ FIRE DEPARTMENT VEHICLE ACCESS IN ACCORDANCE WITH UFC 3-600-01 SECTION 9-1.1
- ⑥ FIRE DEPARTMENT MAIN ENTRY
- ⑦ INCOMING FIRE WATER SERVICE
- ⑧ FIRE PUMP ROOM
- ⑨ FIRE DEPARTMENT CONNECTION

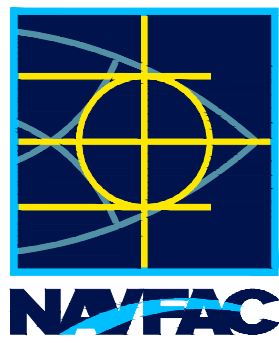

APPROVED
FOR COMMANDER NAVFAC
ACTIVITY
D. EVANS VIA EMAIL
SATISFACTORY TO DATE 01/15/2026
DES RDB DRW RDB CHM MAM
PM/DM MJD/ATP
BRANCH MANAGER DSN
DES PROD DIR WBF
FIRE PROTECTION ENGINEER DSN

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - ATLANTIC
PLANNING, DESIGN AND CONSTRUCTION
VARIOUS LOCATIONS
VARIOUS LOCATIONS
JOINT MARITIME FACILITY
BUILDING CODE SITE PLAN

GRAPHIC SCALE




SCALE: AS NOTED
EPROJECCT NO.: 1838720
CONSTR. CONTR. NO.
NAVFAC DRAWING NO. 14157066
SHEET 4 OF 170
G-008



G-201

FILE NAME: Y:\CONSTRUCTION\MultipleSheets\2026_1783264_P1360_JMFA\B_Design\DWG\Sheet\01_GEN\P1360-1783264_G-201_G-202.dwg LAYOUT NAME: C-202 AIR BARRIER SYSTEM BUILDING SECTIONS PLOTTED: Wednesday, January 21, 2026 - 8:38am USER: paul.a.keller1

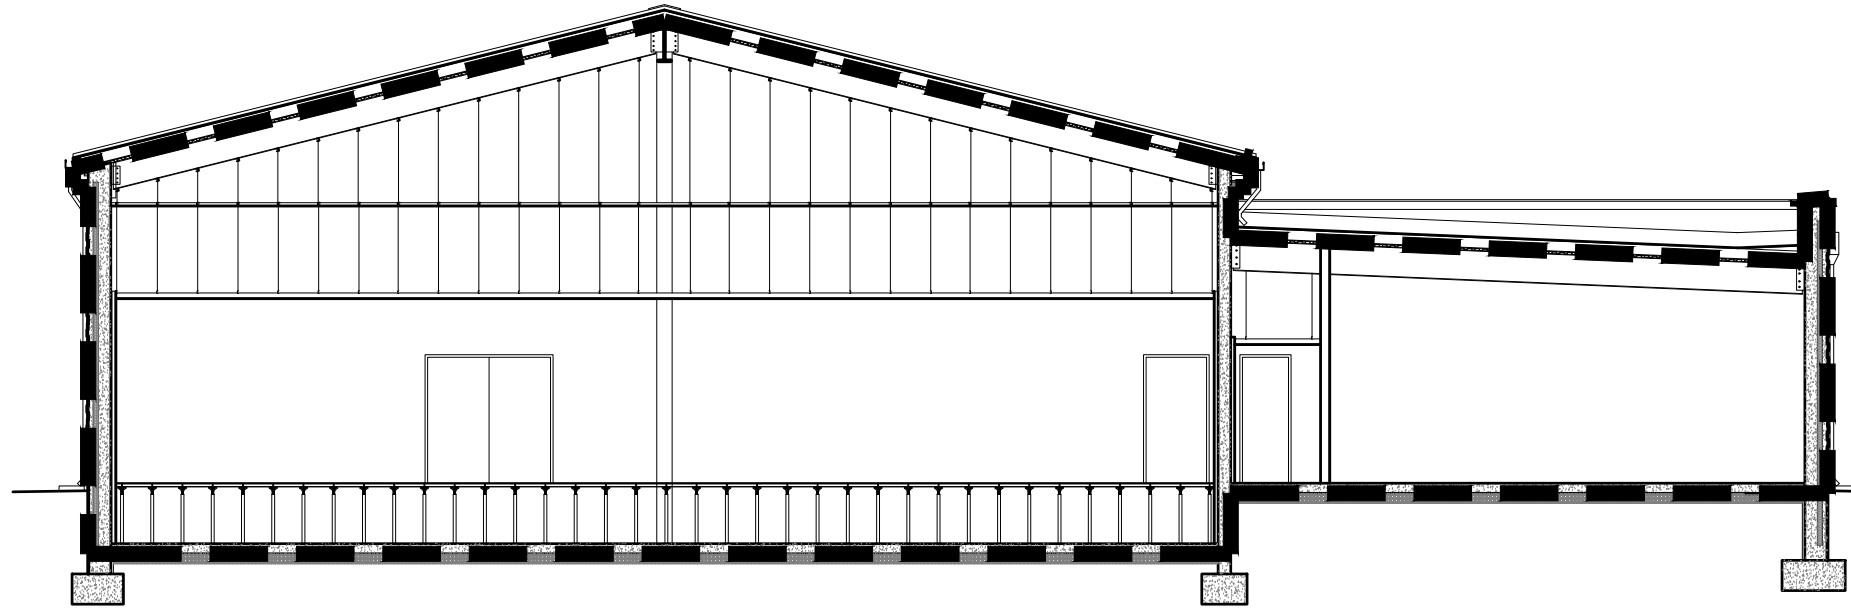

C1 BUILDING SECTION
SCALE: 1:150

G-201

**AIR BARRIER ENCLOSURE
SURFACE AREA OF
EXTERIOR ENVELOPE:**

WALLS:
(INCLUDES FENESTRATION AND DOORS)

INSULATED PRECAST CONCRETE AIR WATER BARRIER
SYSTEM: 1004 SM

FABRICATED WALL PANEL ON PRECAST CONCRETE AIR
WATER BARRIER SYSTEM: 198 SM

TOTAL EXTERIOR WALL SURFACE AIR/WATER BARRIER
SYSTEM: 1202 SM

SOFFITS:
FABRICATED METAL WALL PANELS

TOTAL SOFFIT AREA: 62 SM

ROOF: MODIFIED BITUMEN ROOF AND STANDING SEAM ROOF

TOTAL MODIFIED BITUMEN ROOF SURFACE AREA AIR WATER
BARRIER SYSTEM: 984 SM

TOTAL STANDING SEAM ROOF SURFACE AREA AIR WATER
BARRIER SYSTEM: 734 SM

TOTAL ROOF SURFACE AREA AIR/WATER BARRIER SYSTEM:
1708 SM

FLOOR:
CONCRETE FLOOR SLAB

TOTAL FLOOR SURFACE AREA AIR/WATER BARRIER SYSTEM:
1644 SM

TOTAL ENCLOSURE SURFACE AREA: 5817 SM

ENCLOSURE SURFACE AREA NOTE:

THE ENCLOSURE SURFACE AREAS LISTED TO THE LEFT ARE APPROXIMATES FOR THE FLOOR, WALLS/FENESTRATION, AND ROOF/CEILING. THE SURFACE AREA DOES NOT INCLUDE PENETRATIONS AND UNINTENTIONAL HOLES WITHIN THE AIR BARRIER. THE ENCLOSURE SURFACE AREAS FOR "INTENTIONAL" HOLES IN THE BUILDING ENCLOSURE ARE APPROXIMATES AND DO NOT TAKE INTO ACCOUNT ALL "INTENTIONAL" HOLES. THESE "INTENTIONAL" HOLES INCLUDE AIR INTAKE, EXHAUST LOUVERS, MAKE-UP AIR INTAKES, PRESSURE RELIEF DAMPERS, OR LOUVERS, EXHAUST VENT DAMPERS, AND ANY OTHER INTENTIONAL HOLE THIS IS NOT INCLUDED IN THE AIR BARRIER DESIGN OR CONSTRUCTION. EXTERIOR WINDOWS AND DOORS (FENESTRATION) ARE NOT INTENTIONAL OPENINGS. FENESTRATION IS INCLUDED IN THE AIR BARRIER TEST BOUNDARY. VERIFY THE AREAS/ DIMENSIONS PROVIDED IN THE CALCULATIONS MATCH AS-BUILT CONDITIONS.

AIR BARRIER LEGEND:

--- EXTENTS OF AIR BARRIER

GENERAL NOTES:

1 PERFORM AIR BARRIER INSPECTION IN (AS MINIMUM) AREAS IDENTIFIED IN AIR BARRIER KEY PLANS, THIS SHEET.

2 VERIFY PROPER INSTALLATION & INTEGRITY OF AIR BARRIER ASSEMBLY IN AREAS TO BE CONCEALED (I.E. INSIDE CAVITY WALL, INACCESSIBLE ENCLOSED VOID SPACES, ETC.) PRIOR TO COMMENCING WITH CONCEALMENT.

VARIOUS COMPONENTS OF THE AIR BARRIER ASSEMBLY ARE INDICATED THROUGHOUT THE DRAWING SET. THE FOLLOWING ARE CONSIDERED AIR BARRIER COMPONENTS:

A. EXTERIOR WALLS: INSULATED PRECAST CONCRETE WALLS

B. EXTERIOR WALLS: FABRICATED WALL ASSEMBLY

C. UPPER ROOF: STANDING SEAM METAL ROOF ON SELF ADHERED MODIFIED BITUMEN UNDERLAYMENT AND ICE AND WATER SHIELD OVER GLASS MAT GYPSUM ROOF BOARD ON RIGID INSULATION ON SELF-ADHERED AIRBARRIER ON GLASS MATT COVER BOARD ON METAL DECKING.

D. LOW ROOF: TRIPLE PLY SBS MODIFIED BITUMEN ROOFING ASSEMBLY ON GLASS MAT GYPSUM COVER BOARD ON RIGID INSULATION ON SELF-ADHERED AIRBARRIER ON GLASS MATT COVER BOARD ON METAL DECKING.

E. FENESTRATION: HINGED DOORS AND TRANSLUCENT PANELS.

GENERAL NOTES CONTINUED:

PROVIDE THE FOLLOWING AIR BARRIER TYPES AT SIMILAR MATERIAL JOINTS:

4 A. CONCRETE: FLUID APPLIED AIR BARRIER MEMBRANE, MIN 200mm OVERLAP ALL SIDES

B. GLASS MAT GWB SHEATHING: SELF-ADHERED, VAPOR IMPERMEABLE AIR BARRIER MEMBRANE, OVERLAP MIN 200mm ALL SIDES

5 SEE GENERAL NOTES ON WALL SECTION, SECTION & DETAIL SHEETS FOR ADDITIONAL AIR BARRIER REQUIREMENTS.

6 SEE CEILING DETAILS FOR SEALING TOP OF PARTITIONS / WALLS AT AIR BARRIER ASSEMBLY.

7 AIR BARRIER PRODUCTS AND ACCESSORIES MUST BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDED INSTALLATION REQUIREMENTS AND MUST BE COMPATIBLE WITH FLASHING AND SEALANTS. SEALANTS, COMPONENTS, CLADDING MATERIALS, PENETRATIONS, AND TRANSITION MATERIALS THAT TIE DIRECTLY INTO THE AIR BARRIER ASSEMBLY MUST BE CHECKED FOR COMPATIBILITY WITH THE PRIMARY MANUFACTURER OF AIR BARRIER ASSEMBLY. SUBMIT LETTERS OF COMPLIANCE.

8 PROVIDE AN AIR BARRIER SELF ADHERING TRANSITION MEMBRANE STRIP/UNDERLAYMENT AT ALL CORNERS, ROUGH OPENINGS, AND TRANSITIONS BETWEEN DISSIMILAR MATERIALS. REFER TO ARCHITECTURE DRAWINGS A-500 SERIES AND A-600 SERIES FOR MATERIAL COMPONENT IDENTIFICATIONS AND EXTENTS.

9 SEAL VAPOR BARRIER JOINTS AND SEAMS. SEAL ALL PENETRATIONS AT CONCRETE SLAB WITH AIR BARRIER SEALANT FOR FIRE STOPPING/SMOKE SEALANT AT FIRE RATED CONSTRUCTION.

AIR BARRIER LEGEND:

--- EXTENTS OF AIR BARRIER

GRAPHIC SCALE

1:150 0 1500 7500 15000mm

A1 BUILDING SECTION
SCALE: 1:150

G-201



APPROVED
FOR COMMANDER NAVFAC
ACTIVITY
D. EVANS VIA EMAIL
SATISFACTORY TO DATE 01/15/2026
DES PAK DRW PAK ICHK JHR
PW/DM MJD/ATP
BRANCH MANAGER
DES PROD DIR KMC
FIRE PROTECTION ENGINEER WBF DSN

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - ATLANTIC
PLANNING, DESIGN AND CONSTRUCTION
VARIOUS LOCATIONS
VARIOUS LOCATIONS
JOINT MARITIME FACILITY
AIR BARRIER SYSTEM BUILDING SECTIONS

SCALE: AS NOTED
APPROVED NO.: 1838720
CONSTR. CONTR. NO.
NAVFAC DRAWING NO.: 14157069
SHEET 7 OF 170
G-202