



REPLACE GRAVITY SEWER NEAR B298

WO# 7278814

MARINE CORPS AIR STATION

CHERRY POINT, NORTH CAROLINA

INDEX OF DRAWINGS			
NAVFAC	SHEET NO.	SHEET	TITLE
12926199	1 OF 06	G-001	COVER SHEET
12926200	2 OF 06	C-001	GENERAL NOTES, LEGENDS, AND ABBREVIATIONS
12926201	3 OF 06	CU101	SITE UTILITY PLAN - EXISTING CONDITIONS & DEMOLITION
12926202	4 OF 06	CU102	SITE UTILITY PLAN - NEW WORK
12926203	5 OF 06	CU301	SEWER MAIN PROFILE
12926204	6 OF 06	C-501	DETAILS

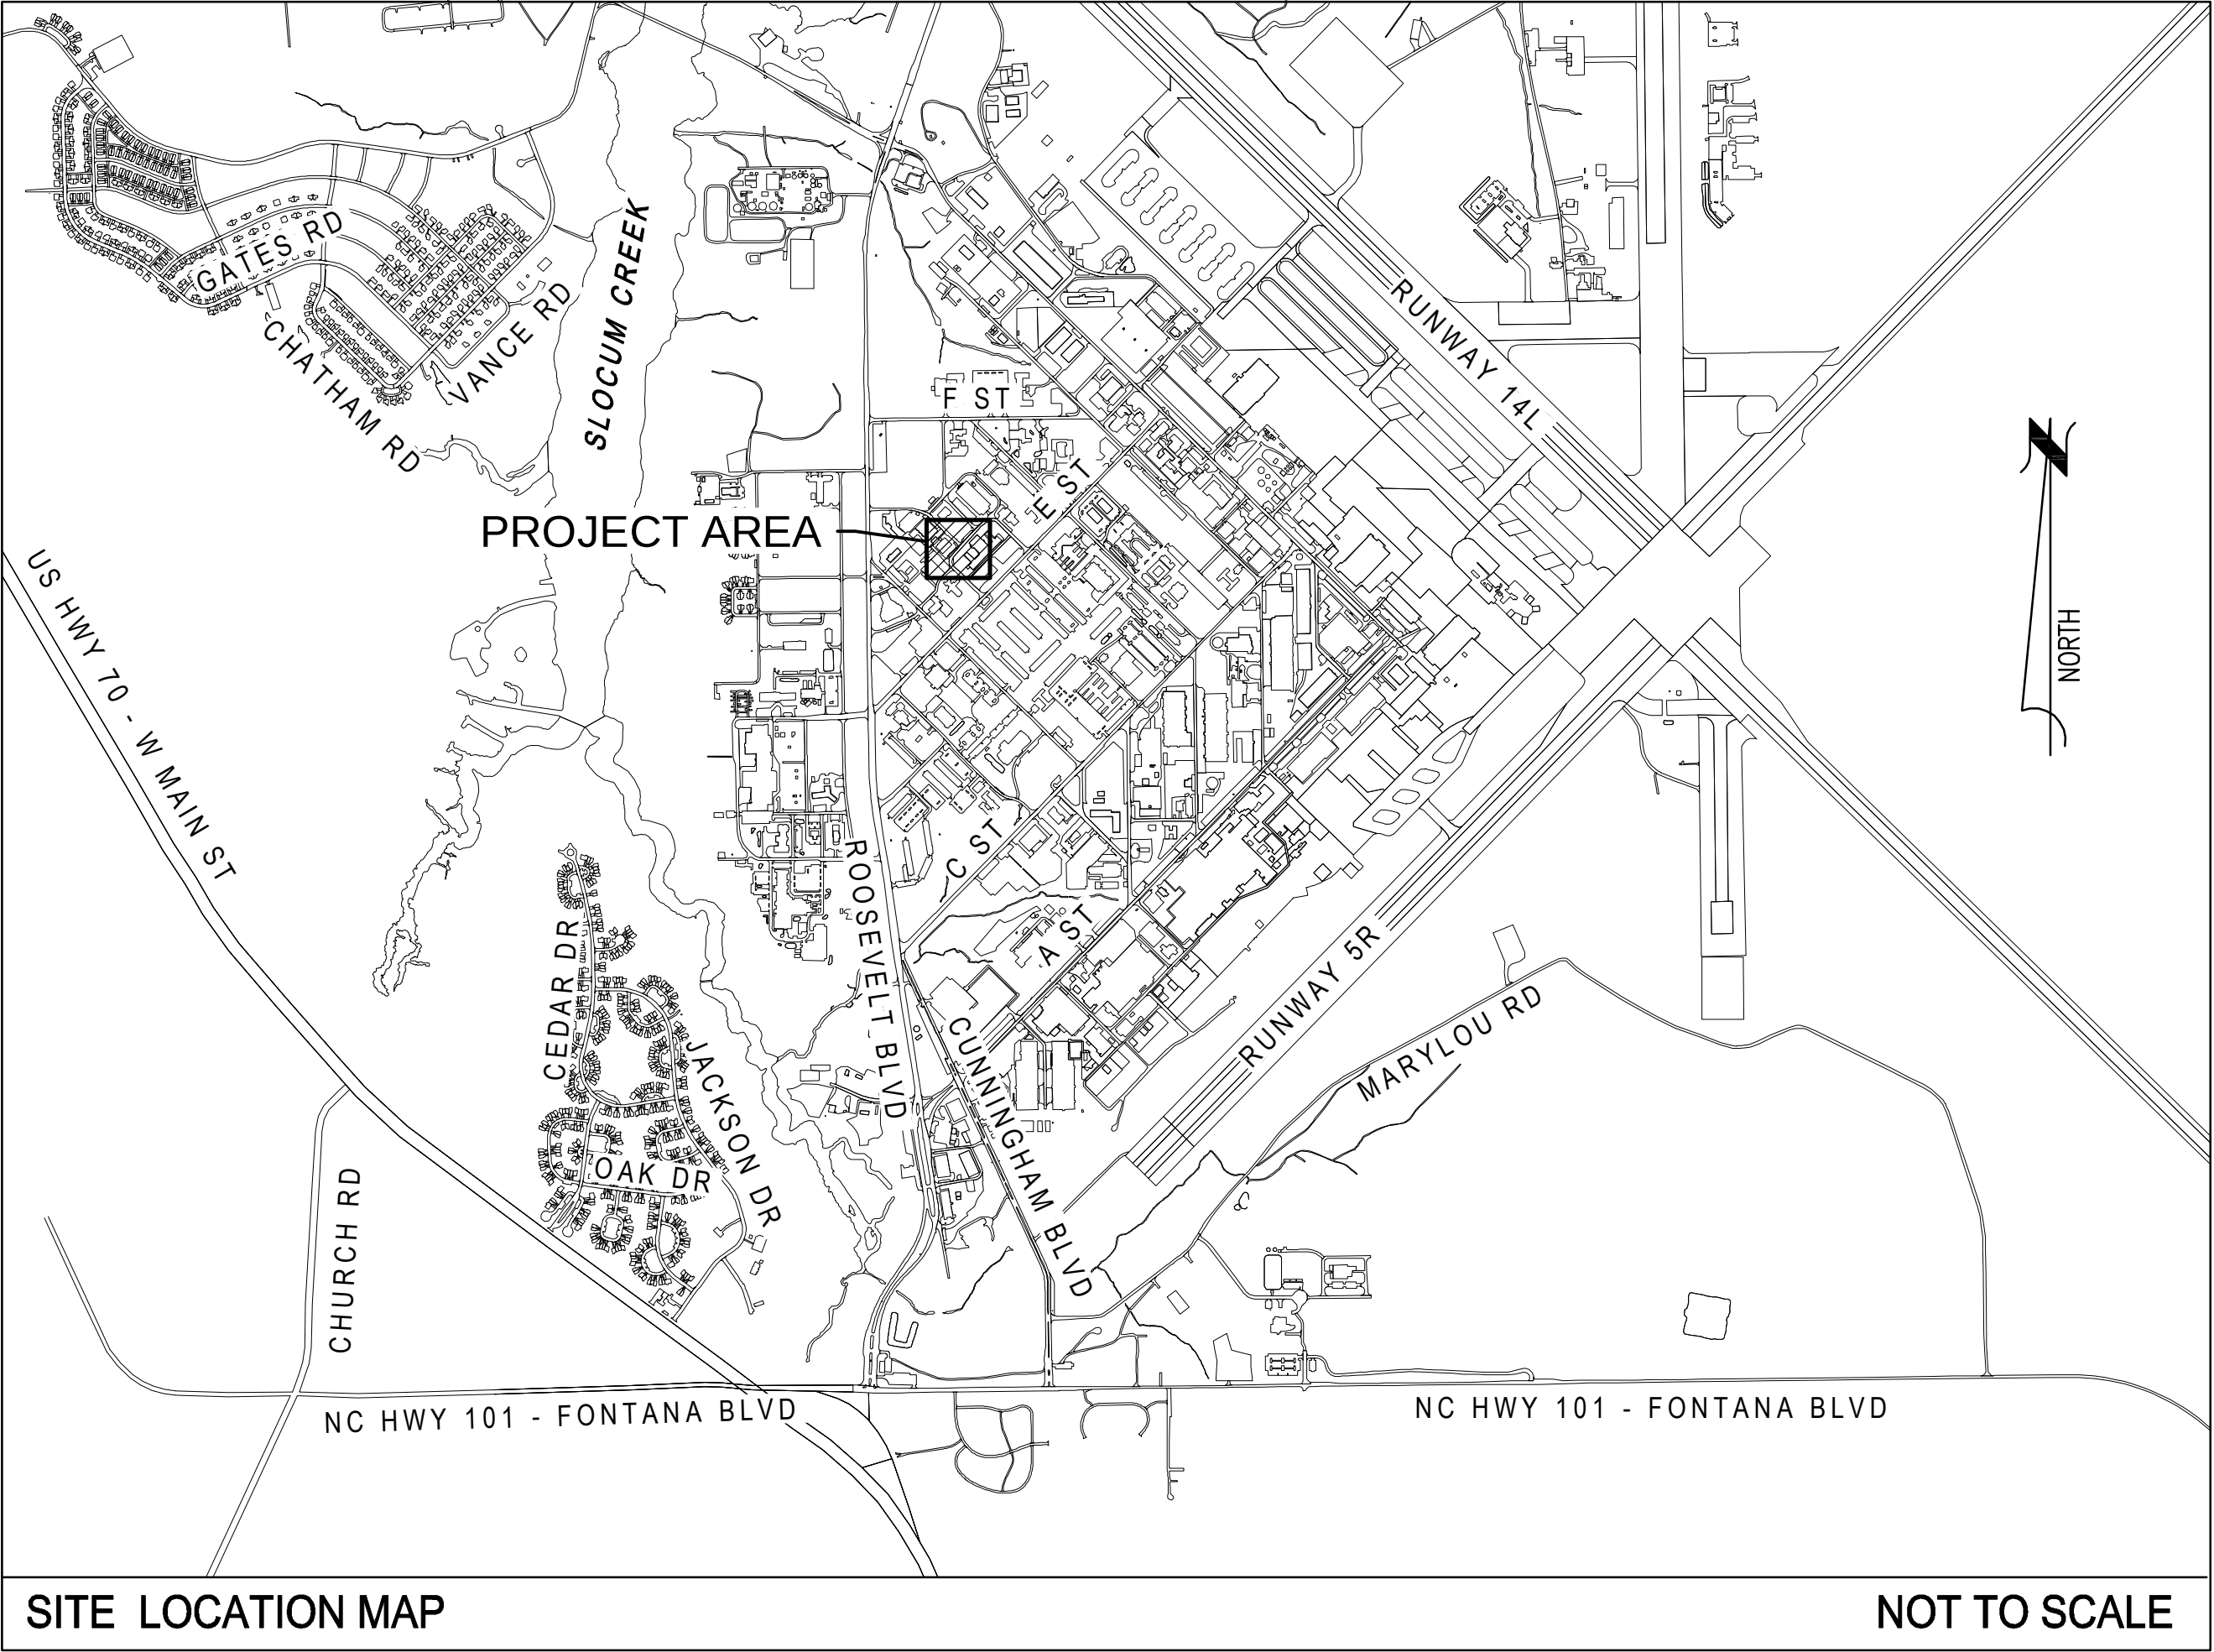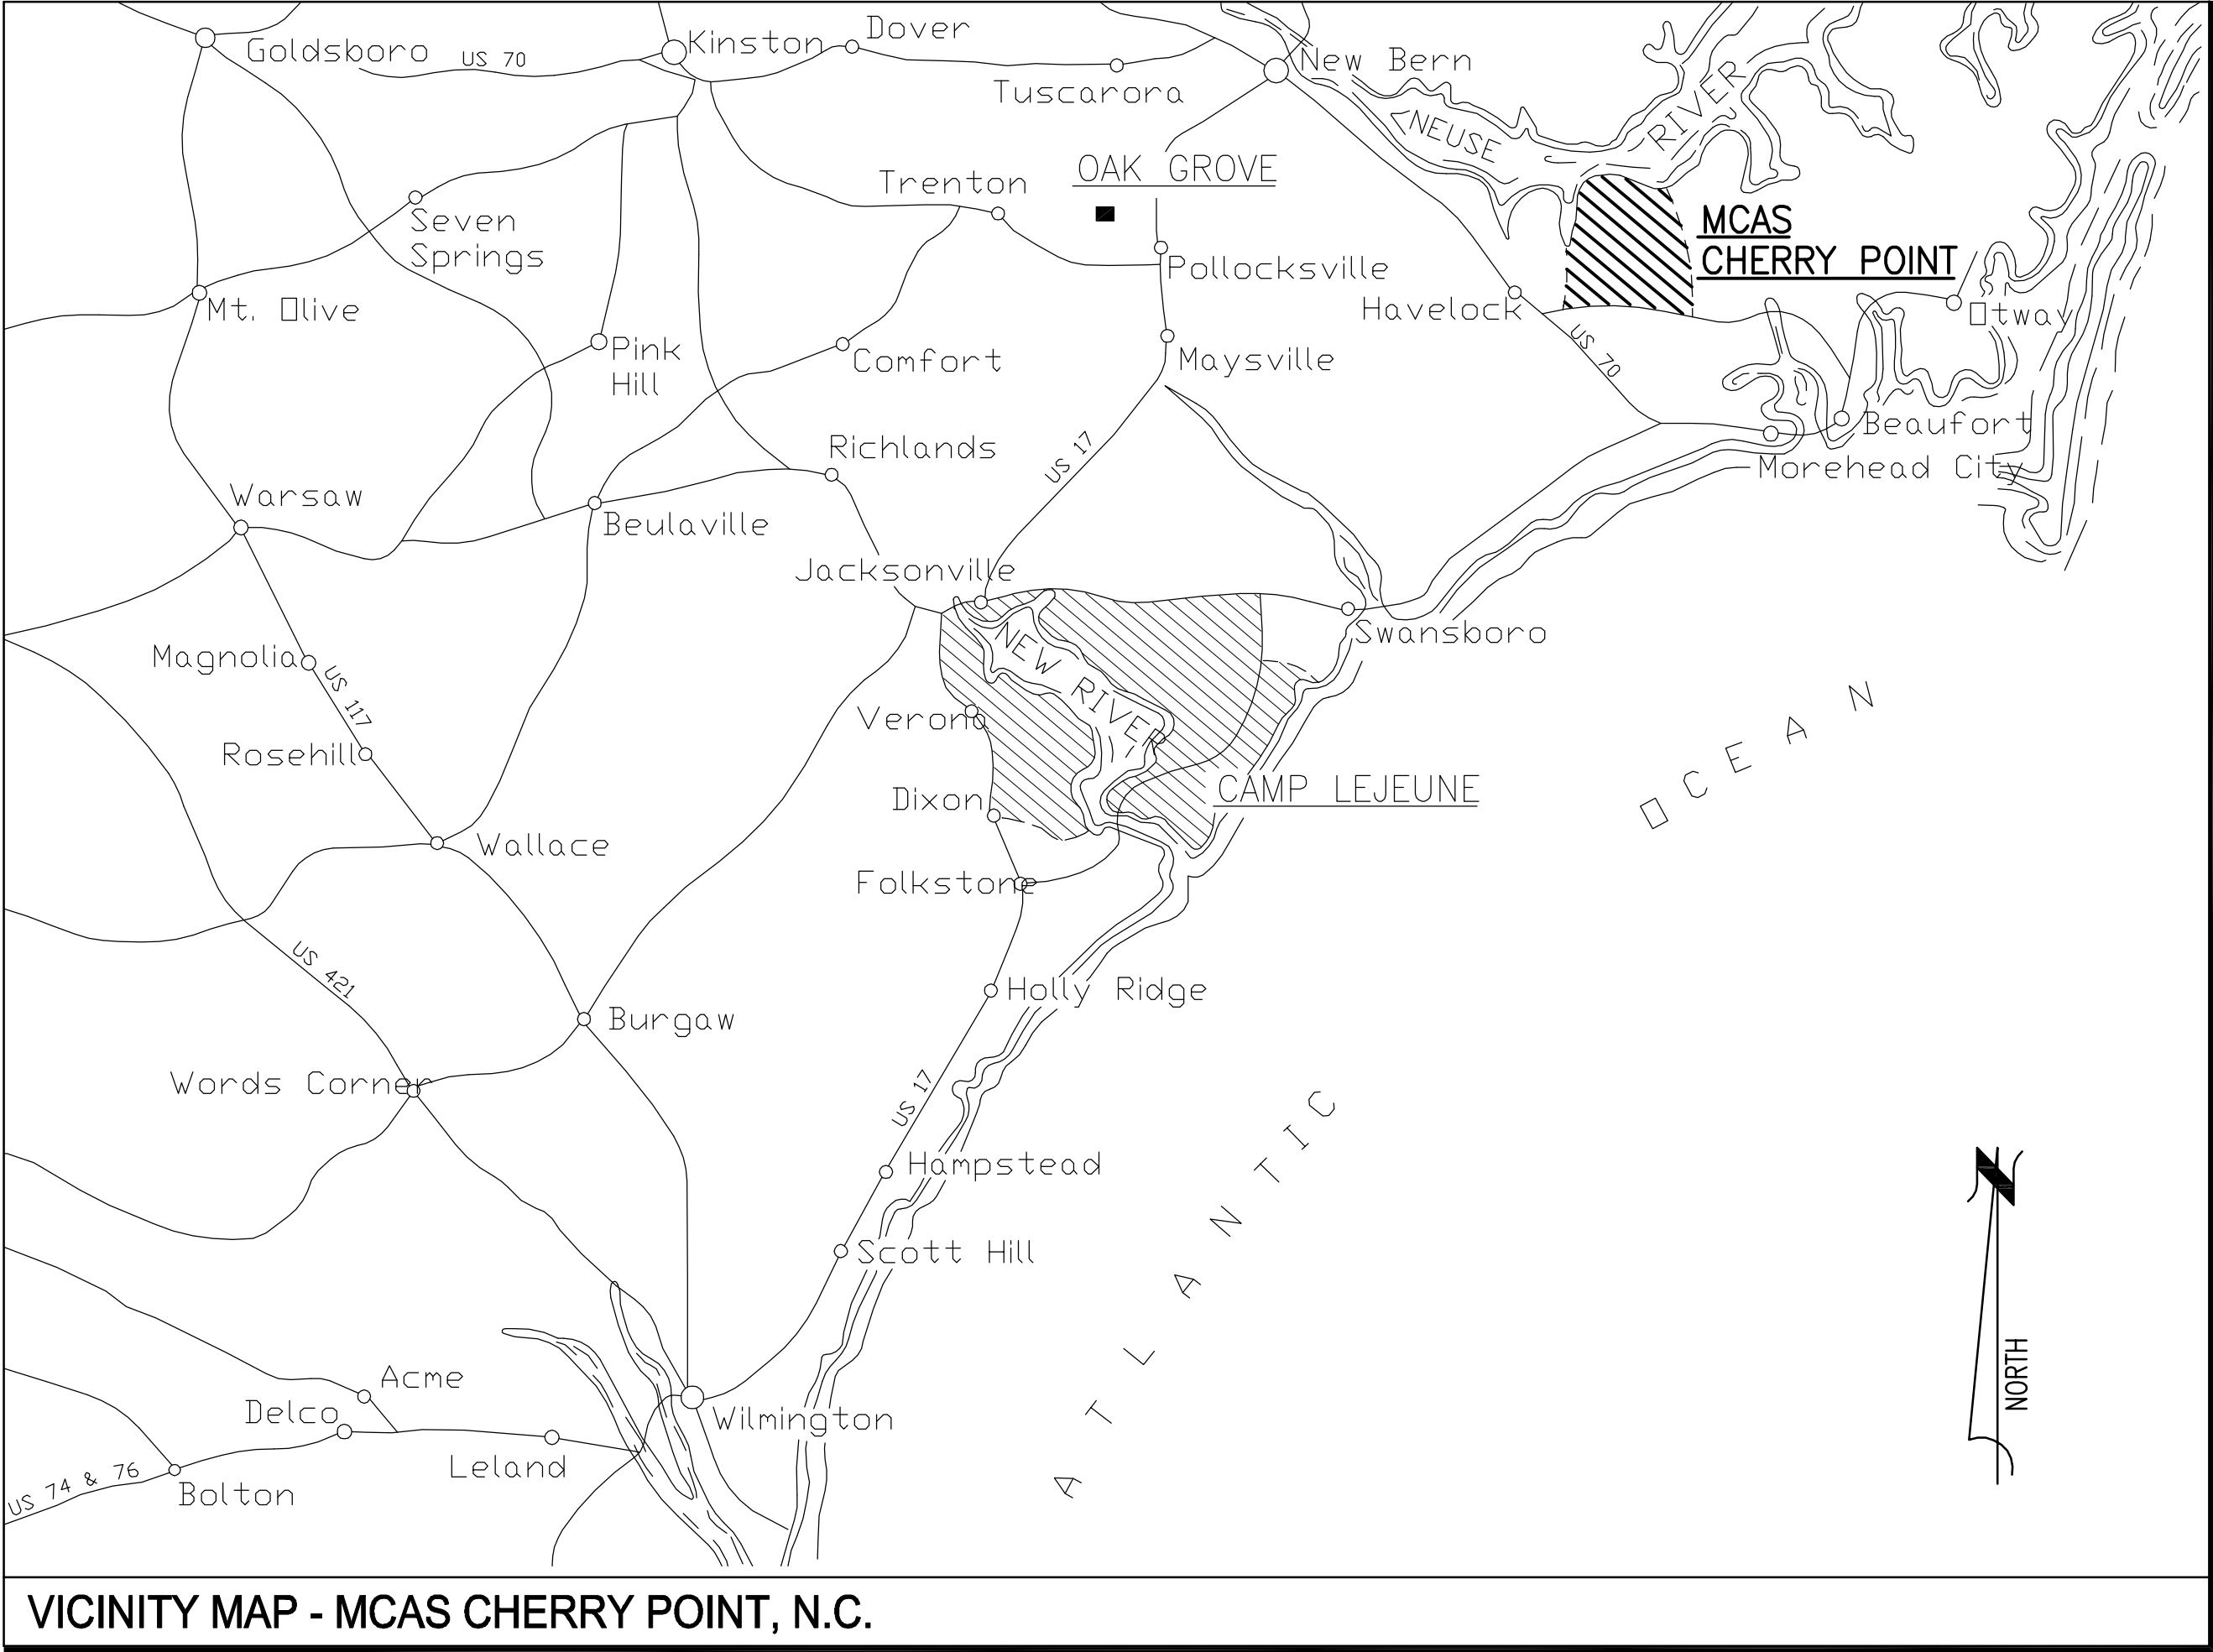

SYN	DESCRIPTION	DATE	APPR



NRW ENGINEERING
Structural Consultants
748 Lord Dunmore Drive, Suite 101
Virginia Beach, VA 23464
Phone 757-474-0812
Fax 757-474-0919

APPROVED

FOR COMMANDER NAVFAC

ACTIVITY

SATISFACTORY TO DATE

DES JKA DRW MSP CHK JCA

PM/TM

BRANCH MANAGER

CHIEF ENG/ARCH

FIRE PROTECTION

NAVAL FACILITIES ENGINEERING COMMAND - MIDATLANTIC
NAVAL STATION - NORFOLK, VA
CHERRY POINT, NORTH CAROLINA
U.S. MARINE CORPS AIR STATION
REPLACE GRAVITY SEWER NEAR B298
COVER SHEET

PROJECT: 25010
SCALE:
EPROJECT NO.:
MAXIMO WORK ORDER NO.:
7278814
NAVFAC DRAWING NO.:
12926199
SHEET 1 OF 06
G-001
DRAWN/REVISED: 10 MARCH 2009
LICENSE NO. C-0706
AVOLIS ENGINEERING, P.A.
P.O. BOX 15564
NEW BERN, NC 28561
PH. (252) 633-0068

PLOT DATE: December 3, 2025 2:11 PM

A

A

HAZARDOUS AND OTHER MATERIAL SPECIAL HANDLING NOTES:

1. THE CONTRACTOR SHALL REMOVE AND LEGALLY DISPOSE OF ALL CONSTRUCTION WASTE AND EXCESS MATERIAL OFF OF THE BASE PROPERTY. THE CONTRACTOR SHALL COMPLY WITH ALL STATE, LOCAL AND FEDERAL HAULING AND DISPOSAL REGULATIONS.
2. BURNING ON THE BASE PROPERTY IS NOT PERMITTED.
3. IF SUSPECT HAZARDOUS MATERIALS ARE ENCOUNTERED DURING CONSTRUCTION, WORK IN THE AFFECTED AREA SHALL STOP AND THE CONTRACTING OFFICER SHALL BE NOTIFIED IMMEDIATELY TO CONFIRM SITE CONDITIONS.
4. IF SUSPECTED AREAS OF SOIL OR GROUNDWATER CONTAMINATION ARE ENCOUNTERED DURING CONSTRUCTION ACTIVITIES, WORK IN THE AFFECTED AREA SHALL STOP AND THE CONTRACTING OFFICER SHALL BE NOTIFIED IMMEDIATELY TO CONFIRM SITE CONDITIONS.
5. MONITORING WELLS EXIST IN THE AREA OF WORK. ALL MONITORING WELLS SHALL BE PROTECTED FROM CONSTRUCTION ACTIVITIES BY THE CONTRACTOR. ANY DAMAGE SHALL BE REPAIRED BY THE CONTRACTOR AT HIS OWN EXPENSE. REPORT ANY DAMAGE TO THE CONTRACTING OFFICER IMMEDIATELY.

SEWER BYPASS REQUIREMENTS:

NO WETLANDS EXIST WITHIN THE LIMITS OF DISTURBANCE.

DOMESTIC SEWER FLOW SHALL BE MAINTAINED FOR THE DURATION OF THE CONTRACTOR'S WORK. THE CONTRACTOR SHALL INSPECT SITE CONDITIONS AND DETERMINE THE ANTICIPATED DOMESTIC SEWER FLOW RATE. THE CONTRACTOR SHALL PROVIDE A SYSTEM THAT SHALL SATISFACTORILY BYPASS THE ANTICIPATED WASTEWATER FLOW TO THE DOWNSTREAM SEWER. THE BYPASS SYSTEM SHALL CONSIST AS A MINIMUM OF A TEMPORARY DUPLEX PUMPING SYSTEM WITH CONTROLS AND TEMPORARY CONNECTIONS TO THE UPSTREAM AND DOWNSTREAM SEWER. THE PUMPING SYSTEM SHALL BE CAPABLE OF HANDLING THE ANTICIPATED FLOW. ALL EXPENSES ASSOCIATED WITH PROVIDING, OPERATING AND MAINTAINING THE BYPASS SYSTEM SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. A PORTABLE GENERATOR SHALL BE PROVIDED, SIZED PROPERLY TO OPERATE THE BYPASS SYSTEM IN THE CASE OF A POWER OUTAGE.

ABBREVIATIONS	
AC	ASBESTOS CEMENT (PIPE)
AIP	ABANDONED IN PLACE
APPROX.	APPROXIMATE/APPROXIMATELY
CI	CAST IRON (PIPE)
CJ	CONTRACTION JOINT
CMH	COMMUNICATIONS MANHOLE
CMP	CORRUGATED METAL PIPE
CMU	CONCRETE MASONRY UNIT
DIA, Ø	DIAMETER
DI	(STORM DRAIN) DROP INLET
DI	DUCTILE IRON (PIPE)
DMH	DRAINAGE MANHOLE
EJ	EXPANSION JOINT
EX, EXIST	EXISTING
HØR	HORIZONTAL
HVAC	HEATING VENTILATION AND A/C
INV	INVERT
JBOX	ELECTRIC JUNCTION BOX
LF	LINEAR FOOT/FEET
MAG	MAG NAIL (SURVEY CONTROL)
MAX	MAXIMUM
MH	MANHOLE
MIN	MINIMUM
OHE	OVERHEAD ELECTRIC
OC	ON CENTER
OD	OUTSIDE DIAMETER
RCP	REINFORCED CONCRETE PIPE
STA	STATION
SMH	SANITARY SEWER MANHOLE
TBM	TEMPORARY SITE BENCHMARK
TON	TOP OF (VALVE) NUT
TYP	TYPICAL
VCP	VITRIFIED CLAY PIPE
XFMR	PAD MOUNTED ELECTRIC TRANSFORMER
YH	YARD HYDRANT

DRAWFORM REVISION: 10 MARCH 2009

DRAWFORM F

DRAWFORM REVISION: 10 MARCH 200

SEWER BYPASS REQUIREMENTS:

DOMESTIC SEWER FLOW SHALL BE MAINTAINED FOR THE DURATION OF THE CONTRACTOR'S WORK. THE CONTRACTOR SHALL INSPECT SITE CONDITIONS AND DETERMINE THE ANTICIPATED DOMESTIC SEWER FLOW RATE. THE CONTRACTOR SHALL PROVIDE A SYSTEM THAT SHALL SATISFACTORILY BYPASS THE ANTICIPATED WASTEWATER FLOW TO THE DOWNSTREAM SEWER. THE BYPASS SYSTEM SHALL CONSIST AS A MINIMUM OF A TEMPORARY DUPLEX PUMPING SYSTEM WITH CONTROLS AND TEMPORARY CONNECTIONS TO THE UPSTREAM AND DOWNSTREAM SEWER. THE PUMPING SYSTEM SHALL BE CAPABLE OF HANDLING THE ANTICIPATED FLOW. ALL EXPENSES ASSOCIATED WITH PROVIDING, OPERATING AND MAINTAINING THE BYPASS SYSTEM SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. A PORTABLE GENERATOR SHALL BE PROVIDED, SIZED PROPERLY TO OPERATE THE BYPASS SYSTEM IN THE CASE OF A POWER OUTAGE.

GENERAL CONSTRUCTION NOTES:

1. THE LOCATION AND DEPTHS OF EXISTING UTILITIES SHOWN ARE APPROXIMATE. THE CONTRACTOR MUST BE RESPONSIBLE FOR SCANNING THE AREA OF WORK TO IDENTIFY TO HIS OWN SATISFACTION THE EXTENT OF UTILITIES PRESENT INCLUDING THE UTILITIES INDICATED TO BE PRESENT, THOSE NOT SHOWN, AND THOSE SHOWN TO BE IN A DIFFERENT LOCATION.
2. PHYSICAL SITE FEATURES OUTSIDE THE AREA OF WORK OR THOSE FEATURES NOT RELEVANT TO THE WORK BEING PERFORMED ARE NOT SHOWN FOR CLARITY.
3. THE CONTRACTOR MUST BE RESPONSIBLE FOR MAINTAINING TRAFFIC FLOW DURING THE COURSE OF CONSTRUCTION. THE CONTRACTOR MUST DEVELOP A TRAFFIC CONTROL PLAN TO BE SUBMITTED TO THE CONTRACTING OFFICER FOR APPROVAL PRIOR TO STARTING CONSTRUCTION.
4. ALL EXISTING VEGETATED AREAS DISTURBED DURING CONSTRUCTION MUST BE REVEGETATED IN ACCORDANCE WITH THE PROJECT VEGETATION PLAN, SEE DETAIL C3, SHEET C-501.
5. COMPLETE ALL TRENCH SECTION IN ACCORDANCE WITH DETAIL A3, SHEET C-501.

DEMOLITION WORK ITEMS

- 1 REMOVE EXISTING PAVEMENT AND STONE BASE.
- 2 REMOVE EXISTING CURB AND GUTTER.
- 3 REMOVE EXISTING 8" VCP WITH CAST-IN-PLACE LINER SEWER MAIN.
- 4 REMOVE MANHOLE.
- 5 SILT FENCE - SEE DETAIL A1, SHEET C-501.

UNCLASSIFIED//FOR OFFICIAL USE ONLY

UNCLASSIFIED//FOR OFFICIAL USE ONLY



NRW ENGINEERING
Structural Consultants
748 Lord Dunmore Drive, Suite 101
Virginia Beach, VA 23464
Phone 757-474-0612
Fax 757-474-0919

APPROVED

FOR COMMANDER NAVFAC

ACTIVITY

SATISFACTORY TO DATE

DES JKA DRW MSP CHK JKA

PA/TM

BRANCH MANAGER

CHIEF ENG/ARCH

FIRE PROTECTION

NAVAL FACILITIES ENGINEERING COMMAND - MID-ATLANTIC
NAVAL STATION - NORFOLK, VA

CHERRY POINT, NORTH CAROLINA

U.S. MARINE CORPS AIR STATION

REPLACE GRAVITY SEWER NEAR B298

SITE UTILITY PLAN - EXISTING CONDITIONS & DEMOLITION

PROJECT: 28010

SCALE:

PROJECT NO.:

MAXIMO WORK ORDER NO.

7278814

NAVFAC DRAWING NO.

12926201




SHEET 3 OF 06

CU101

DRAWING REVISION: 10 MARCH 2009

SITE UTILITY PLAN - EXISTING CONDITIONS & DEMOLITION

SCALE: 1" = 10'

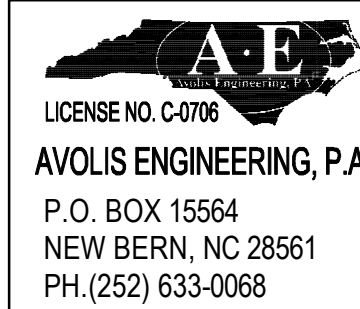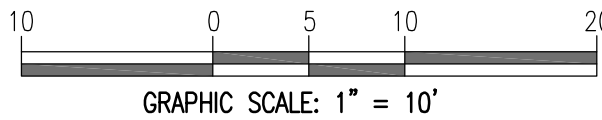

AVOLIS ENGINEERING, P.A.
P.O. BOX 15564
NEW BERN, NC 28561
PH.(252) 633-0068

PROJECT: 28010

LICENSE NO. C-0706

AVOLIS ENGINEERING, P.A.
P.O. BOX 15564
NEW BERN, NC 28561
PH.(252) 633-0068

SEWER BYPASS REQUIREMENTS:

DOMESTIC SEWER FLOW SHALL BE MAINTAINED FOR THE DURATION OF THE CONTRACTOR'S WORK. THE CONTRACTOR SHALL INSPECT SITE CONDITIONS AND DETERMINE THE ANTICIPATED DOMESTIC SEWER FLOW RATE. THE CONTRACTOR SHALL PROVIDE A SYSTEM THAT SHALL SATISFACTORILY BYPASS THE ANTICIPATED WASTEWATER FLOW TO THE DOWNSTREAM SEWER. THE BYPASS SYSTEM SHALL CONSIST AS A MINIMUM OF A TEMPORARY DUPLEX PUMPING SYSTEM WITH CONTROLS AND TEMPORARY CONNECTIONS TO THE UPSTREAM AND DOWNSTREAM SEWER. THE PUMPING SYSTEM SHALL BE CAPABLE OF HANDLING THE ANTICIPATED FLOW. ALL EXPENSES ASSOCIATED WITH PROVIDING, OPERATING AND MAINTAINING THE BYPASS SYSTEM SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. A PORTABLE GENERATOR SHALL BE PROVIDED, SIZED PROPERLY TO OPERATE THE BYPASS SYSTEM IN THE CASE OF A POWER OUTAGE.

GENERAL CONSTRUCTION NOTES:

1. THE LOCATION AND DEPTHS OF EXISTING UTILITIES SHOWN ARE APPROXIMATE. THE CONTRACTOR MUST BE RESPONSIBLE FOR SCANNING THE AREA OF WORK TO IDENTIFY TO HIS OWN SATISFACTION THE EXTENT OF UTILITIES PRESENT INCLUDING THE UTILITIES INDICATED TO BE PRESENT, THOSE NOT SHOWN, AND THOSE SHOWN TO BE IN A DIFFERENT LOCATION.
2. PHYSICAL SITE FEATURES OUTSIDE THE AREA OF WORK OR THOSE FEATURES NOT RELEVANT TO THE WORK BEING PERFORMED ARE NOT SHOWN FOR CLARITY.
3. THE CONTRACTOR MUST BE RESPONSIBLE FOR MAINTAINING TRAFFIC FLOW DURING THE COURSE OF CONSTRUCTION. THE CONTRACTOR MUST DEVELOP A TRAFFIC CONTROL PLAN TO BE SUBMITTED TO THE CONTRACTING OFFICER FOR APPROVAL PRIOR TO STARTING CONSTRUCTION.
4. ALL EXISTING VEGETATED AREAS DISTURBED DURING CONSTRUCTION MUST BE REVEGETATED IN ACCORDANCE WITH THE PROJECT VEGETATION PLAN, SEE DETAIL C3, SHEET C-501.
5. COMPLETE ALL TRENCH SECTION IN ACCORDANCE WITH DETAIL A3, SHEET C-501.

SPECIFIC WORK ITEMS (THIS SHEET):

- 1 PROVIDE 99LF± 8" DI SEWER MAIN.
- 2 ROUTE SEWER BELOW EXISTING UTILITY.
- 3 ASPHALT CUT AND PATCH - SEE DETAIL C1, SHEET C-501.
- 4 CONCRETE CURB AND GUTTER - SEE DETAIL B1, SHEET C-501.
- 5 SILT FENCE - SEE DETAIL A1, SHEET C-501.
- 6 PROVIDE PAVEMENT MARKING - SEE DETAIL D4, SHEET C-501.
- 7 SEWER 4' DIAMETER MANHOLE - SEE DETAIL A4, SHEET C-501.

UNCLASSIFIED//FOR OFFICIAL USE ONLY

UNCLASSIFIED//FOR OFFICIAL USE ONLY





NRW ENGINEERING
Structural Consultants
748 Lord Dunmore Drive, Suite 101
Virginia Beach, VA 23464
Phone 757-474-0612
Fax 757-474-0919

APPROVED	A/E INFO
FOR COMMANDER NAVFAC	
ACTIVITY	
SATISFACTORY TO	DATE
DES JKA	DRW MSP
PA/DM	CHK JCA
BRANCH MANAGER	
CHIEF ENG/ARCH	
FIRE PROTECTION	

NAVAL FACILITIES ENGINEERING COMMAND - MIDATLANTIC
NAVAL STATION - NORFOLK, VA
U.S. MARINE CORPS AIR STATION
CHERRY POINT, NORTH CAROLINA
REPLACE GRAVITY SEWER NEAR B298
SITE UTILITY PLAN - NEW WORK
PROJECT: 28010

SITE UTILITY PLAN - NEW WORK

SCALE: 1" = 10'

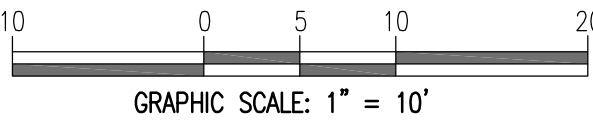

AVS
LICENSE NO. C-0706
AVOLIS ENGINEERING, P.A.
P.O. BOX 15564
NEW BERN, NC 28561
PH.(252) 633-0068

SCALE:
E/PROJECT NO.:
MAXIMO WORK ORDER NO.
7278814
NAVFAC DRAWING NO.
12926202
SHEET 4 OF 06
CU102
DRAWN/REVISION: 10 MARCH 2009

FILE NAME: 100_NOSEALS.DWG
PLOT DATE: December 3, 2025 2:11 PM

UNCLASSIFIED//FOR OFFICIAL USE ONLY

D




C

B

A

SEWER MAIN PROFILE

HOR. SCALE: 1" = 20'
VERT. SCALE: 1" = 2'

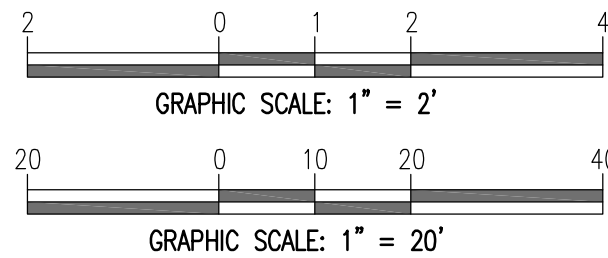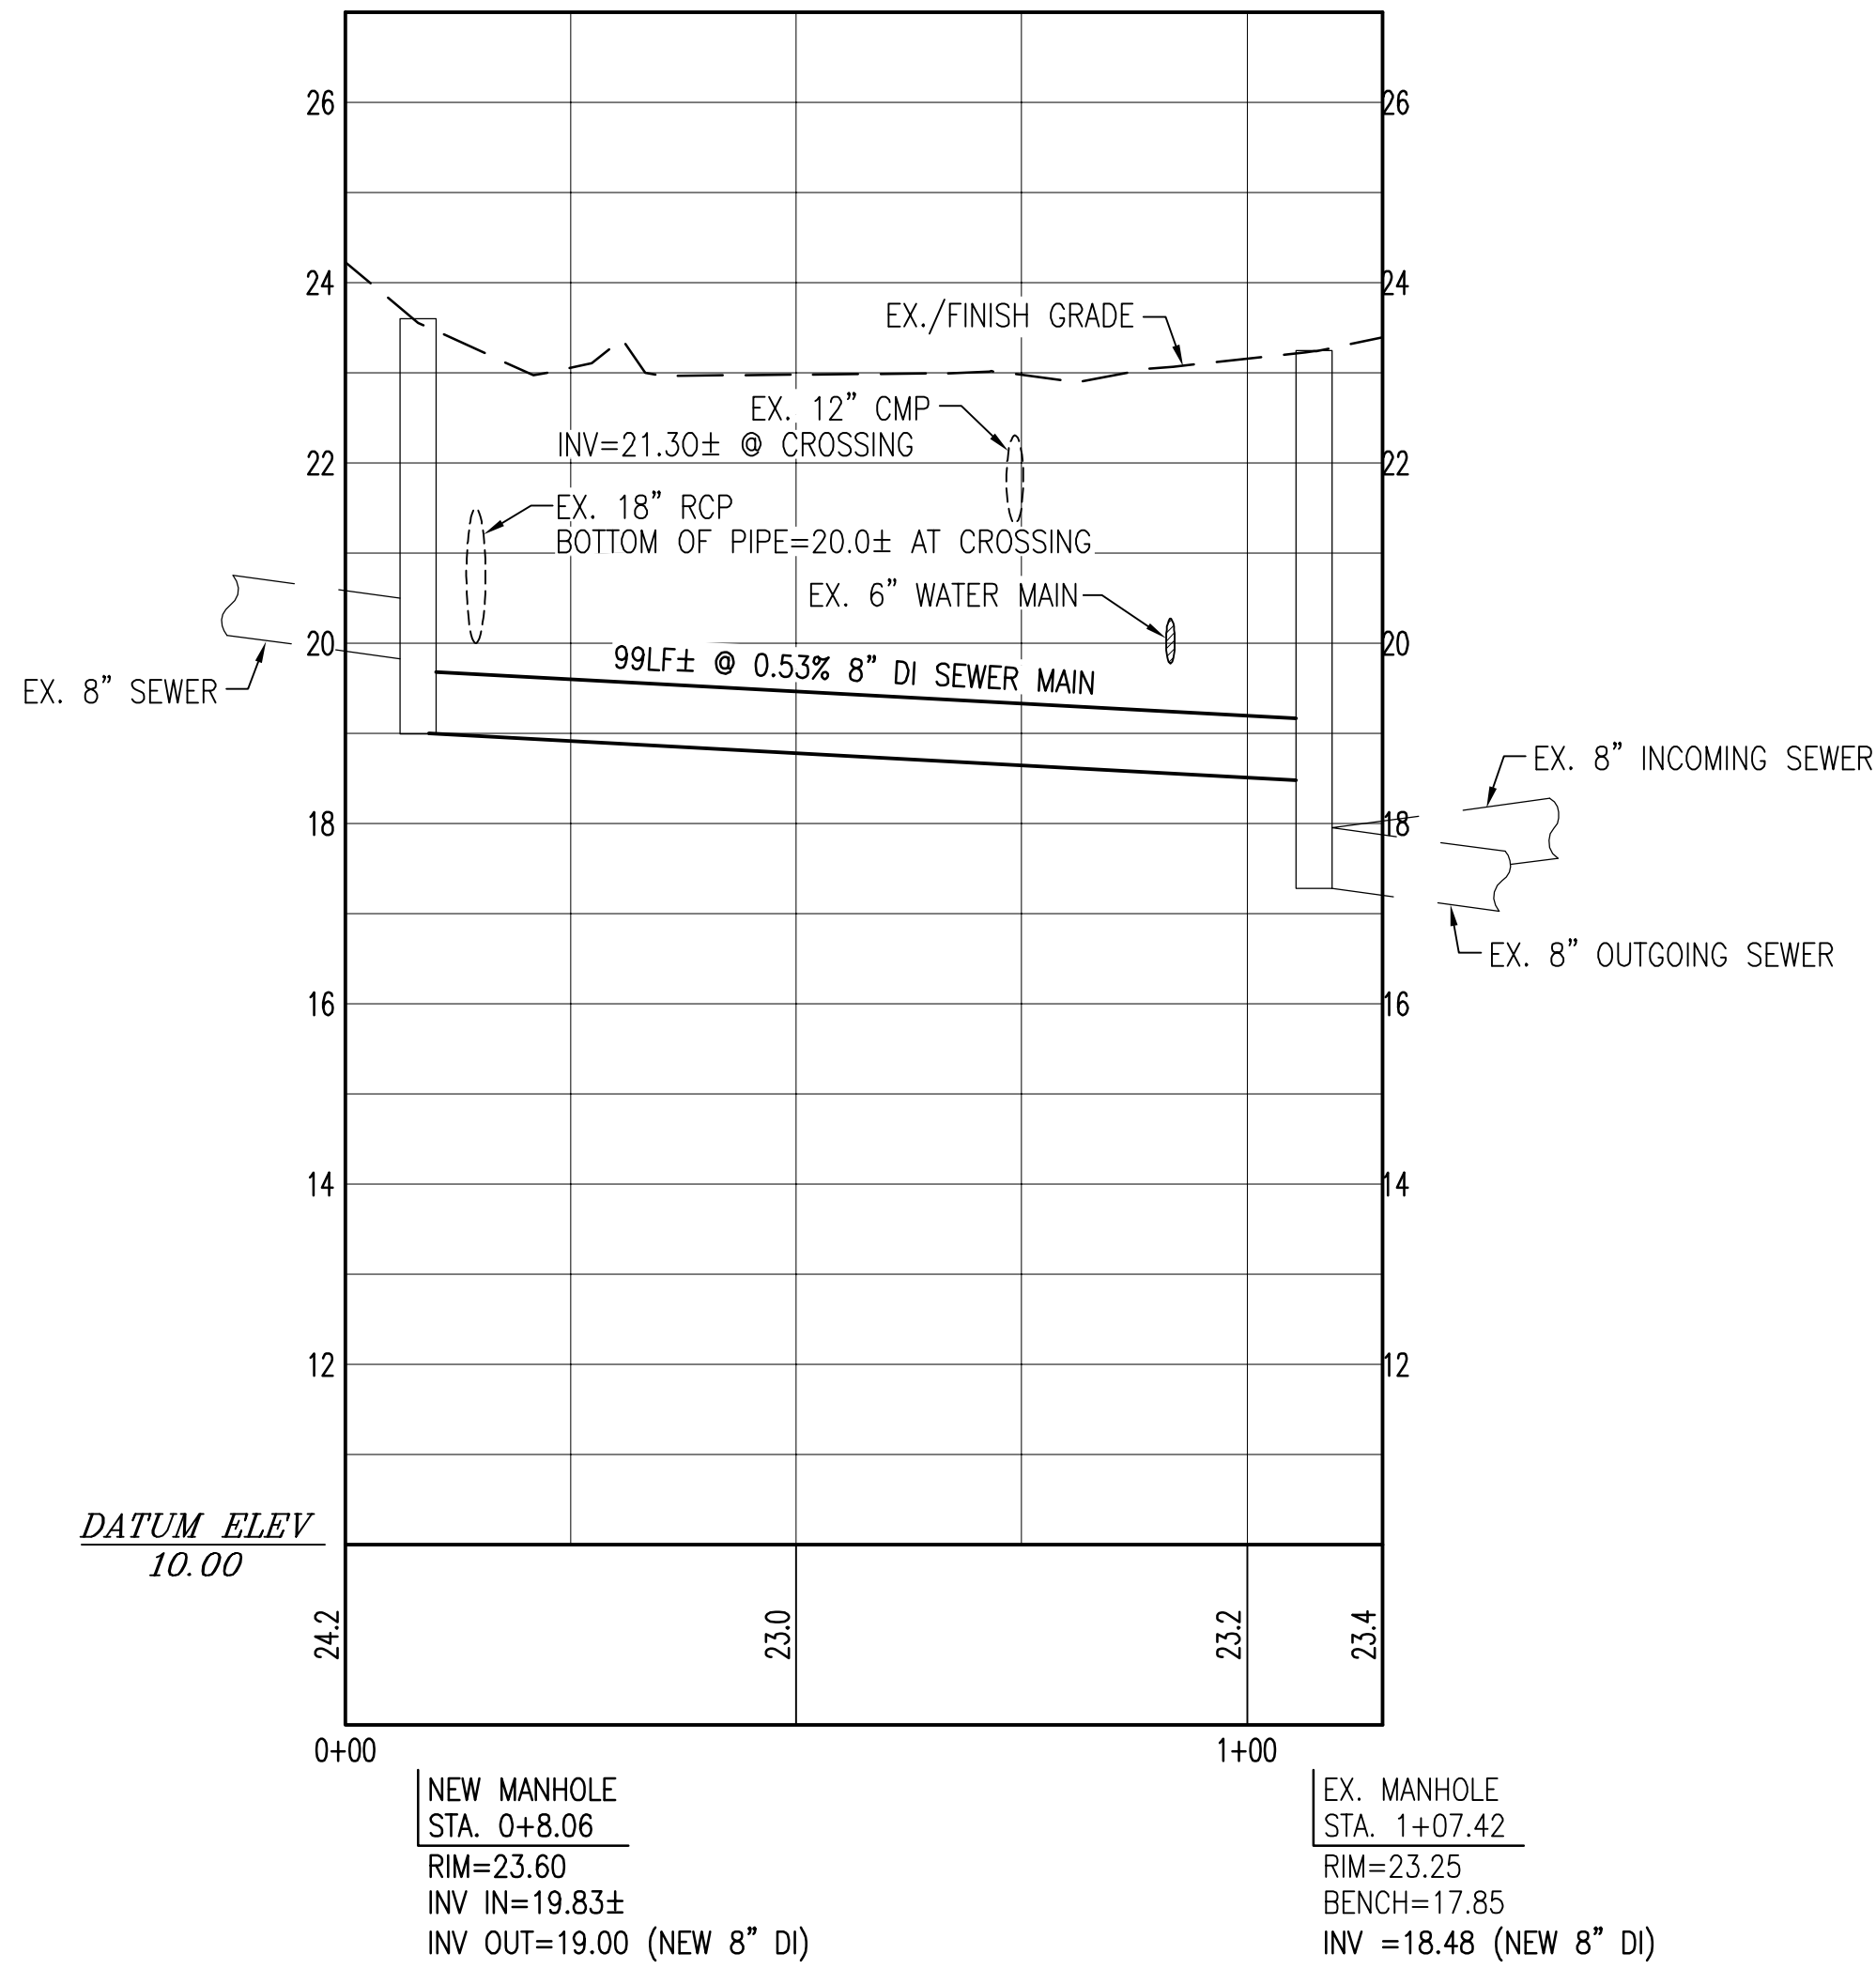

PROJECT: 25010
SCALE:
EPROJECT NO.:
MAXIMO WORK ORDER NO.:
7278814
NAVFAC DRAWING NO.:
12926203
SHEET 5 OF 06
CU301
DRAWN/REVISED: 10 MARCH 2009

UNCLASSIFIED//FOR OFFICIAL USE ONLY



NRW ENGINEERING
Structural Consultants
748 Lord Dunmore Drive, Suite 101
Virginia Beach, VA 23464
Phone 757-474-0612
Fax 757-474-0919

APPROVED
FOR COMMANDER NAVFAC
ACTIVITY
SATISFACTORY TO DATE
DES JKA DRW MSP CHK JCA
PM/TM
BRANCH MANAGER
CHIEF ENG/ARCH
FIRE PROTECTION

NAVAL FACILITIES ENGINEERING COMMAND - MIDATLANTIC
NAVAL STATION - NORFOLK, VA
U.S. MARINE CORPS AIR STATION
CHERRY POINT, NORTH CAROLINA
REPLACE GRAVITY SEWER NEAR B298
SEWER MAIN PROFILE

UNCLASSIFIED//FOR OFFICIAL USE ONLY

D

C

B

A

FILE NAME: 100-NOSEALS.DWG
PLOT DATE: December 3, 2025 2:11 PM


UNCLASSIFIED//FOR OFFICIAL USE ONLY

D


C

B

A

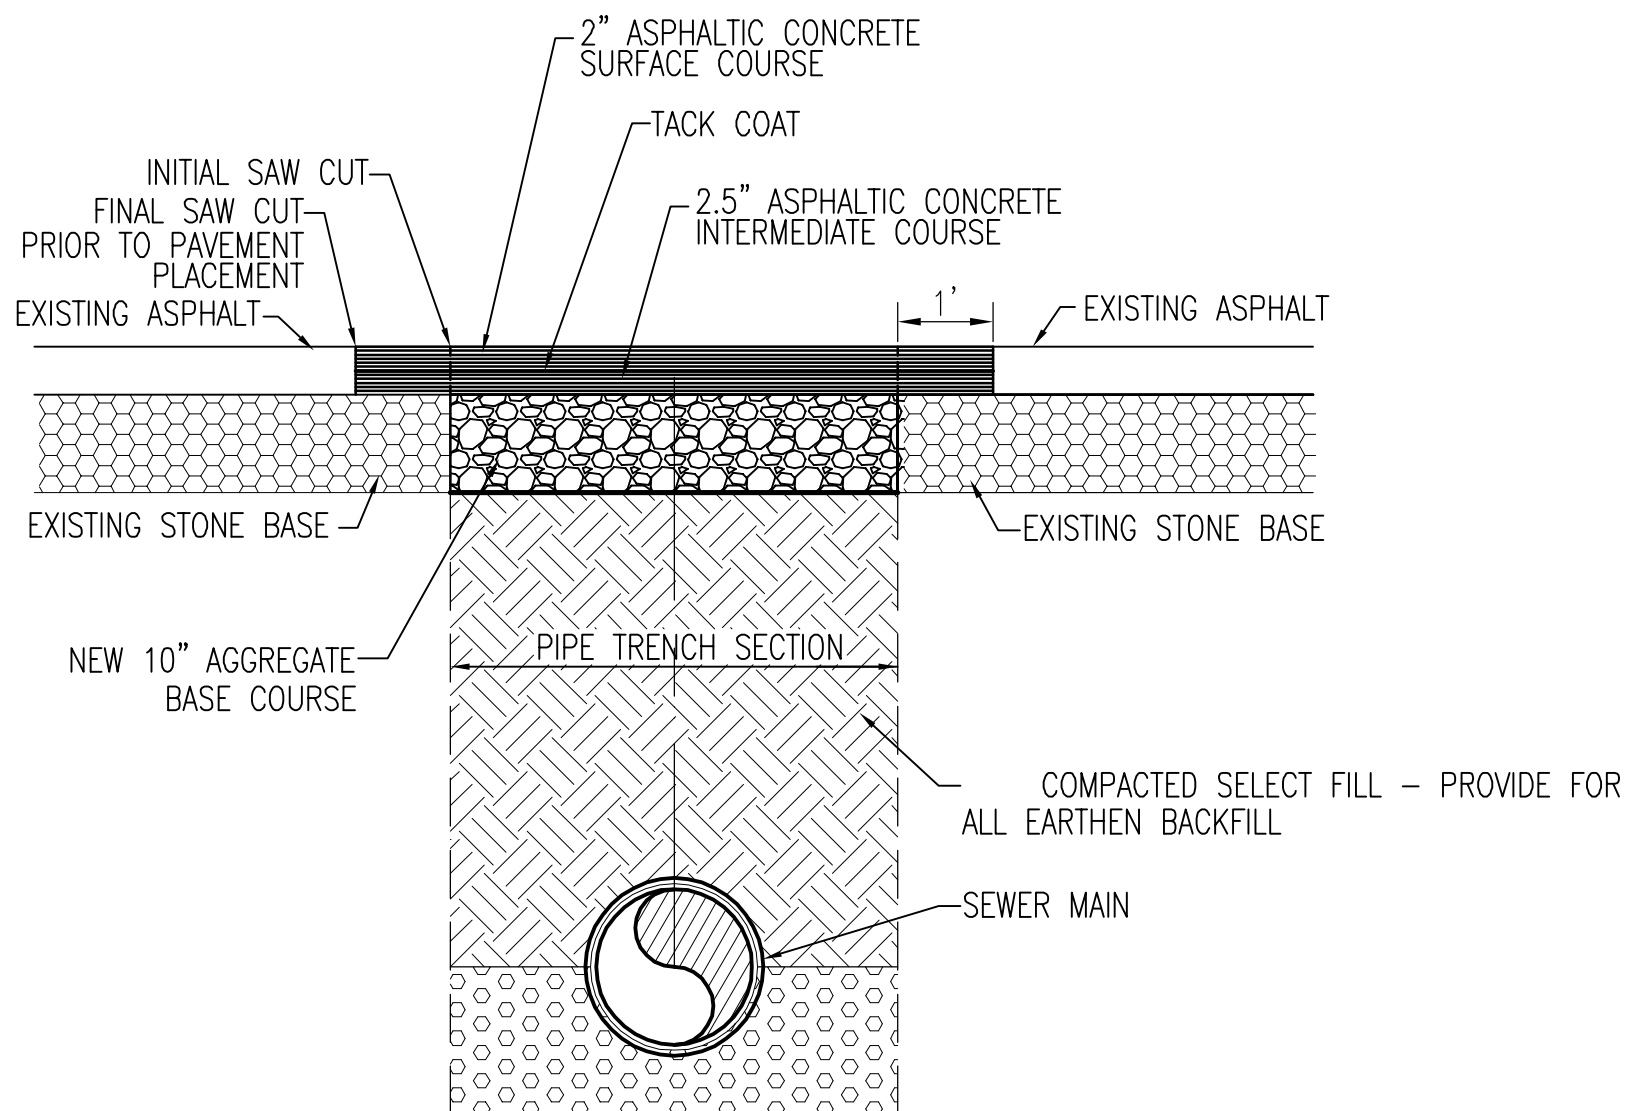


C1 ASPHALT CUT AND PATCH
NOT TO SCALE

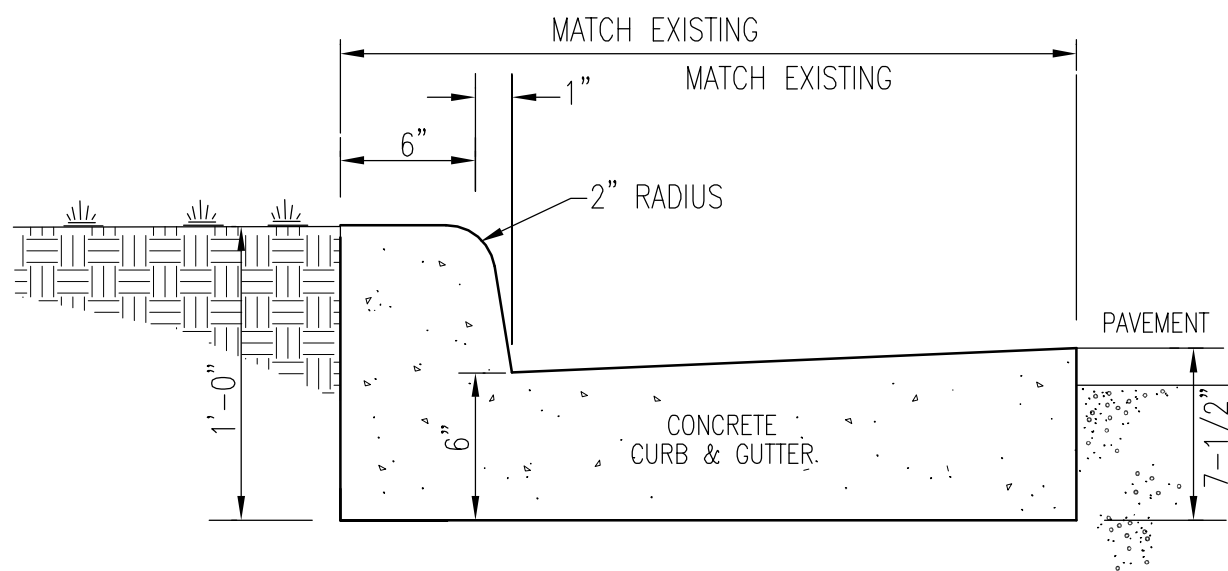

- NOTES:
- CONTRACTION JOINTS SHALL BE PLACED 10'-0" O.C. TO A MINIMUM DEPTH OF 1-1/2".
 - CONTRACTION JOINTS SHALL BE FILLED COMPLETELY WITH A JOINT FILLER SUITABLE FOR THE APPLICATION.
 - EXPANSION JOINTS SHALL BE PLACED 80' O.C. AND ADJACENT TO ALL FIXED OBJECTS (WALLS, WALKS, ETC.)
 - PROVIDE AT ELEVATIONS SHOWN. SLOPE CURB & GUTTER EVENLY BETWEEN SPOT ELEVATIONS.

B1 CURB AND GUTTER REPAIR
NOT TO SCALE

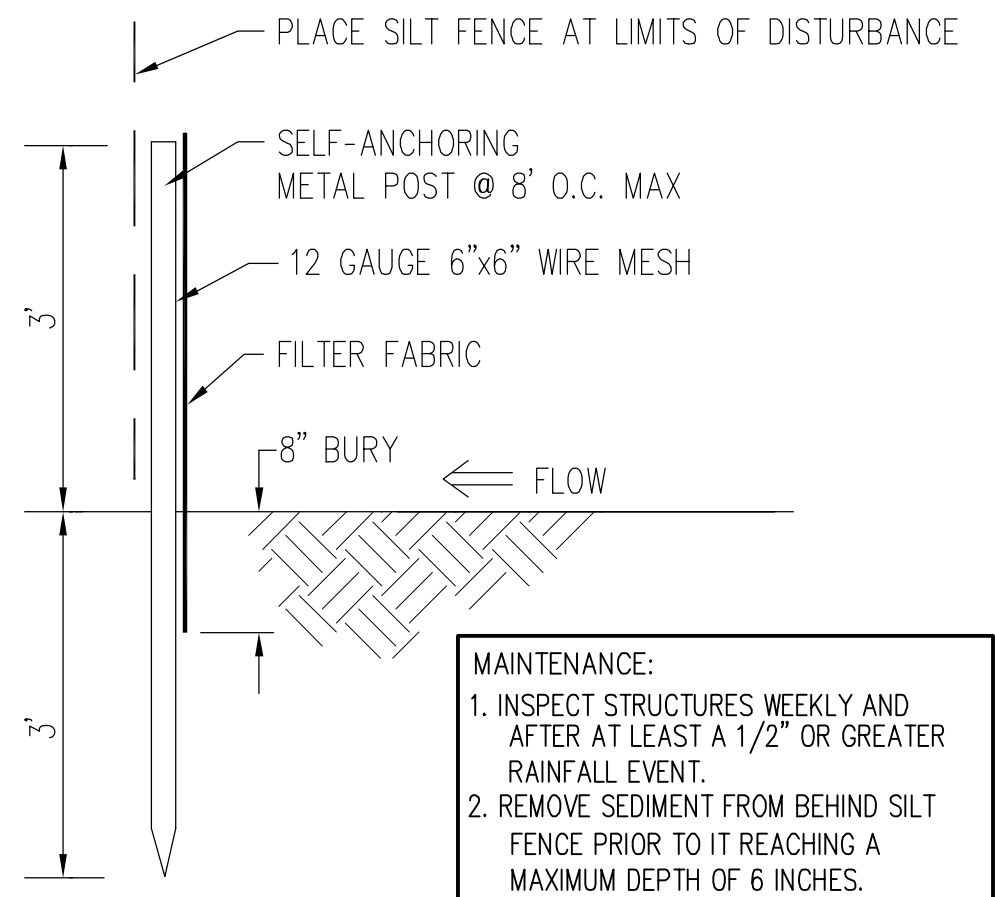

A1 SILT FENCE
NOT TO SCALE

TEMPORARY VEGETATIVE SEEDING
(PRIOR TO ESTABLISHING PERMANENT VEGETATION)

AFTER COMPLETION OF GRADING ACTIVITIES AND THE CONSTRUCTION OF SWALES, ALL EXPOSED AREAS SHALL BE SEED TO THE FOLLOWING SPECIFICATIONS:

SEED BED

LIME 1-1/2 TON PER ACRE
FERTILIZER 1/2-TON PER ACRE
SEED

RYE GRAIN 50 LBS PER ACRE
TALL FESCUE 100 LBS PER ACRE

SUPPLEMENTAL SEED

MAY THROUGH AUGUST:
CENTIPEDE 5 LBS PER ACRE

PROCEDURE

STRAW MULCH SHALL BE APPLIED AT A RATE WHICH WILL INSURE APPROXIMATELY 75% COVERAGE OF THE SEEDING AREA. THE STRAW AND SOWN SEED WILL BE LIGHTLY DISCED INTO THE BED TO GIVE IT FURTHER RESISTANCE TO BLOWING AND WASHING. THE CONTRACTOR SHALL GUARANTEE A FULL STAND OF GRASS OVER THE ENTIRE DISTURBED AREA. IF NECESSARY THE CONTRACTOR WILL WET DOWN THE AREAS TO ASSIST IN SEED GERMINATION OR AID IN GROWTH IN TIMES OF EXCESSIVELY DRY WEATHER. A STAND OF GRASS WILL BE CONSIDERED ACCEPTABLE WHEN THE ENTIRE STAND OF GRASS IS AT LEAST FOUR INCHES HIGH AND HAS ACHIEVED AT LEAST 95% COVERAGE OF DISTURBED AREAS. RESEEDING WILL BE REQUIRED AS NECESSARY BY THE CONTRACTOR TO OBTAIN THE SPECIFIED STAND OF GRASS.

PERMANENT VEGETATION

ALL DISTURBED AREAS NOT COVERED WITH BUILDINGS, PAVEMENTS, OR OTHER IMPERMEABLE SURFACES SHALL BE SODDED WITH CENTIPEDE SOLID SOD AS THE FINAL/PERMANENT VEGETATION.


REFERENCE SPECIFICATION SECTION 02 82 30 "RE-ESTABLISHING VEGETATION" FOR SPECIFIC SOD INSTALLATION AND SOD BED PREPARATION REQUIREMENTS.

SPECIAL SEEDING NOTE:


ALL DENUDED AREAS WILL, WITHIN 7 CALENDAR DAYS OF COMPLETION OF ANY PHASE OF GRADING OR CEASING OF GRADING ACTIVITIES, BE PLANTED AND PROVIDED WITH TEMPORARY OR PERMANENT GROUND COVER, DEVICES, OR STRUCTURES SUFFICIENT TO RESTRAIN EROSION.

ALL DENUDED AREAS WILL, WITHIN 7 DAYS OF COMPLETION OF CONSTRUCTION, BE PROVIDED PERMANENT GROUND COVER.



C3 VEGETATION PLAN
NOT TO SCALE

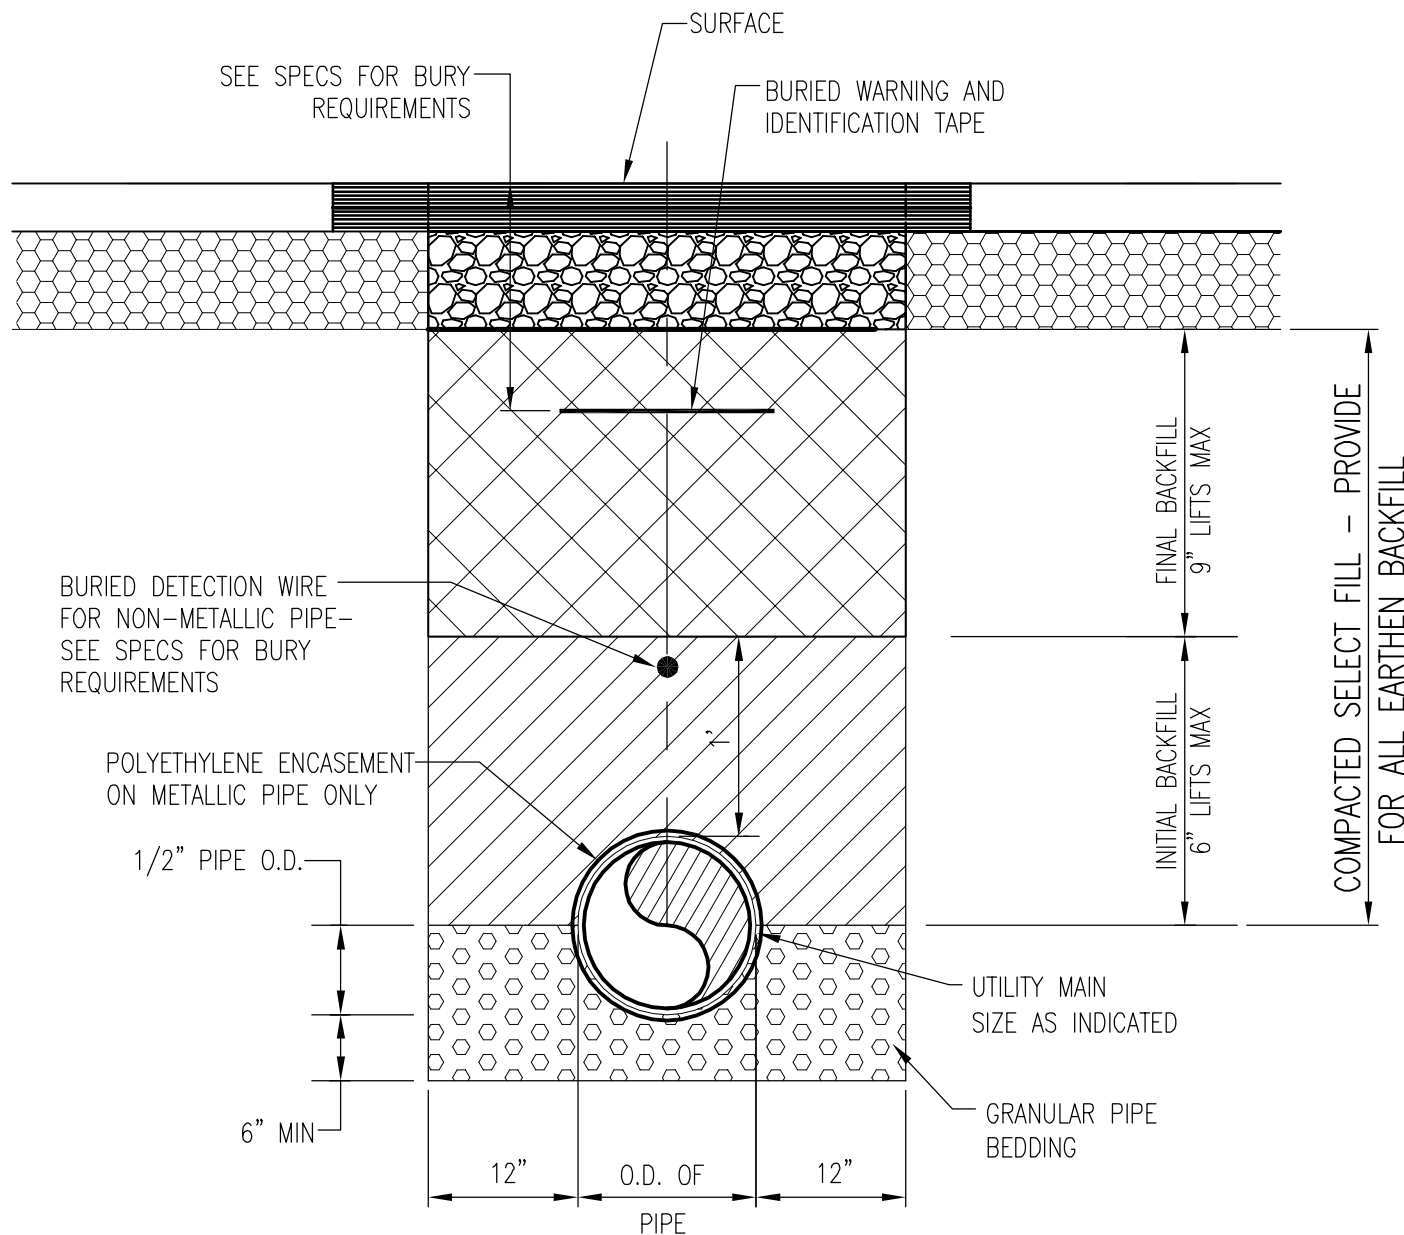

A3 TRENCH SECTION
NOT TO SCALE

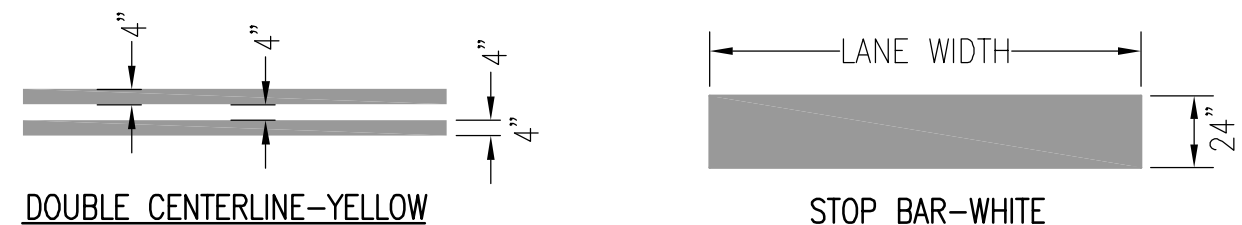

D4 PAVEMENT MARKINGS
NOT TO SCALE

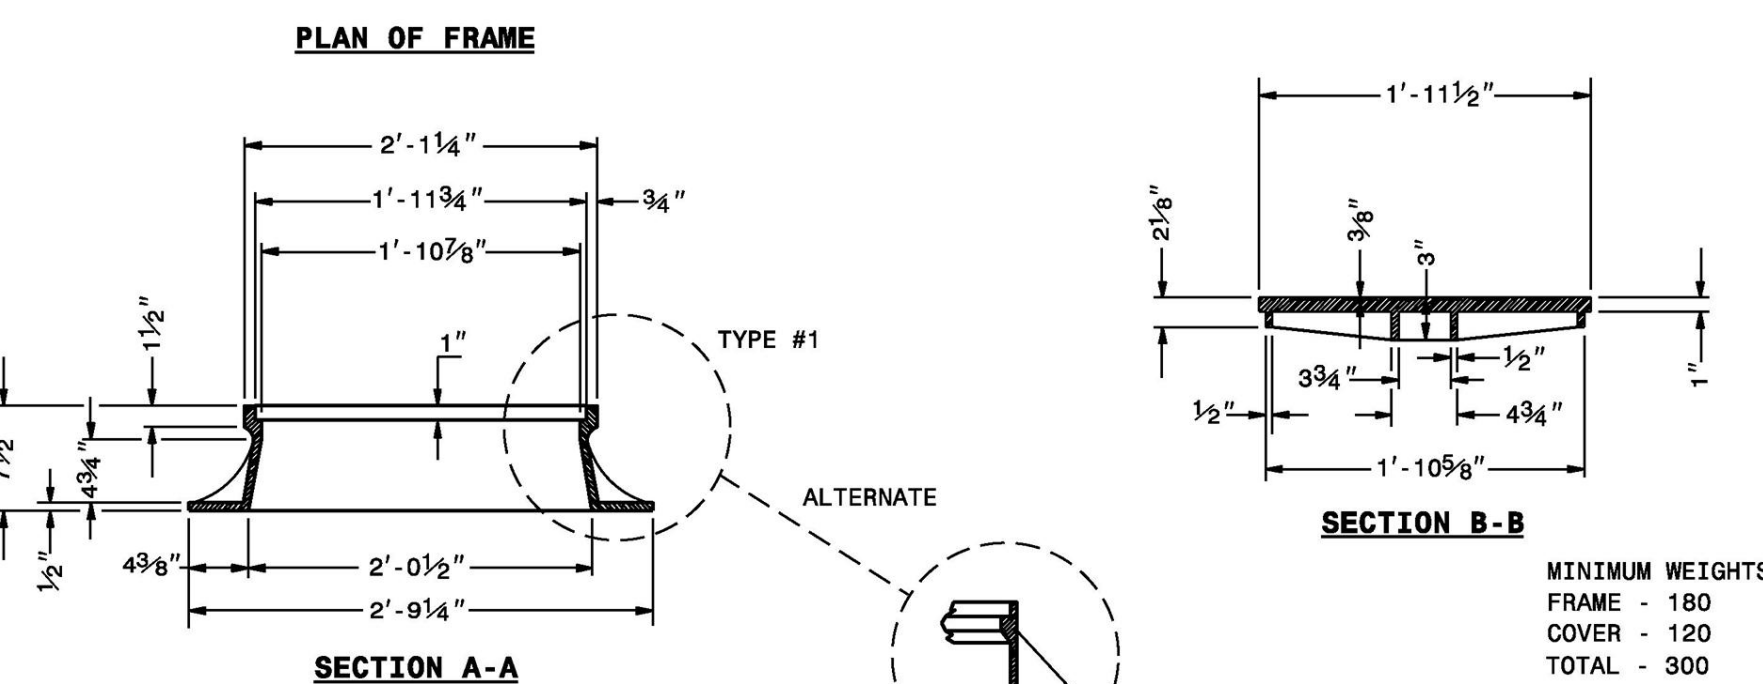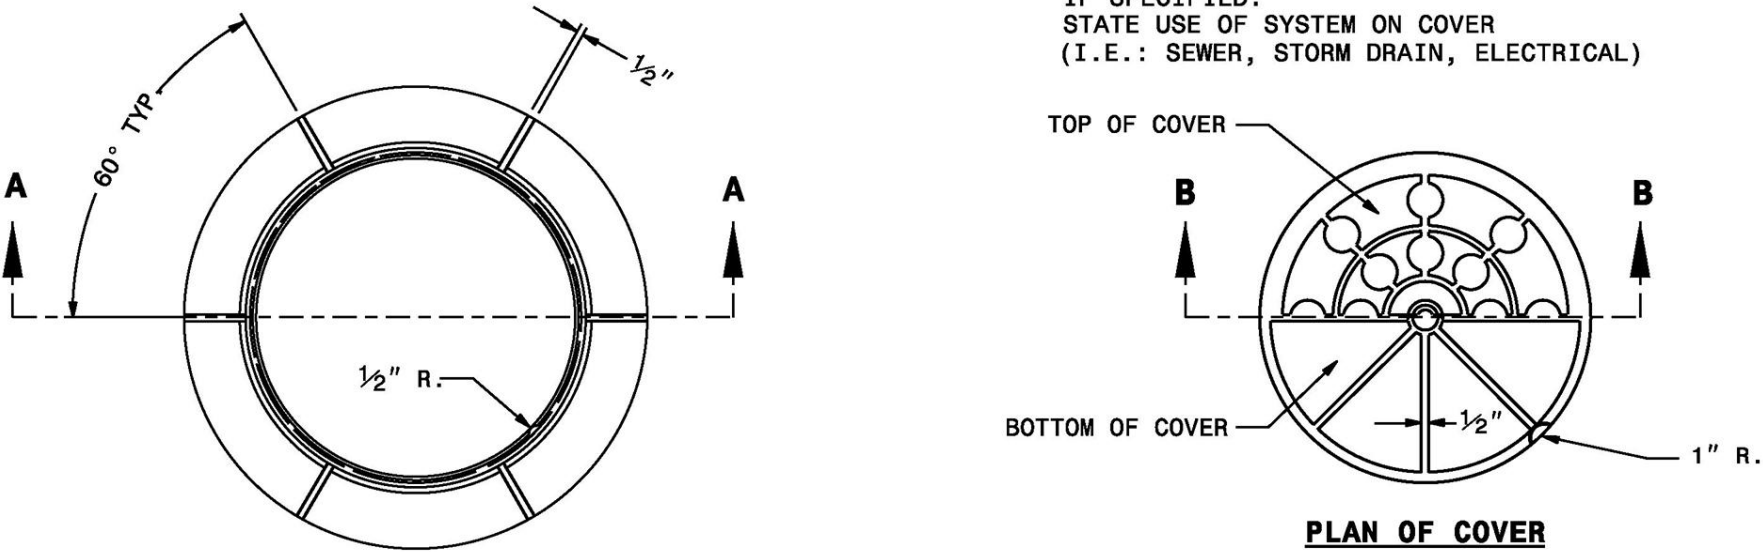

GENERAL NOTES

USE 4000 PSI MINIMUM COMPRESSIVE STRENGTH CONCRETE.

USE ASTM A615 GRADE 60 REINFORCING STEEL. USE ASTM A1064 WELDED WIRE FABRIC (WWF).

FABRICATE, ASSEMBLE AND DESIGN PRECAST MANHOLE COMPONENTS ACCORDANCE WITH AASHTO M199.

ASSEMBLE RISER AND GRADE RINGS WITH THE STEPS SPACED 12" FROM THE TOP TO THE BOTTOM OF THE MANHOLE.



WHERE THE MANHOLE IS EXPOSED TO ROAD TRAFFIC, CONSTRUCT THE TOP OF THE MANHOLE FLUSH WITH THE GROUND AND A MINIMUM OF 9" ABOVE THE GROUND AT OTHER LOCATIONS.

LIMIT DEPTH OF FILL TO 30'-0" FROM FINISH GRADE TO TOP OF BOTTOM SLAB.


THE MIN. SLAB THICKNESS "T" IS THE DIMENSION OF THE THINNEST PORTION OF THE TOP/BOTTOM SLAB.

* TOP MAT OF REINFORCEMENT MAY BE NEGLECTED IF TOP SLAB HAS A DISTINGUISHABLE TOP AND BOTTOM.

FRAME AND GRATE	STD. NO.
TRAFFIC BEARING	840.27
NONTRAFFIC BEARING	840.22
	840.24
	840.25
	840.29
	840.33

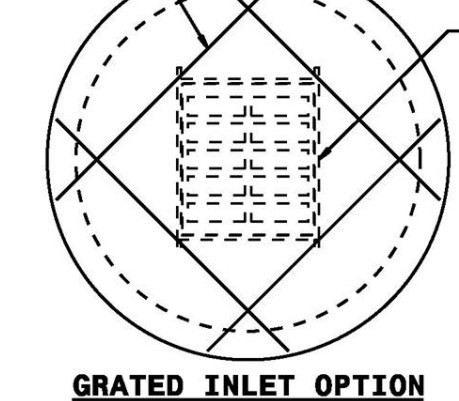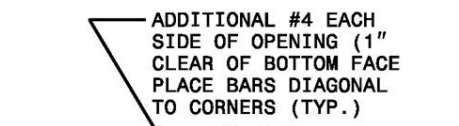


GRADED INLET OPTION

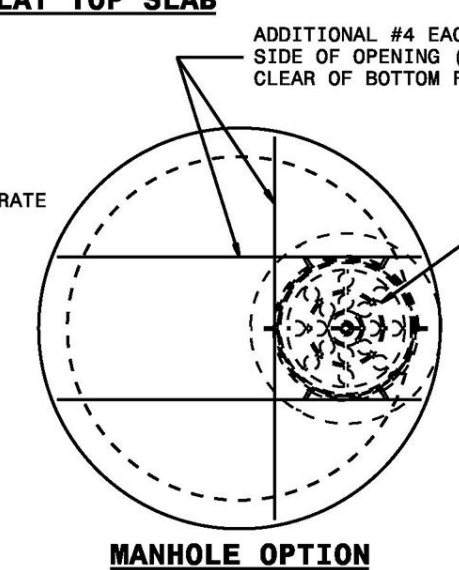

MANHOLE OPTION

D	W	T	As
INTERNAL DIAMETER (FT.)	MIN. WALL THICKNESS (IN.)	MIN. TOP/BOTTOM SLAB THICKNESS (IN.)	MIN. CIRCUMFERENTIAL AREA OF STEEL PER VERTICAL FT. (SQ. IN.)
4	4	6	0.12
5	5	8	0.15
6	6	8	0.18

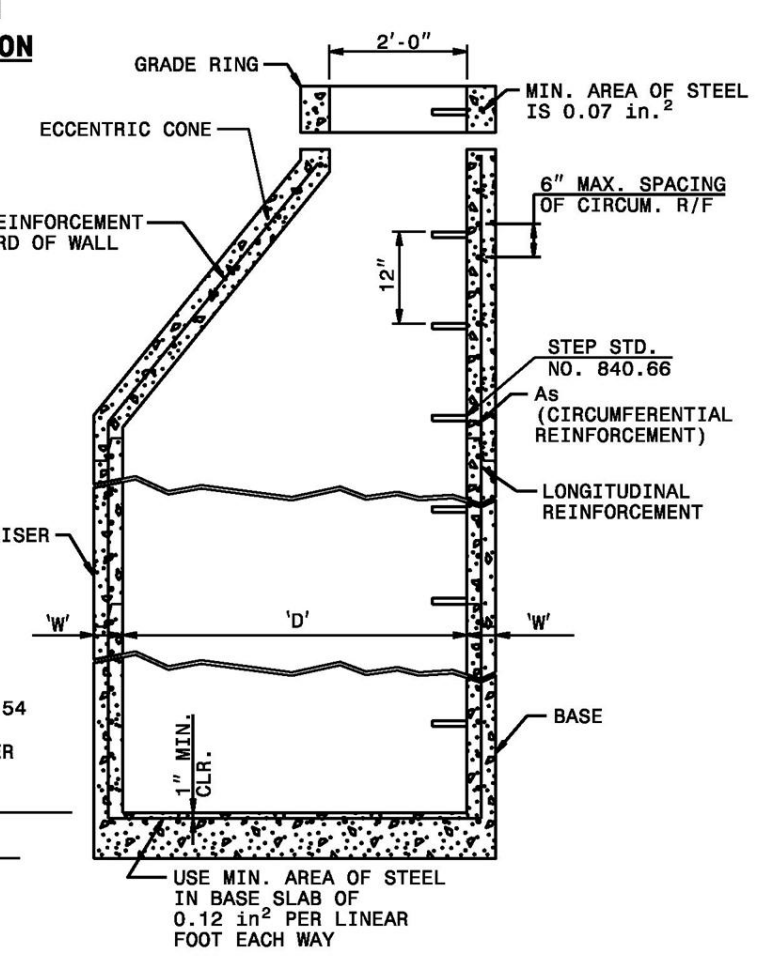

TYPICAL MANHOLE SECTION

A4 PRECAST CONCRETE MANHOLE
SCALE: NTS

STATE OF NORTH CAROLINA
DEPT. OF TRANSPORTATION
DIVISION OF HIGHWAYS
RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
MANHOLE FRAME AND COVER

SHEET 1 OF 1
840.54



NRW ENGINEERING
Structural Consultants
748 Lord Dunmore Drive, Suite 101
Virginia Beach, VA 23464
Phone 757-474-0812
Fax 757-474-0919

APPROVED: _____
FOR COMMANDER NAFC:
ACTIVITY: _____

SATISFACTORY TO DATE: _____
DES: JKA DRW: MSP CHK: JCA
PA/TM: _____
BRANCH MANAGER: _____
CHIEF ENGINEER: _____
FIRE PROTECTION: _____

NAVAL FACILITIES ENGINEERING COMMAND - MID-ATLANTIC
NAVAL STATION - NORFOLK, VA
U.S. MARINE CORPS AIR STATION
CHERRY POINT, NORTH CAROLINA
REPLACE GRAVITY SEWER NEAR B298

PROJECT: 28010
SCALE: _____
EPROJECT NO.: _____
MAXIMO WORK ORDER NO.: 7278814
NAVFAC DRAWING NO.: 12926204
SHEET 6 OF 06
C-501
DRAWN BY: _____
CHECKED BY: _____
DATE: _____