



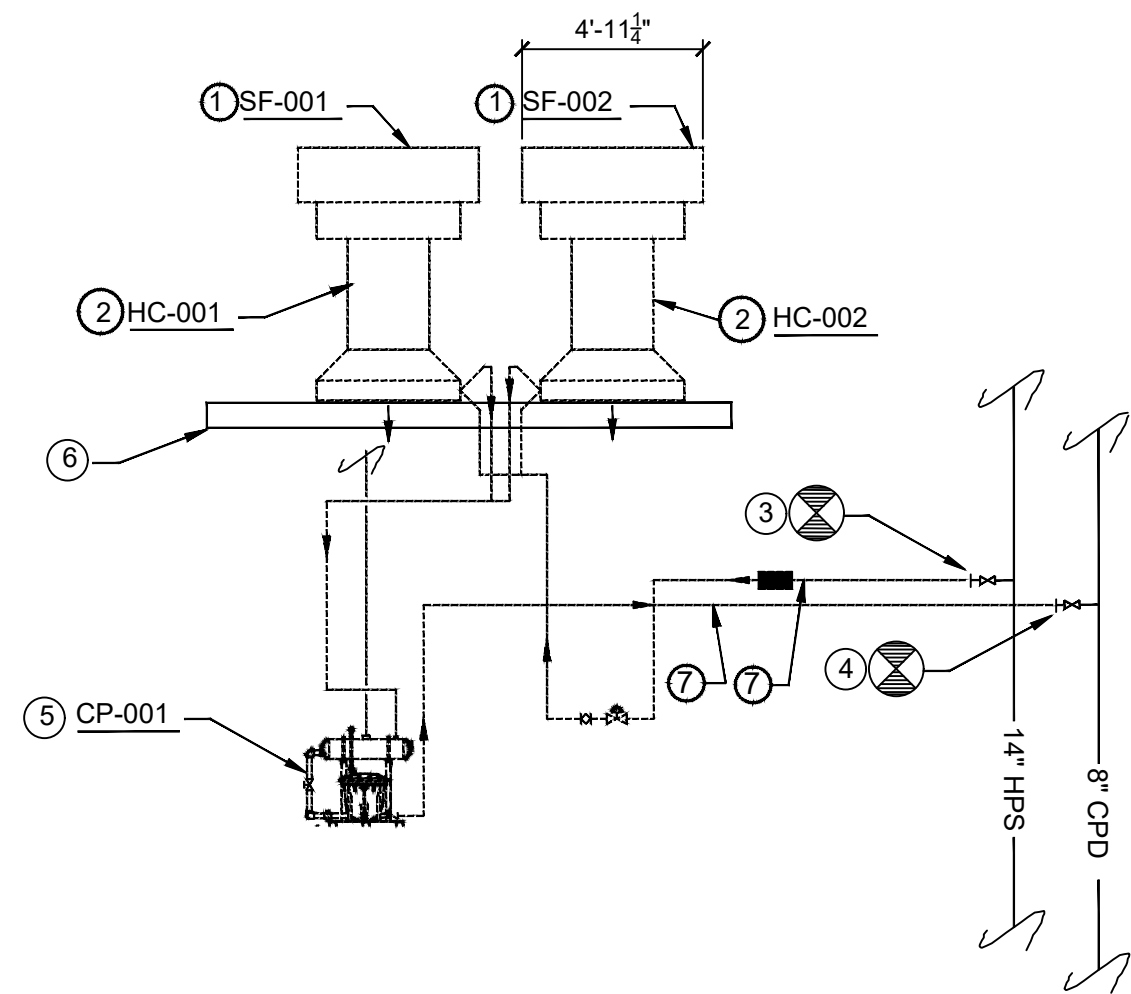

VENTILATION AND STEAM SYSTEM DEMOLITION

- 1 REMOVE SUPPLY FAN COMPLETELY INCLUDING POWER AND CONTROLS TYPICAL OF 2 FANS. TEMPORARILY CAP CURB OPENINGS.
- 2 REMOVE STEAM HEATING COIL , PIPING AND CONTROLS, TYPICAL OF 2 COILS.
- 3 CUT AND WELD CAP TO 2" HPS, FIELD VERIFY SIZE AND LOCATION.
- 4 CUT AND WELD CAP TO 2" CPD, FIELD VERIFY SIZE AND LOCATION.
- 5 REMOVE STEAM COND. PUMP INCLUDING PIPING, POWER AND CONTROLS.
- 6 CONCRETE CURB TO REMAIN, TEMPORARILY CAP & SECURE CURB OPENINGS.
- 7 REMOVE ALL HPS AND CPD PIPING, PIPE INSULATION AND PIPE HANGERS COMPLETELY.

DEMOLITION PLAN

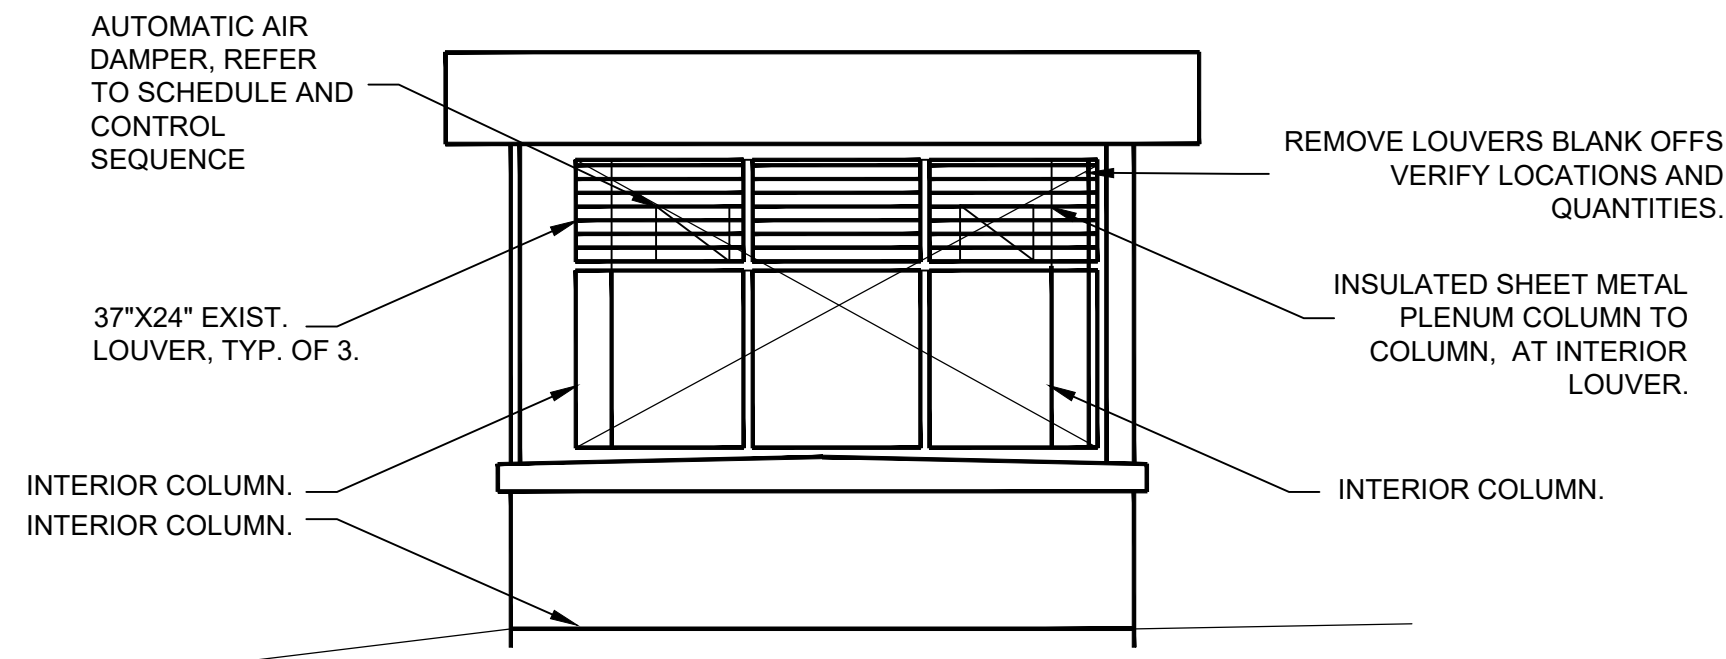


TUNNEL STAIR ENCLOSURE PLAN (TYP. OF 3 ENCLOSURES)

SCALE: NOT TO SCALE


NOTES:

1. FIELD VERIFY ALL DIMENSIONS
2. REMOVE LOUVER BLANK OFFS
3. BALANCE EACH AUTOMATIC DAMPER MAX OPEN POSITION FOR 2,000 CFM OF RELIEF EACH.
4. PROVIDE (2) AUTOMATIC DAMPERS PER ENCLOSURE.

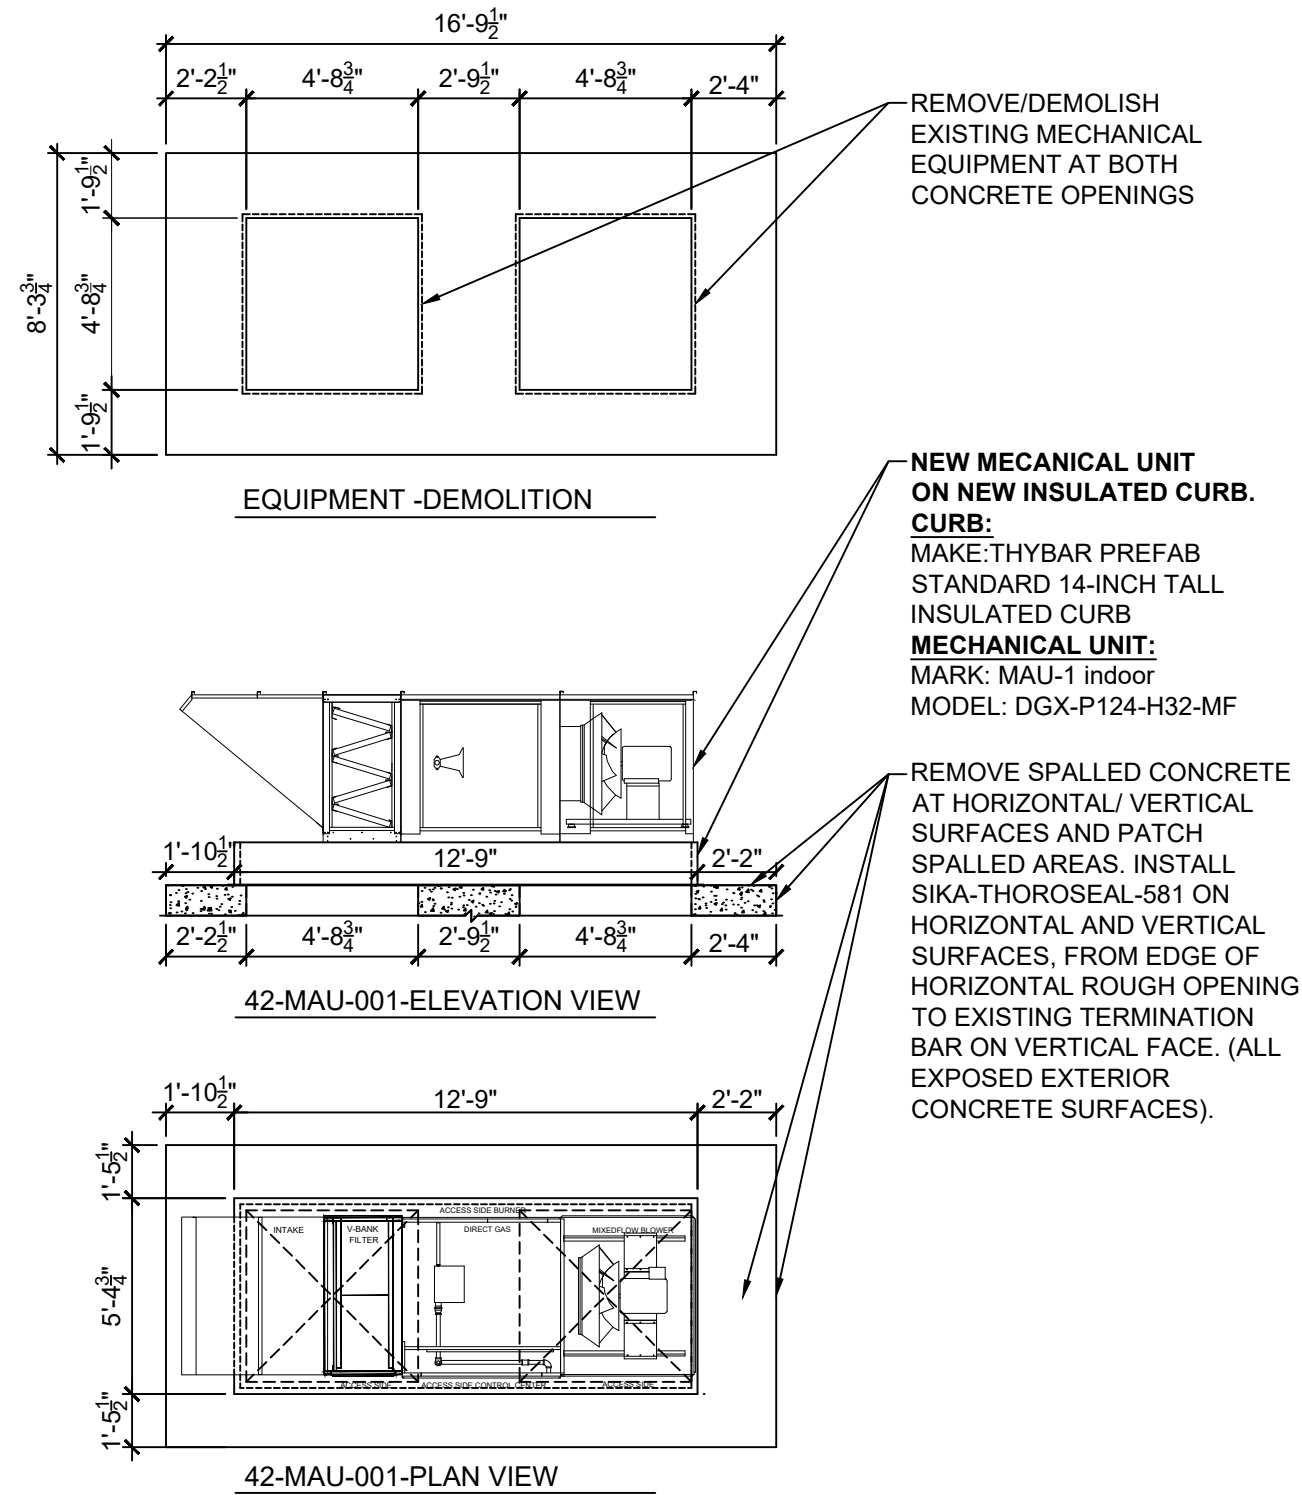

MECHANICAL EQUIP. ON CONCRETE STRUCTURE

SCALE: NOT TO SCALE

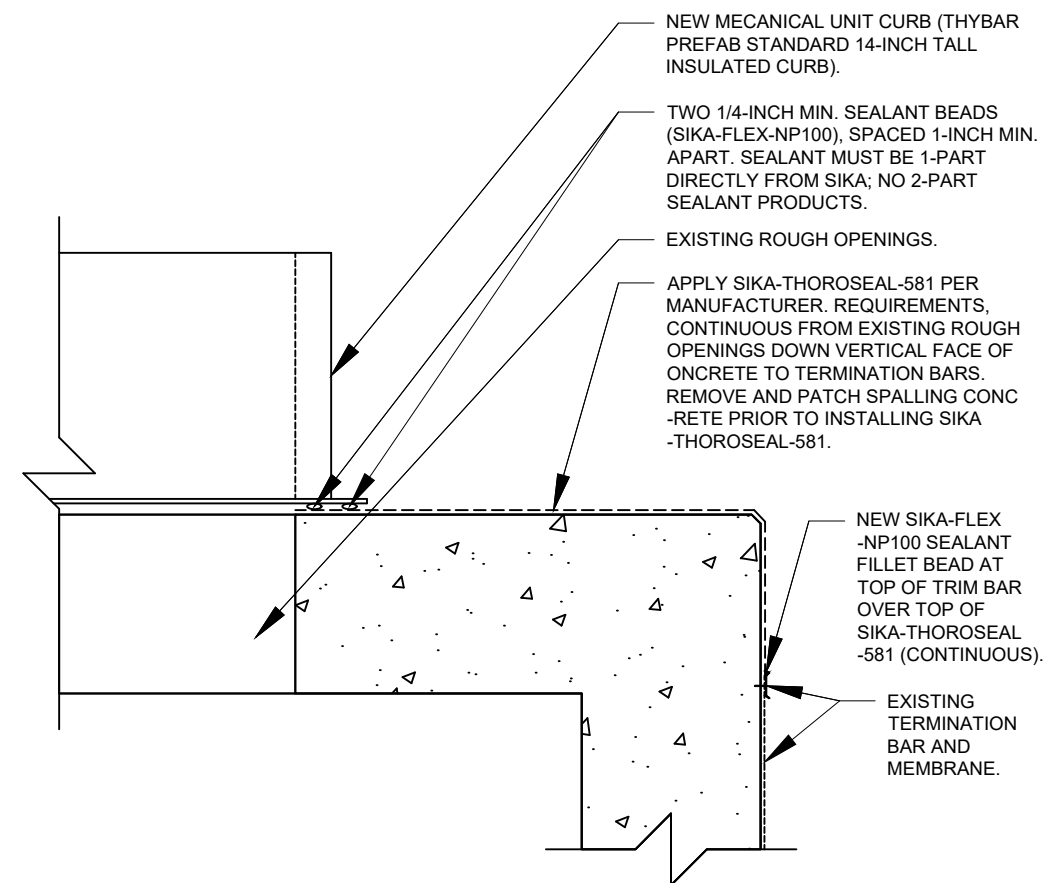

WEATHER RESISTANT BARRIER COATING DETAIL

NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY
BOULDER DESIGN AND CONSTRUCTION DIVISION
325 BROADWAY BOULDER, COLORADO 80305-3328

BUILDING 42 TUNNEL VENTILATION

DESIGN	DRAFTING	APPROVAL	DATE	SHEET NUMBER
COOK	COOK		3/10/2026	M-1
PROJECT NAME	of			
ADDITIONAL TUNNEL HEAT				