
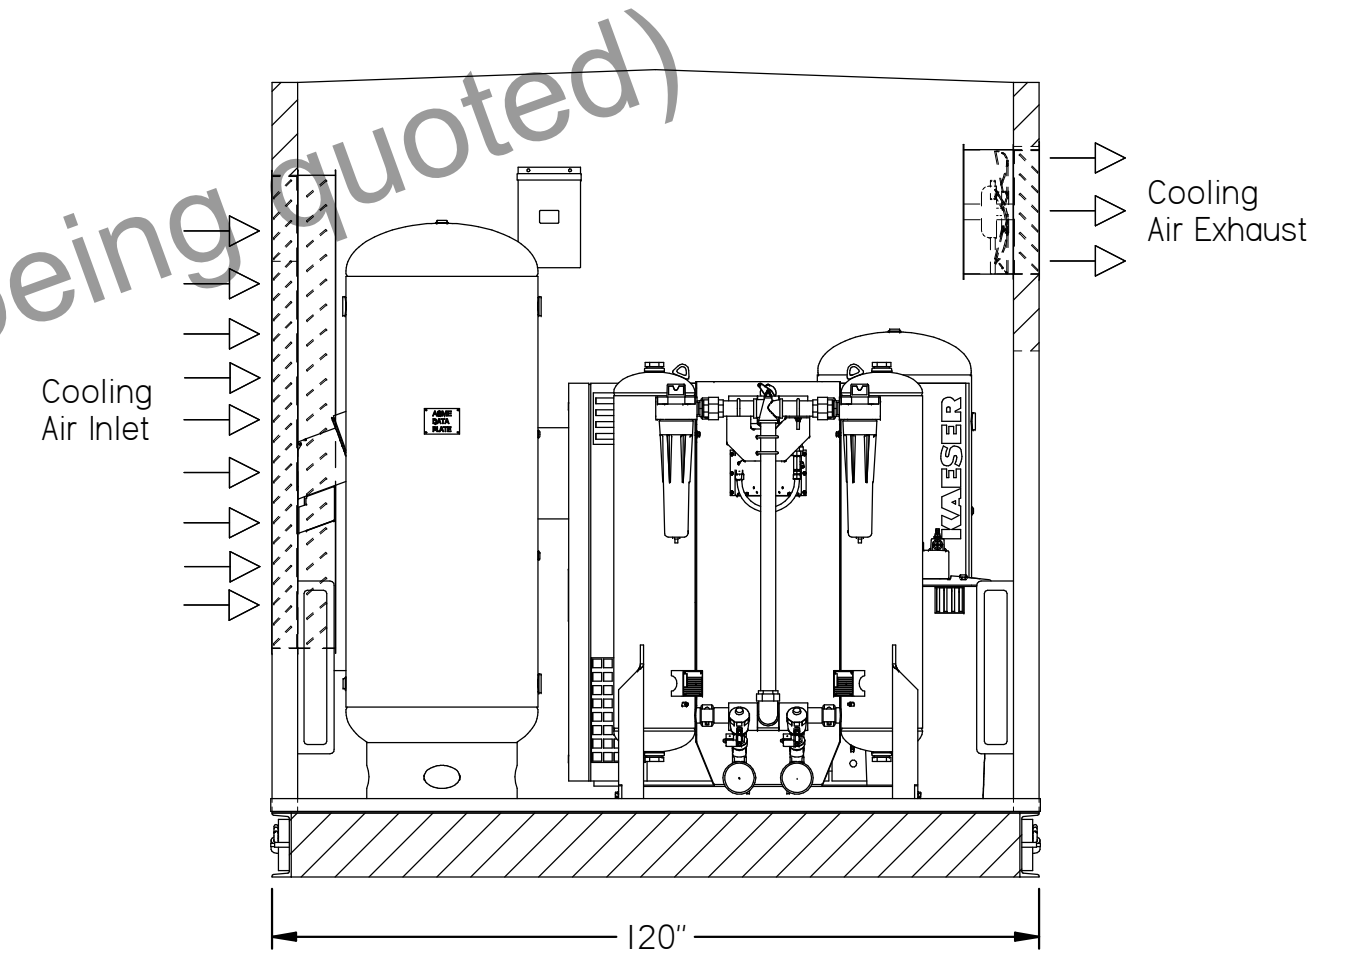
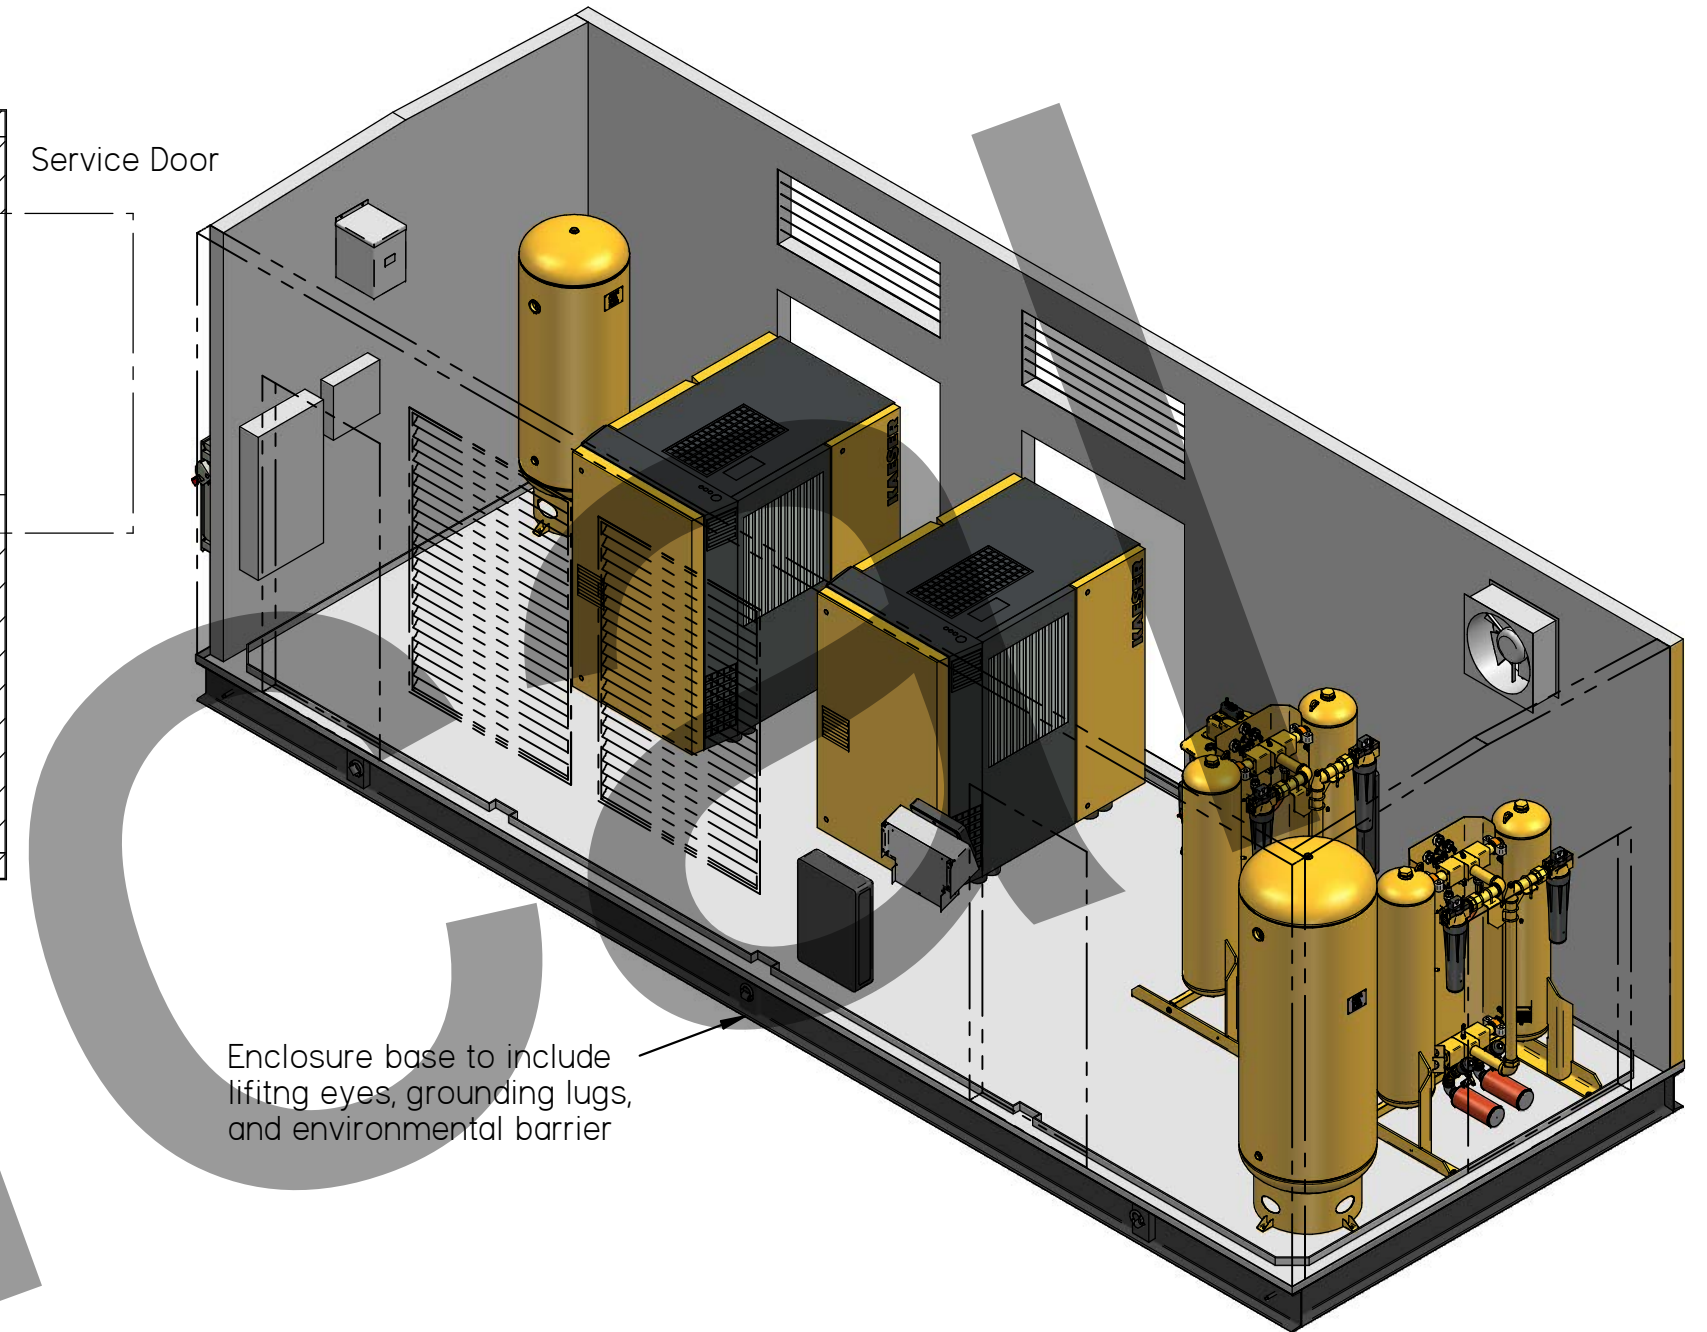


Overview

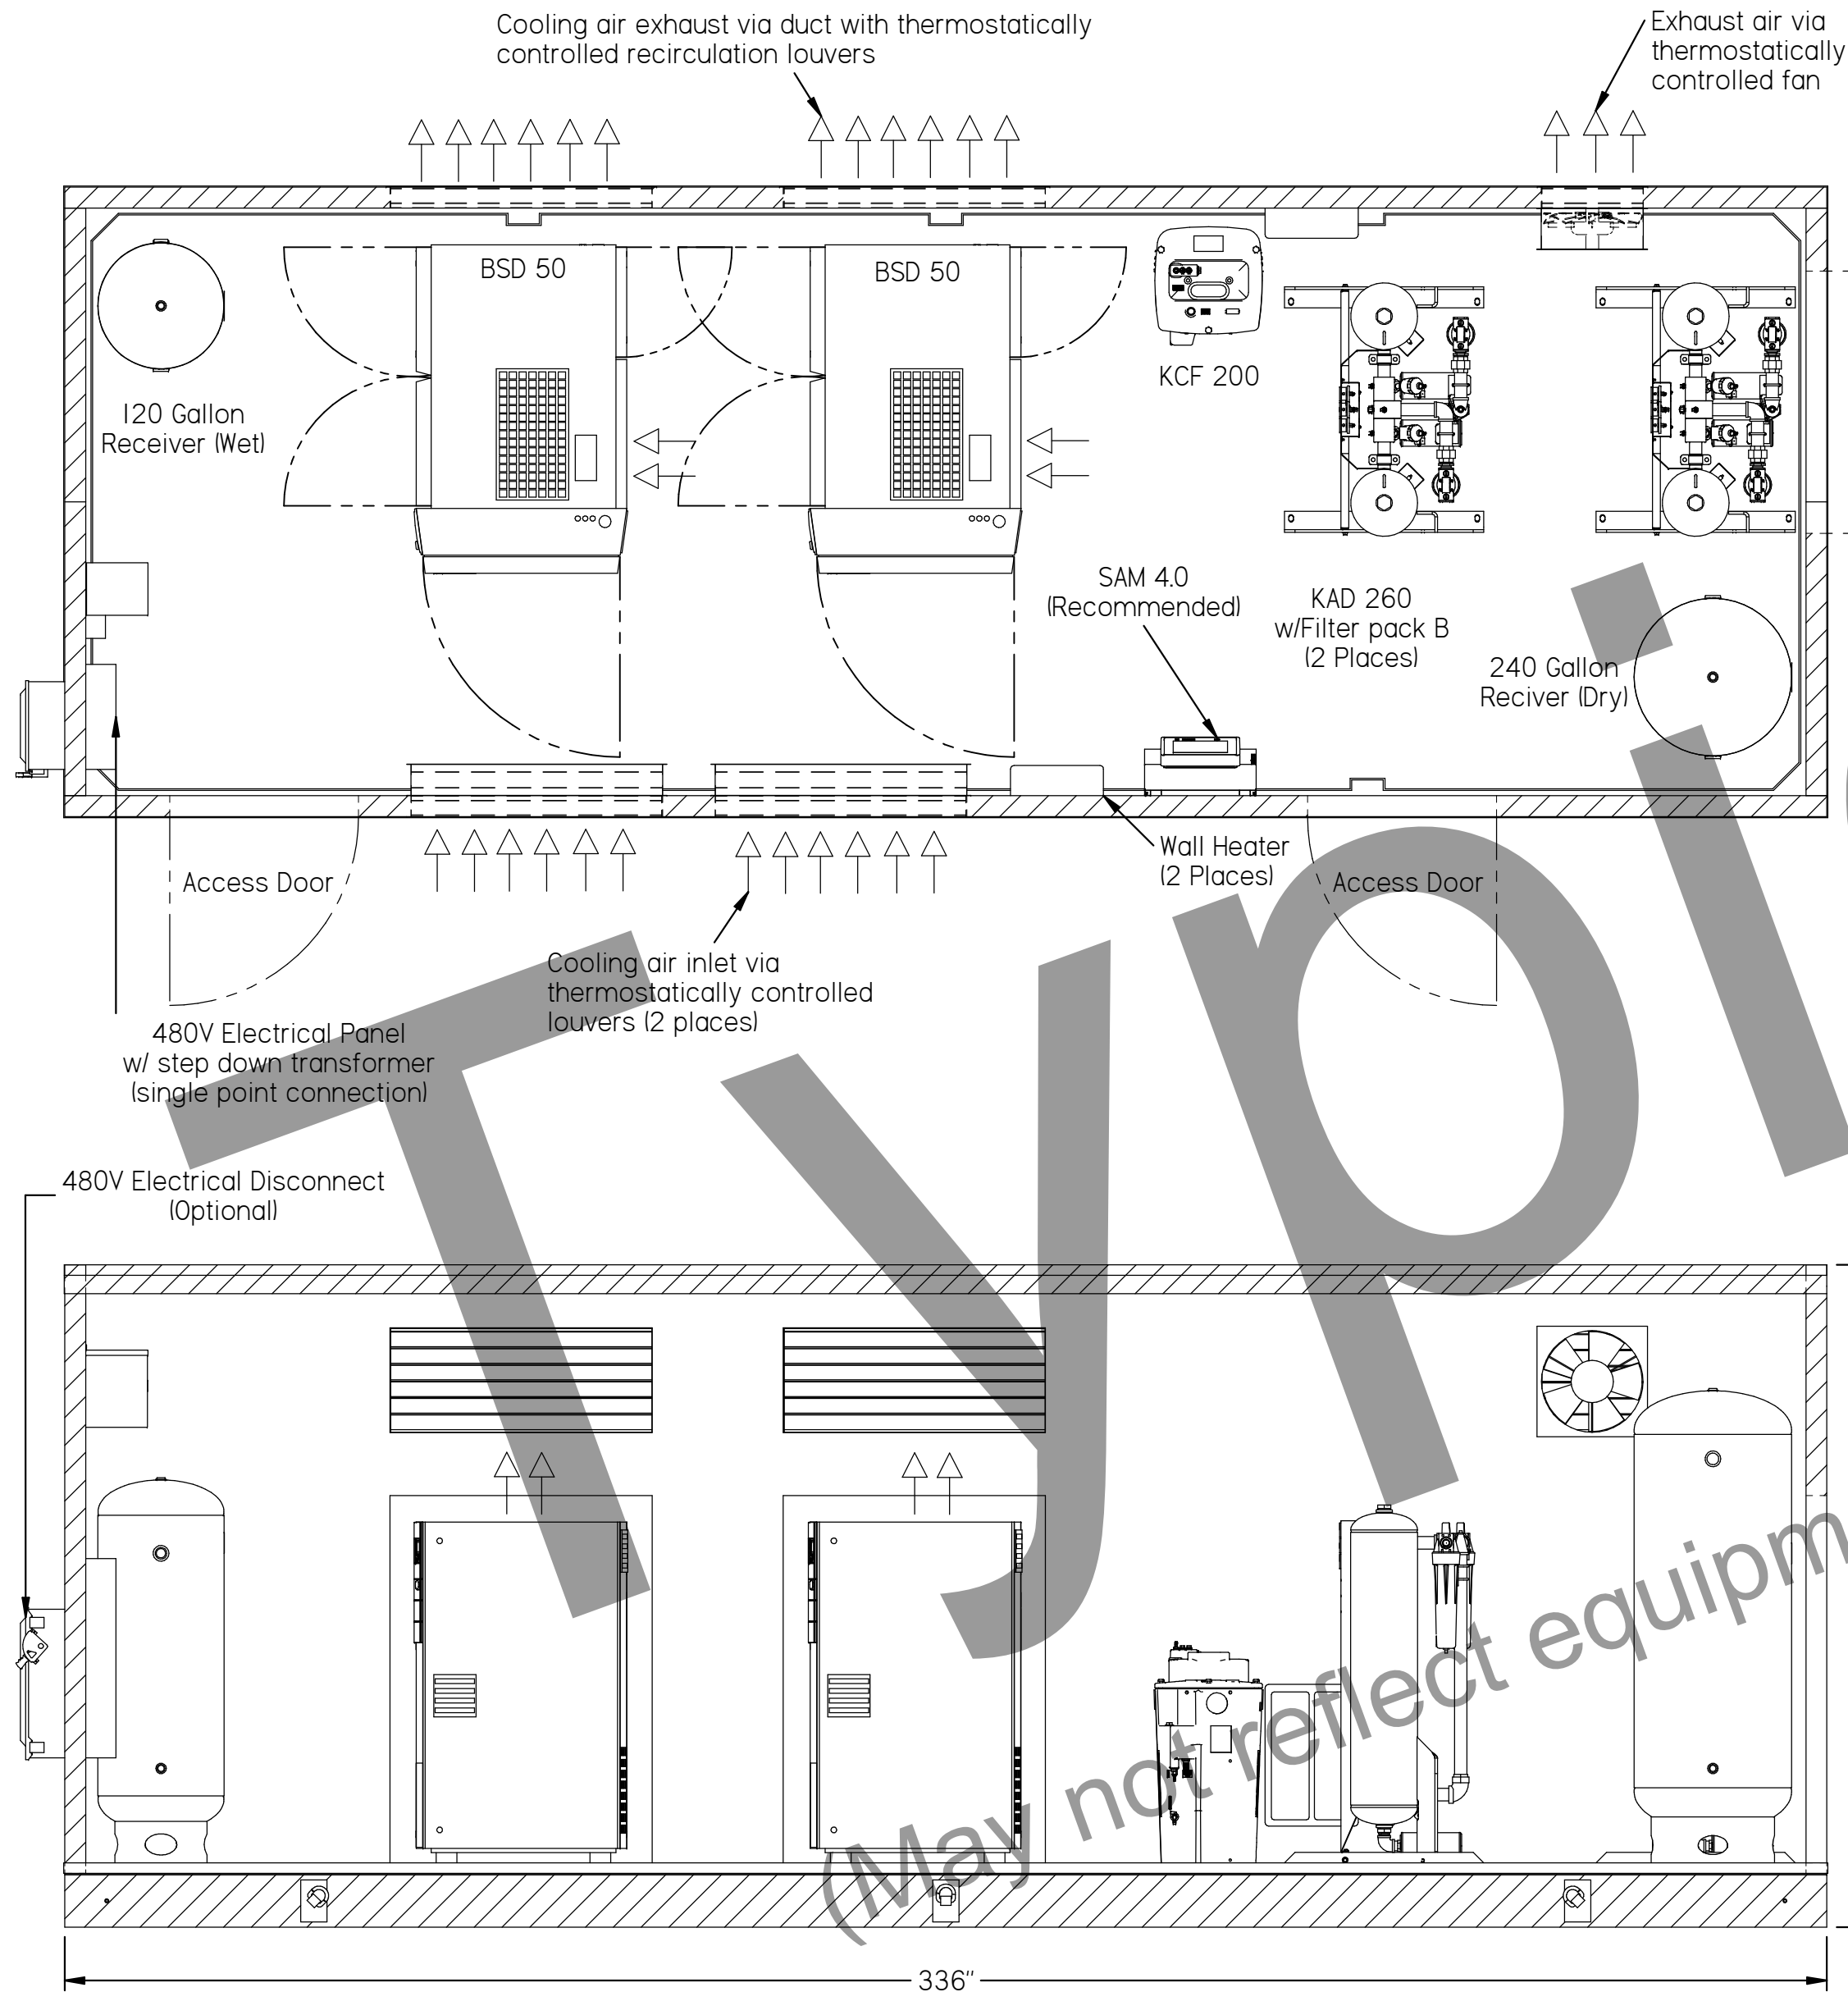

All dimensions are in inches

Thermostatically controlled inlet louvers

This drawing was prepared in accordance with NEC standards

Thermostatically controlled recirculating louver with back flow prevention

Recommended clearance dimensions for service and proper ventilation are 4ft on all sides (additional clearance is recommended for forklift/service access on the rear)

Additional civil preparations at the site location are the responsibility of the user

Condensate discharge must be handled and treated in accordance with all local and state laws

All site work, including but not limited to, site preparation, construction, system component assembly and installation, must be completed in accordance with all relevant local, state and national codes and regulations, including but not limited to, building, electrical and occupational safety. End-users and all sub-contractors responsible for this work may be provided with product information to initiate these tasks, however this is not a substitution for reading and understanding the appropriate Product Manuals prior to installation of the equipment. Since the compliance with the various federal, state and local laws and regulations concerning environmental health and safety, and the use, maintenance and operation of Equipment and other matters over which Kaiser has no control, Kaiser assumes no responsibility for compliance with those laws and regulations, whether by way of indemnity, warranty or otherwise.

Documents released by engineering are identified by these characteristics in the title block:
Date of review/ release and name of the reviewing/ releasing individual.

			Documents released by engineering are identified by these characteristics in the title block: Date of review/ release and name of the reviewing/ releasing individual.		
Project No. Status PROPOSAL			Station Setup ID		Station ID
				Date	Name
			Drawing	12/11/2019	refaia
			Review	12/11/2019	Kemph
			Released	12/11/2019	Manzke
			Template Rev. 05.03.2019		
					
1	Layout Drawing	12/11/2019	refaia	Sketch P&I Diagram Sketch	Page 1 of 1 PI LYU50193600
Rev.	Modification	Date	Name	Original	Replaces Replaced by
					Paper size Description ANSI C / 1:50

1x BSD 50 Standby