



2-HOUR FIRE AND SMOKE ZONE BARRIER

THIS APPLIES TO OCCUPANCY SEPARATION WALLS, HORIZONTAL EXITS, AND STAIRWELLS OF 4 OR MORE STORIES. THIS COMBINATION WALL IS WHERE A PORTION OF THE 2-HOUR RATED WALL IS ALSO PART OF THE SMOKE WALL.

- WALL: WALL EXTENDS FROM FLOOR TO DECK ABOVE.
- DUCTS: ALL DUCT PENETRATIONS ARE PROTECTED BY COMBINATION FIRE AND SMOKE DAMPERS. SMOKE DAMPERS ARE NOT REQUIRED WHERE ADJACENT SMOKE COMPARTMENTS ARE PROTECTED BY QUICK RESPONSE SPRINKLERS THROUGHOUT EACH COMPARTMENT.
- PENETRATIONS: ALL NEW PENETRATIONS ARE SEALED WITH LISTED FIRESTOP MATERIALS FOR PROTECTING 2-HOUR WALL ASSEMBLIES. WALL PENETRATIONS ARE REQUIRED TO BE FILLED ON BOTH SIDES OF THE WALL. FLOOR PENETRATIONS ARE ONLY REQUIRED TO BE FILLED ON THE TOP OF THE FLOOR.
- DOORS: ALL DOORS REQUIRE THE FOLLOWING:
1. LABELED FRAMES (NFPA 80 4.2.1)
 2. LABELED 1 1/2 HOUR DOOR (NFPA 80 4.3.1)
 3. MAXIMUM 100 SQ. IN. WINDOW (NFPA 80 4.4.5)
 4. POSITIVE LATCHING (NFPA 80 6.4.1.4)
 5. SELF CLOSING OR AUTOMATIC CLOSING (NFPA 80 6.4.1)
 6. COORDINATING DEVICES REQUIRED (NFPA 80 6.4.1.2.1)
 7. MAXIMUM 1/8" GAP (NFPA 80 6.3.1.7.3)
 8. MAXIMUM 3/4" UNDERCUT (NFPA 80 4.8.4.1)
 9. MAXIMUM 16" PROTECTIVE PLATE (NFPA 80 6.4.5.1)
 10. SWING IN PRIMARY DIRECTION OF TRAVEL (NFPA 101 18/19.2.2.2).
 11. PERIODIC INSPECTION AND TESTING SHALL BE PERFORMED AT LEAST ANNUALLY (NFPA 80 5.2.4.1)



2-HOUR FIRE BARRIER

THIS APPLIES TO OCCUPANCY SEPARATION WALLS, HORIZONTAL EXITS, AND STAIRWELLS OF 4 OR MORE STORIES.

- WALL: WALL EXTENDS FROM FLOOR TO DECK ABOVE.
- DUCTS: ALL DUCT PENETRATIONS ARE PROTECTED BY FIRE DAMPERS.
- PENETRATIONS: ALL NEW PENETRATIONS ARE SEALED WITH LISTED FIRESTOP MATERIALS FOR PROTECTING 2-HOUR WALL ASSEMBLIES. WALL PENETRATIONS ARE REQUIRED TO BE FILLED ON BOTH SIDES OF THE WALL. FLOOR PENETRATIONS ARE ONLY REQUIRED TO BE FILLED ON THE TOP OF THE FLOOR.
- DOORS: ALL DOORS REQUIRE THE FOLLOWING:
1. LABELED FRAMES (NFPA 80 4.2.1)
 2. LABELED 1 1/2 HOUR DOOR (NFPA 80 4.3.1)
 3. MAXIMUM 100 SQ. IN. WINDOW (NFPA 80 TABLE 4.4.5)-LIMITED TO MAX AREA LISTED.
 4. POSITIVE LATCHING (NFPA 80 6.4.1.4)
 5. SELF CLOSING OR AUTOMATIC CLOSING (NFPA 80 6.4.1)
 6. COORDINATING DEVICES REQUIRED (NFPA 80 6.4.1.2.1)
 7. MAXIMUM 1/8" GAP (NFPA 80 6.3.1.7.3)
 8. MAXIMUM 3/4" UNDERCUT (NFPA 80 4.8.4.1)
 9. MAXIMUM 16" PROTECTIVE PLATE (NFPA 80 6.4.5.1)
 10. SWING IN PRIMARY DIRECTION OF TRAVEL (NFPA 101 18/19.2.2.2).
 11. PERIODIC INSPECTION AND TESTING SHALL BE PERFORMED AT LEAST ANNUALLY (NFPA 80 5.2.4.1)
- * 2 HOUR DOOR REQUIRED FOR STAIRWELLS 4 OR MORE STORIES (NFPA 101 7.1.3.2.1)(3).



HEALTH CARE OCCUPANCY CORRIDORS

IF THE SMOKE COMPARTMENT IS SPRINKLERED, THE WALL SHALL FORM A BARRIER TO LIMIT THE TRANSFER OF SMOKE. THE WALL HAS NO REQUIRED FIRE RESISTANCE RATING AND MAY TERMINATE AT A CEILING CONSTRUCTED TO LIMIT TRANSFER OF SMOKE.

IF THE SMOKE COMPARTMENT IS NOT SPRINKLERED, THE WALL SHALL BE CONTINUOUS FROM THE FLOOR TO THE UNDERSIDE OF THE FLOOR OR ROOF DECK ABOVE. CORRIDOR WALL SHALL HAVE A MINIMUM 1/2 HOUR FIRE RESISTANCE RATING. DOORS ARE MANUALLY CLOSED IN AN EMERGENCY NFPA 101 19.3.6.2 AND 18.3.6.2

- DOORS: DOORS THAT ARE NOT PART OF A RATED WALL:
1. NON-LABELED FRAME (NFPA 101 18.3.6.3.1, 19.3.6.3 & 19.3.6.3.3)
 2. NON-RATED DOORS PERMITTED IF SPRINKLERED (NFPA 101 18.3.6.3.1, 19.3.6.3.2(2))
 3. 20-MINUTE OR SOLID WOOD CORE DOOR IF NOT SPRINKLERED (NFPA 101 19.3.6.3.1) 1 3/4" THICK.
 4. POSITIVE LATCHING EXCEPT TOILETS, SHOWER AND SINK CLOSETS (NFPA 101 18.3.6.3.6 & 19.3.6.3.6)
 5. SELF-CLOSING NOT REQUIRED (NFPA 101 19.3.6.3.11)
 6. NO MAXIMUM GAP (NFPA 101 18.3.6.3.1 & 19.3.6.3.3)
 7. MAXIMUM 1" UNDERCUT (NFPA 101 18.3.6.3.1 & 19.3.6.3.4)
 8. UNLIMITED HEIGHT PROTECTIVE PLATE (NFPA 101 18/19.3.6.3.12)
 9. TRANSFER GRILLS NOT PERMITTED EXCEPT TOILETS, SHOWER AND SINK CLOSETS (NFPA 101 18/19.3.6.4)
 10. SWING IN ANY DIRECTION
 11. SMOKE DOOR ASSEMBLIES SHALL BE TESTED AT LEAST ANNUALLY (NFPA 105 5.2.1.1)

SMOKE ZONE BARRIER

SUBSTANTIAL WALLS AND DOORS TO DIVIDE EACH FLOOR INTO COMPARTMENTS FOR DEFEND IN PLACE EMERGENCY OPERATIONS. IF THE SMOKE ZONE BARRIER WALL IS OF MASONRY, GYPSUM BOARD, OR METAL LATH AND PLASTER CONSTRUCTION, AND THE BARRIER WAS CONSTRUCTED POST 1948, THE SMOKE ZONE BARRIER WALLS ARE REQUIRED TO BE OF 1 HOUR FIRE RESISTANCE RATING. (NFPA 101, 18.3.2.7.5) SMOKE ZONE BARRIER WALLS OF WOOD LATH AND PLASTER CONSTRUCTION ARE PERMITTED TO BE OF A 1/2 HOUR FIRE RESISTANCE RATING (NFPA 101, 19.3.7.3)

- WALL: WALL EXTENDS FROM FLOOR TO DECK ABOVE.
- DUCTS: ALL DUCT PENETRATIONS ARE PROTECTED BY SMOKE DAMPERS. SMOKE DAMPERS ARE NOT REQUIRED WHERE ADJACENT SMOKE COMPARTMENTS ARE PROTECTED BY QUICK RESPONSE SPRINKLERS THROUGHOUT EACH COMPARTMENT.
- PENETRATIONS: ALL PENETRATIONS ARE SEALED WITH LISTED FIRESTOP MATERIALS FOR PROTECTING 1-HOUR FIRE AND SMOKE WALL ASSEMBLIES. PENETRATIONS ARE TO BE FILLED ON BOTH SIDES OF THE WALL.
- DOORS: ALL DOORS FOR SMOKE BARRIERS REQUIRE THE FOLLOWING:
1. NON-LABELED FRAME (NFPA 101 18.3.7.6)
 2. 20 MINUTE OR SOLID WOOD CORE (NFPA 101 18.3.7.6) 1 3/4" THICK.
 3. MAXIMUM SIZE LISTED WINDOW (NFPA 80 TABLES 4.4.5)
 4. POSITIVE LATCHING NOT REQUIRED (NFPA 101 18.3.7.8)
 5. SELF CLOSING OR AUTOMATIC CLOSING (NFPA 101 18.3.7.8)
 6. MAXIMUM 1/8" GAP (NFPA 101 18.3.7.6.)
 7. MAXIMUM 3/4" UNDERCUT (NFPA 101 8.5.4)
 8. UNLIMITED IN HEIGHT PROTECTIVE PLATE (NFPA 101 18.3.7.6/19.3.7.6.1
 9. SWING IN DIRECTION OPPOSITE OF EACH OTHER (NFPA 101 18.3.7.6)
 10. SMOKE DOOR ASSEMBLIES SHALL BE TESTED AT LEAST ANNUALLY (NFPA 105 5.2.1.1)

1-HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)

THIS APPLIES TO 1-HOUR FIRE RATED OCCUPANCY SEPERATIONS, HAZARDOUS ROOM ENCLOSURES AND STAIRWELLS 3 STORIES OR LESS.

- WALL: WALL EXTENDS FROM FLOOR TO DECK ABOVE.
- DUCTS: STEEL DUCT PENETRATIONS NOT REQUIRED TO BE PROTECTED BY FIRE DAMPERS.
- PENETRATIONS: ALL NEW PENETRATIONS ARE SEALED WITH LISTED FIRESTOP MATERIALS FOR PROTECTING 1-HOUR WALL ASSEMBLIES. WALL PENETRATIONS ARE REQUIRED TO BE FILLED ON BOTH SIDES OF THE WALL. FLOOR PENETRATIONS ARE ONLY REQUIRED TO BE FILLED ON THE TOP OF THE FLOOR.
- DOORS*: ALL DOORS REQUIRE THE FOLLOWING:
1. LABELED FRAMES (NFPA 80 4.2.1)
 2. LABELED 3/4 OR 1-HOUR DOOR (NFPA 80 4.3.1)*
 3. MAXIMUM 100 SQ. IN. WINDOW (NFPA 80 TABLE 4.4.5)
 4. POSITIVE LATCHING (NFPA 80 6.4.1.4)
 5. SELF CLOSING OR AUTOMATIC CLOSING (NFPA 80 6.4.1)
 6. COORDINATING DEVICES REQUIRED (NFPA 80 6.4.1.2.1)
 7. MAXIMUM 1/8" GAP (NFPA 80 6.3.1.7.3)
 8. MAXIMUM 3/4" UNDERCUT (NFPA 80 4.8.4.1)
 9. MAXIMUM 16" PROTECTIVE PLATE (NFPA 80 6.4.5.1)
 10. SWING IN PRIMARY DIRECTION OF TRAVEL (NFPA 101 18/19.2.2.2).
 11. PERIODIC INSPECTION AND TESTING SHALL BE PERFORMED AT LEAST ANNUALLY (NFPA 80 5.2.4.1)
- * 1-HOUR DOORS ARE REQUIRED IN STAIRWELLS THAT ARE 3 STORIES OR LESS. (NFPA101 7.1.3.2.1)(1)



NON-RATED SMOKE ZONE PARTITION

FORMER DECOMMISSIONED SMOKE BARRIER RETAINED AS FIRE ALARM/SPRINKLER ZONE. BUILDING OCCUPANTS PERMITTED TO DEFEND IN PLACE UNTIL DIRECTED BY THE FIRE DEPARTMENT PER SECTION 16.7.4.3 OF NFPA 99-2018 EDITION AND PRIVATE MODE AUDIBLE REQUIREMENTS OF SECTION 16.7.4.3 OF NFPA 72-2019 EDITION.

- WALL: WALL EXTENDS FROM FLOOR TO SUSPENDED CEILING OR DECK ABOVE.
- DUCTS: NO MINIMUM REQUIREMENTS.
- PENETRATIONS: NO MINIMUM REQUIREMENTS FOR WALL PENETRATIONS ABOVE A SUSPENDED CEILING. PENETRATIONS BELOW A SUSPENDED CEILING OR DECK SEALED WITH NON-FIRE-RATED MATERIALS TO BE SMOKE RESISTIVE.
- DOORS: NON-FIRE-RATED DOORS AND FRAMES SELF CLOSING OR AUTOMATIC CLOSING IN AN EMERGENCY.



SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE

- WALL: IF THE HAZARDOUS ROOM HAS A SUSPENDED CEILING CONSTRUCTED TO LIMIT TRANSFER OF SMOKE, THE WALL HAS NO FIRE RESISTANCE RATING AND MAY TERMINATE AT THE CEILING. IF THE ROOM DOES NOT HAVE A SUSPENDED CEILING, THE WALL HAS NO FIRE RESISTANCE RATING AND SHALL EXTEND TO THE DECK ABOVE.
- DUCTS: STEEL DUCT PENETRATIONS ARE NOT REQUIRED TO BE PROTECTED BY FIRE DAMPERS OR SMOKE DAMPERS.
- PENETRATIONS: SEALED WITH NON-FIRE-RATED MATERIALS TO BE RESISTIVE. USE OF LISTED FIRESTOP MATERIALS IS NOT REQUIRED.
- DOORS: EXISTING HAZARDOUS ROOMS:
1. NON-LABELED FRAME (NFPA 101 19.3.7.9)
 2. 20 MINUTE OR SOLID WOOD CORE (NFPA 101 19.3.7.6) 1 3/4" THICK.
 3. MAXIMUM 1296 SQ. IN. WINDOW (NFPA 101 19.3.6.3.17)
 4. POSITIVE LATCHING NOT REQUIRED (NFPA 101 19.3.6.3.5)
 5. SELF CLOSING OR AUTOMATIC CLOSING (NFPA 101 19.3.2.1.3)
 6. MAXIMUM 1/8" GAP (NFPA 101 19.3.6.3.1)
 7. MAXIMUM 1" UNDERCUT (NFPA 101 19.3.6.3.4)
 8. MAXIMUM 48" PROTECTIVE PLATE (NFPA 101 19.3.2.1.2)
 9. SWING IN ANY DIRECTION
 10. SMOKE DOOR ASSEMBLIES SHALL BE TESTED AT LEAST ANNUALLY (NFPA 105 5.2.1.1)



FIRE EXTINGUISHER



EXIT SIGN



EMERGENCY LIGHT



FIRE ALARM STATION



FIRE ALARM CONTROL PANEL



FIRE ALARM ANNUNCIATOR PANEL



AUTOMATED EXTERNAL DEFIBRILLATOR



EYEWASH STATION



SPRINKLER SYSTEM RISER



SHOWER STATION



EVACUATION CHAIR



FIRE HOSE VALVE

NOTE: ALL CODE REFERENCES ARE PER THE 2018 EDITION OF NFPA 101 LIFE SAFETY CODE AND THE OTHER APPLICABLE CODES. FEDERAL FACILITIES FOLLOW 2018 LIFE SAFETY CODE.

Revisions	Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No.	Contract No.	Drawing Title: BARRIER DESCRIPTION	Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. X-1 Sht. 1 of 35
FP&C Project Number: 3032.02					Building No. ALL	AutoCAD File Name X-1 DESCRIPTION		Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			

<u>APPLICABLE CODES AND STANDARDS:</u> 1. THE ORIGINAL BUILDING WAS DESIGNED TO THE 1942 EDITION OF NFPA 101, LIFE SAFETY CODE. 2. THE 1960 PUBLIC BUILDING AMENDMENT ACT (PL100-678) REQUIRES ALL FEDERAL AGENCIES TO FOLLOW THE LATEST EDITIONS OF NATIONALLY RECOGNIZED FIRE AND LIFE SAFETY CODES. THE VA HAS ADOPTED THE NATIONAL FIRE CODES PUBLISHED BY THE NATIONAL FIRE PROTECTION ASSOCIATION. LIFE SAFETY REQUIREMENTS ARE SPECIFICALLY ADDRESSED IN THE 2018 EDITION OF NFPA 101, LIFE SAFETY CODE. 3. ALL NEW CONSTRUCTION OR BUILDING RENOVATIONS ARE REQUIRED TO COMPLY WITH THE LATEST EDITION OF NFPA 101 OR IT'S REFERENCED STANDARDS. EXISTING BUILDING CONDITIONS ARE REQUIRED TO COMPLY WITH THE APPLICABLE CODES OR STANDARDS AT THE TIME OF BUILDING DESIGN AND THE APPLICABLE PROVISIONS FOR EXISTING BUILDINGS IN CURRENT EDITIONS OF APPLICABLE CODES AND STANDARDS. 4. OTHER NFPA CODES AND STANDARDS: A. NFPA 10 - PORTABLE FIRE EXTINGUISHERS, 2018 EDITION. B. NFPA 13 - SPRINKLER SYSTEMS, 2019 EDITION. C. NFPA 14 - STANDPIPE SYSTEMS, 2016 EDITION. D. NFPA 20 - FIRE PUMPS, 2019 EDITION E. NFPA 70 - NATIONAL ELECTRIC CODE, 2017 EDITION. F. NFPA 72 - NATIONAL FIRE ALARM CODE, 2019 EDITION. G. NFPA 75 - ELECTRONIC COMPUTER EQUIPMENT, 2017 EDITION. H. NFPA 80 - FIRE DOORS, 2019 EDITION. I. NFPA 90A&B - HEATING AND AIR CONDITIONING SYSTEMS, 2018 EDITION. J. NFPA 96 - COMMERCIAL COOKING EQUIPMENT, 2017 EDITION. K. NFPA 99 - HEALTH CARE FACILITIES CODE, 2018 EDITION. L. NFPA 105 - SMOKE DOORS, 2019 EDITION. M. NFPA 110 - EMERGENCY POWER SYSTEMS, 2019 EDITION. N. NFPA 241 - CONSTITUTION AND DEMOLITION, 2019 EDITION.	<u>FIRE SPRINKLER SYSTEM:</u> 1. THE COMBINATION STANDPIPE AND FIRE SPRINKLER SYSTEM WAS DESIGNED TO NFPA 13 AND NFPA 14. 2. QUICK RESPONSE TYPE SPRINKLERS ARE INSTALLED THROUGHOUT MOST OF THE BUILDING. STANDARD RESPONSE TYPE SPRINKLERS ARE INSTALLED IN THE ELEVATOR MACHINE ROOMS (NFPA 13- 3.6.4.8). 3. SPRINKLERS WERE INSTALLED IN LIGHT HAZARD AREAS INCLUDING; CORRIDORS, OFFICES, PATIENT CARE AND PATIENT SLEEPING ROOMS AT LIGHT HAZARD 0.10 GPM/1500 SQ. FT. DENSITY. MAXIMUM PROTECTION AREA OF 225 SQ. FT. (NFPA 13- TABLE 10.2.4.2.1.A). 4. SPRINKLERS WERE INSTALLED IN ORDINARY HAZARD GROUP I AREAS INCLUDING; LABORATORIES (WITHOUT FLAMMABLE LIQUIDS), MECHANICAL EQUIPMENT ROOMS, ELECTRICAL SWITCH GEAR ROOMS, REPAIR SHOPS AND STORAGE ROOMS UNDER 250 SQ. FT. AT A 0.15 GPM/1500 SQ. FT. DENSITY. MAXIMUM PROTECTION AREA OF 150 SQ. FT. (NFPA 13- TABLE 10.2.4.2.1.B). 5. SPRINKLERS WERE INSTALLED IN ORDINARY HAZARD GROUP II AREAS INCLUDING GENERAL STORAGE ROOMS OVER 250 SQ. FT. AND LABORATORIES (WITH THE USE OF FLAMMABLE LIQUIDS) AT A 0.20 GPM/1500 SQ. FT. DENSITY. 6. MAXIMUM DISTANCE FROM SPRINKLERS TO WALLS FOR STANDARD SPRAY SPRINKLERS SHALL NOT EXCEED 7'-6" (NFPA 13-10.2.5.2.1). MAXIMUM DISTANCE FROM SPRINKLERS TO WALLS FOR STANDARD SPRAY SPRINKLERS IN SMALL ROOMS (800 SQ. FT. MAXIMUM) SHALL NOT EXCEED 9' FROM ANY SINGLE WALL (NFPA 13-10.2.5.2.3.1). 7. SPRINKLERS SHALL BE INSTALLED UNDER FIXED OBSTRUCTIONS (I.E. DUCTWORK) OVER 4' WIDE (NFPA 13-10.2.7.3.2). THE WIDTH OF DUCT INSULATION NOT A FACTOR FOR SPRINKLERS INSTALLED PRIOR TO THE 2013 EDITION ON NFPA 13. SPRINKLERS NOT REQUIRED UNDER NON COMBUSTIBLE OBSTRUCTIONS OVER 4' WIDE WHERE THE BOTTOM OF THE OBSTRUCTION IS A MAXIMUM 24" ABOVE THE FLOOR (NFPA 13- 9.5.5.3.1.5). 8. SPRINKLERS SHALL BE INSTALLED A MAXIMUM 12" BELOW A CEILING OR FLOOR/ROOF DECK (NFPA 13- 10.2.6.1.1.1) OR A MAXIMUM 22" BELOW A FLOOR/ROOF DECK WITH STRUCTURAL MEMBER OBSTRUCTIONS (NFPA 13- 10.6.1.2). 9. SHELVING ON A WALL OR SHELVING AGAIN A WALL INCLUDING STORAGE THEREON SHALL BE PERMITTED TO EXTEND WITHIN THE 18" SPRINKLERS CLEARANCE BELOW CEILING SPRINKLER DEFLECTORS (NFPA 13- 9.5.6.6.1). 10. WHERE THE 18" CLEARANCE BETWEEN SPRINKLERS AND SHELVING STORAGE CANNOT BE MAINTAINED, SPRINKLERS SHALL BE INSTALLED IN EVERY AISLE (NFPA 13- 9.3.7). 11. CEILING MOUNTED OBSTRUCTIONS(I.E. PATIENT LIFT TRACKS) WITHIN THE 18" SPRINKLER DISCHARGE CLEARANCE ARE PERMITTED PER NFPA 13 TABLE 10.2.7.1.2 AND FIGURE 10.2.7.2(A). 12. FLOOR MOUNTED OBSTRUCTIONS (I.E. ROOM DIVIDERS OR SHELVING) WITHIN THE 18" SPRINKLER DISCHARGE CLEARANCE ARE PERMITTED PER NFPA 13 TABLE 10.2.7.2.2 AND FIGURE 10.2.7.2.2.	<u>FIRE ALARM SYSTEM:</u> 1. THE FIRE ALARM SYSTEM WAS DESIGNED TO OLDER OF NFPA 72, NATIONAL FIRE ALARM CODE. 2. PRIVATE MODE BUILDING OCCUPANT NOTIFICATION IS INSTALLED PER SECTIONS 19.3.4.3.1 AND 9.6.3.6.3 OF NFPA 101-2018 EDITION. 3. PRIVATE MODE AUDIBLE DEVICES (SPEAKERS) ARE INSTALLED IN CORRIDORS AND LARGER ROOMS OR SUITES PER SECTION 18.4.4.1 OF NFPA 72- 2019 EDITION. 4. PRIVATE MODE VISIBLE DEVICES (STROBES) ARE INSTALLED AT REDUCED QUANTITY AND SPACING PER SECTION 18.6 OF THE NFPA 72- 2019 EDITION. 5. STROBE CIRCUITS ARE REQUIRED TO BE SYNCHRONIZED IN ACCORDANCE WITH SECTION 18.5.5.4.2(2) OF NFPA 72-2019 EDITION. 6. TYPICAL SMOKE DETECTORS HAVE A 21 FT. RADIUS OF COVERAGE AREA (NFPA 72- 17.7.3.2.3.1) 7. SMOKE DETECTORS THAT ARE CONNECTED TO THE BUILDING FIRE ALARM SYSTEM AND LOCATED ON BOTH SIDES OF SMOKE/FIRE DOORS MAY BE SPACED AT MAXIMUM 21' RADIUS FOR DOOR RELEASE SERVICE (NFPA 72- 17.7.5.6.1) SMOKE DETECTORS NOT CONNECTED TO THE BUILDING FIRE ALARM SYSTEM AND USED EXCLUSIVELY FOR SMOKE/FIRE DOOR RELEASE SHALL BE LOCATED AND SPACED PER NFPA 72- 17.7.5.6. 8. CEILINGS WITH BEAM DEPTHS OF LESS THAN 10% OF CEILING HEIGHT SHALL BE CONSIDERED A SMOOTH CEILING FOR SMOKE DETECTOR COVERAGE. CEILINGS WITH BEAM DEPTHS GREATER THAN 10% OF CEILING HEIGHT SHALL HAVE REDUCED SMOKE DETECTOR SPACING COVERAGE (NFPA 72- 17.7.3.2.4.2). 9. SMOKE DETECTORS SHALL BE LOCATED ON THE CEILINGS THE BOTTOM OF BEAMS OR MAXIMUM 12" DOWN FROM THE CEILING TO TOP OF THE DETECTOR (NFPA 72- 17.7.3.2.1). 10. SMOKE DETECTORS SHALL NOT BE LOCATED DIRECTLY IN THE AIR STREAM OF SUPPLY AIR REGISTERS (NFPA 72- 17.7.6.3.2).
<u>PENETRATIONS:</u> 1. PRIOR TO THE EARLY 1990'S, THE STANDARD INDUSTRY PRACTICE FOR THE SEALING OF		

OCCUPANCY TABLE


BUILDING #	BUILDING SECTION	FLOOR	HEALTH CARE OCCUPANCY	AMBULATORY HEALTH CARE OCCUPANCY	BUSINESS OCCUPANCY	INDUSTRIAL OCCUPANCY	ASSEMBLY OCCUPANCY	TOTAL
1	BED TOWER	6	0	0	0	28,856	0	28,856
1	MAIN HOSPITAL	6	0	0	0	2,107	0	2,107
1	E-WING	6	0	0	0	7,951	0	7,951
1	BED TOWER	5	47,573	0	0	0	0	47,573
1	MAIN HOSPITAL	5	0	34,655	0	0	0	34,655
1	E-WING	5	0	0	27,418	0	0	27,418
1	BED TOWER	4	47,573	0	0	0	0	47,573
1	MAIN HOSPITAL	4	0	0	38,212	0	0	38,212
1	E-WING	4	0	0	27,418	0	0	27,418
1	BED TOWER	3	47,573	0	0	0	0	47,573
1	MAIN HOSPITAL	3	40,813	0	0	0	0	40,813
1	E-WING	3	0	0	25,189	0	0	25,189
1	BED TOWER	2	47,573	0	0	0	0	47,573
1	MAIN HOSPITAL	2	23,322	0	0	0	0	23,322
1	E-WING	2	0	0	26,357	0	0	26,357
1	AMBULATORY HC	2	0	0	0	2,403	0	2,403
1	BED TOWER	1	0	13,774	34,737	0	0	48,511
1	MAIN HOSPITAL	1	55,384	0	31,173	0	0	86,557
1	E-WING	1	0	0	21,102	0	0	21,102
1	AMBULATORY HC	1	0	0	42,121	0	0	42,121
1	BED TOWER	BASEMENT	0	0	1,775	0	0	1,775
1	MAIN HOSPITAL	BASEMENT	0	0	37,516	0	18,595	56,111
1	E-WING	BASEMENT	0	0	38,474	0	0	38,474
1	AMBULATORY HC	BASEMENT	0	0	40,887	0	0	40,887
0	SUB TOTAL	0	309,811	48,429	392,379	41,317	18,595	810,531
12	CLC	PENTHOUSE	0	0	0	814	0	814
12	CLC	3	12,545	0	0	0	0	12,545
12	CLC	2	0	0	12,545	0	0	12,545
12	CLC	1	0	0	14,316	0	0	14,316
0	SUB TOTAL	0	12,545	0	26,861	814	0	40,220
0	GRAND TOTAL	0	322,356	48,429	419,240	42,131	18,595	850,751

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

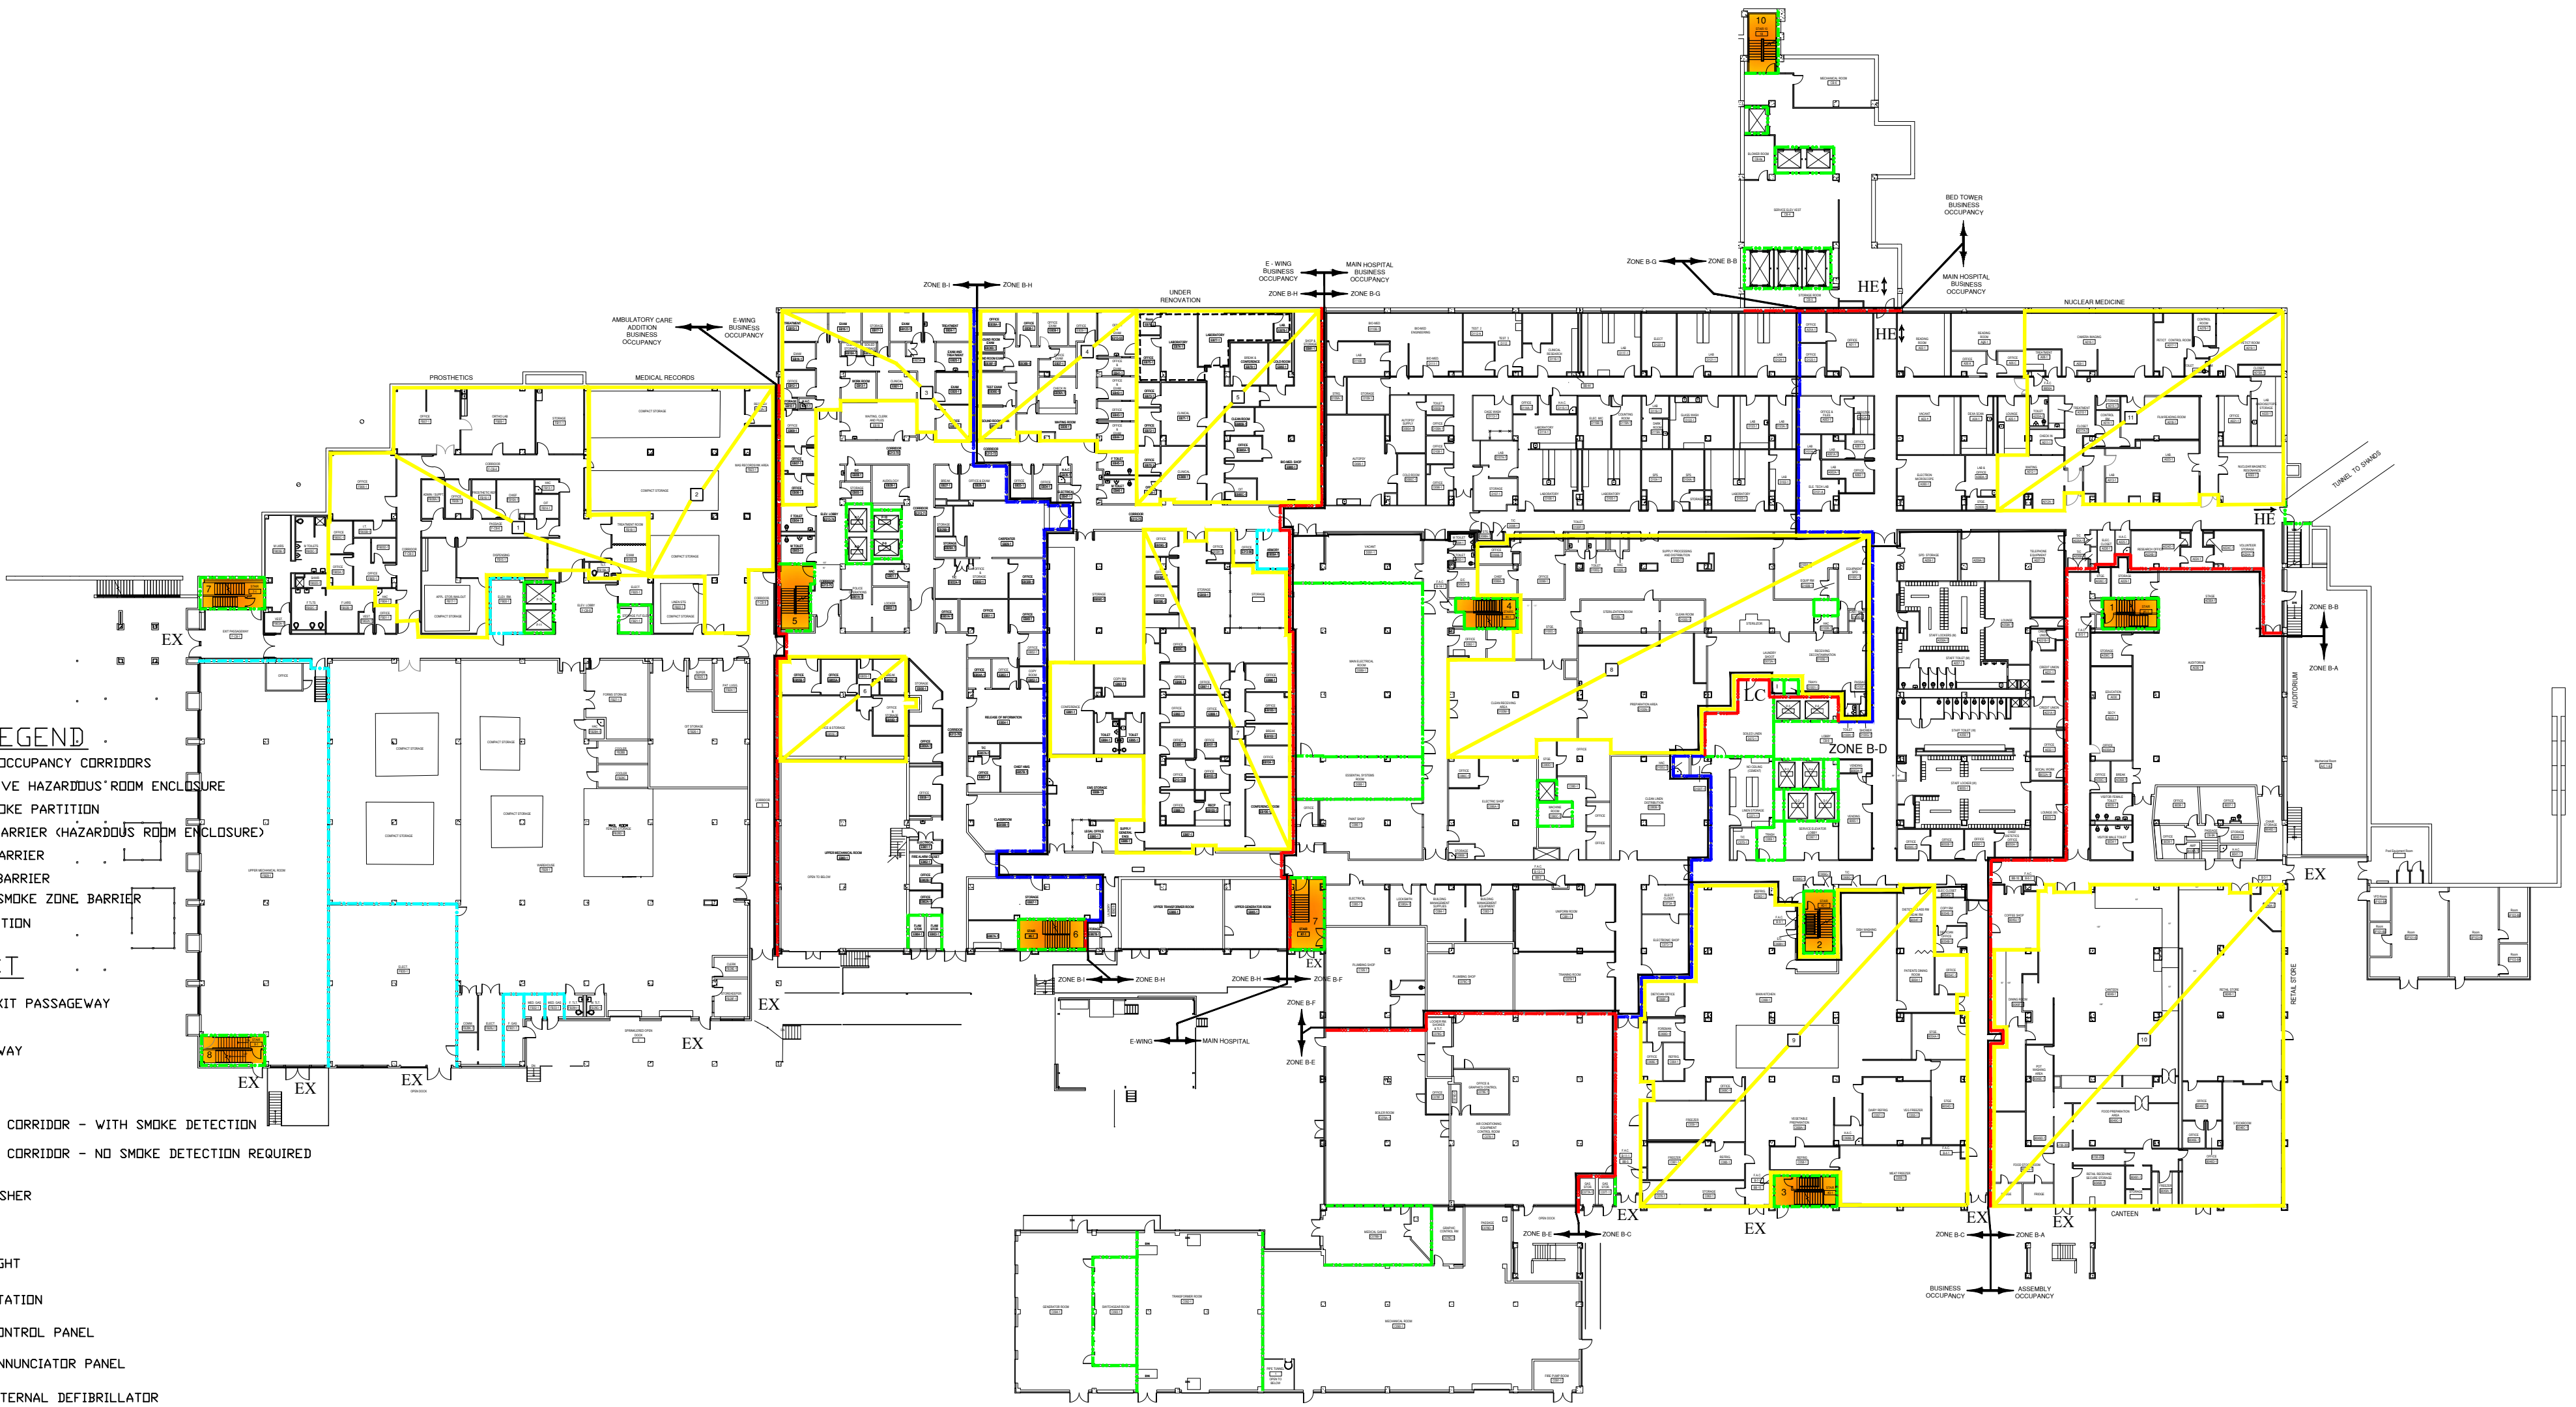

BASEMENT FLOOR
COMPOSITE
FULLY SPRINKLERED
MIXED OCCUPANCY

Revisions		Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No.	Contract No.	Drawing Title: BASEMENT COMPOSITE	Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-1 Sht. 3 Of 35
FP&C Project Number: 3032.02						Building No. 01	AutoCAD File Name LS02-B		Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	PROSTHETICS SUITE	6125 Sq. Ft.	NON-SLEEPING PATIENT CARE	2
2	MEDICAL RECORDS	3895 Sq. Ft.	NON PATIENT CARE	2

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION



BASEMENT FLOOR
AMBULATORY CARE ADDITION
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	

Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197

FP&C
FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title: **FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS02-B

Drawing Title: **BASEMENT
AMBULATORY CARE
ADDITION**

Designed By
FVO
Location

Drawn By
KW/TK
VA MEDICAL CENTER
GAINESVILLE, FLORIDA

Checked By
FVO
Scale:

Date
12/28/2018
Sht. 4 of 35

Drawing No.
LS-2

KEY NOTES:

1 FIRE SPRINKLERS INSTALLED PER LIBRARY AND SHELVING STORAGE SPACING REQUIREMENTS OF SECTION 8.15.10 OF NFPA 13-2016 EDITION.

SUITE DESCRIPTIONS


SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
3	PLASTIC SURGERY CLINIC SUITE	2,605 Sq. Ft.	NON SLEEPING PATIENT CARE	2
4	AUDIOLOGY CLINIC SUITE	2,355 Sq. Ft.	NON SLEEPING PATIENT CARE	2
5	CLINICAL LAB SUITE	3,979 Sq. Ft.	NON SLEEPING PATIENT CARE	2
6	EMS OFFICE SUITE	1,502 Sq. Ft.	NON PATIENT CARE	2
7	EMS OFFICE SUITE	6,162 Sq. Ft.	NON PATIENT CARE	2

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

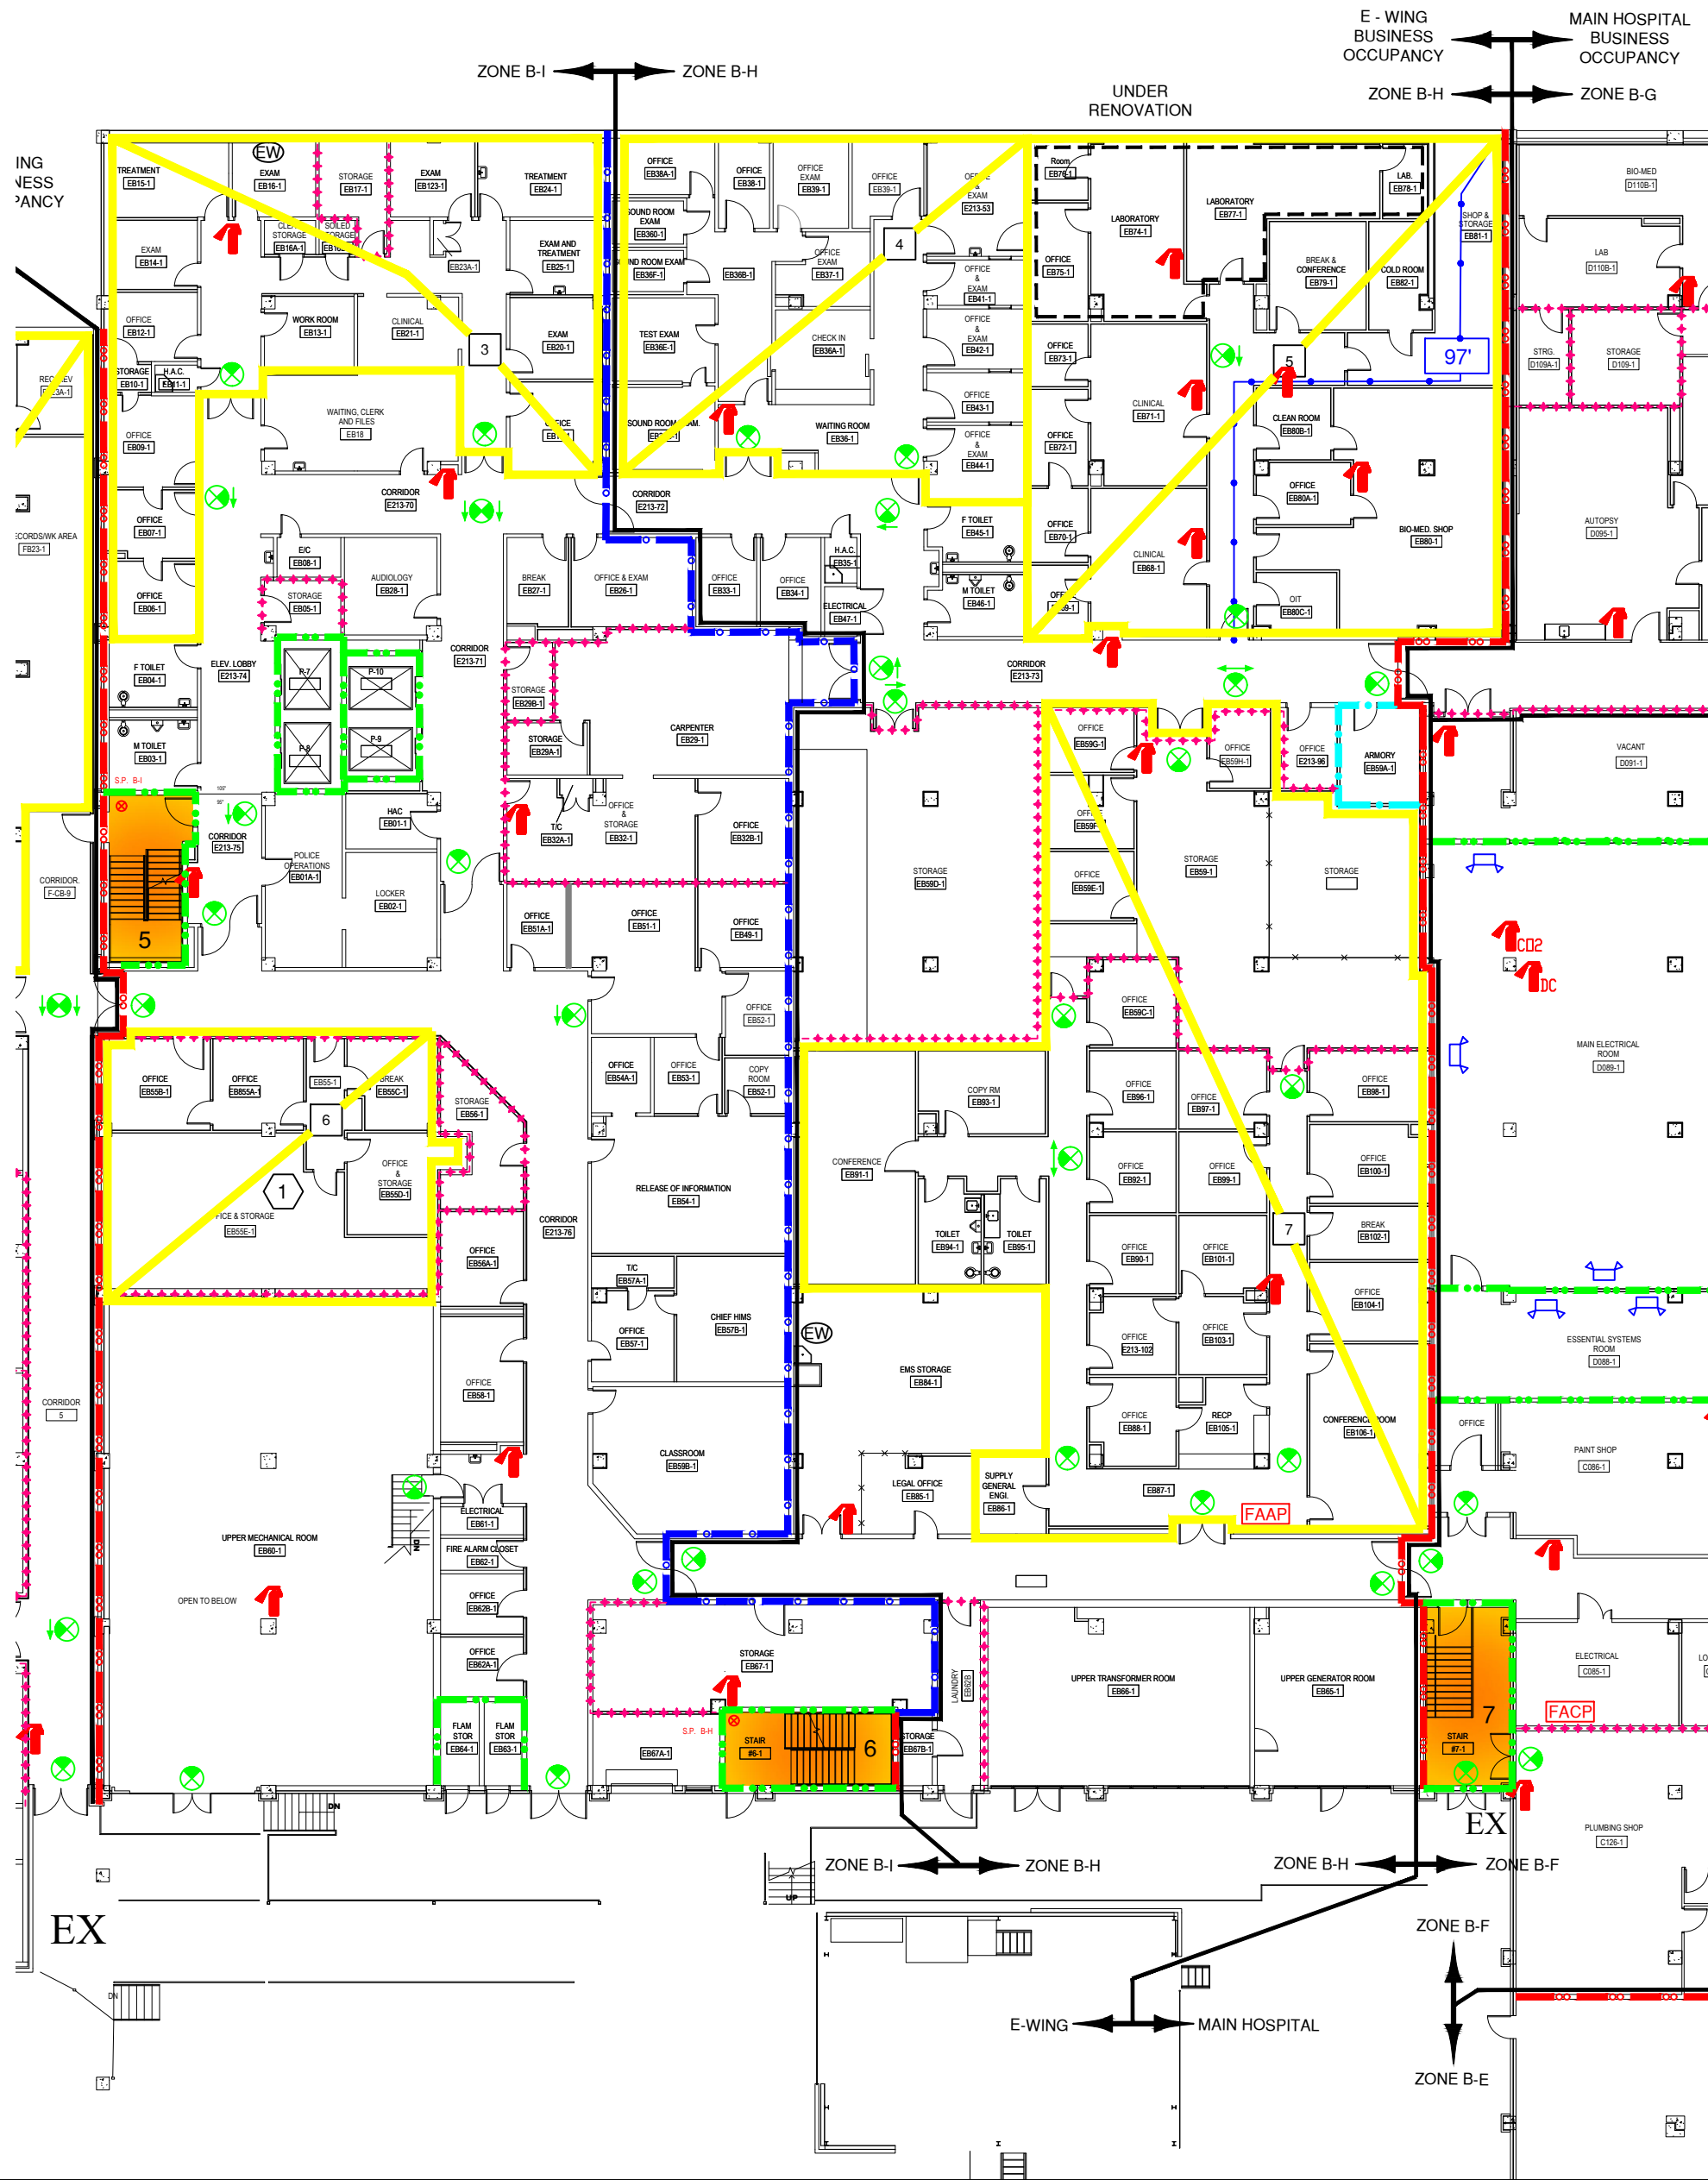

BASEMENT FLOOR
E-WING
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions		Date:		 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title:		Client Project No.		Contract No.		Drawing Title:		Designed By	Drawn By	Checked By	Date	Drawing No.
FP&C Project Number: 3032.02						FIRE AND LIFE SAFETY SURVEY		Building No. 01		AutoCAD File Name LS02-B		BASEMENT E-WING		Location	VA MEDICAL CENTER GAINESVILLE, FLORIDA			Scale:

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
8	SPS SUITE	8,514 Sq. Ft.	NON PATIENT CARE	3
9	MAIN KITCHEN	10,301 Sq. Ft.	NON PATIENT CARE	4
10	CANTEEN SERVICE	10,231 Sq. Ft.	NON PATIENT CARE	4
11	NUCLEAR MEDICINE	5,849 Sq. Ft.	NON-SLEEPING PATIENT CARE	3

KEY NOTES:


- 1 AUTOMATIC FIRE SHUTTER NOT SPRINKLERED.
- 2 MAXIMUM 49 OCCUPANTS.
- 3 CHUTES NOT IN SERVICE.

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION


SYMBOLS LIST

- HE HORIZONTAL EXIT PASSAGEWAY
- EX EXIT
- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FACFP FIRE ALARM CONTROL PANEL
- FAAP FIRE ALARM ANNUNCIATOR PANEL
- AED AUTOMATED EXTERNAL DEFIBRILLATOR
- EVC EVACUATION CHAIR
- FHV FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SH SHOWER STATION
- EW EYEWASH STATION

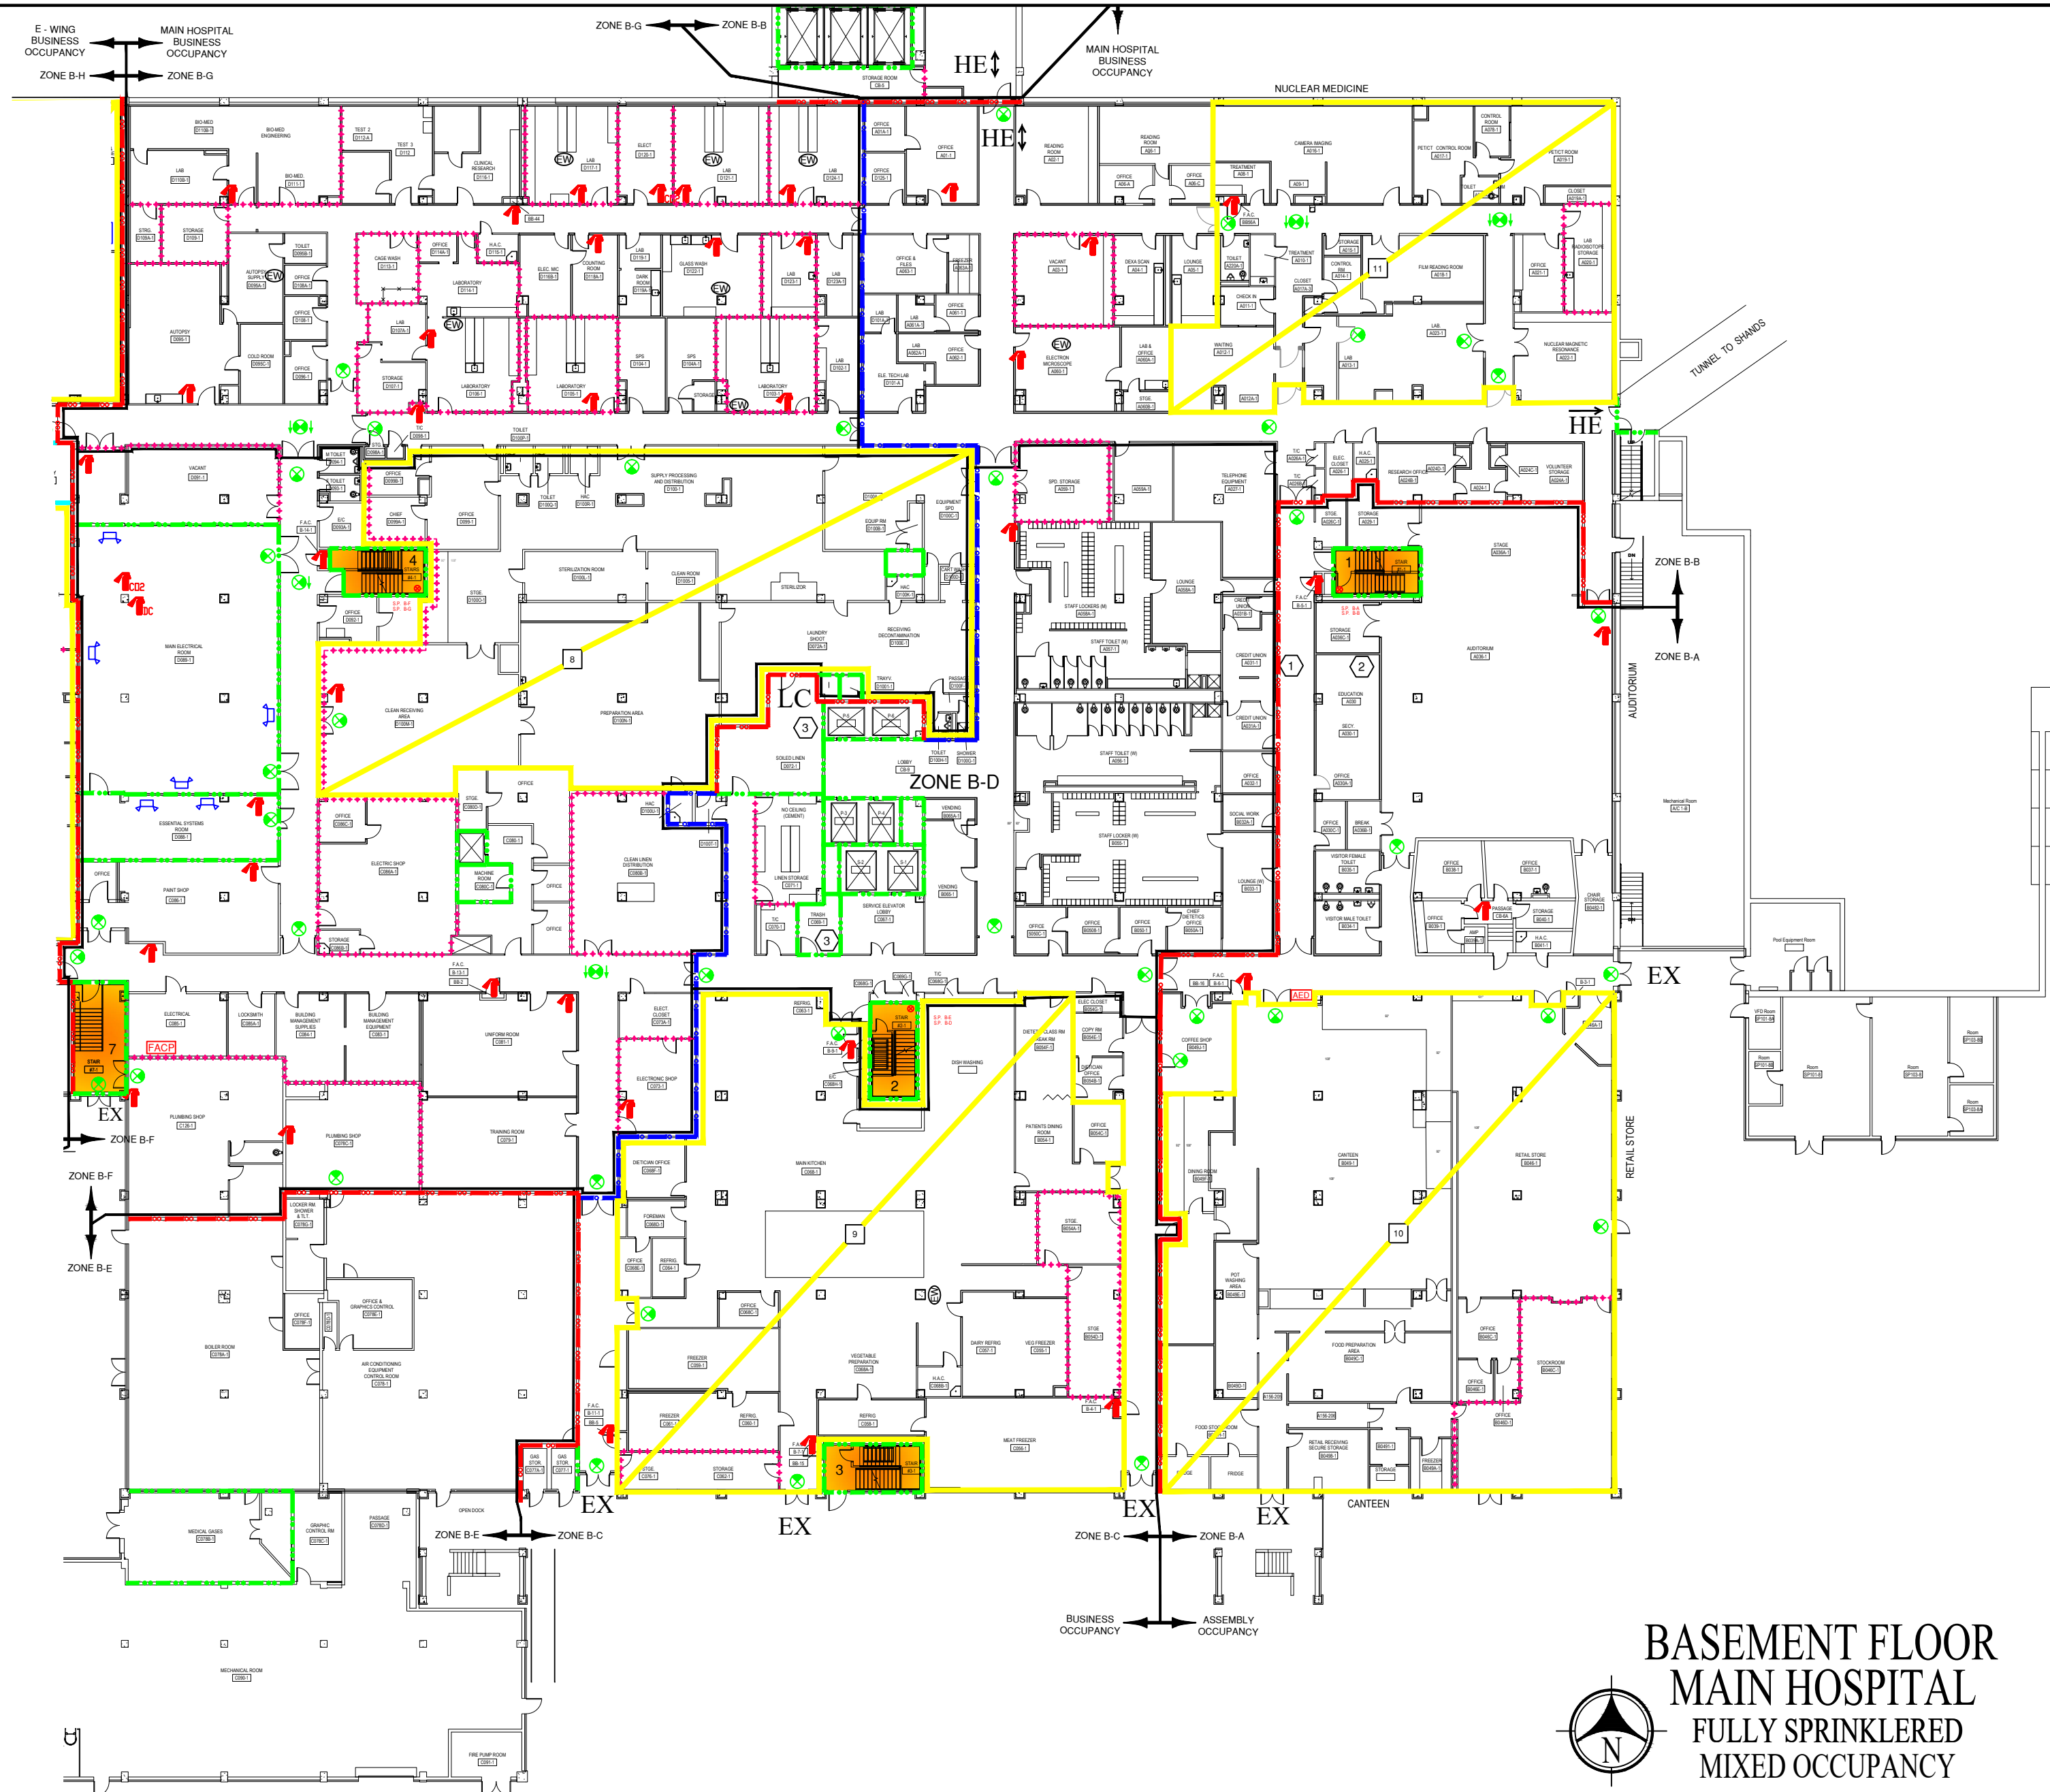

BASEMENT FLOOR MAIN HOSPITAL FULLY SPRINKLERED MIXED OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS02-B

Drawing Title:
**BASEMENT
MAIN HOSPITAL**


Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-4
Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			Sht. 6 Of 35

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION


SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

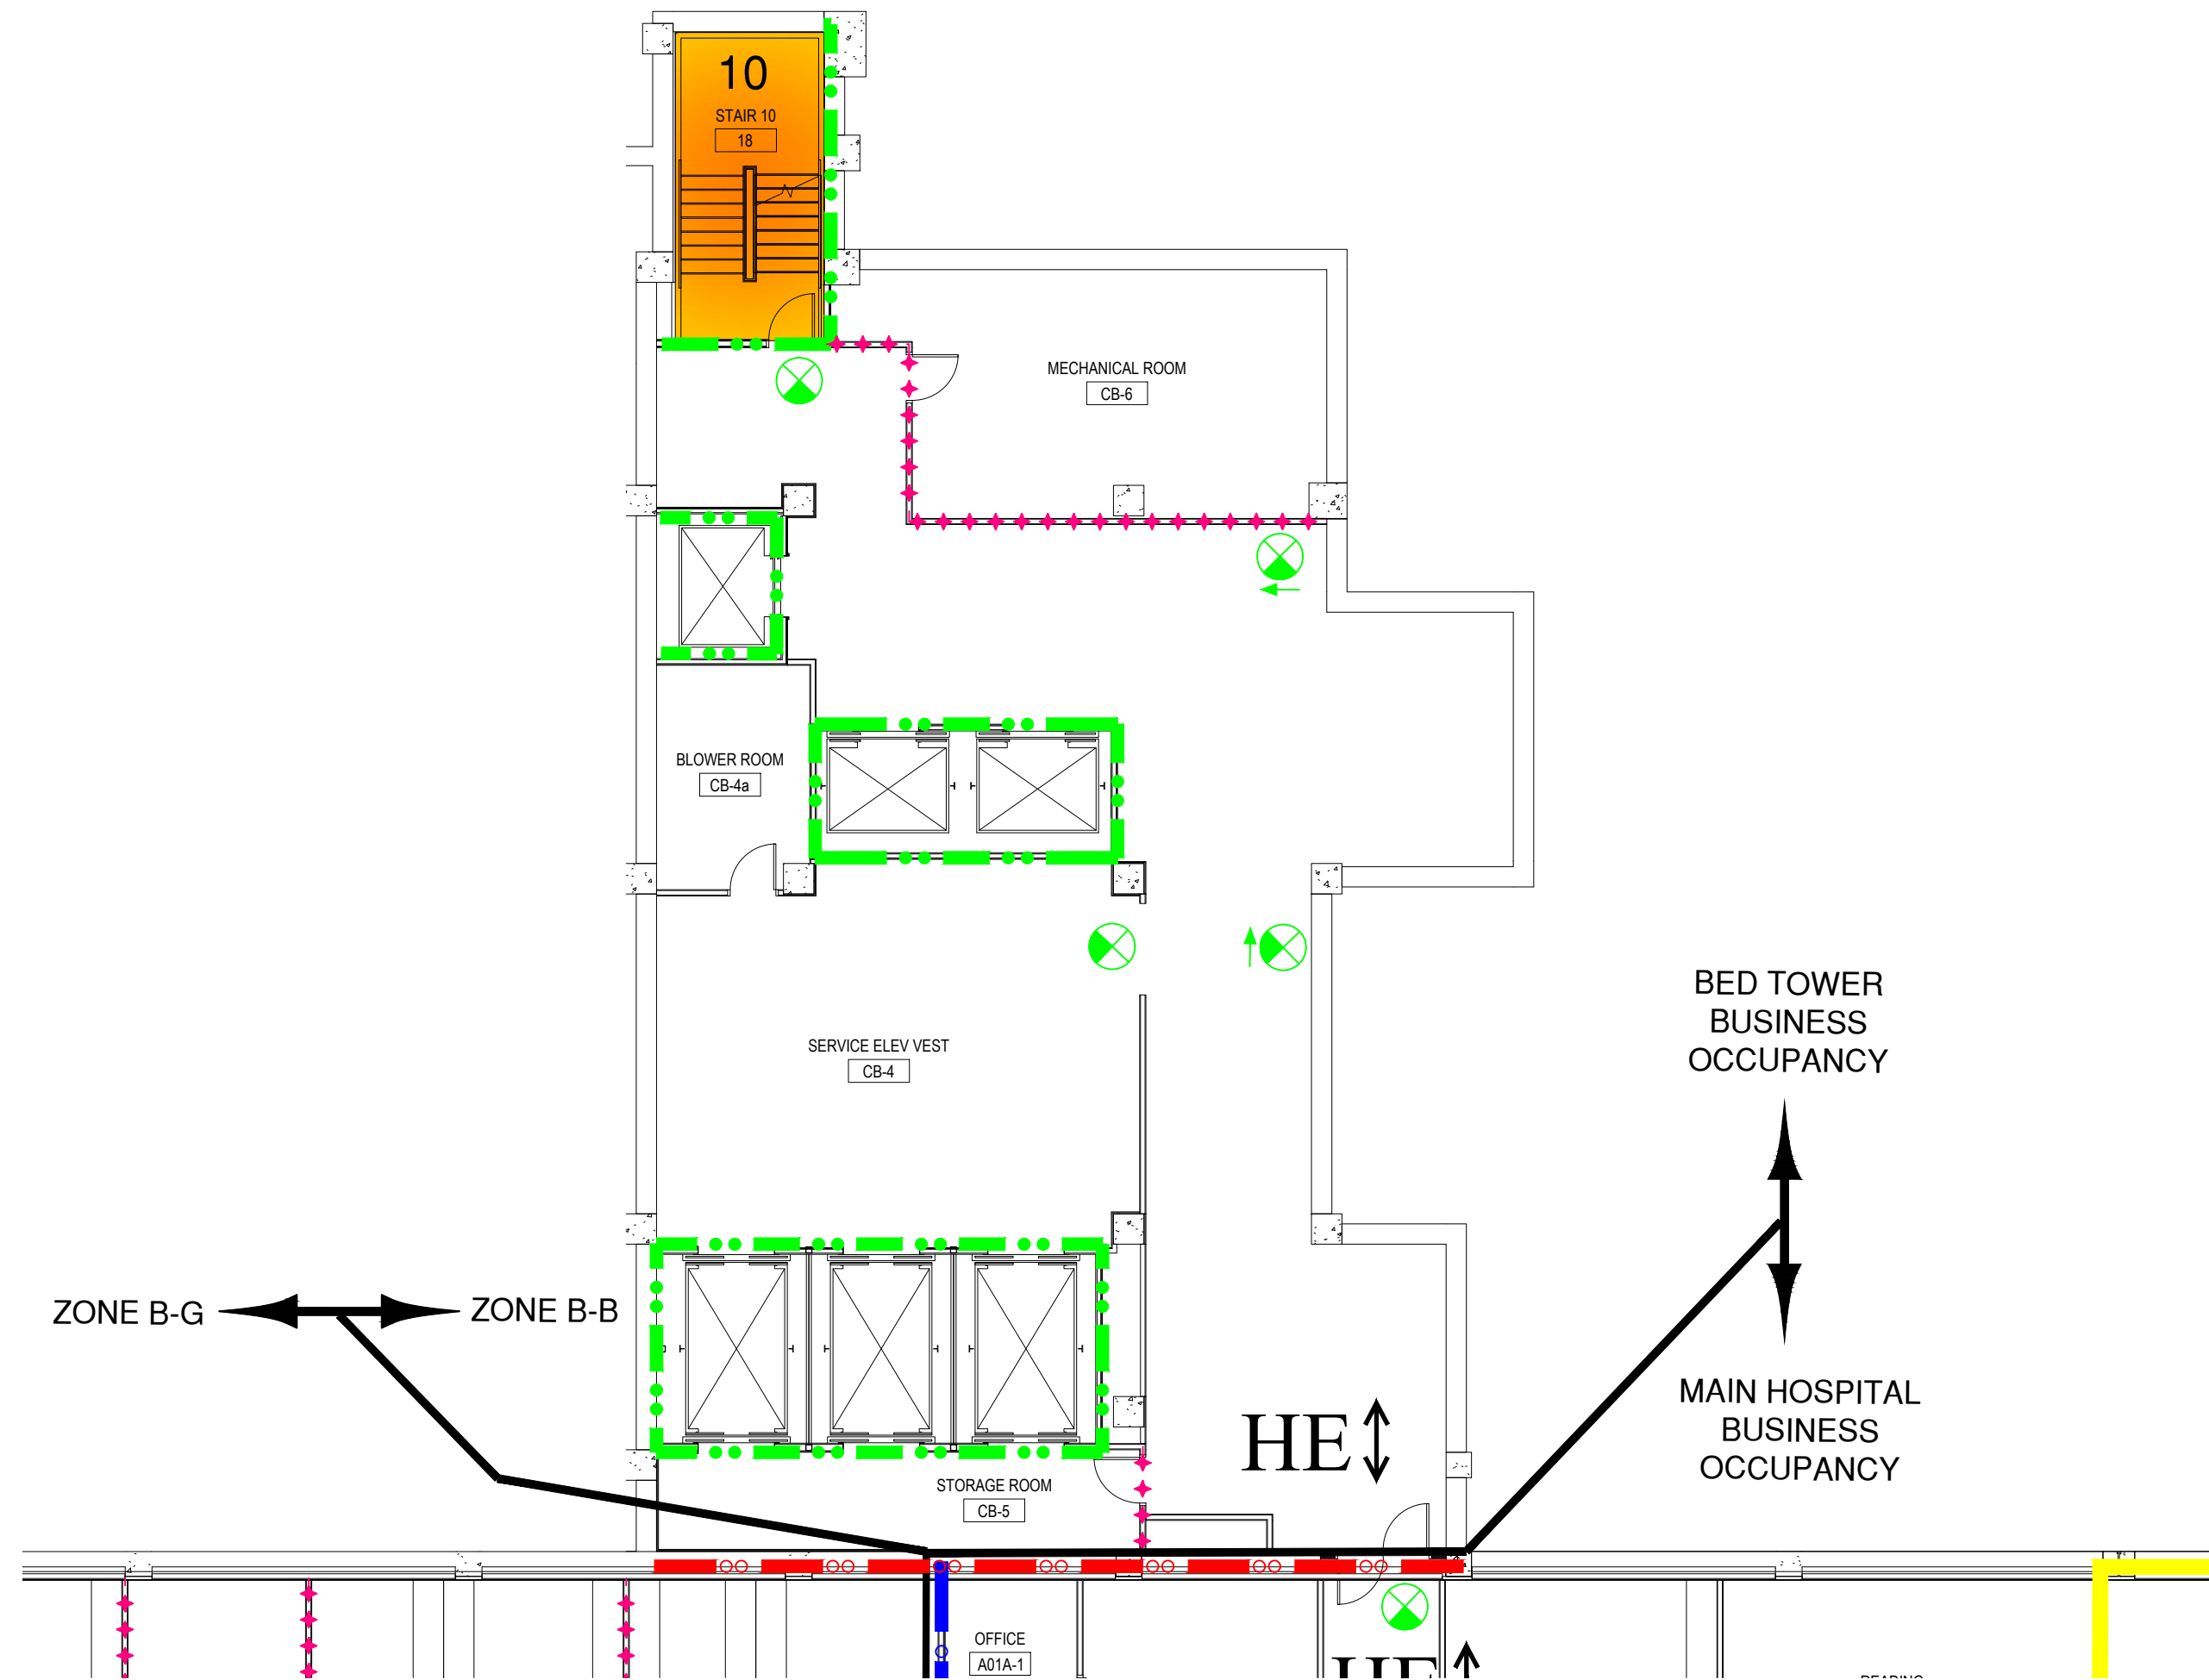

BASEMENT FLOOR
BED TOWER
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:	FIRE AND LIFE SAFETY SURVEY
----------------	--------------------------------

Client Project No.	
Building No.	01

Contract No.	
AutoCAD File Name	LS02-B

Drawing Title:	BASEMENT BED TOWER
----------------	-----------------------



Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-5
Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			Sht. 7 of 35

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION


SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

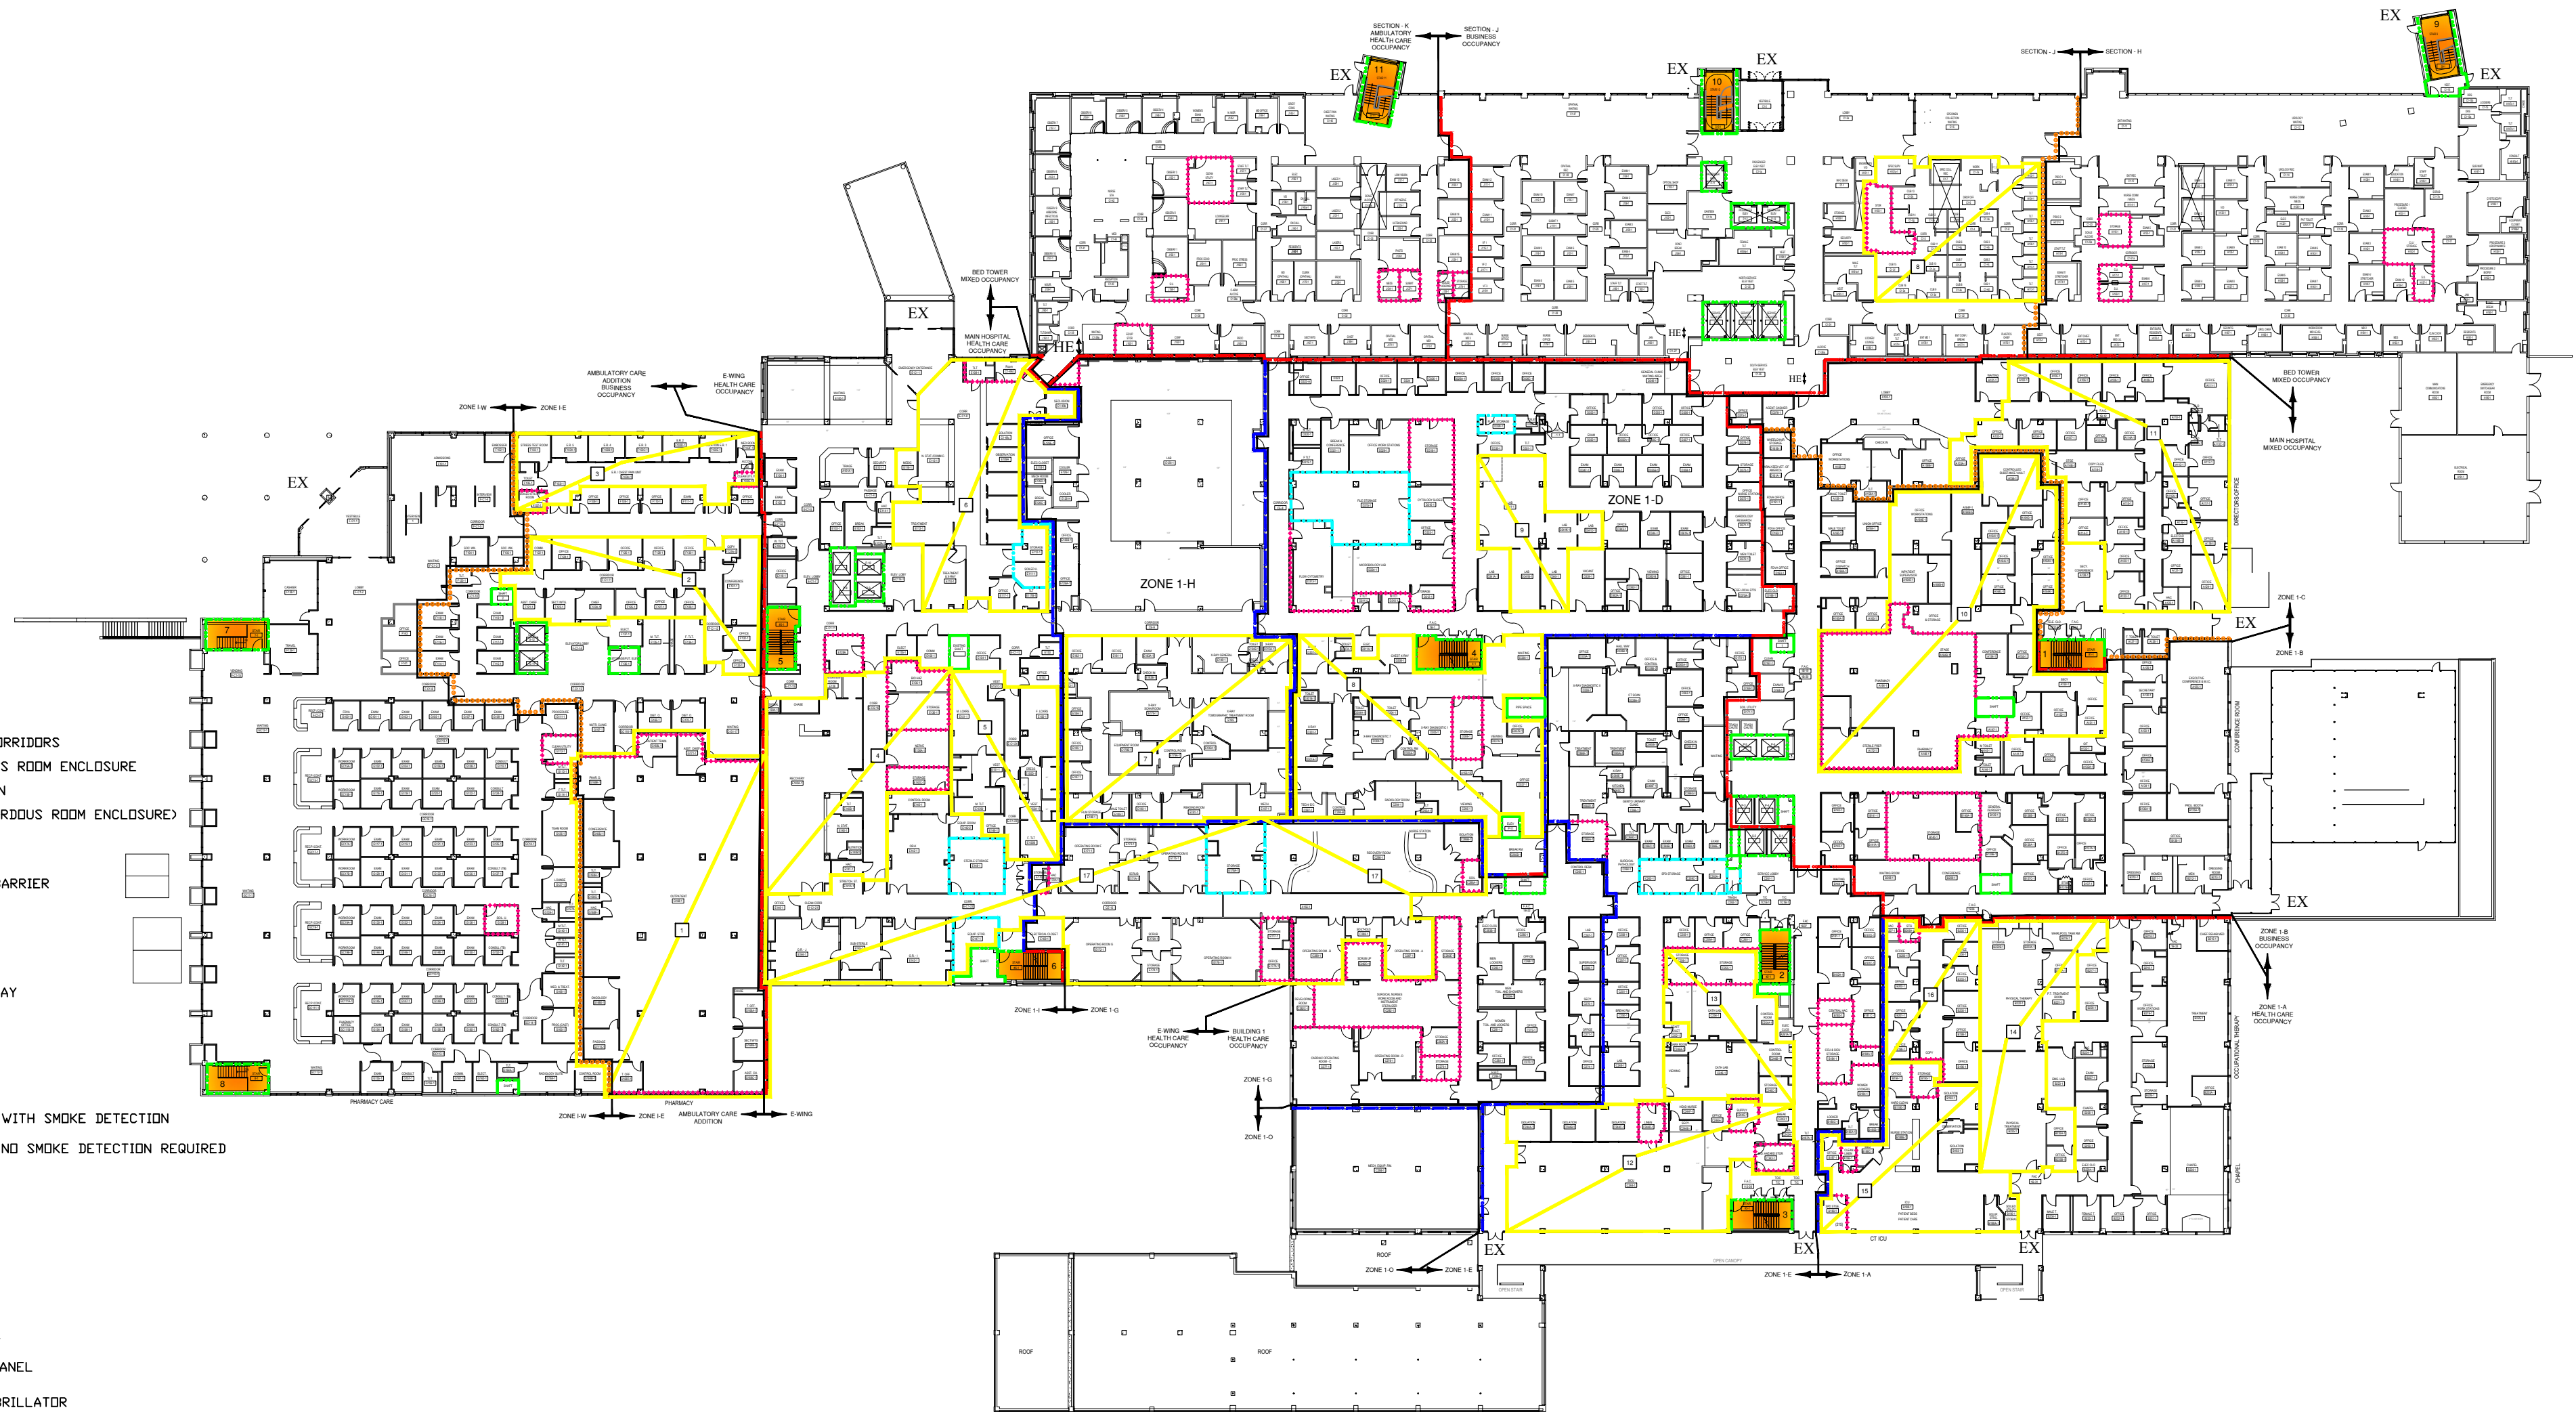

FIRST FLOOR
COMPOSITE
FULLY SPRINKLERED
MIXED OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name

Drawing Title:
**FIRST FLOOR
COMPOSITE**

Designed By
FVO
Location

Drawn By
KW/TK
VA MEDICAL CENTER
GAINESVILLE, FLORIDA

Checked By
FVO
Scale:

Date
12/28/2018

Drawing No.
LS-6
Sht. 8 of 35

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	PHARMACY SUITE	8008 Sq. Ft.	NON PATIENT CARE	3
2	ADMINISTRATIVE SUITE	2687 Sq. Ft.	NON PATIENT CARE	2
3	GERIATRIC CLINIC SUITE	1731 Sq. Ft.	NON SLEEPING PATIENT CARE	2

KEY NOTES:


- A FIRE SPRINKLERS INSTALLED PER FLOOR MOUNTED OBSTRUCTION SPACING REQUIREMENTS OF TABLE 8.6.5.2.2 IN NFPA 13-2016 EDITION.

PARTITION LEGEND


- HEALTH CARE OCCUPANCY CORRIDORS
SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
NON-RATED SMOKE PARTITION
1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
SMOKE ZONE BARRIER
2 HOUR FIRE BARRIER
2 HOUR FIRE/SMOKE ZONE BARRIER
SUITE DESIGNATION

SYMBOLS LIST


- HORIZONTAL EXIT PASSAGEWAY
EXIT
EXIT PASSAGEWAY
LINEN CHUTE
TRASH CHUTE
AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
FIRE EXTINGUISHER
EXIT SIGN
EMERGENCY LIGHT
FIRE ALARM STATION
FIRE ALARM CONTROL PANEL
FIRE ALARM ANNUNCIATOR PANEL
AUTOMATED EXTERNAL DEFIBRILLATOR
EVACUATION CHAIR
FIRE HOSE VALVE
SPRINKLER SYSTEM RISER
SHOWER STATION
EYEWASH STATION

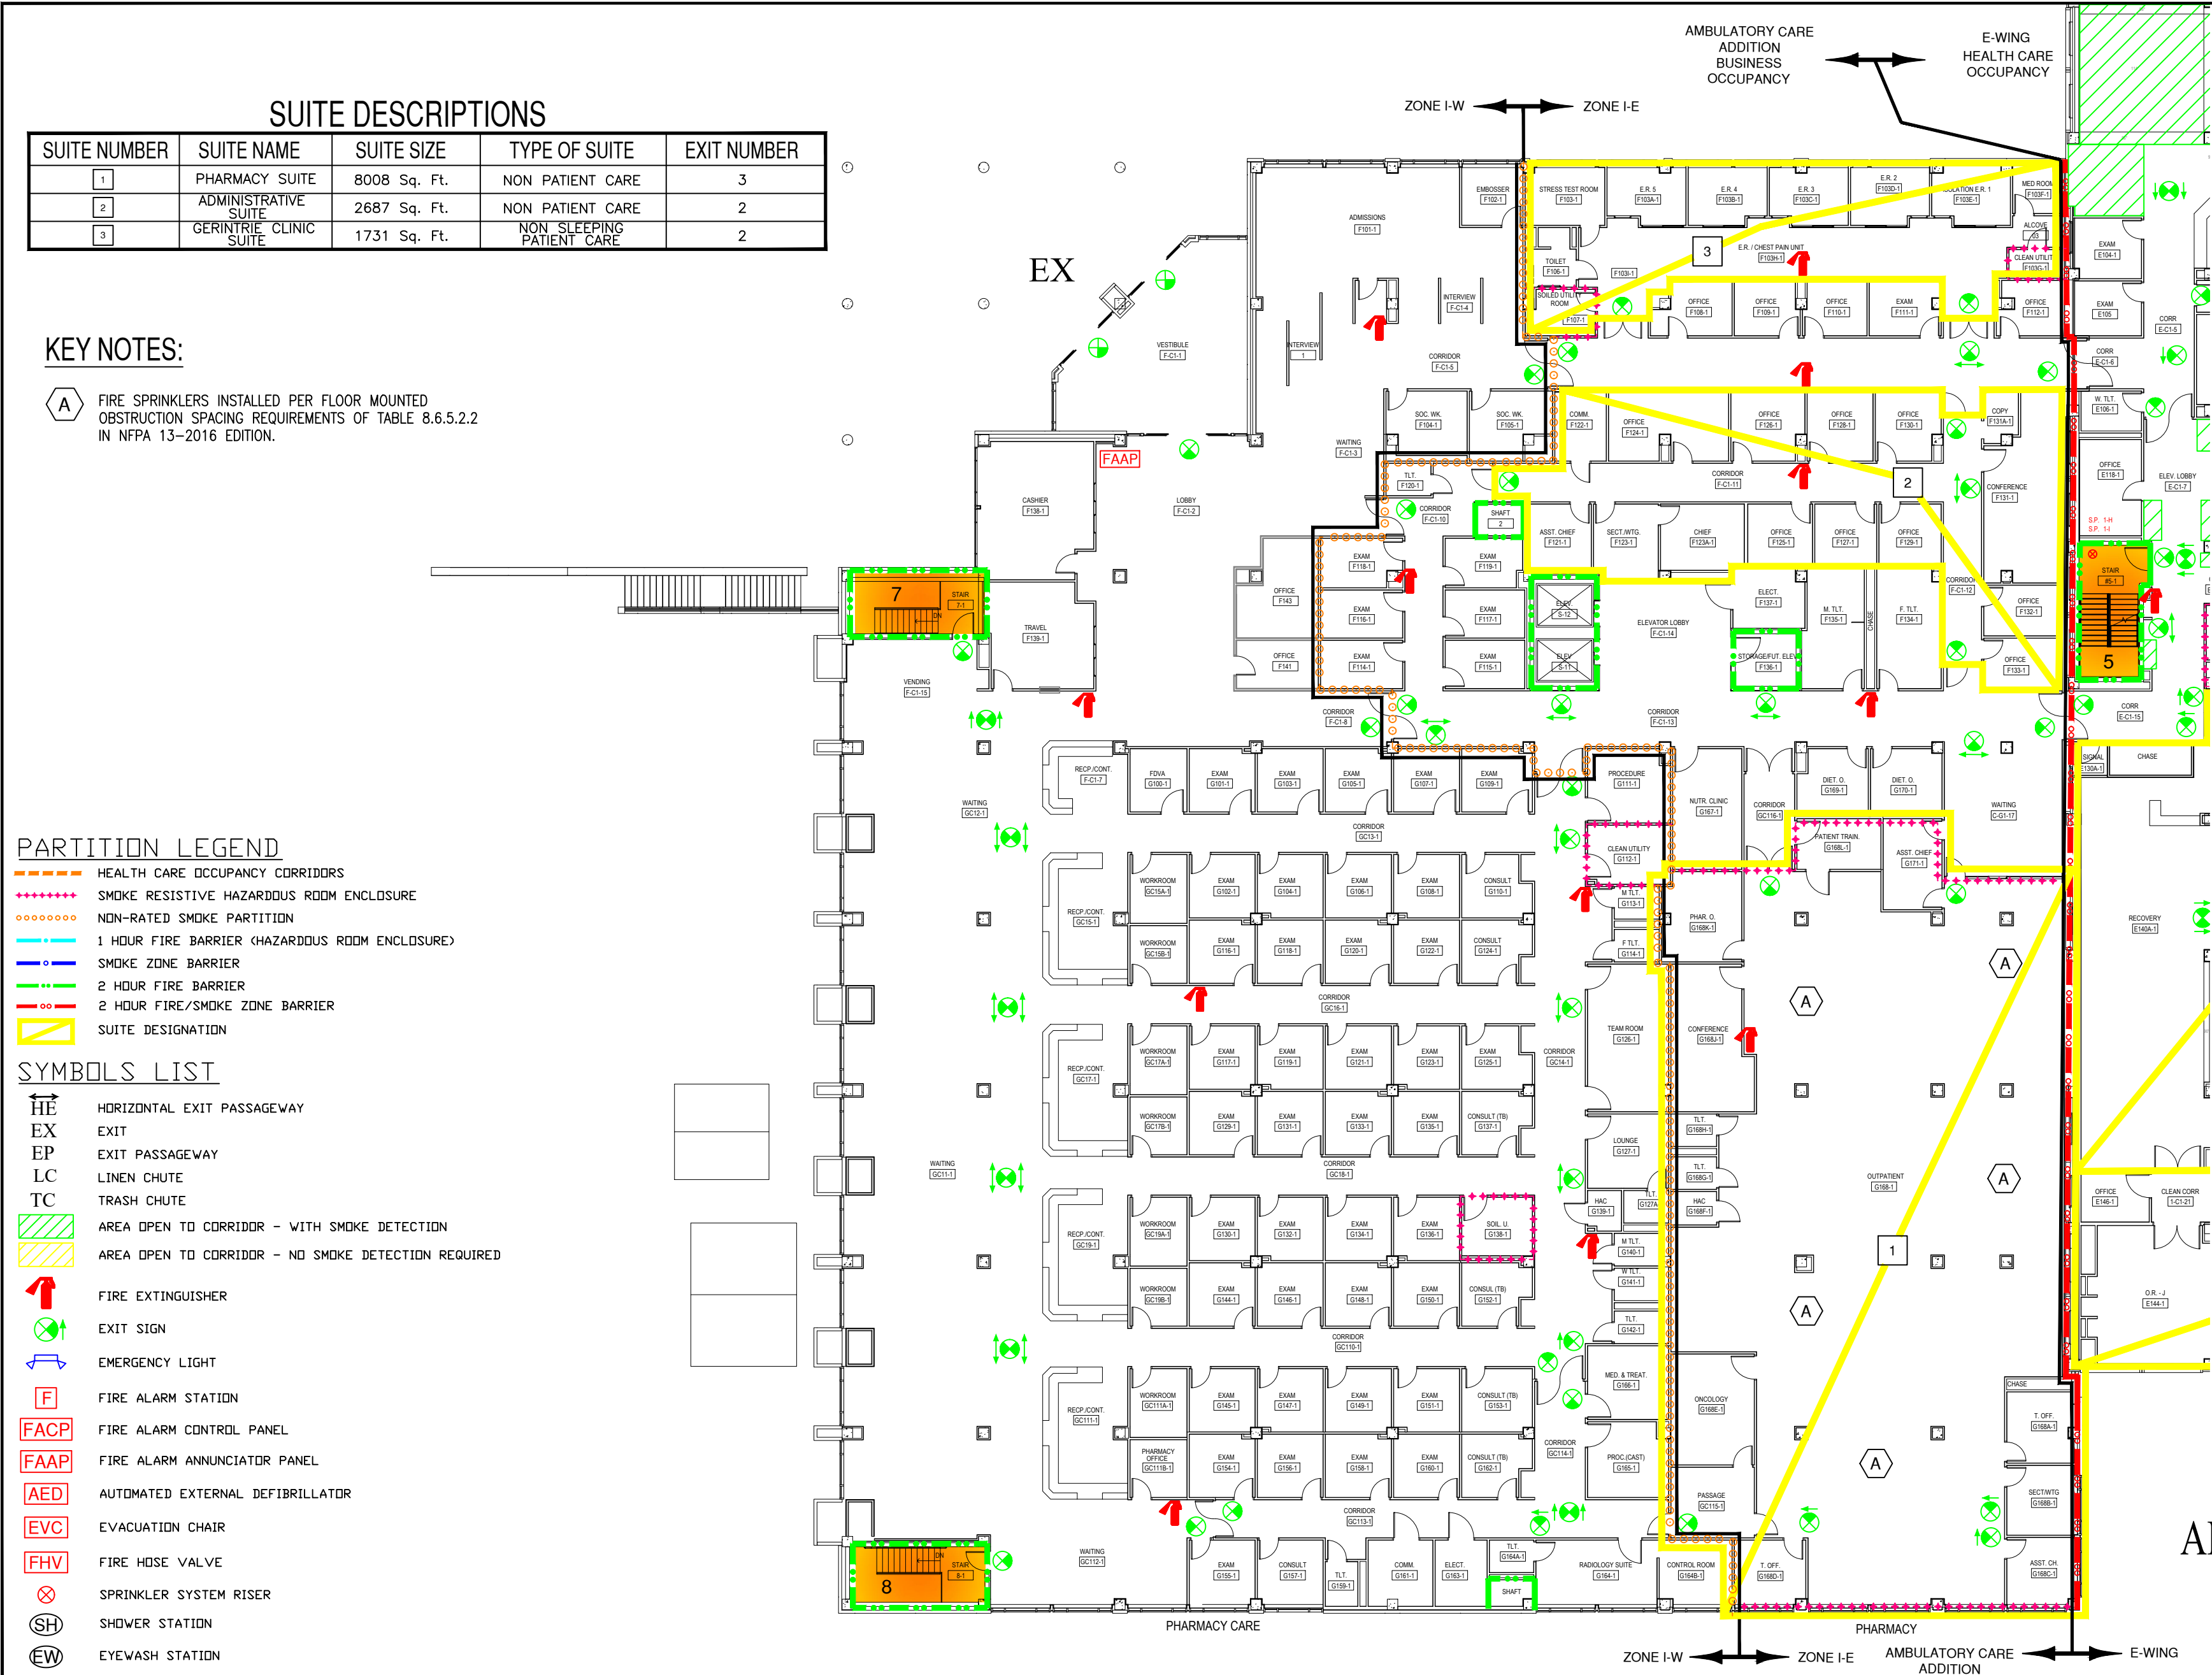

FIRST FLOOR
AMBULATORY CARE ADDITION
FULLY SPRINKLERED
BUSINESS OCCUPANCY



Revisions	Date:
FP&C Project Number: 3032.02	



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS03-1

Drawing Title: **FIRST FLOOR
AMBULATORY CARE
ADDITION**

Designed By
Location
FVO

Drawn By
VA MEDICAL CENTER
GAINESVILLE, FLORIDA
KW/TK

Checked By
FVO

Date
12/28/2018
Scale:

Drawing No.
LS-7
Sht. 9 of 35

SUITE DESCRIPTIONS


SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
4	RECOVERY SUITE	3,995 Sq. Ft.	NON SLEEPING PATIENT CARE	2
5	OR LOCKER SUITE	2,116 Sq. Ft.	NON PATIENT CARE	2
6	ED SUITE	3,663 Sq. Ft.	NON SLEEPING PATIENT CARE	2
7	WEST RADIOLOGY SUITE	4,971 Sq. Ft.	NON SLEEPING PATIENT CARE	2

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

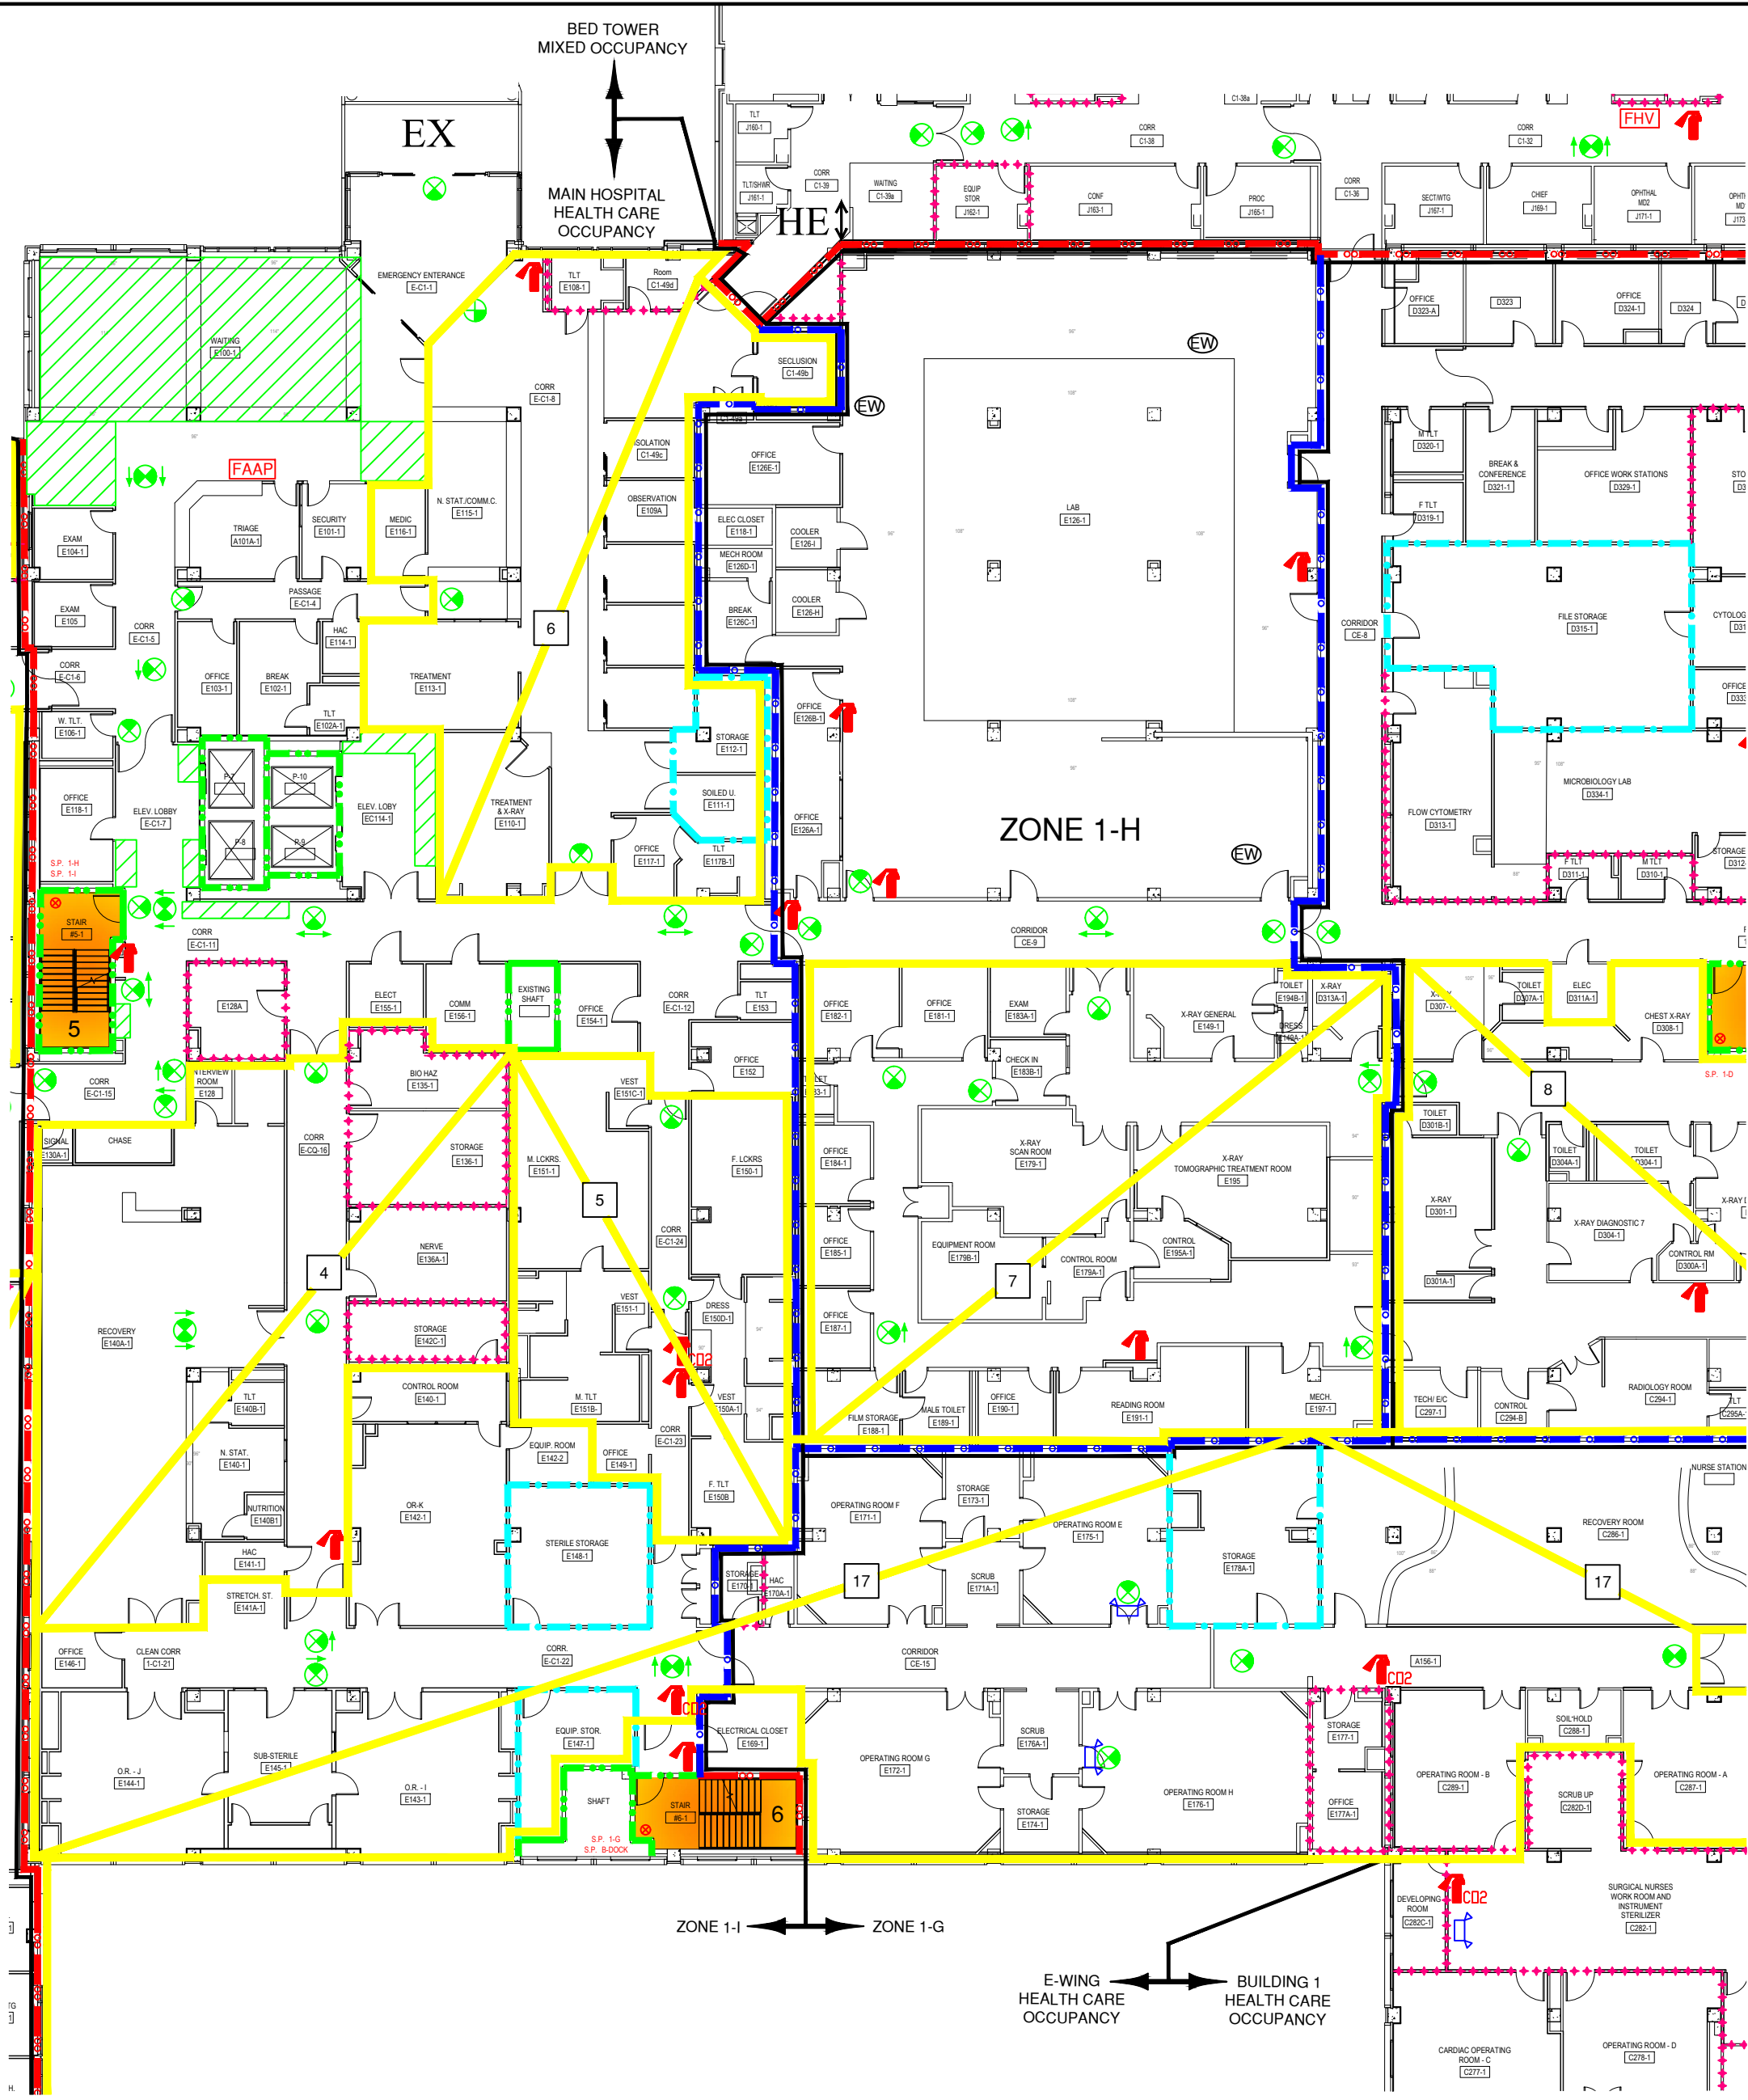

FIRST FLOOR
E-WING
FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	

Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title: FIRE AND LIFE
SAFETY SURVEY

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS03-1

Drawing Title: FIRST FLOOR
E-WING

Designed By
FVO

Drawn By
KW/TK

Checked By
FVO

Date
12/28/2018

Drawing No.
LS-8
Sht. 10 Of 35

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
8	X-RAY SUITE	5,032 Sq. Ft.	NON SLEEPING PATIENT CARE	2
9	GROSSING LAB SUITE	1,451 Sq. Ft.	NON SLEEPING PATIENT CARE	1
10	PHARMACY SUITE	6,928 Sq. Ft.	NON PATIENT CARE	2
11	DIRECTORS OFFICE SUITE	5,589 Sq. Ft.	NON PATIENT CARE	2
12	SICU SUITE	3,937 Sq. Ft.	PATIENT SLEEPING CARE	2
13	CATH LAB SUITE	1,969 Sq. Ft.	NON SLEEPING PATIENT CARE	2
14	PHYSICAL THERAPY SUITE	2,702 Sq. Ft.	NON SLEEPING PATIENT CARE	2
15	ICU SUITE	2,732 Sq. Ft.	PATIENT SLEEPING CARE	2
16	SUPPLY OFFICE SUITE	1,685 Sq. Ft.	NON SLEEPING PATIENT CARE	1
17	SURGERY SUITE	11,740 Sq. Ft.	NON SLEEPING PATIENT CARE	3

KEY NOTES:



- (A) ELECTRICAL TRANSFORMER OVER 112.5 KVA WITH CLASS 155 OR HIGHER INSULATION SYSTEM. 1 HOUR FIRE RESISTIVE ENCLOSURE NOT REQUIRED PER EXCEPTION 1 OF ARTICLE 450.21(B) OF NFPA 70-2011 EDITION.
- (B) CLASS C INTERIOR FINISH.

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HE HORIZONTAL EXIT PASSAGEWAY
- EX EXIT
- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- F FIRE ALARM STATION
- FACP FIRE ALARM CONTROL PANEL
- FAAP FIRE ALARM ANNUNCIATOR PANEL
- AED AUTOMATED EXTERNAL DEFIBRILLATOR
- EVC EVACUATION CHAIR
- FHV FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SH SHOWER STATION
- EW EYEWASH STATION

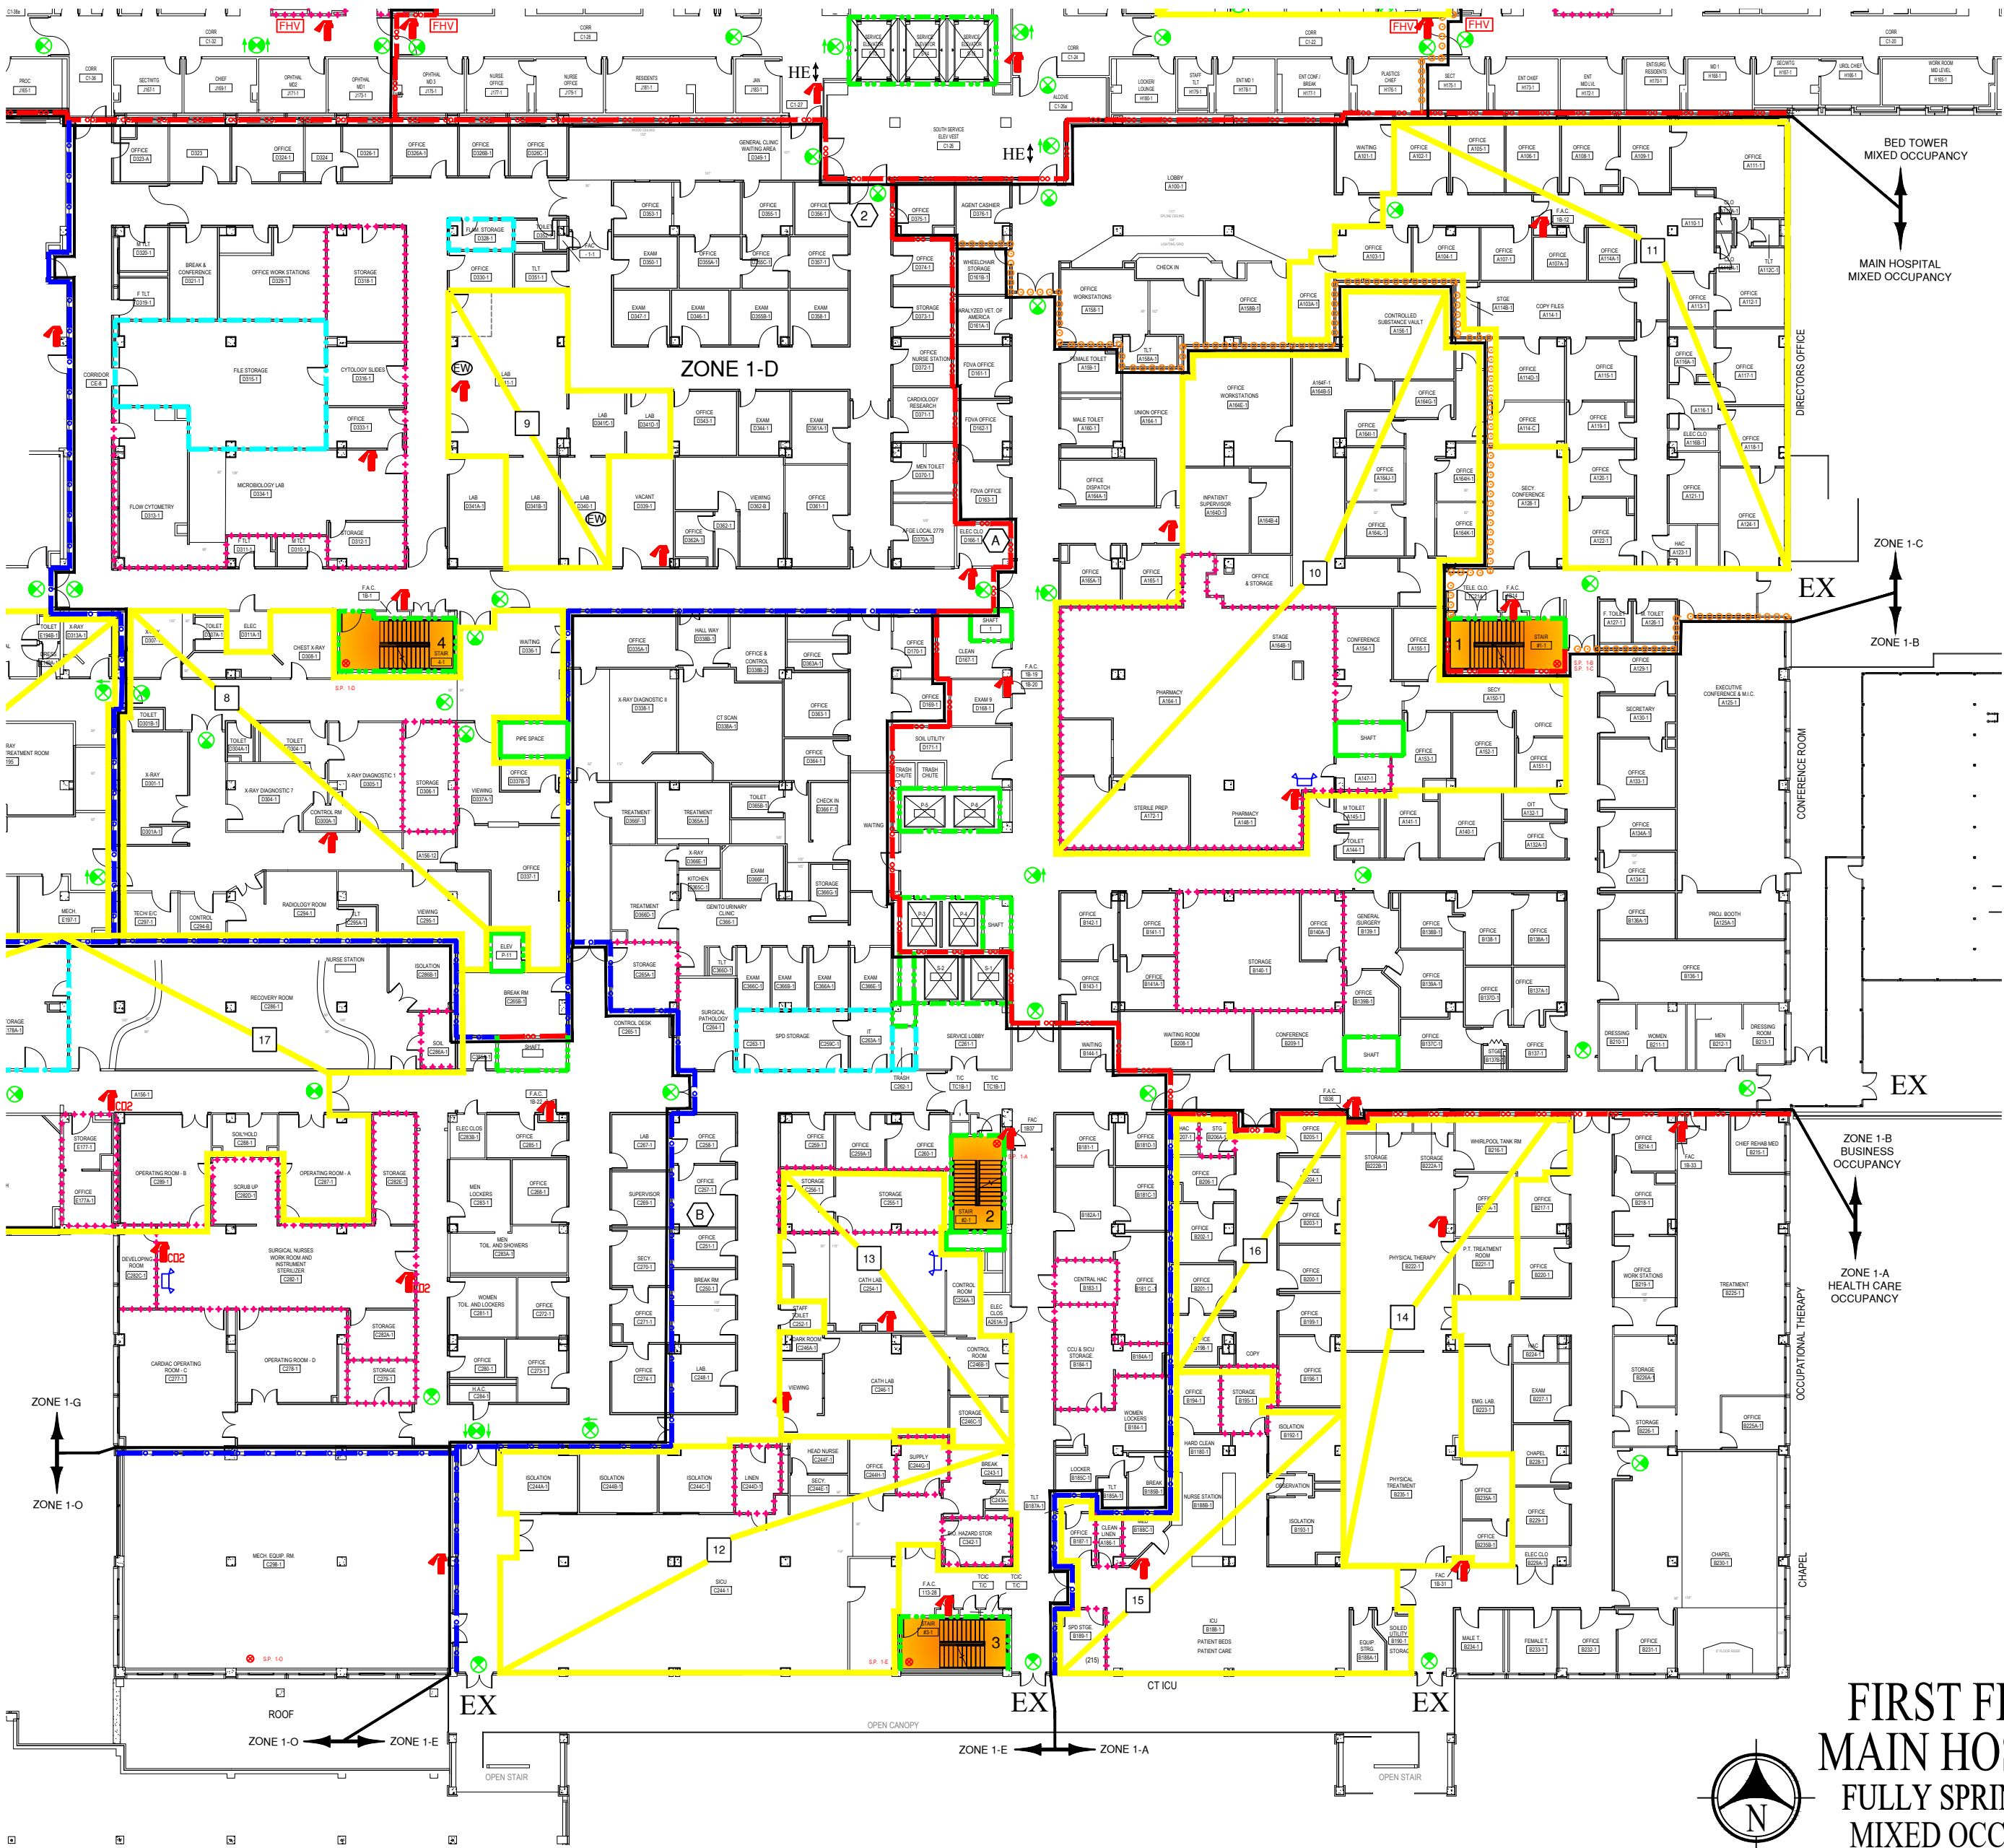

FIRST FLOOR
MAIN HOSPITAL
FULLY SPRINKLERED
MIXED OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	

Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title: FIRE AND LIFE
SAFETY SURVEY

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS03-1

Drawing Title:
FIRST FLOOR
MAIN HOSPITAL

Designed By
FVO

Drawn By
KW/TK

Checked By
FVO


Date
12/28/2018

Drawing No.
LS-9
Sht. 11 of 35

1 SHAFT ABOVE.


2 FRAME LABEL BLOCKED BY SECURE DOOR.

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
8	LAB SUITE	2887 Sq. Ft.	NON SLEEPING PATIENT CARE	2

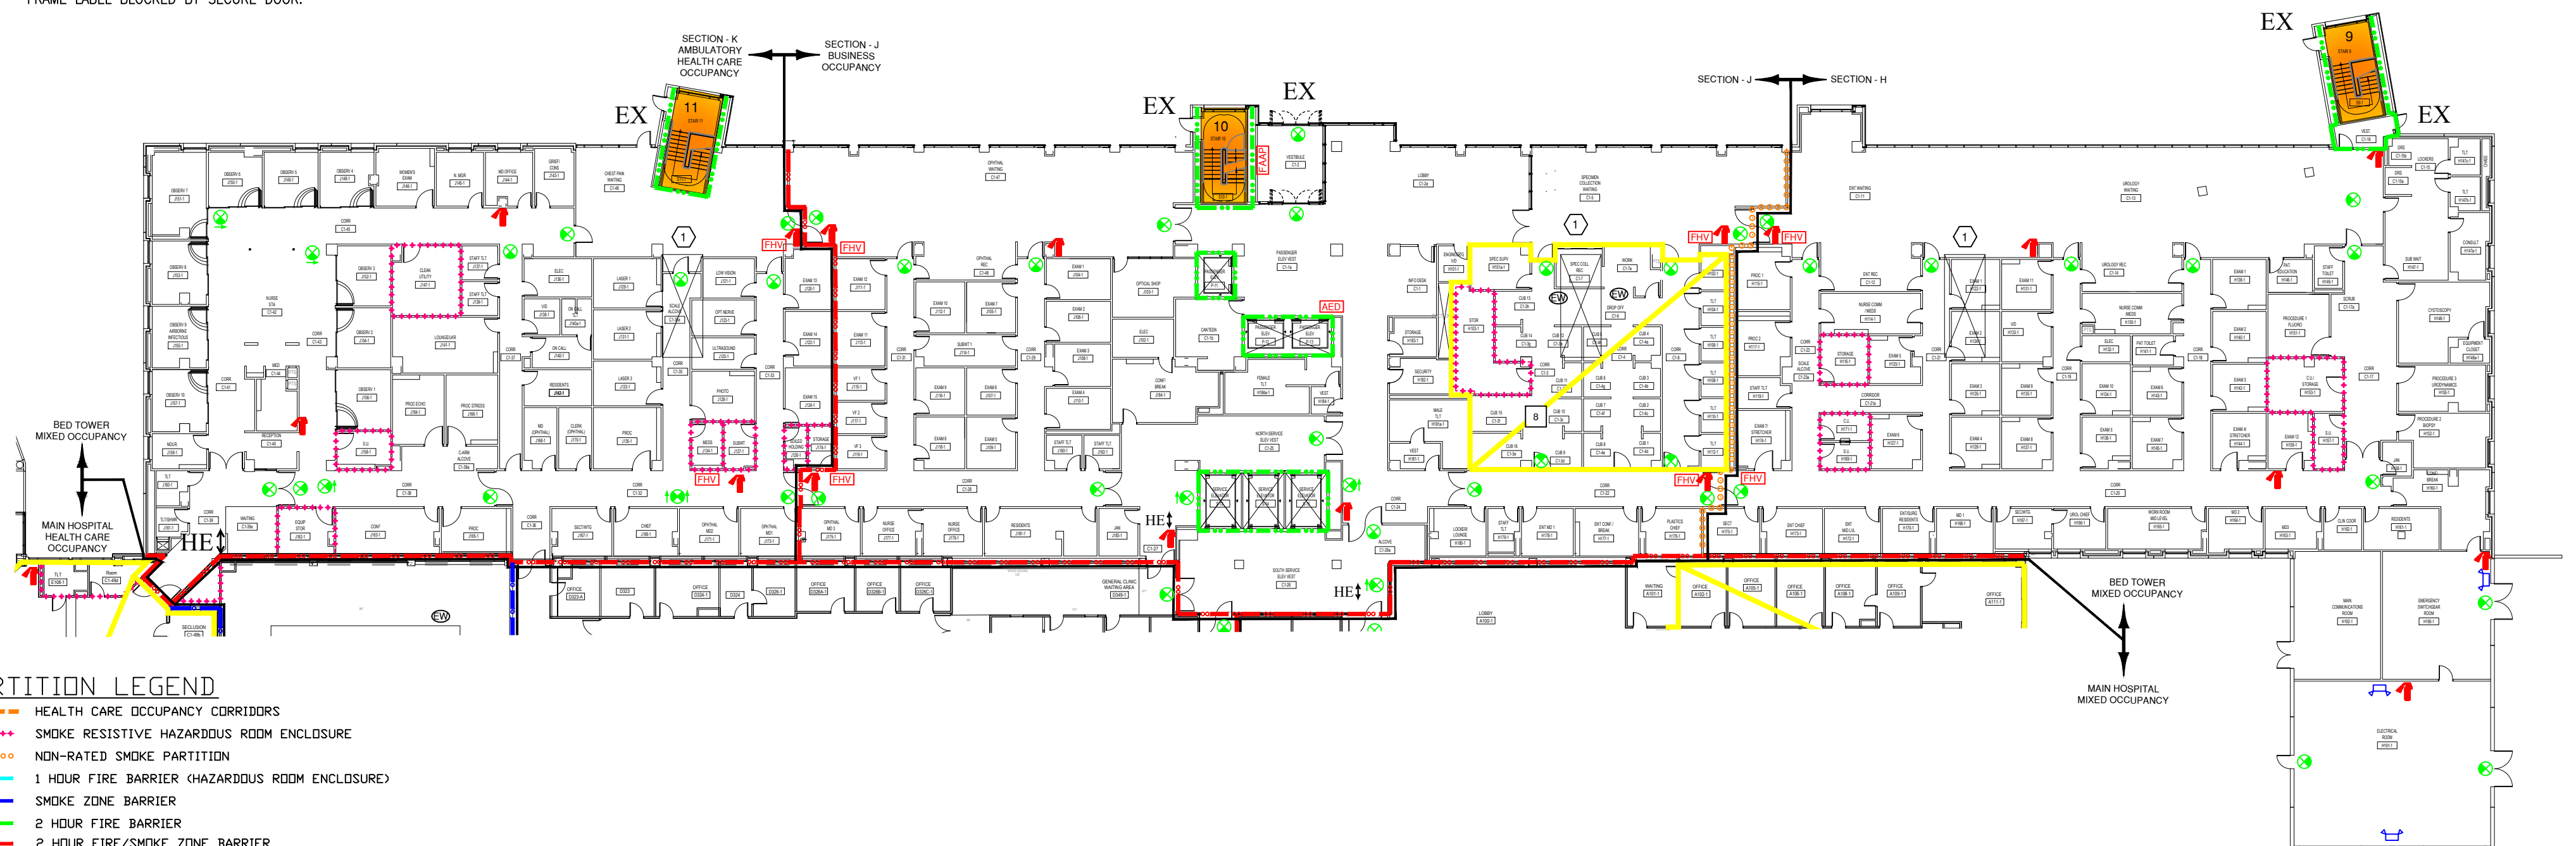

	HEALTH CARE OCCUPANCY CORRIDORS
	SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
	NON-RATED SMOKE PARTITION
	1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
	SMOKE ZONE BARRIER
	2 HOUR FIRE BARRIER
	2 HOUR FIRE/SMOKE ZONE BARRIER
	SUITE DESIGNATION

HE	HORIZONTAL EXIT PASSAGEWAY
EX	EXIT
EP	EXIT PASSAGEWAY
LC	LINEN CHUTE
TC	TRASH CHUTE
	AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
	AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
	FIRE EXTINGUISHER
	EXIT SIGN
	EMERGENCY LIGHT
	FIRE ALARM SYSTEM
	FIRE ALARM CONTROL PANEL
	FIRE ALARM ANNUNCIATOR PANEL
	AUTOMATED EXTERNAL DEFIBRILLATOR
	ELEVATOR VACUATION CHAIR
	FIRE HOSE VALVE
	SPRINKLER SYSTEM RISER
	SHOWER STATION
	EYEWASH STATION



FIRST FLOOR
BED TOWER
FULLY SPRINKLERED
MIXED OCCUPANCY

Revisions	Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title:	Client Project No.	Contract No.	Drawing Title:	Designed By	Drawn By	Checked By	Date	Drawing No.
FP&C Project Number: 3032.02				FIRE AND LIFE SAFETY SURVEY	Building No. 01	AutoCAD File Name LS03-1	FIRST FLOOR BED TOWER	FVO	KW/TK	FVO	12/28/2018	LS-10
								Location	VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:	Sht. 12 Of 35	

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	DENTAL CLINIC SUITE	6858 Sq. Ft.	NON SLEEPING PATIENT CARE	2
2	MENTAL HEALTH CLINIC SUITE	2943 Sq. Ft.	NON SLEEPING PATIENT CARE	2
3	EEG SUITE	1042 Sq. Ft.	NON SLEEPING PATIENT CARE	1
4	NEUROLOGY SUITE	1401 Sq. Ft.	NON PATIENT CARE	1
5	PSYCHIATRY OFFICE SUITE	1657 Sq. Ft.	NON SLEEPING PATIENT CARE	2

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION



SECOND FLOOR
E-WING
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions		Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No.	Contract No.	Drawing Title: SECOND FLOOR E-WING	Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-12 Sht. 14 Of 35
FP&C Project Number: 3032.02						Building No. 01	AutoCAD File Name LS04-2		Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	BREAST IMAGING SUITE	1,220 Sq. Ft.	NON SLEEPING PATIENT CARE	1
2	WOMEN'S PRIMARY CARE AND GYN	3,279 Sq. Ft.	NON SLEEPING PATIENT CARE	2
3	SOCIAL WORK OFFICE SUITE	1,012 Sq. Ft.	NON SLEEPING PATIENT CARE	2



- | | |
|-------|--|
| ===== | HEALTH CARE OCCUPANCY CORRIDORS |
| +++++ | SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE |
| ooooo | NON-RATED SMOKE PARTITION |
| ----- | 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE) |
| ----- | SMOKE ZONE BARRIER |
| ----- | 2 HOUR FIRE BARRIER |
| ----- | 2 HOUR FIRE/SMOKE ZONE BARRIER |
| ===== | SUITE DESIGNATION |

HE	HORIZONTAL EXIT PASSAGEWAY
EX	EXIT
EP	EXIT PASSAGEWAY
LC	LINEN CHUTE
TC	TRASH CHUTE
	AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
	AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
	FIRE EXTINGUISHER
	EXIT SIGN
	EMERGENCY LIGHT
	FIRE ALARM STATION
	FIRE ALARM CONTROL PANEL
	FIRE ALARM ANNUNCIATOR PANEL
	AUTOMATED EXTERNAL DEFIBRILLATOR
	EVACUATION CHAIR
	FIRE HOSE VALVE
	SPRINKLER SYSTEM RISER
	SHOWER STATION
	EYEWASH STATION

KEY NOTES:

- 1

SEE EQUIVALENCY FOR USE OVERSIZED PROTECTIVE PLATE.
- 2

MINIMUM OF 8' WIDE CORRIDOR PROVIDED AROUND EXISTING DRINKING FOUNTAIN PROJECTION.




PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION



SECOND FLOOR
BED TOWER
FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

Revisions	Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No.	Contract No.	Drawing Title: SECOND FLOOR BED TOWER	Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-14
FP&C Project Number: 3032.02					Building No. 01	AutoCAD File Name LS04-2		Location	VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:		Sht. 16 Of 35



Revisions	Date:
FP&C Project Number: 3032.02	

 Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197

 FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title: FIRE AND LIFE
SAFETY SURVEY

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS05-3

Drawing Title: THIRD FLOOR
COMPOSITE

Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-15
Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			Sht. 17 of 35

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	EKG/ECHO SUITE	2,610 Sq. Ft.	NON-SLEEPING PATIENT CARE	2

KEY NOTES:


- A** MAXIMUM 49 OCCUPANTS
- B** ELECTRICAL TRANSFORMER OVER 112.5 KVA WITH CLASS 155 OR HIGHER INSULATION SYSTEM. 1 HOUR FIRE RESISTIVE ENCLOSURE NOT REQUIRED PER EXCEPTION 1 OF ARTICLE 450.21(B) OF NFPA 70-2011 EDITION.

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST


- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

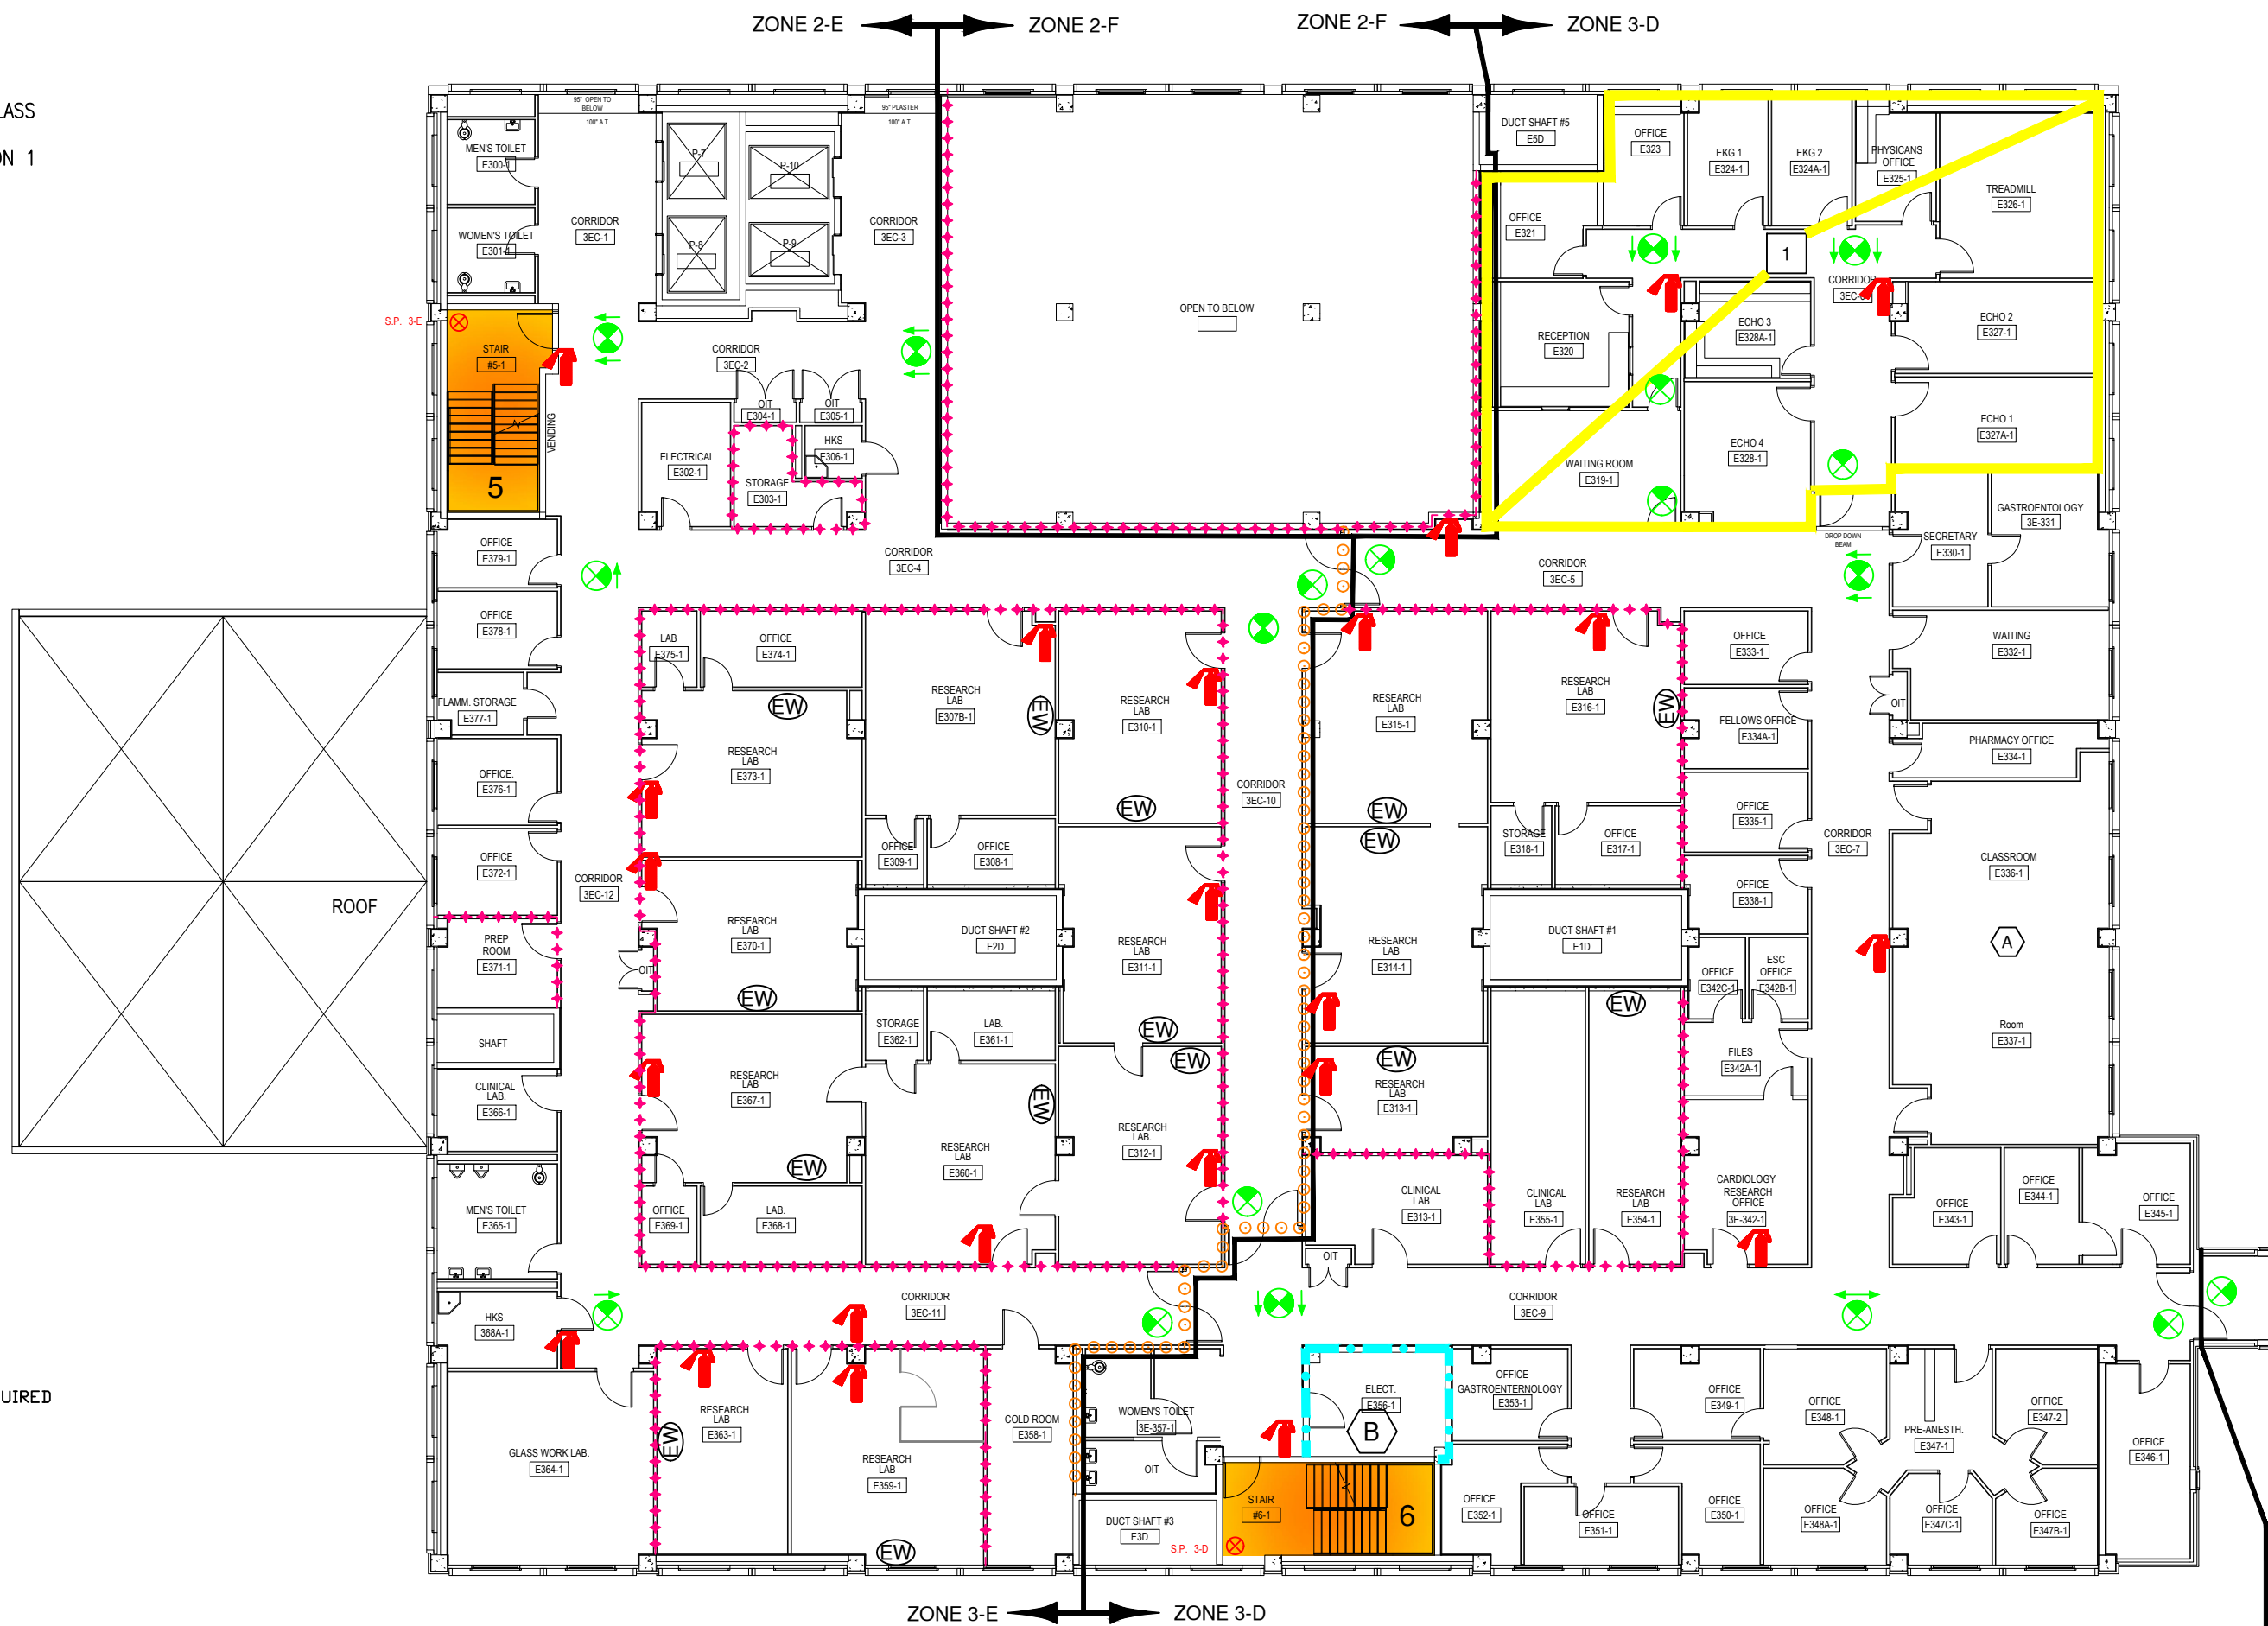

E-WING
BUSINESS
OCCUPANCY

THIRD FLOOR
E-WING
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS05-3

Drawing Title:
**THIRD FLOOR
E-WING**

Designed By
FVO
Location
VA MEDICAL CENTER
GAINESVILLE, FLORIDA

Drawn By
KW/TK

Checked By
FVO

Date
12/28/2018
Scale:

Drawing No.
LS-16
Sht. 18 of 35

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	MICU SUITE	7,475 Sq. Ft.	PATIENT CARE SLEEPING	2
2	G.I. SUITE	5,070 Sq. Ft.	NON SLEEPING PATIENT CARE	3
3	MEDICAL SERVICE SUITE	3,120 Sq. Ft.	NON PATIENT CARE	2

KEY NOTES:



- A TRASH AND LINEN CHUTES NOT IN SERVICE.
- B ELECTRICAL TRANSFORMER OVER 112.5 KVA WITH CLASS 155 OR HIGHER INSULATION SYSTEM. 1 HOUR FIRE RESISTIVE ENCLOSURE NOT REQUIRED PER EXCEPTION 1 OF ARTICLE 450.21(B) OF NFPA 70-2017 EDITION.

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

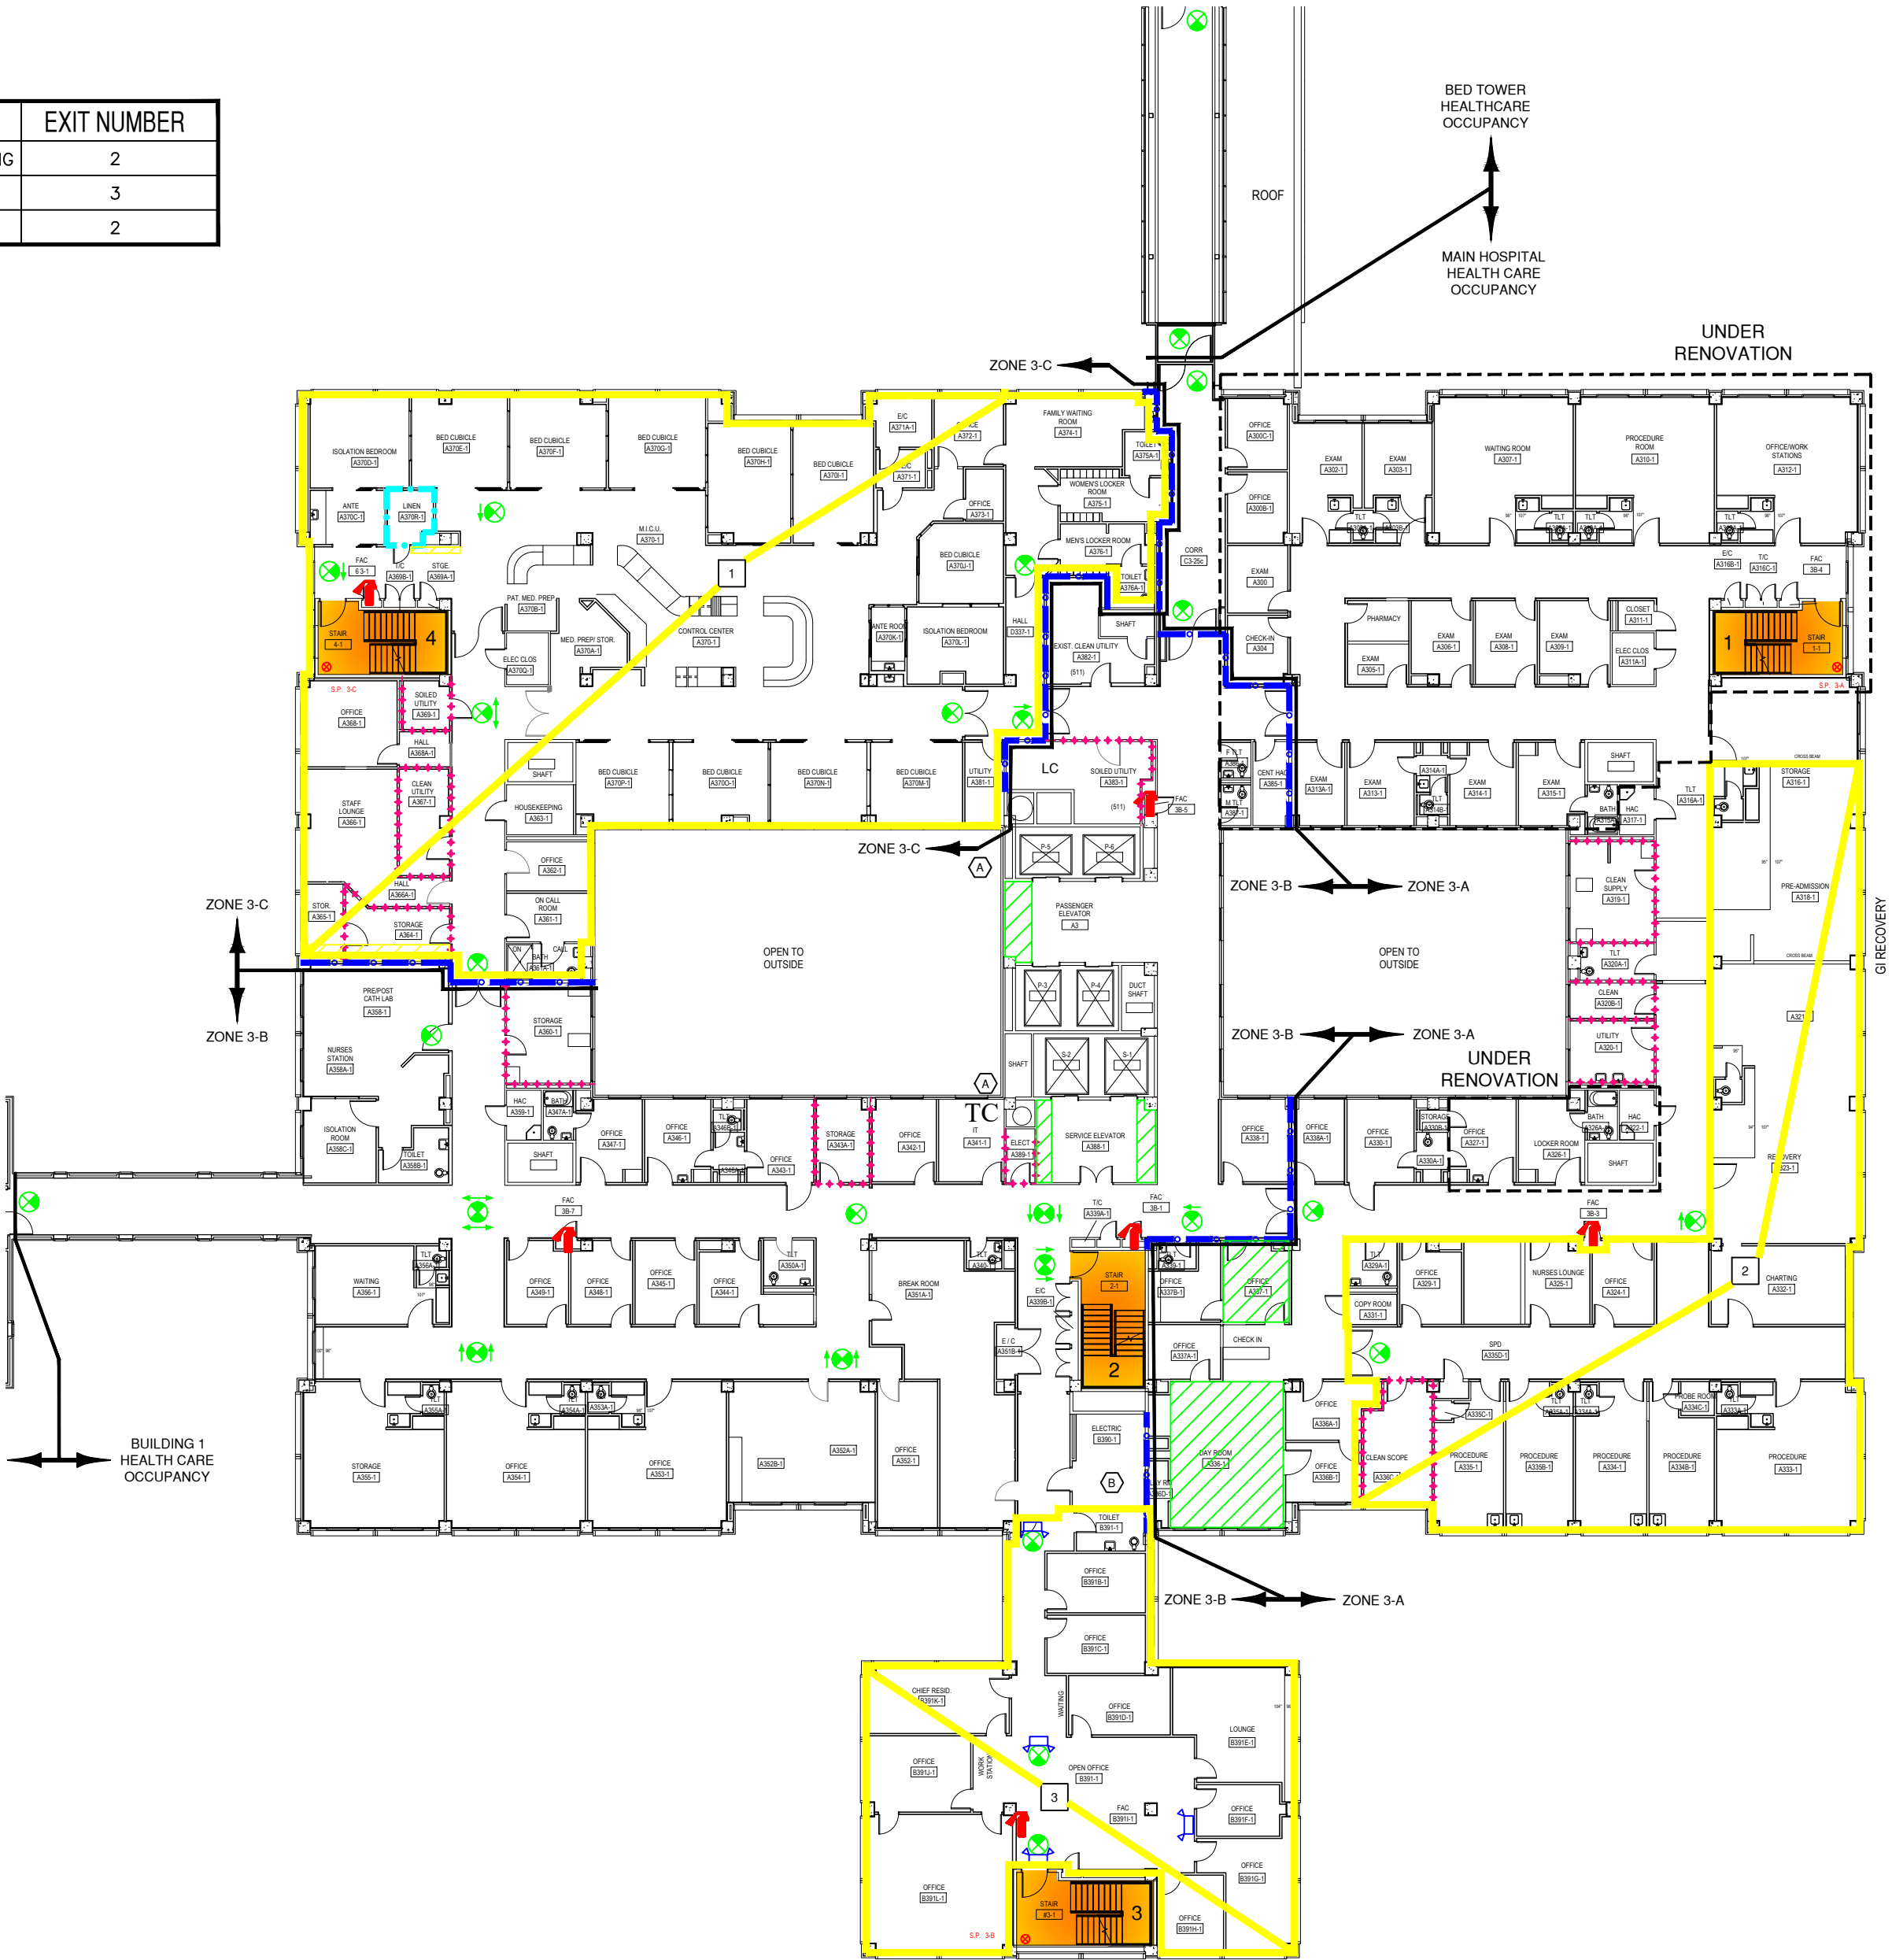

THIRD FLOOR
MAIN HOSPITAL
FULLY SPRINKLERED
HEALTHCARE OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	

Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title: FIRE AND LIFE
SAFETY SURVEY

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS05-3

Drawing Title: THIRD FLOOR
MAIN HOSPITAL


Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-17
Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			Sht. 19 Of 35

KEY NOTES:

- 1

SEE EQUIVALENCY FOR USE OF OVERSIZED PROTECTIVE PLATE.
- 2

MINIMUM OF 8' WIDE CORRIDOR PROVIDED AROUND EXISTING DRINKING FOUNTAIN PROJECTION.

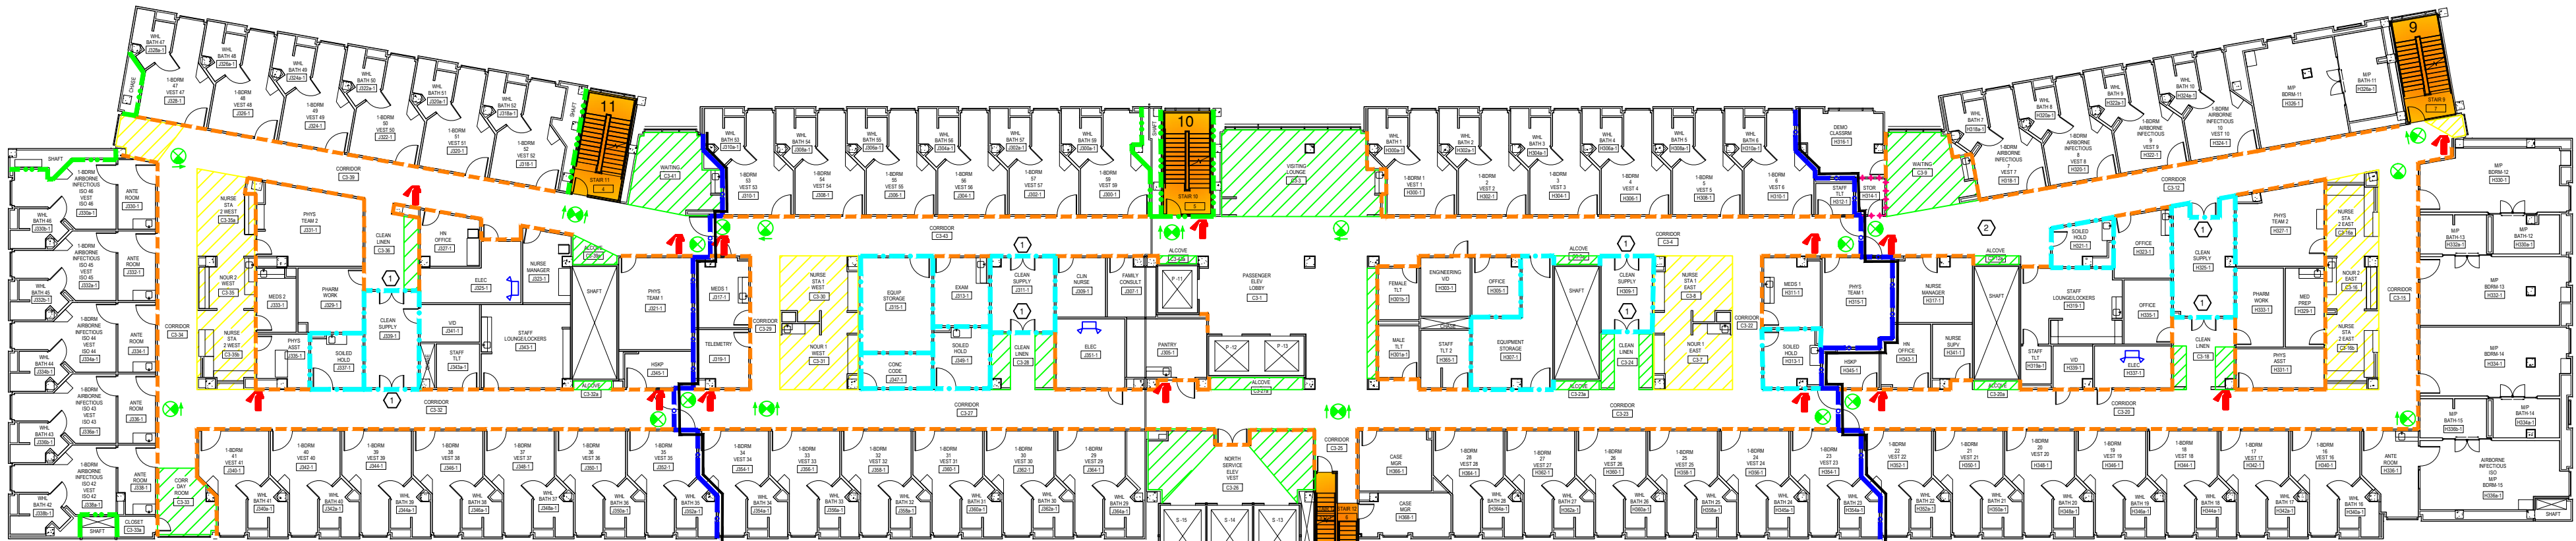

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HE

HORIZONTAL EXIT PASSAGEWAY
- EX

EXIT
- EP

EXIT PASSAGEWAY
- LC

LINEN CHUTE
- TC

TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- F

FIRE ALARM STATION
- FACP

FIRE ALARM CONTROL PANEL
- FAAP

FIRE ALARM ANNUNCIATOR PANEL
- AED

AUTOMATED EXTERNAL DEFIBRILLATOR
- EVC

EVACUATION CHAIR
- FHV

FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SH

SHOWER STATION
- EW

EYEWASH STATION

THIRD FLOOR
BED TOWER
FULLY SPRINKLERED
HEALTH CARE OCCUPANCY


Revisions	Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No. Building No. 01	Contract No. AutoCAD File Name LS05-3	Drawing Title: THIRD FLOOR BED TOWER	Designed By FVO Location	Drawn By KW/TK VA MEDICAL CENTER GAINESVILLE, FLORIDA	Checked By FVO	Date 12/28/2018 Scale:	Drawing No. LS-18 Sht. 20 Of 35
-----------	-------	---	---	--	---------------------------------------	---	--	--------------------------------	--	-------------------	------------------------------	--

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION



FOURTH FLOOR
COMPOSITE
FULLY SPRINKLERED
MIXED OCCUPANCY

Revisions	Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title:	FIRE AND LIFE SAFETY SURVEY	Client Project No.		Contract No.		Drawing Title:	FOURTH FLOOR COMPOSITE	Designed By	FVO	Drawn By	KW/TK	Checked By	FVO	Date	12/28/2018	Drawing No.	LS-19
FP&C Project Number: 3032.02								Building No.	01	AutoCAD File Name	LS06-4			Location	VA MEDICAL CENTER GAINESVILLE, FLORIDA		Scale:				Sht. 21 of 35

KEY NOTES:

A MAXIMUM 49 OCCUPANTS

SUITE DESCRIPTIONS


SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	MEDICAL MEDIA SUITE	1980 Sq. Ft.	NON PATIENT CARE	2
2	MEDICAL CLINIC SUITE	4110 Sq. Ft.	NON SLEEPING PATIENT CARE	2

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

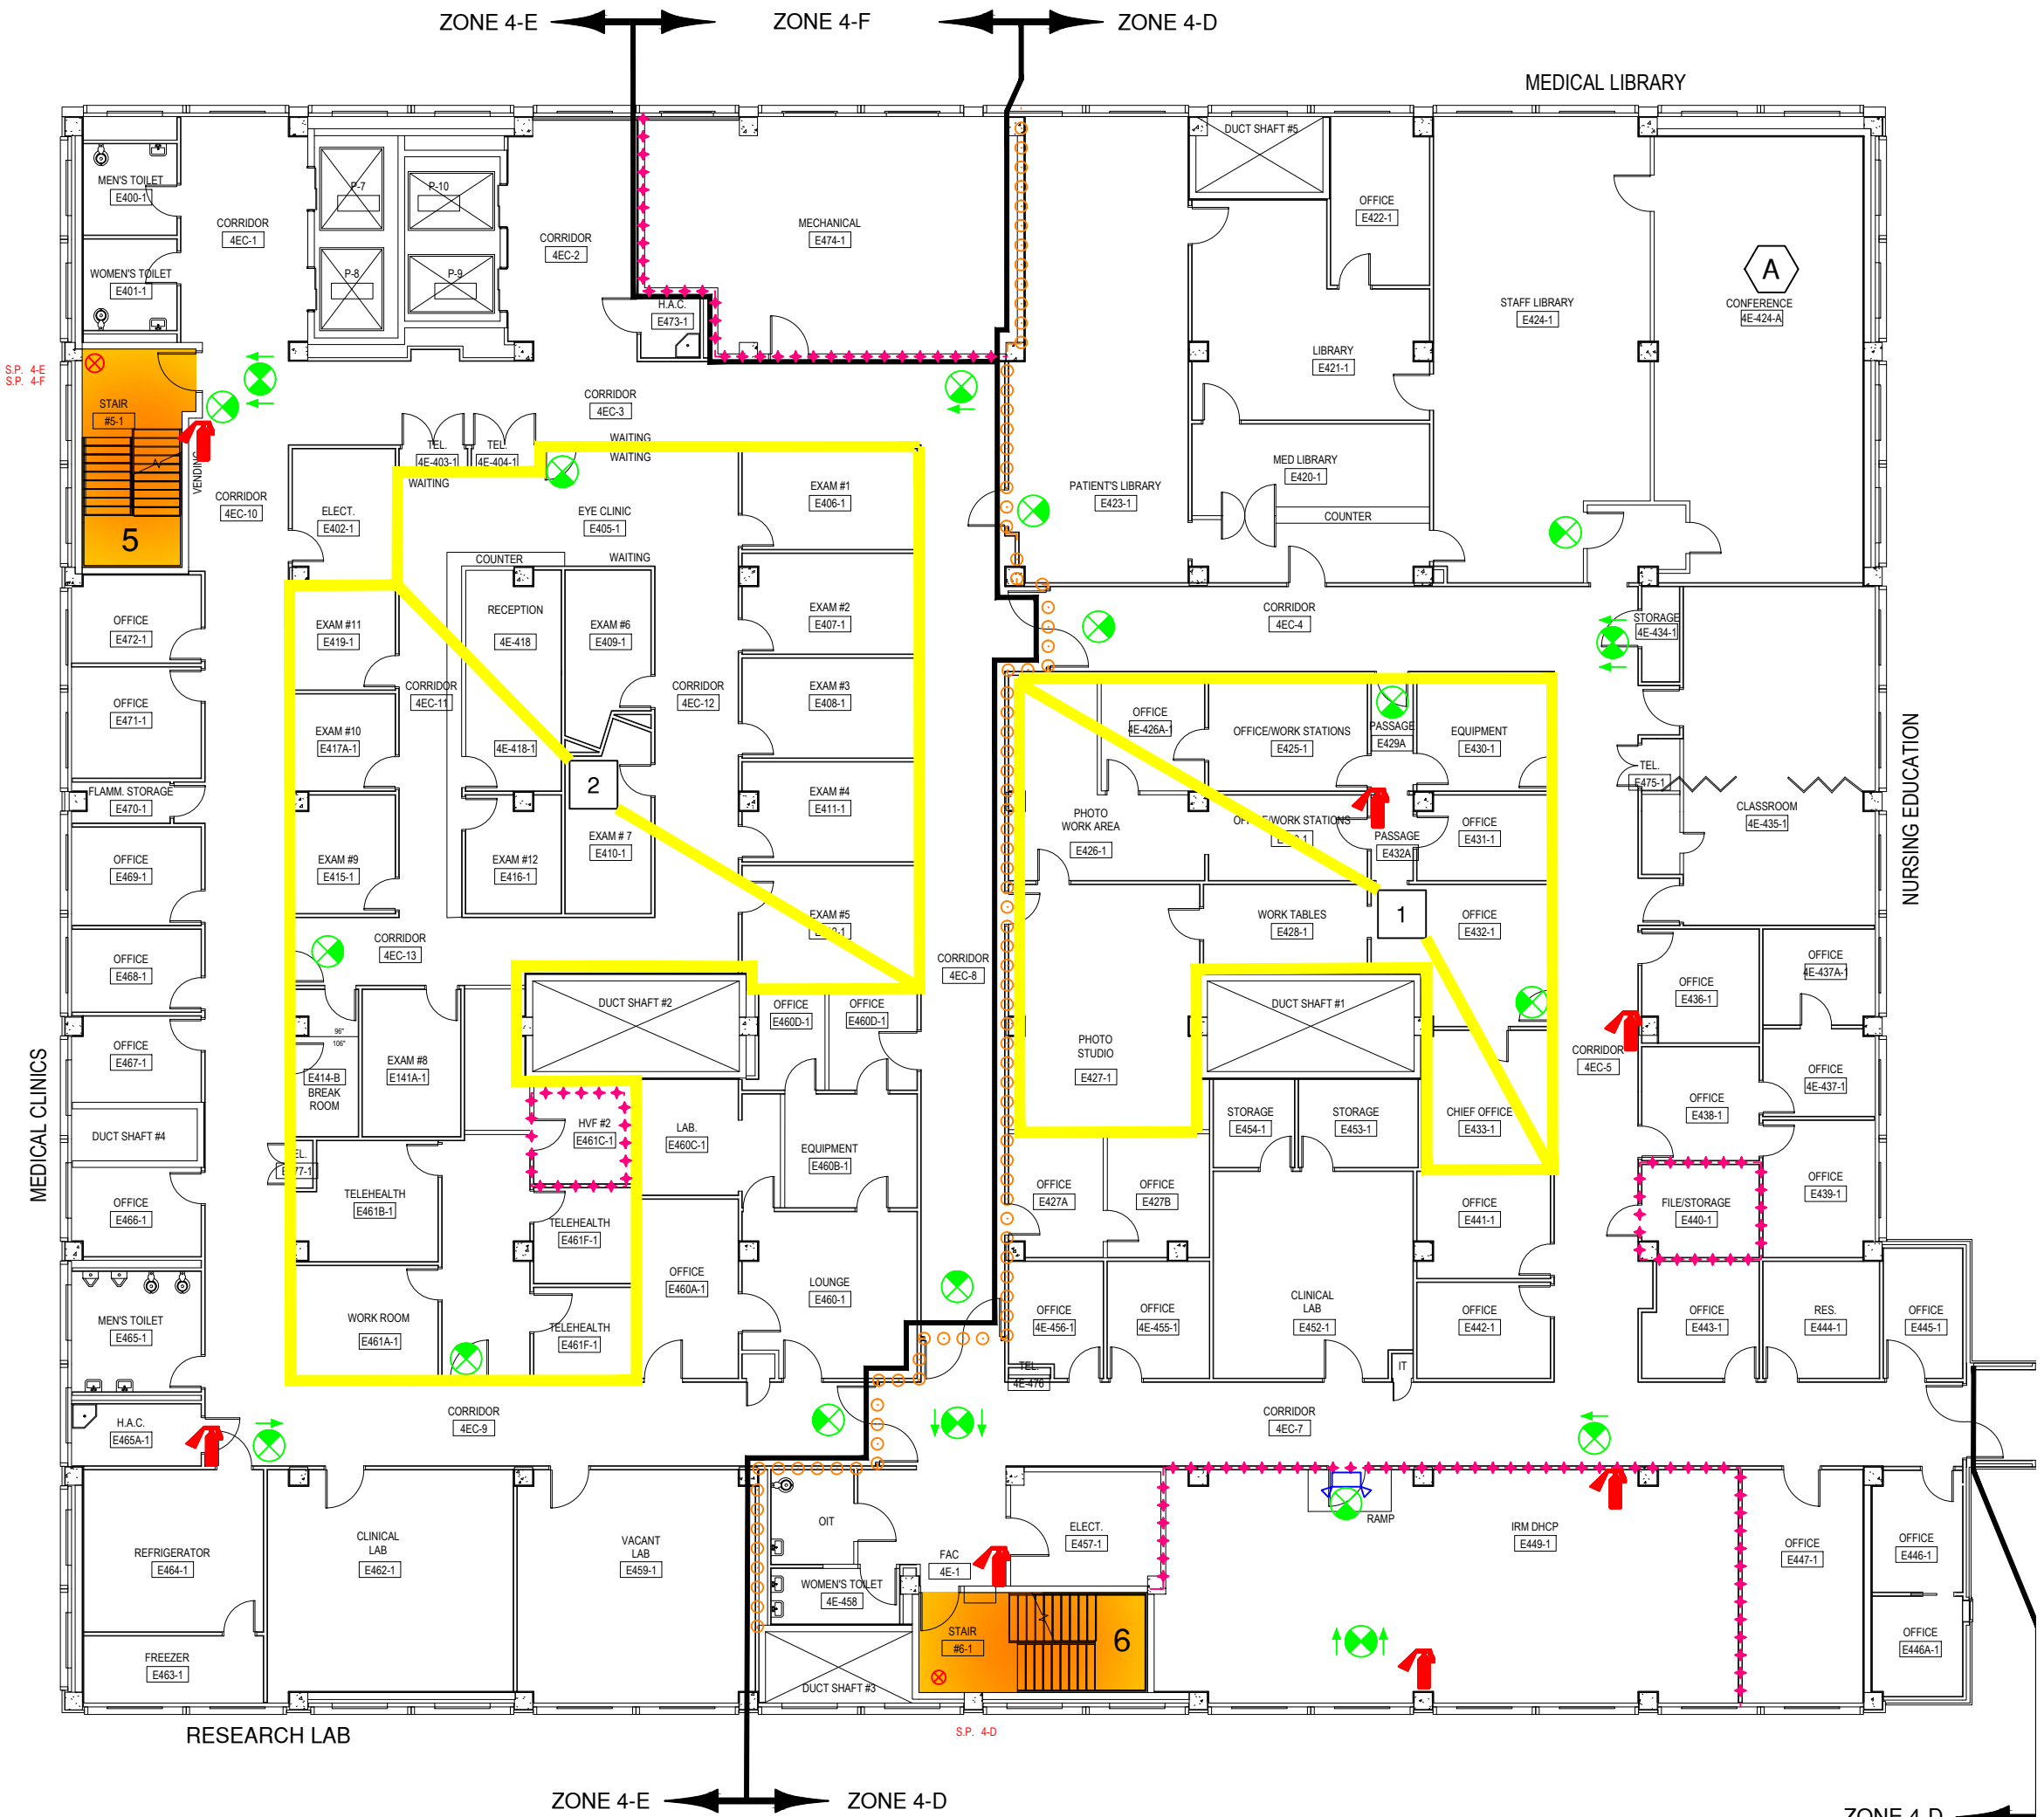

FOURTH FLOOR
E-WING
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions		Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title:	FIRE AND LIFE SAFETY SURVEY	Client Project No.	Contract No.	Drawing Title:	FOURTH FLOOR E-WING	Designed By	Drawn By	Checked By	Date	Drawing No.
FP&C Project Number: 3032.02					Building No.	AutoCAD File Name		Location							
					01	LS06-4					VA MEDICAL CENTER GAINESVILLE, FLORIDA			12/28/2018	LS-20
															Sht. 22 Of 35



PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION



FOURTH FLOOR MAIN HOSPITAL FULLY SPRINKLERED BUSINESS OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS06-4

Drawing Title:
**FOURTH FLOOR
MAIN HOSPITAL**

Designed By
FVO
Location

Drawn By
KW/TK
VA MEDICAL CENTER
GAINESVILLE, FLORIDA

Checked By
FVO
Scale:

Date
12/28/2018
Scale:

Drawing No.
LS-21
Sht. 23 of 35

KEY NOTES:

- 1 SEE EQUIVALENCY FOR USE OF OVERSIZED PROTECTIVE PLATE.
- 2 MINIMUM OF 8' WIDE CORRIDOR PROVIDED AROUND EXISTING DRINKING FOUNTAIN PROJECTION.



PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HE HORIZONTAL EXIT PASSAGEWAY
- EX EXIT
- EP EXIT PASSAGEWAY
- LC LINEN CHUTE
- TC TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

FOURTH FLOOR
BED TOWER
FULLY SPRINKLERED
HEALTH CARE OCCUPANCY


Revisions	Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No.	Contract No.	Drawing Title: FOURTH FLOOR BED TOWER	Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-22 Sht. 24 of 35
FP&C Project Number: 3032.02					Building No. 01	AutoCAD File Name LS06-4		Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION


SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION



FIFTH FLOOR
COMPOSITE
FULLY SPRINKLERED
MIXED OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:	FIRE AND LIFE SAFETY SURVEY
----------------	--------------------------------

Client Project No.	Contract No.
Building No. 01	AutoCAD File Name LS07-5 & 6

Drawing Title:	FIFTH FLOOR COMPOSITE
----------------	--------------------------

Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-23
Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			Sht. 25 of 35

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	RESPIRATORY SUITE	1,536 Sq. Ft.	NON SLEEPING PATIENT CARE	2
2	PULMONARY OFFICE SUITE	2,697 Sq. Ft.	NON SLEEPING PATIENT CARE	2
3	OFFICE SUITE	1,746 Sq. Ft.	NON SLEEPING PATIENT CARE	2

KEY NOTES:

- A

ELECTRICAL TRANSFORMER OVER 112.5 KVA WITH CLASS 155 OR LOWER INSULATION SYSTEM. 1 HOUR FIRE RESISTIVE ENCLOSURE REQUIRED PER EXCEPTION 1 OF ARTICLE 450.21(B) OF NFPA 70-2017 EDITION.

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HE

HORIZONTAL EXIT PASSAGEWAY
- EX

EXIT
- EP

EXIT PASSAGEWAY
- LC

LINEN CHUTE
- TC

TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- F

FIRE ALARM STATION
- FACP

FIRE ALARM CONTROL PANEL
- FAAP

FIRE ALARM ANNUNCIATOR PANEL
- AED



AUTOMATED EXTERNAL DEFIBRILLATOR
- EVC

EVACUATION CHAIR
- FHV

FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SH


SHOWER STATION
- EW

EYEWASH STATION

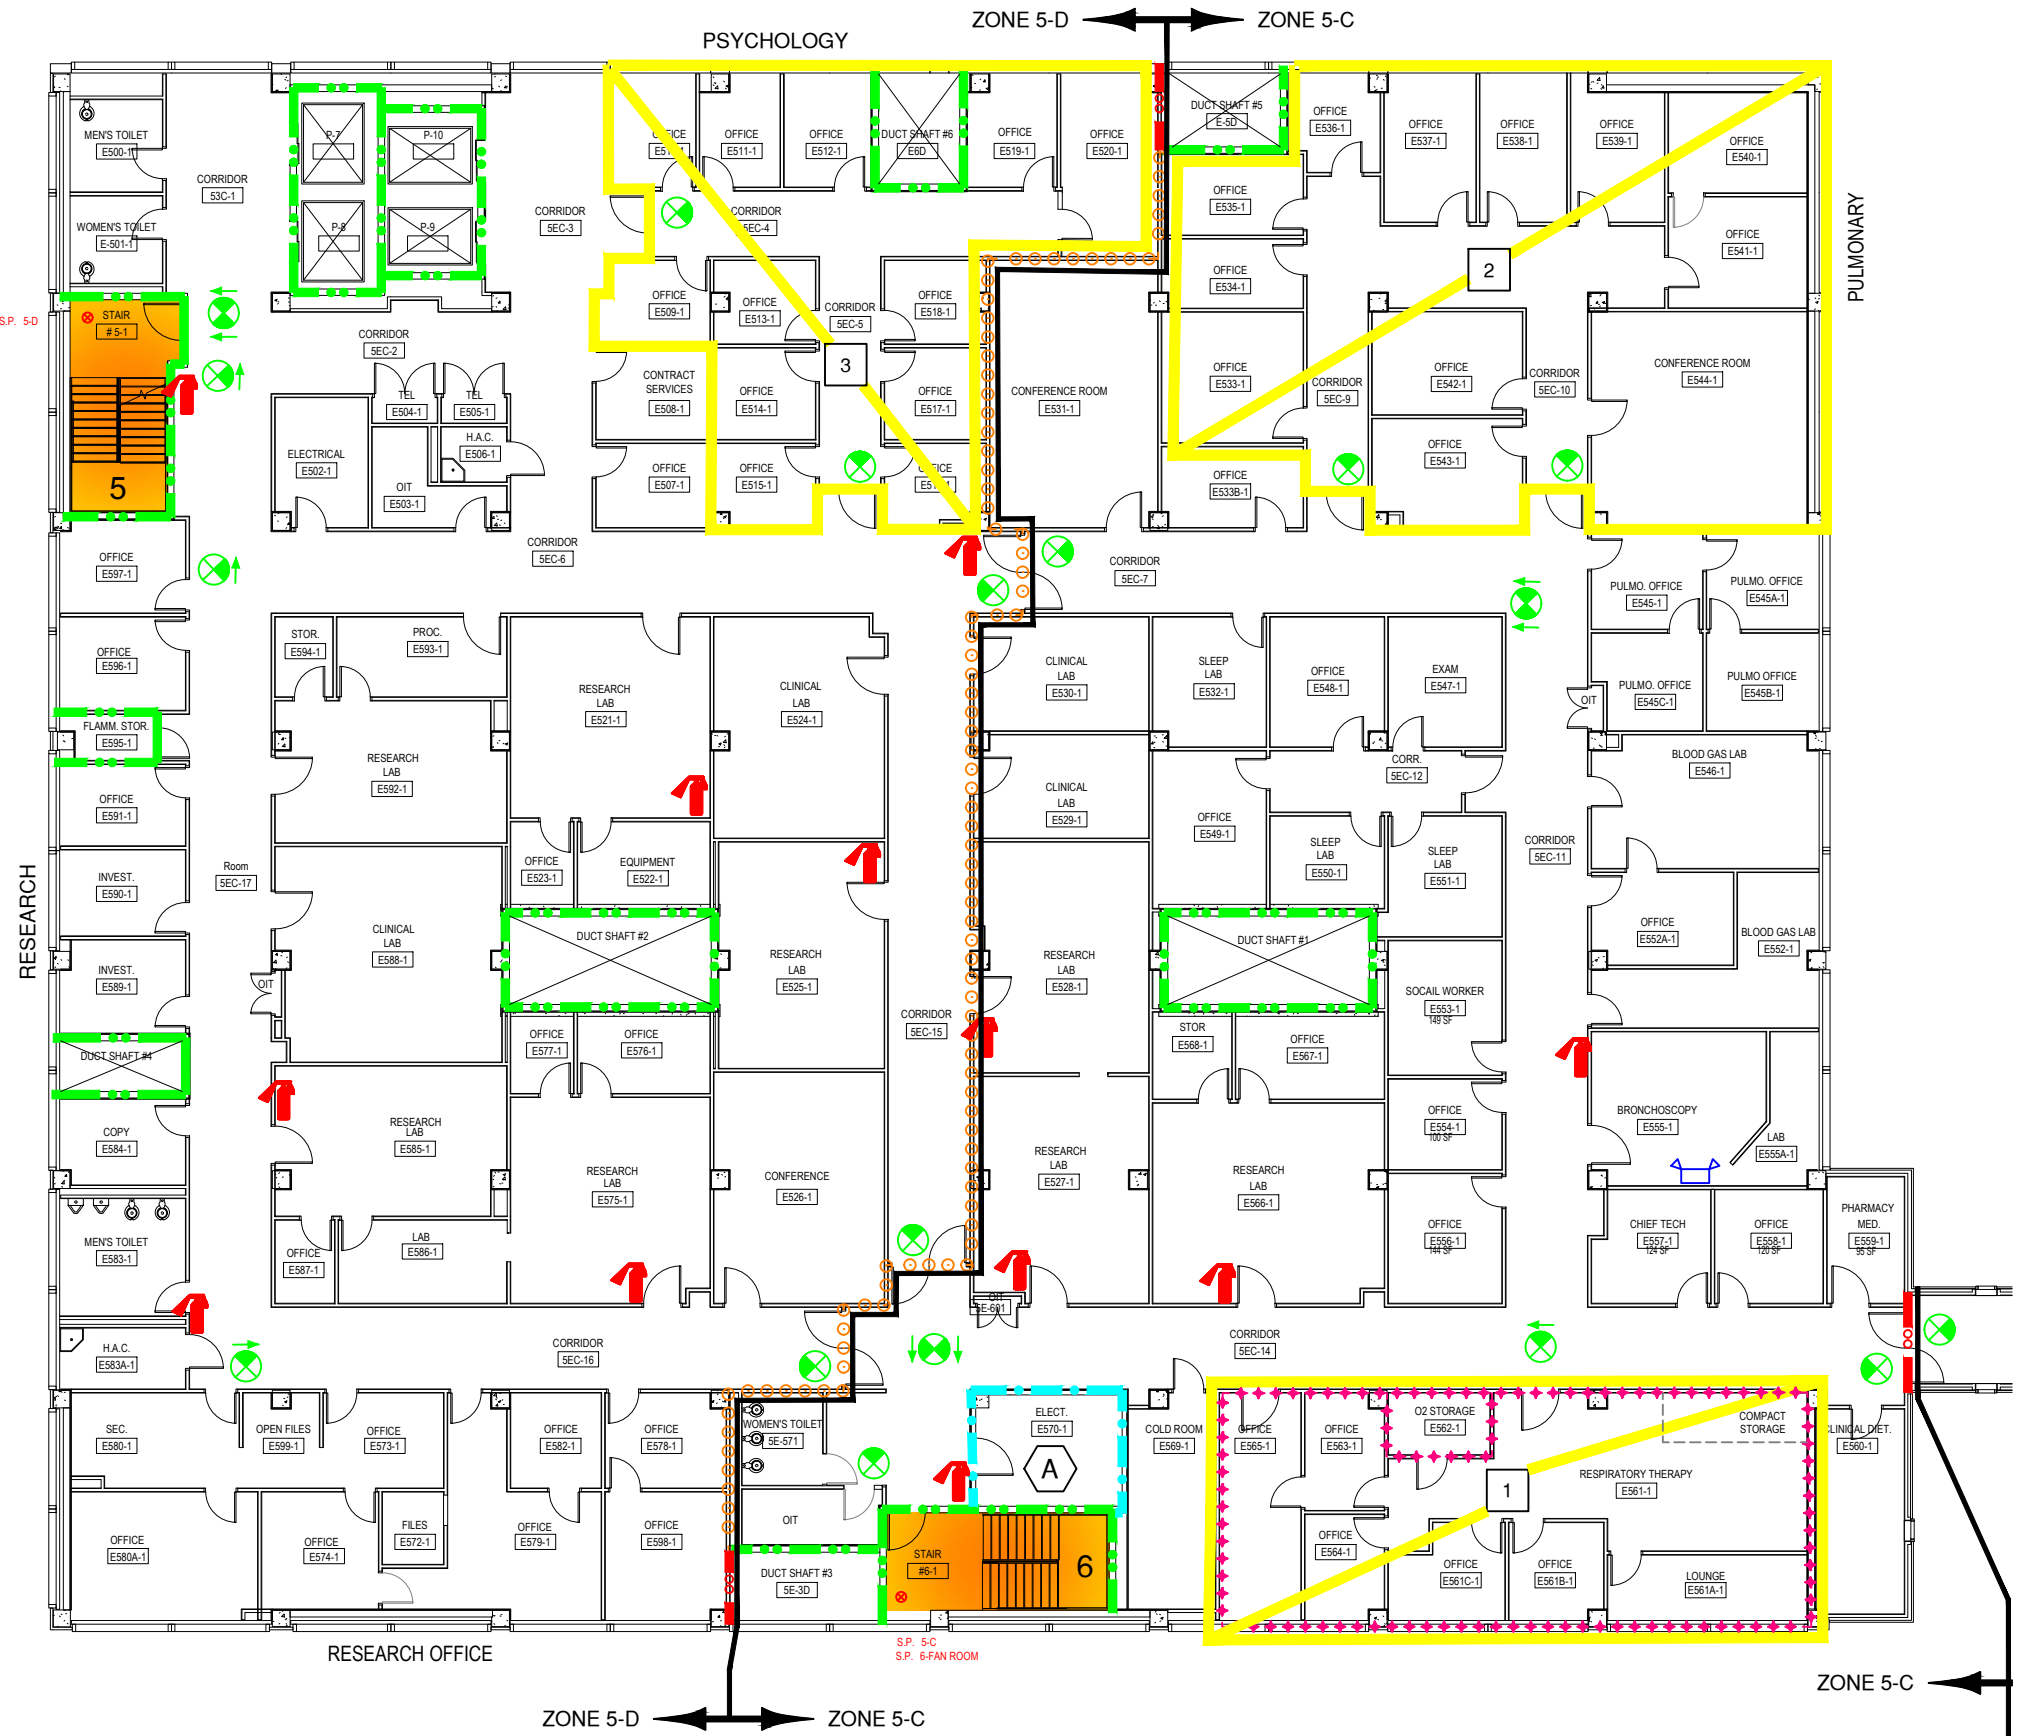

FIFTH FLOOR
E-WING
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS07-5 & 6

Drawing Title:
**FIFTH FLOOR
E-WING**

Designed By
FVO
Location
VA MEDICAL CENTER
GAINESVILLE, FLORIDA

Drawn By
KW/TK
Checked By
FVO

Date
12/28/2018
Scale:

Drawing No.
LS-24
Sht. 26 Of 35

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	HEMODIALYSIS SUITE	1,890 Sq. Ft.	NON-SLEEPING PATIENT CARE	2

KEY NOTES:



A TRASH AND LINEN CHUTES OUT OF SERVICE

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION


SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

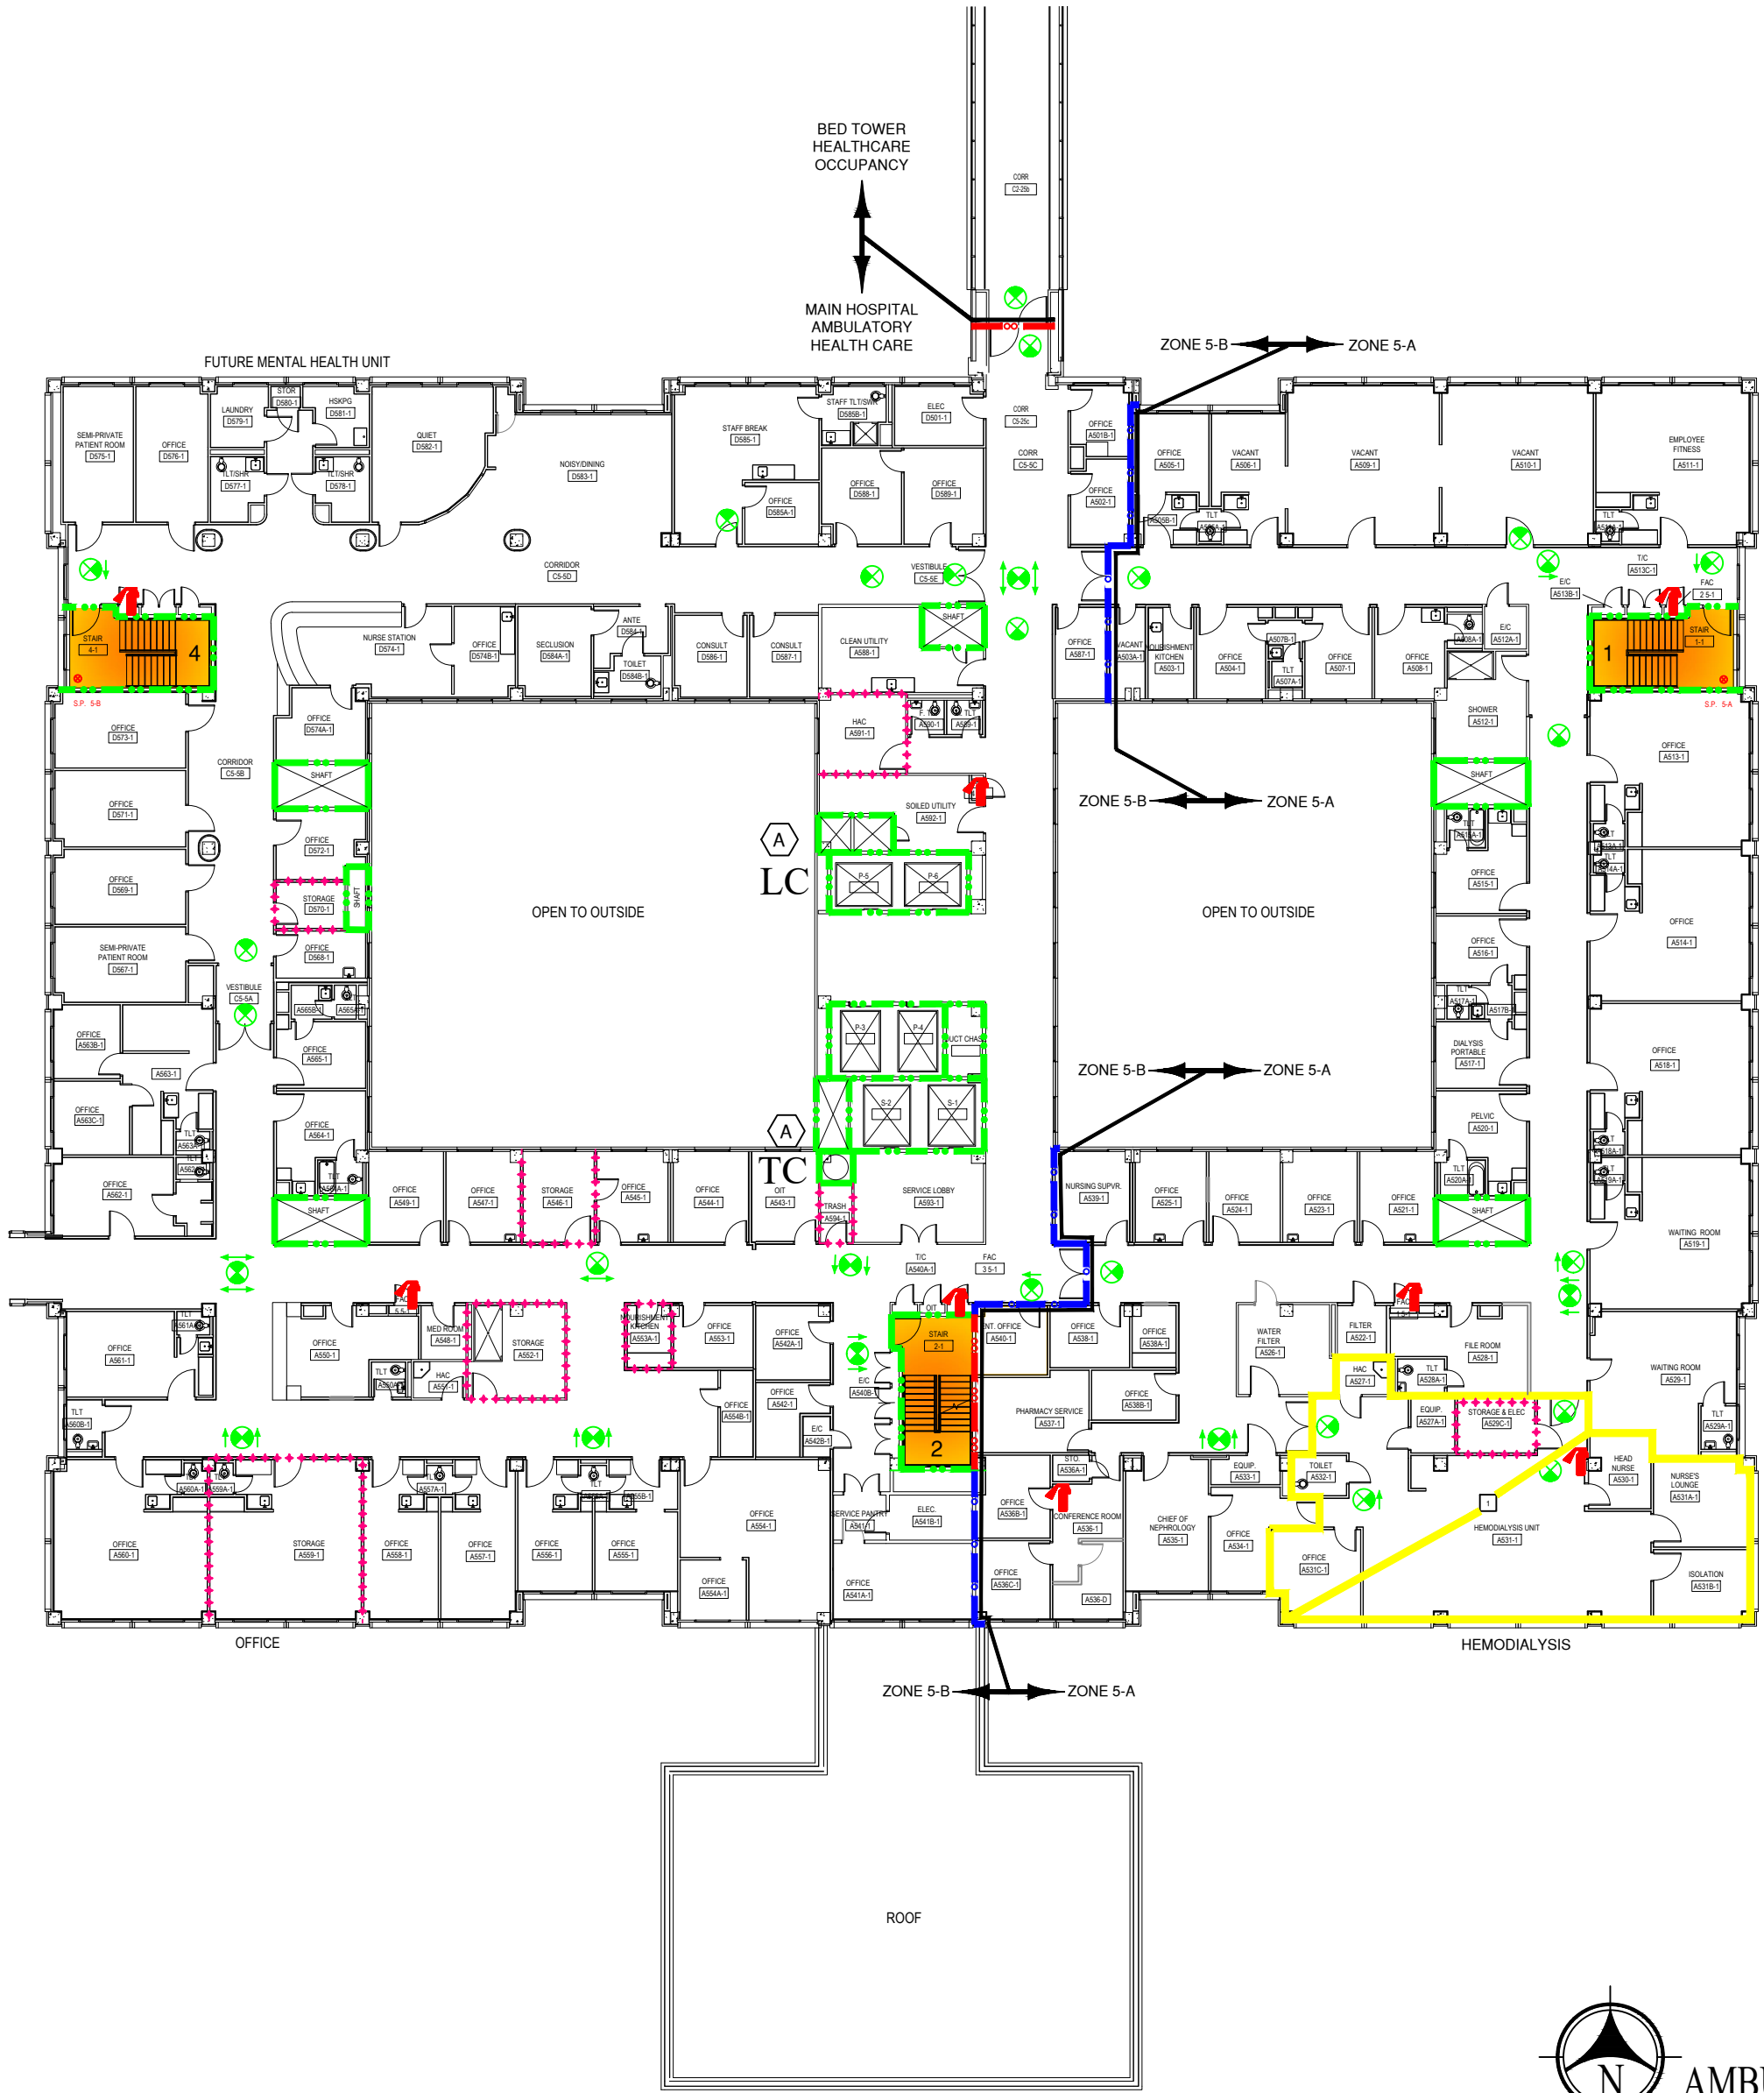

FIFTH FLOOR
MAIN HOSPITAL
FULLY SPRINKLERED
AMBULATORY HEALTH CARE OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	

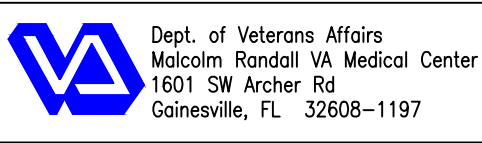

FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name
LS07-5 & 6

Drawing Title:
**FIFTH FLOOR
MAIN HOSPITAL**

Designed By
FVO
Location

Drawn By
KW/TK
VA MEDICAL CENTER
GAINESVILLE, FLORIDA


Checked By
FVO
Scale:

Date
12/28/2018
Sht. 27 of 35

Drawing No.
LS-25

KEY NOTES:

1 DOOR LOCKED FOR CLINICAL NEEDS OF PATIENTS PER SECTION 18.2.2.5.1 OF NFPA 101-2018 EDITION.

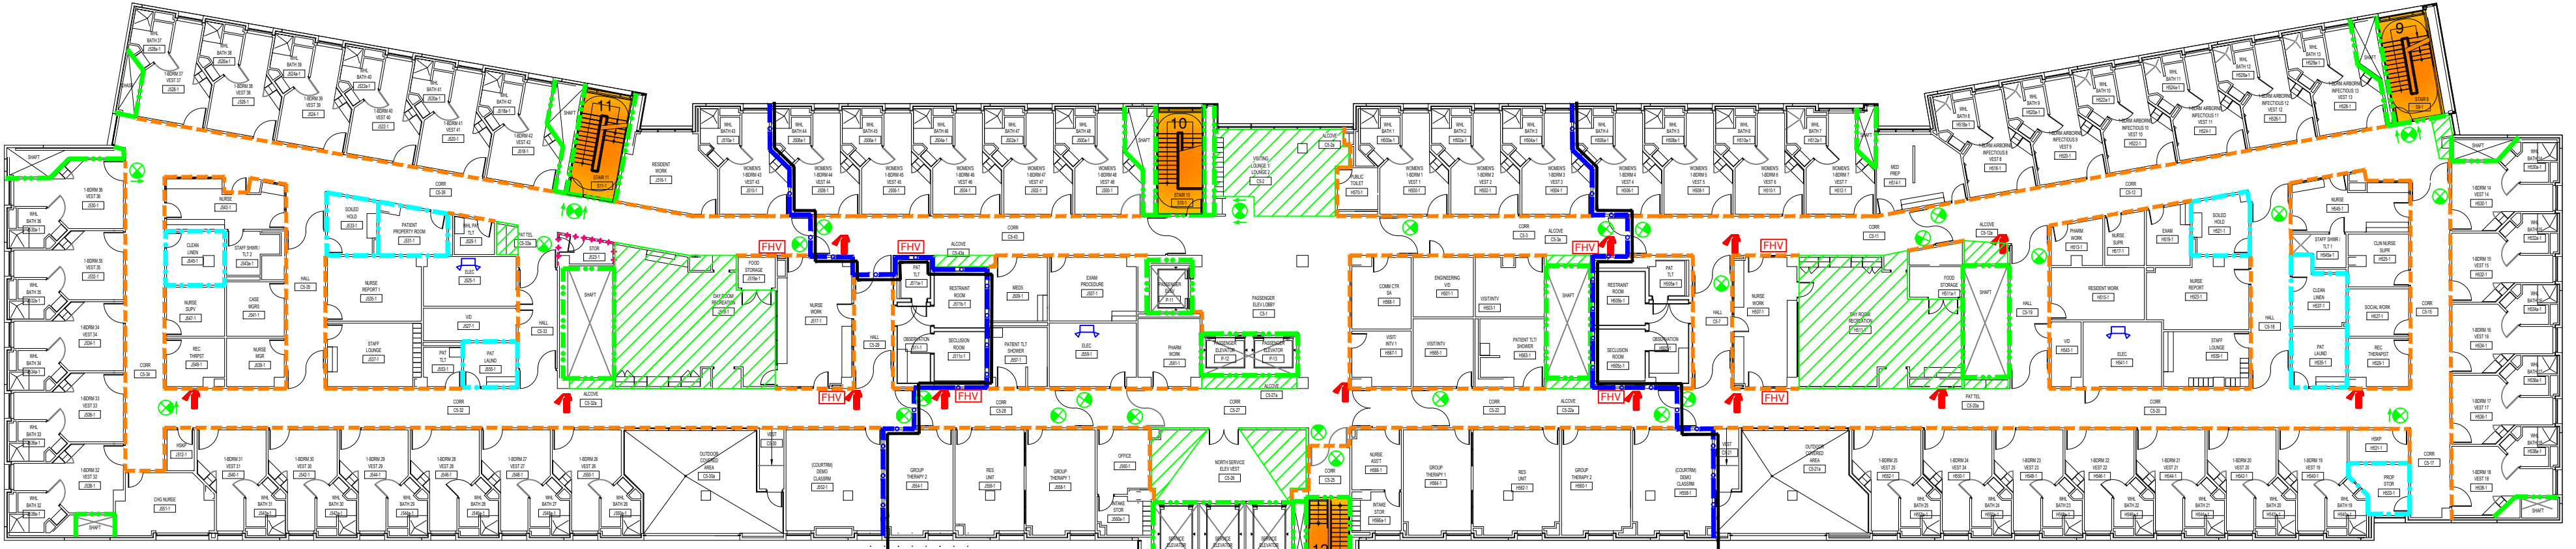


PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION




FIFTH FLOOR
BED TOWER
FULLY SPRINKLERED
HEALTH CARE OCCUPANCY

Revisions		Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No.	Contract No.	Drawing Title: FIFTH FLOOR BED TOWER	Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-26 Sht. 28 of 35
FP&C Project Number: 3032.02		Building No. 01				AutoCAD File Name LS07-5 & 6	Location VA MEDICAL CENTER GAINESVILLE, FLORIDA		Scale:				

KEY NOTES:

 EXISTING $\frac{3}{16}$ " MINIMUM STEEL PLATE FLOOR ACCESS PANEL
CONSIDERED EQUIVALENT TO 2 HOUR FLOOR ASSEMBLY AT
THE TIME OF BUILDING CONSTRUCTION.

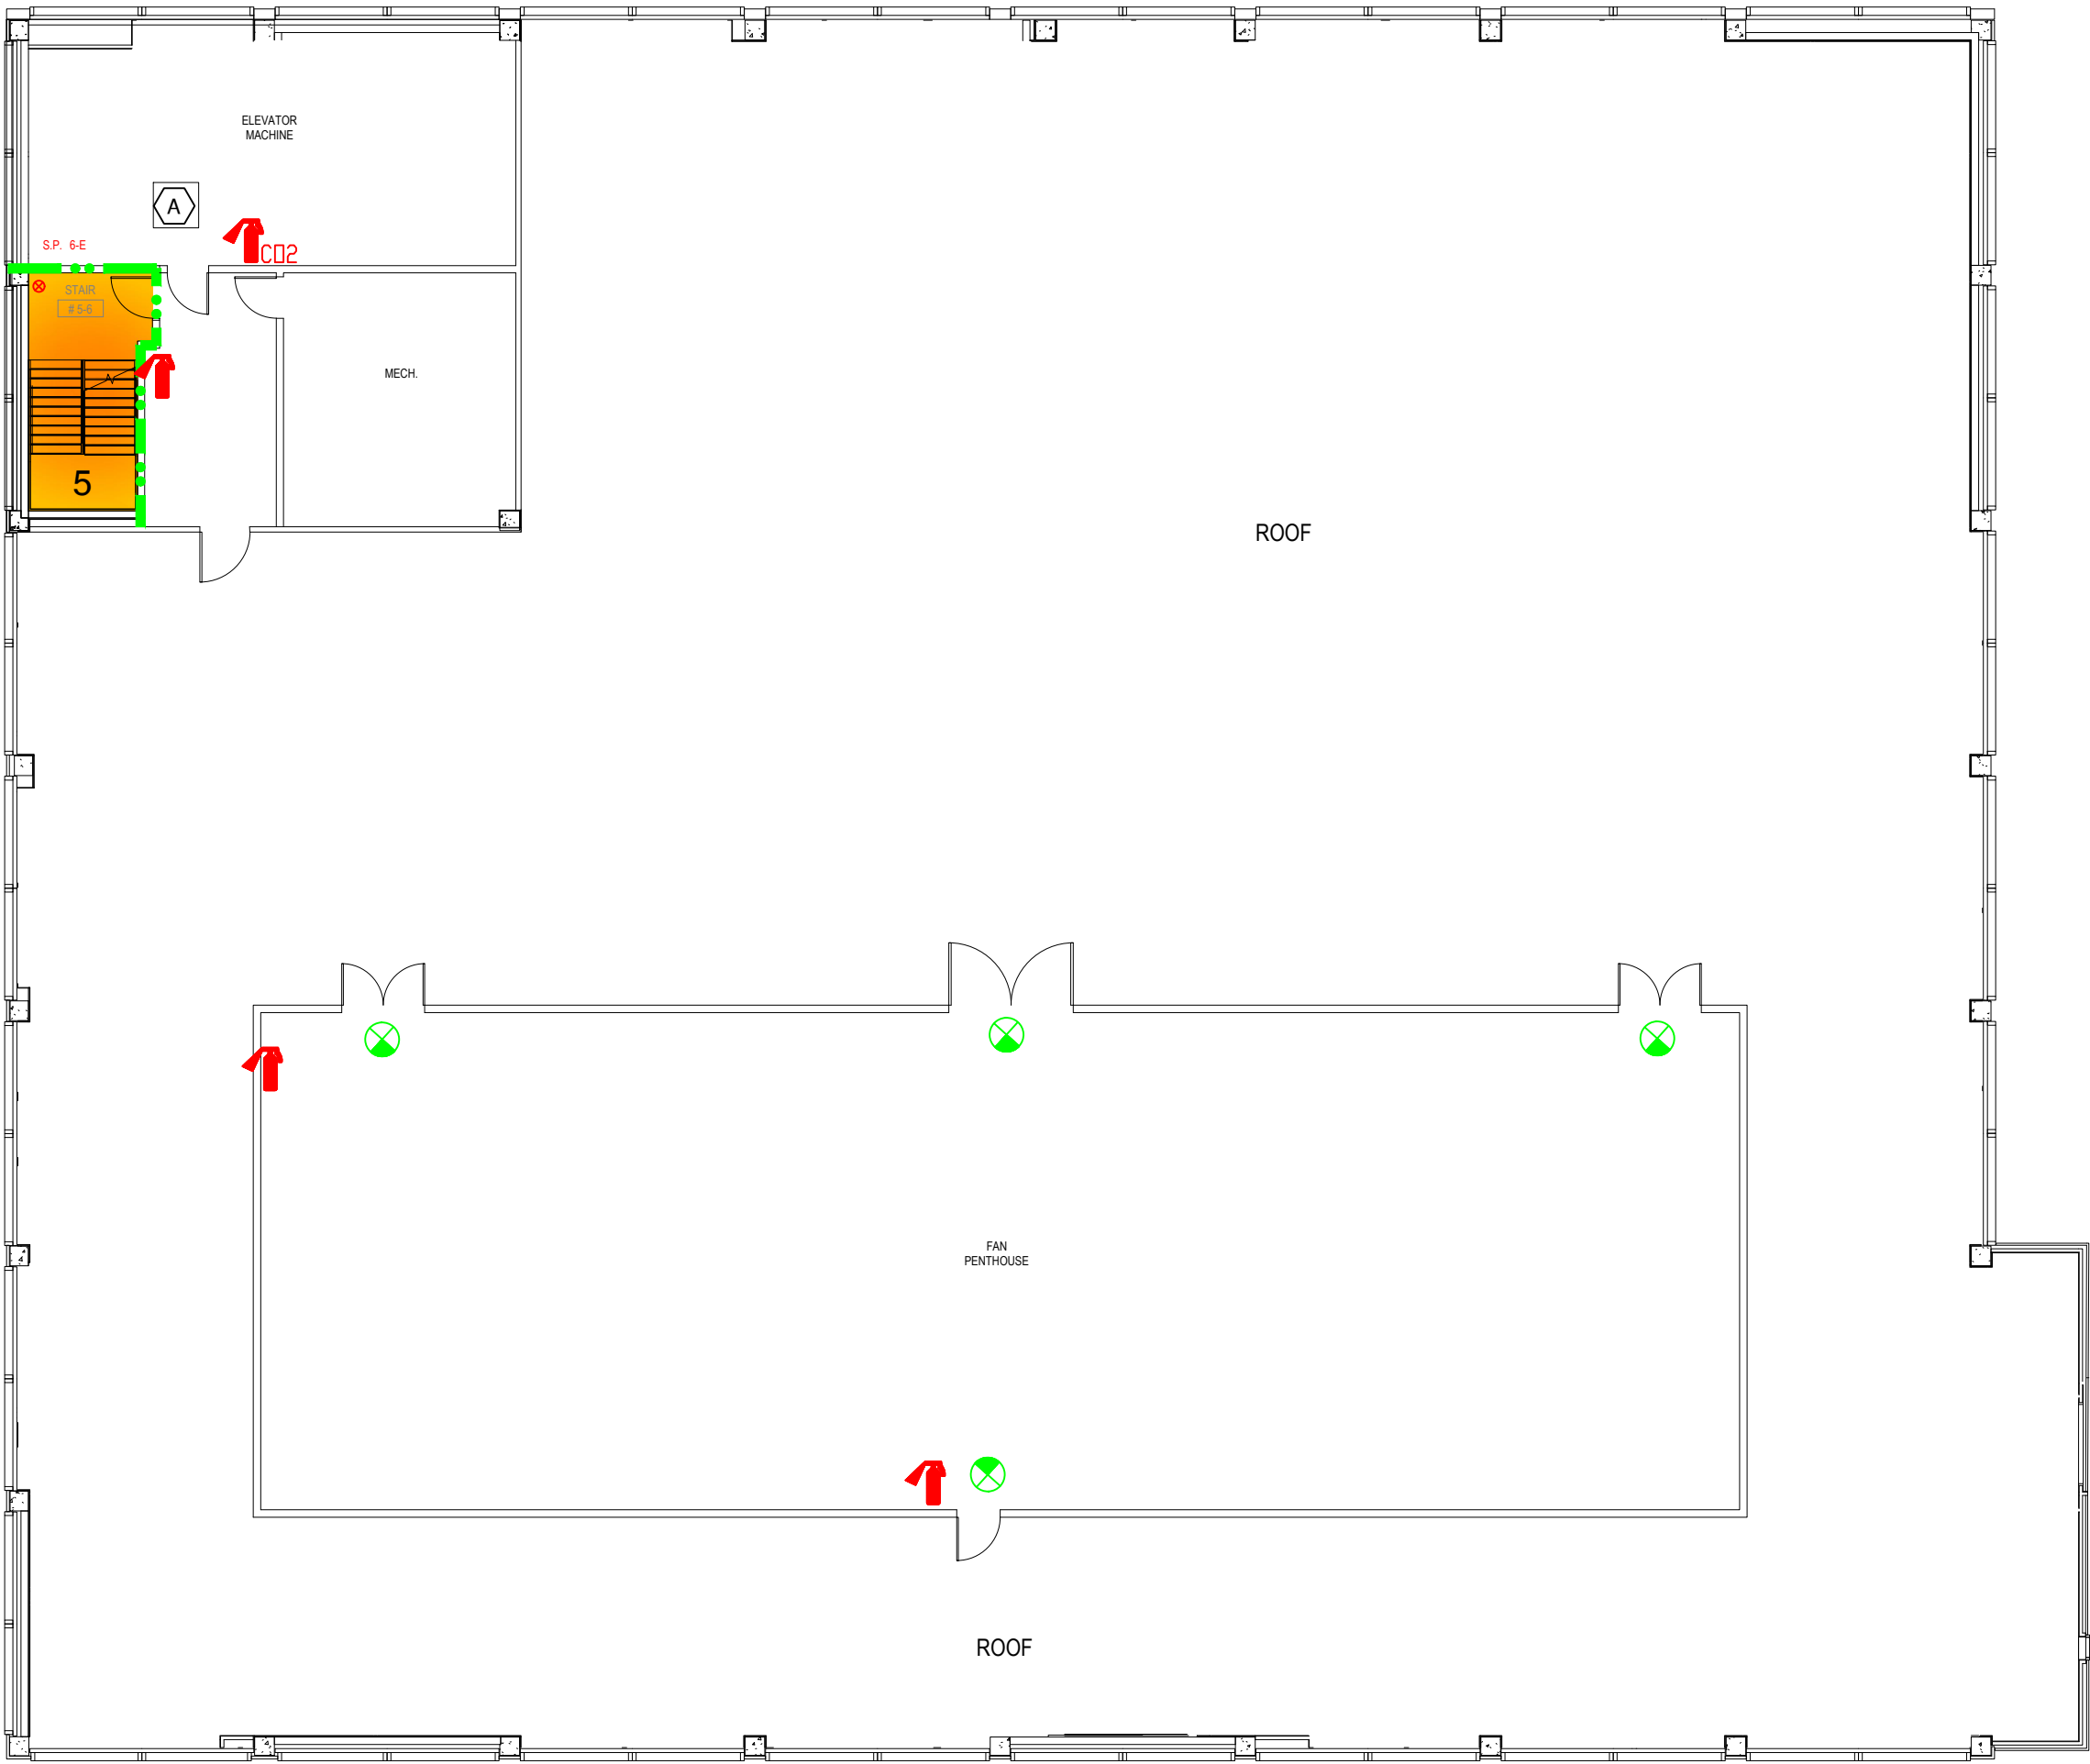


PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

-  HORIZONTAL EXIT PASSAGEWAY
-  EXIT
-  EXIT PASSAGEWAY
-  LINEN CHUTE
-  TRASH CHUTE
-  AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
-  AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
-  FIRE EXTINGUISHER
-  EXIT SIGN
-  EMERGENCY LIGHT
-  FIRE ALARM STATION
-  FIRE ALARM CONTROL PANEL
-  FIRE ALARM ANNUNCIATOR PANEL
-  AUTOMATED EXTERNAL DEFIBRILLATOR
-  EVACUATION CHAIR
-  FIRE HOSE VALVE
-  SPRINKLER SYSTEM RISER
-  SHOWER STATION
-  EYEWASH STATION



SIXTH FLOOR
E-WING
FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:	FIRE AND LIFE SAFETY SURVEY
----------------	--------------------------------

Client Project No.	Contract No.
Building No. 01	AutoCAD File Name LS07-5 & 6

Drawing Title:	SIXTH FLOOR E-WING
----------------	-----------------------

Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-27
Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:	Sht. 29 Of 35		

KEY NOTES:



 EXISTING $\frac{3}{8}$ " MINIMUM STEEL PLATE FLOOR ACCESS PANEL
CONSIDERED EQUIVALENT TO 2 HOUR FLOOR ASSEMBLY AT
THE TIME OF BUILDING CONSTRUCTION.

PARTITION LEGEND

-  HEALTH CARE OCCUPANCY CORRIDORS
-  SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
-  NON-RATED SMOKE PARTITION
-  1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
-  SMOKE ZONE BARRIER
-  2 HOUR FIRE BARRIER
-  2 HOUR FIRE/SMOKE ZONE BARRIER
-  SUITE DESIGNATION

SYMBOLS LIST

-  HORIZONTAL EXIT PASSAGEWAY
-  EXIT
-  EXIT PASSAGEWAY
-  LINEN CHUTE
-  TRASH CHUTE
-  AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
-  AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
-  FIRE EXTINGUISHER
-  EXIT SIGN
-  EMERGENCY LIGHT
-  FIRE ALARM STATION
-  FIRE ALARM CONTROL PANEL
-  FIRE ALARM ANNUNCIATOR PANEL
-  AUTOMATED EXTERNAL DEFIBRILLATOR
-  EVACUATION CHAIR
-  FIRE HOSE VALVE
-  SPRINKLER SYSTEM RISER
-  SHOWER STATION
-  EYEWASH STATION

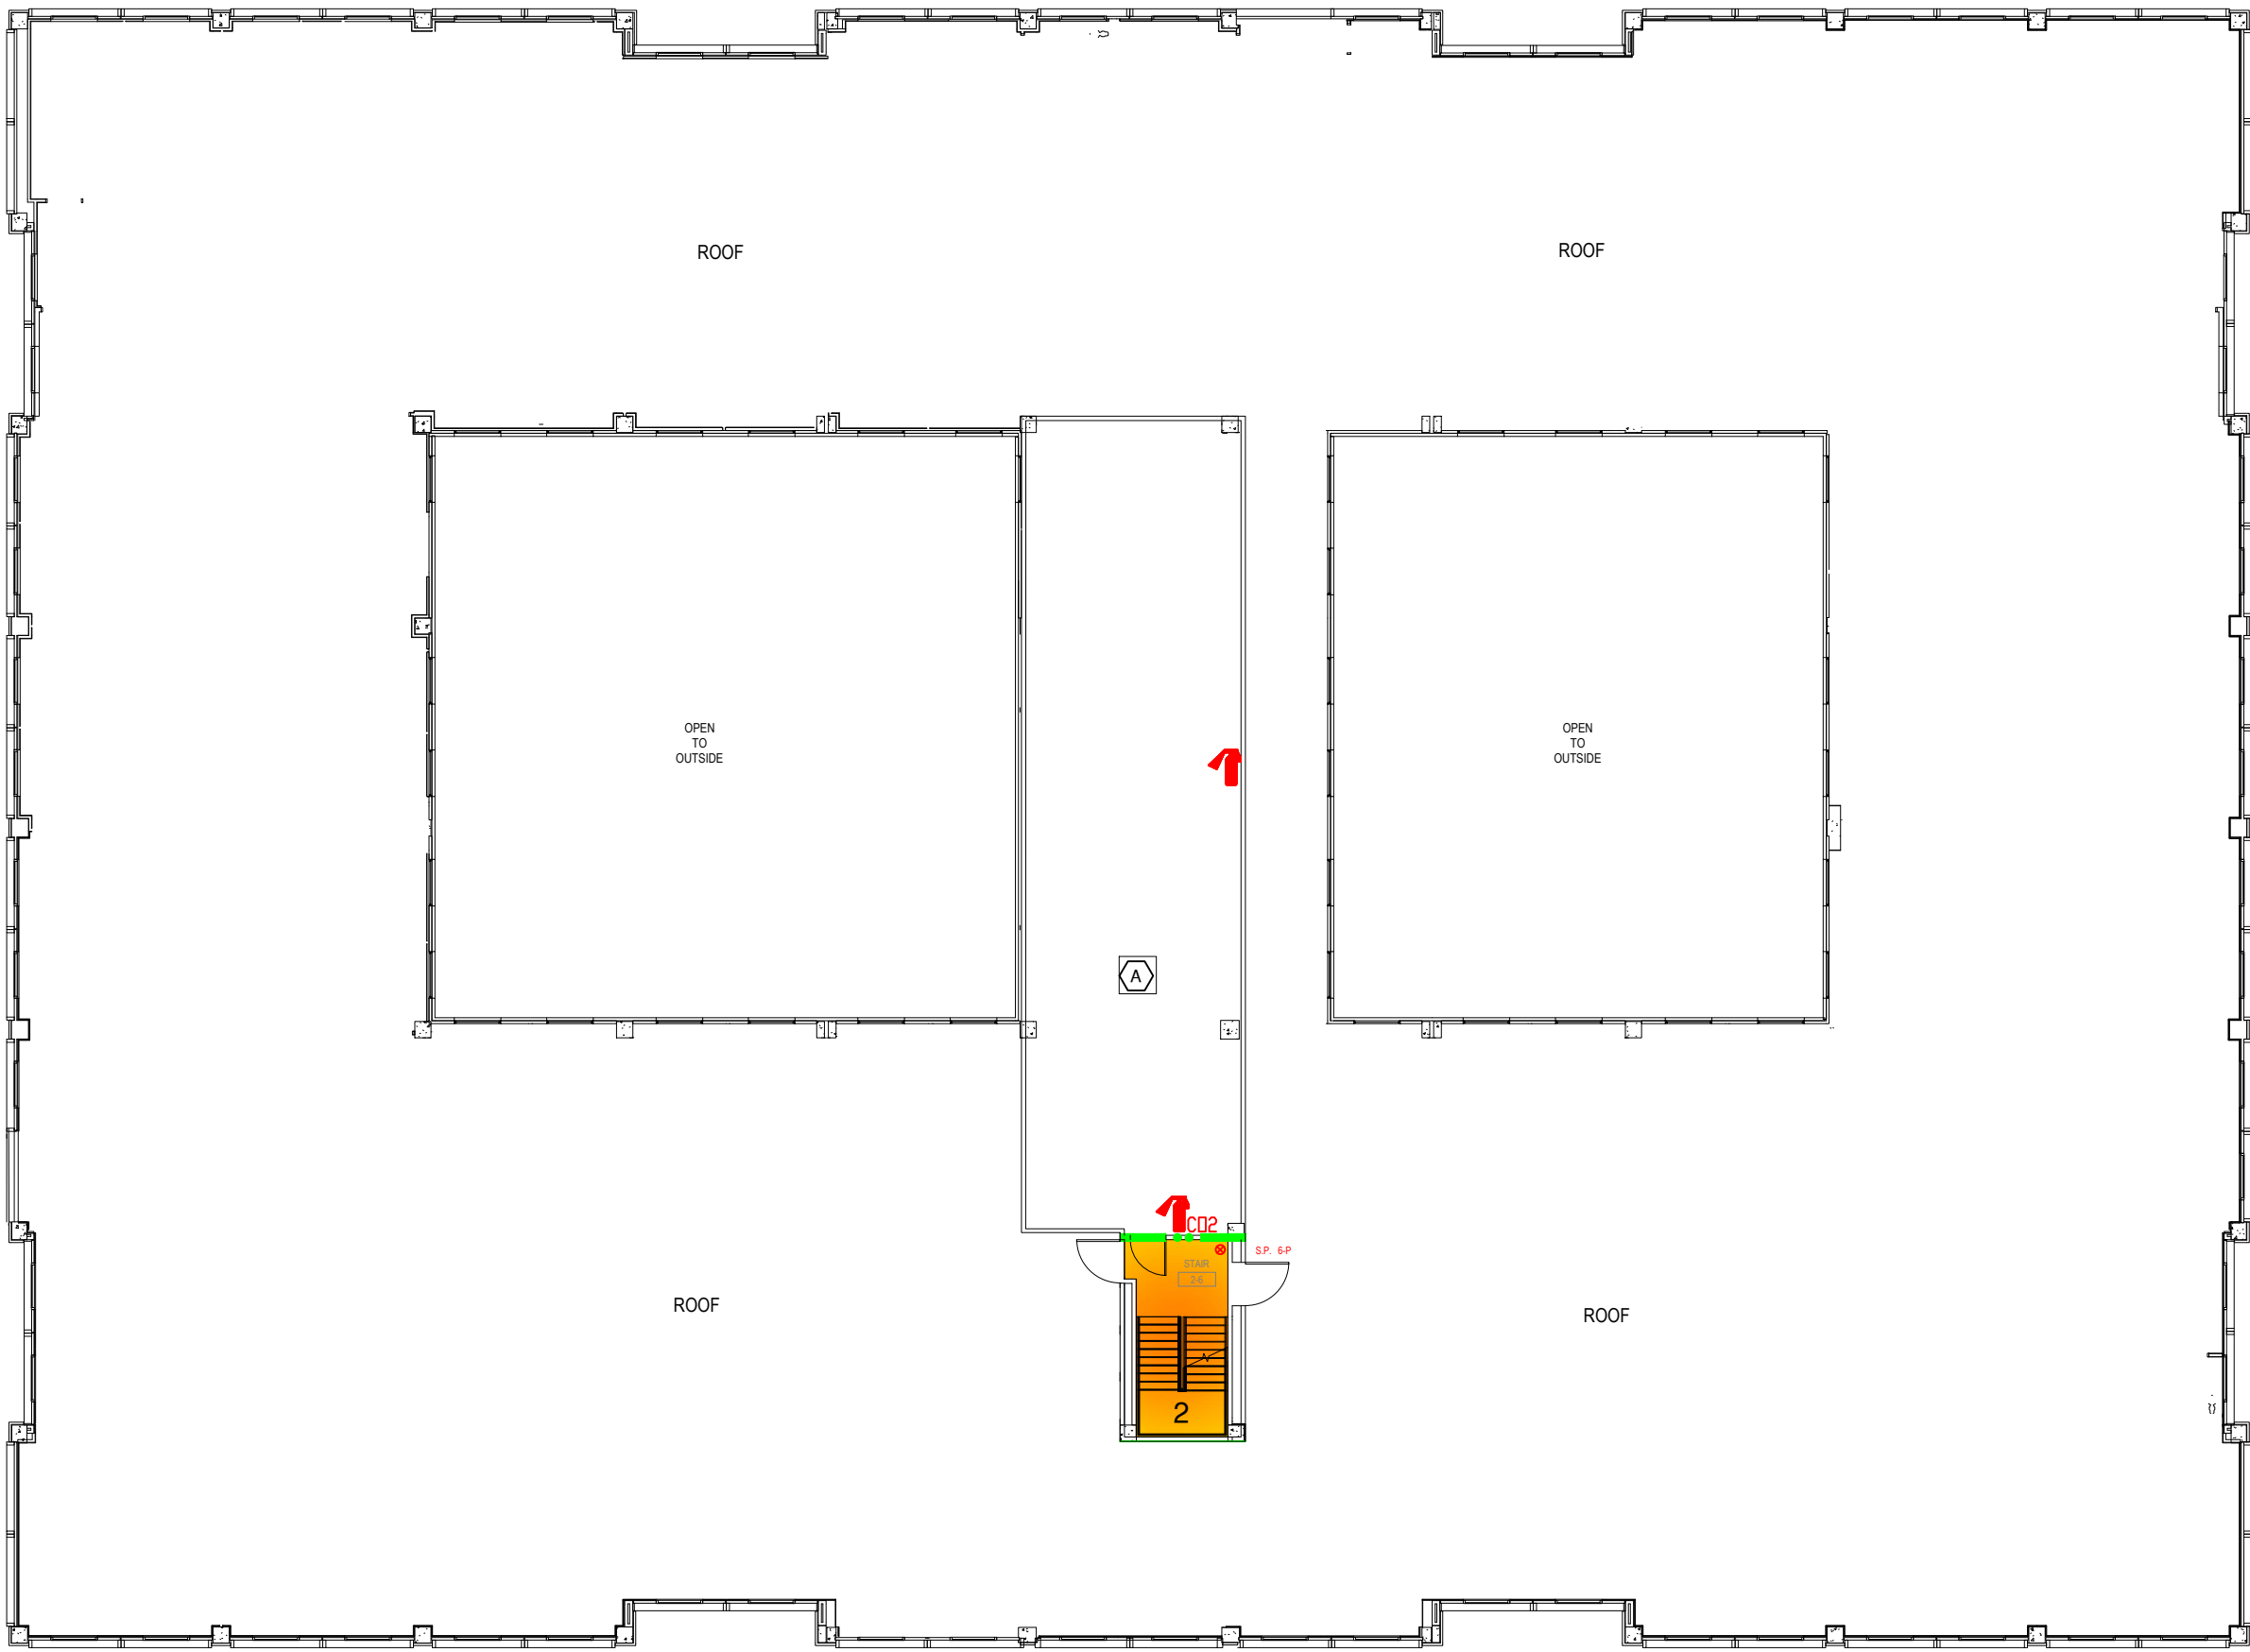

SIXTH FLOOR
MAIN HOSPITAL
FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, L.L.C.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:	FIRE AND LIFE SAFETY SURVEY
----------------	--------------------------------

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name LS07-5 & 6

Drawing Title:	SIXTH FLOOR MAIN HOSPITAL
----------------	------------------------------



Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-28
Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:	Sht. 30 of 35		

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EVACUATION CHAIR
- FIRE HOSE VALVE
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EYEWASH STATION

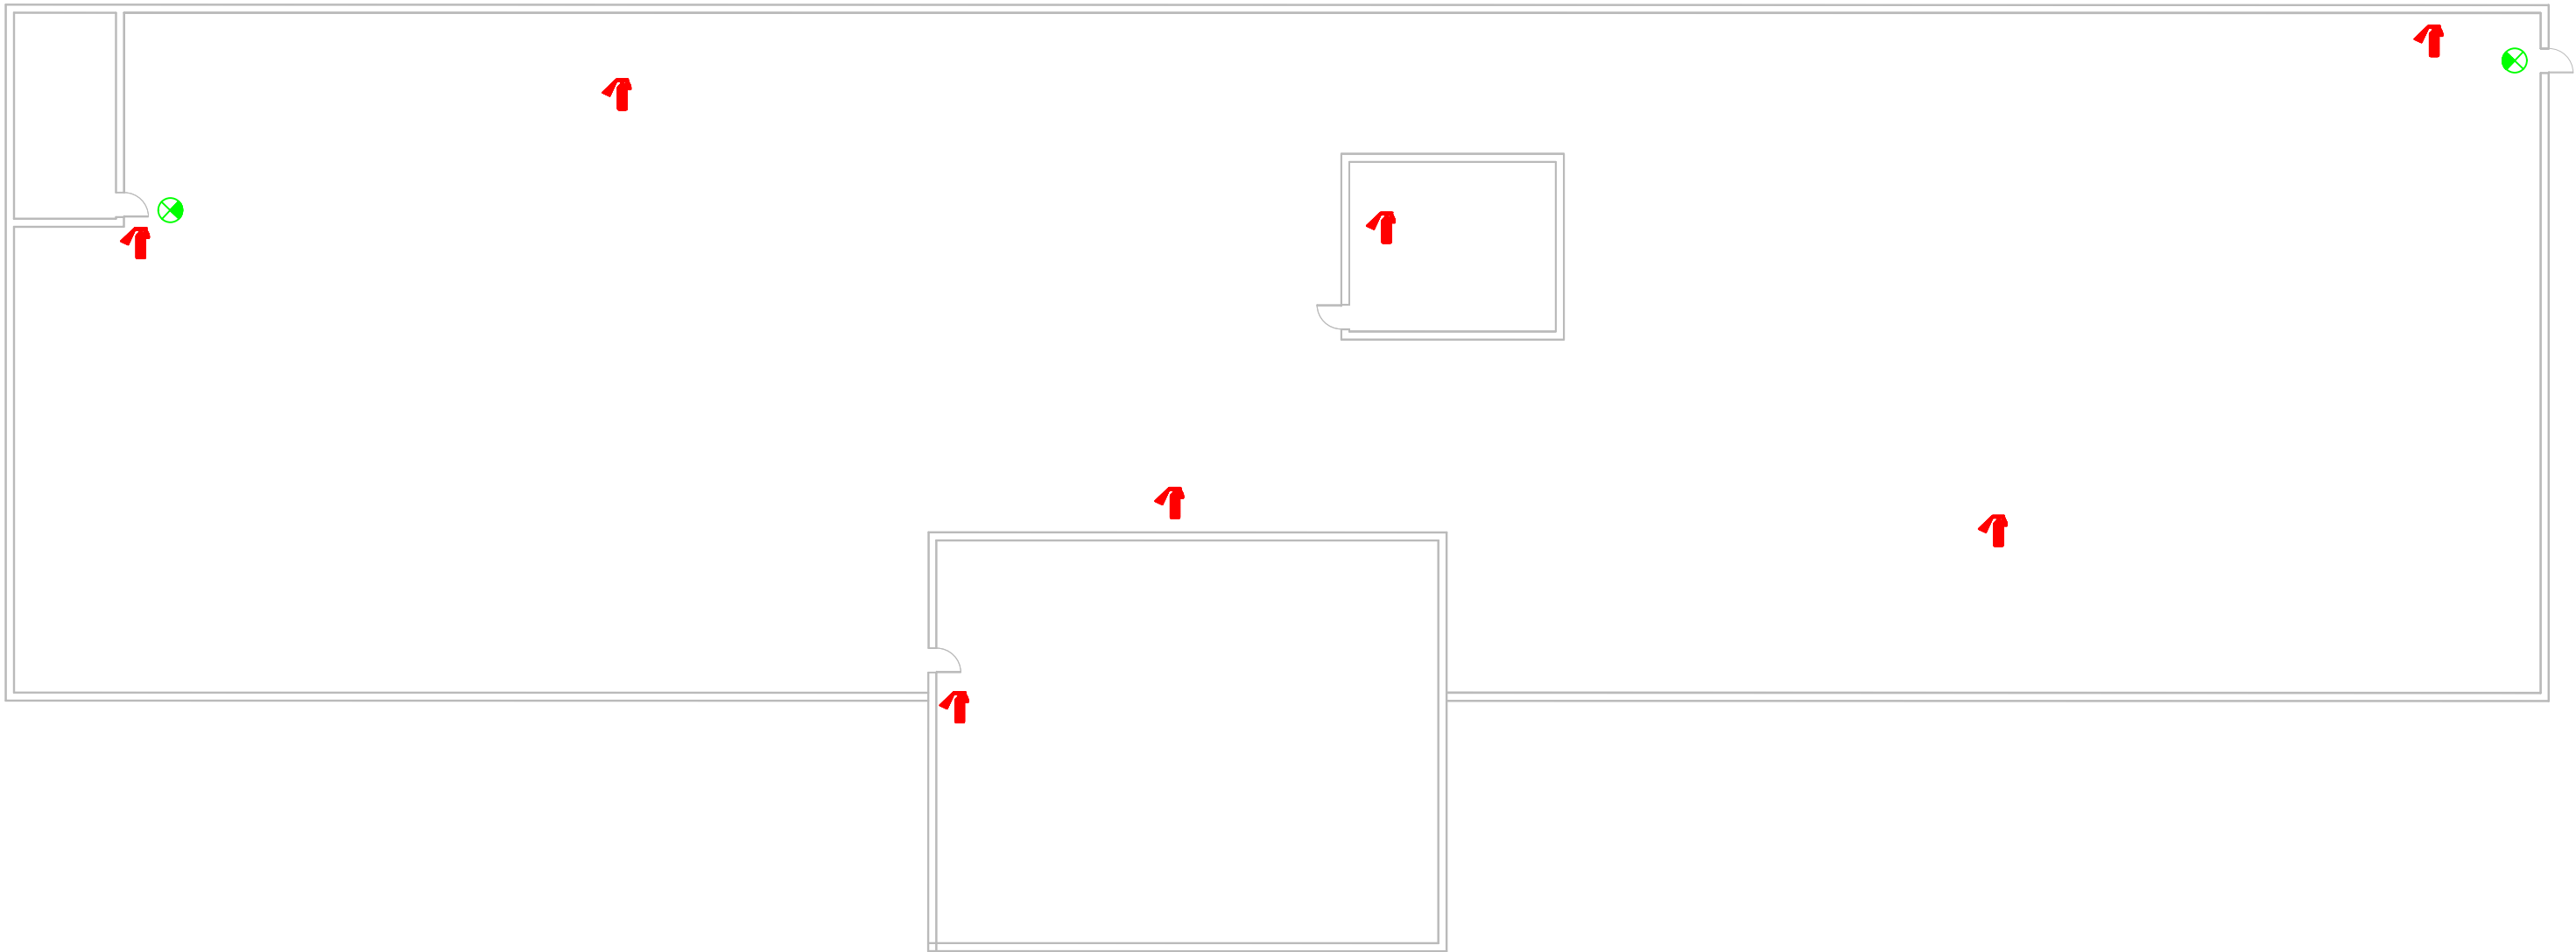

SIXTH FLOOR
BED TOWER
FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	



Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 01

Contract No.
AutoCAD File Name

Drawing Title:
**SIXTH FLOOR
BED TOWER**

Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-29
Location VA MEDICAL CENTER GAINESVILLE, FLORIDA		Scale:		Sht. 31 Of 35

KEY NOTES:

1 TRASH CHUTE OUT OF SERVICE.

SUITE DESCRIPTIONS


SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	REHAB SUITE	1,893 Sq. Ft.	NON-SLEEPING PATIENT CARE	2

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EYEWASH STATION
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EVACUATION CHAIR
- FIRE HOSE VALVE

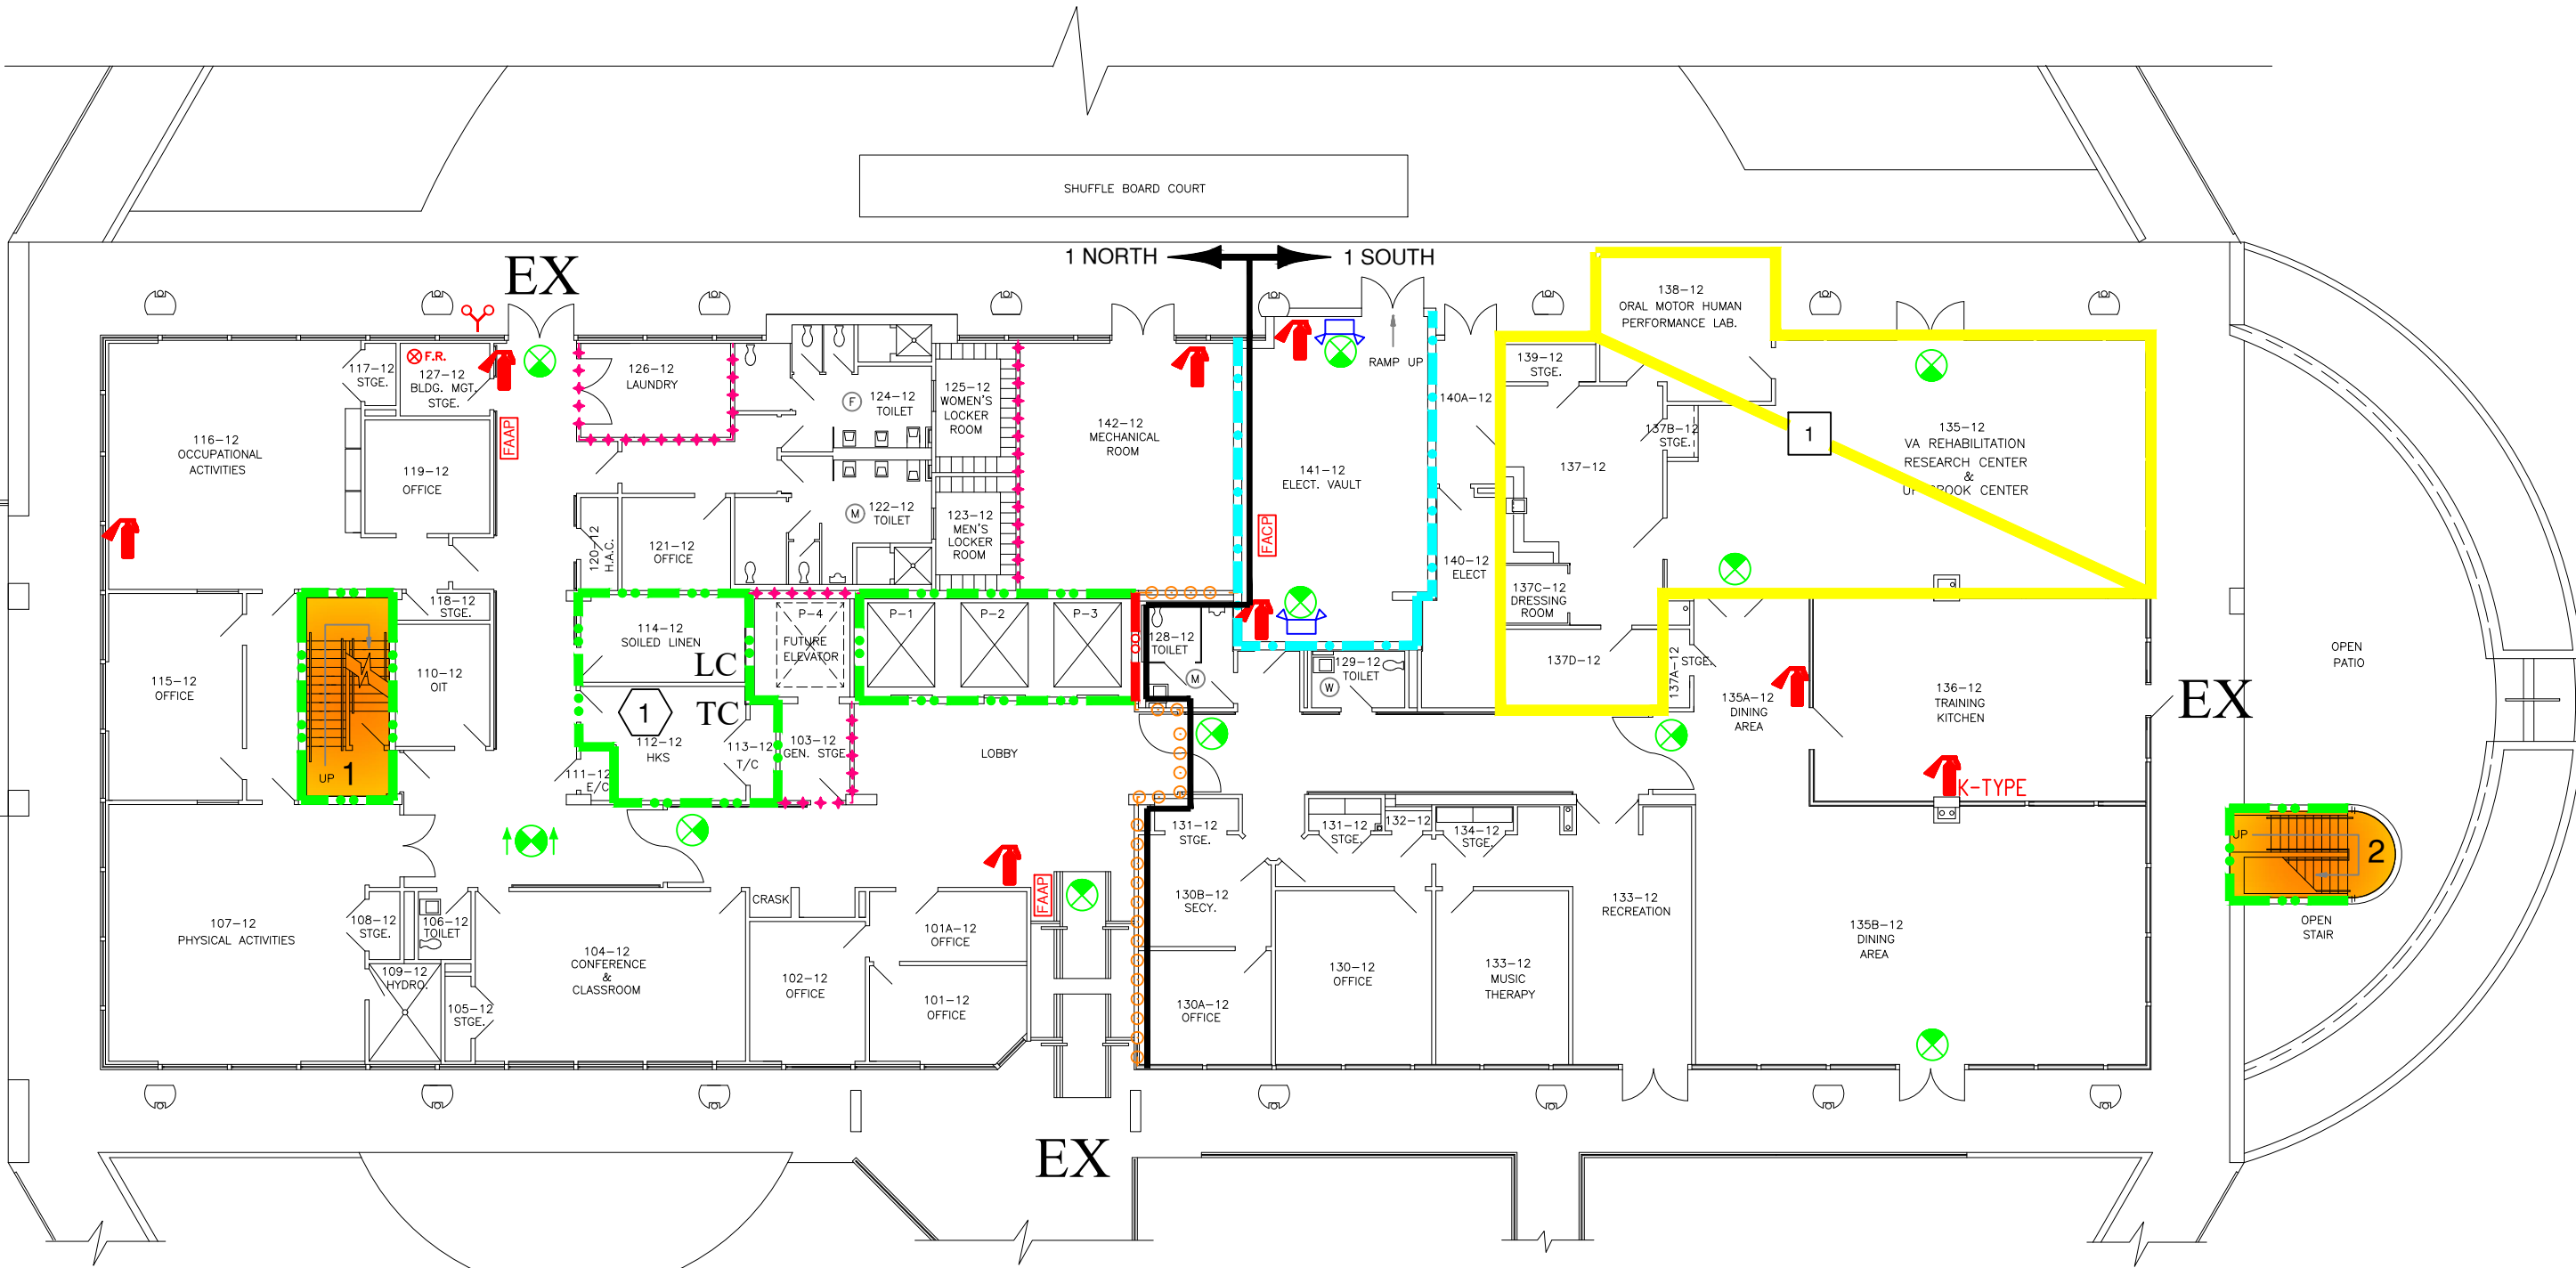

FIRST FLOOR
COMMUNITY LIVING CENTER
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	

Dept. of Veterans Affairs
Malcolm Randall VA Medical Center
1601 SW Archer Rd
Gainesville, FL 32608-1197



FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
FIRE AND LIFE
SAFETY SURVEY

Client Project No.
Building No. 12

Contract No.
AutoCAD File Name
LS02-1

Drawing Title
FIRST FLOOR
COMMUNITY LIVING CENTER

Designed By
FVO

Drawn By
KW/TK

Checked By
FVO

Date
12/28/2018
Scale:

Drawing No.
LS-30
Sht. 32 Of 35

KEY NOTES:


1 TRASH CHUTE OUT OF SERVICE.

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION


SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EYEWASH STATION
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EVACUATION CHAIR
- FIRE HOSE VALVE

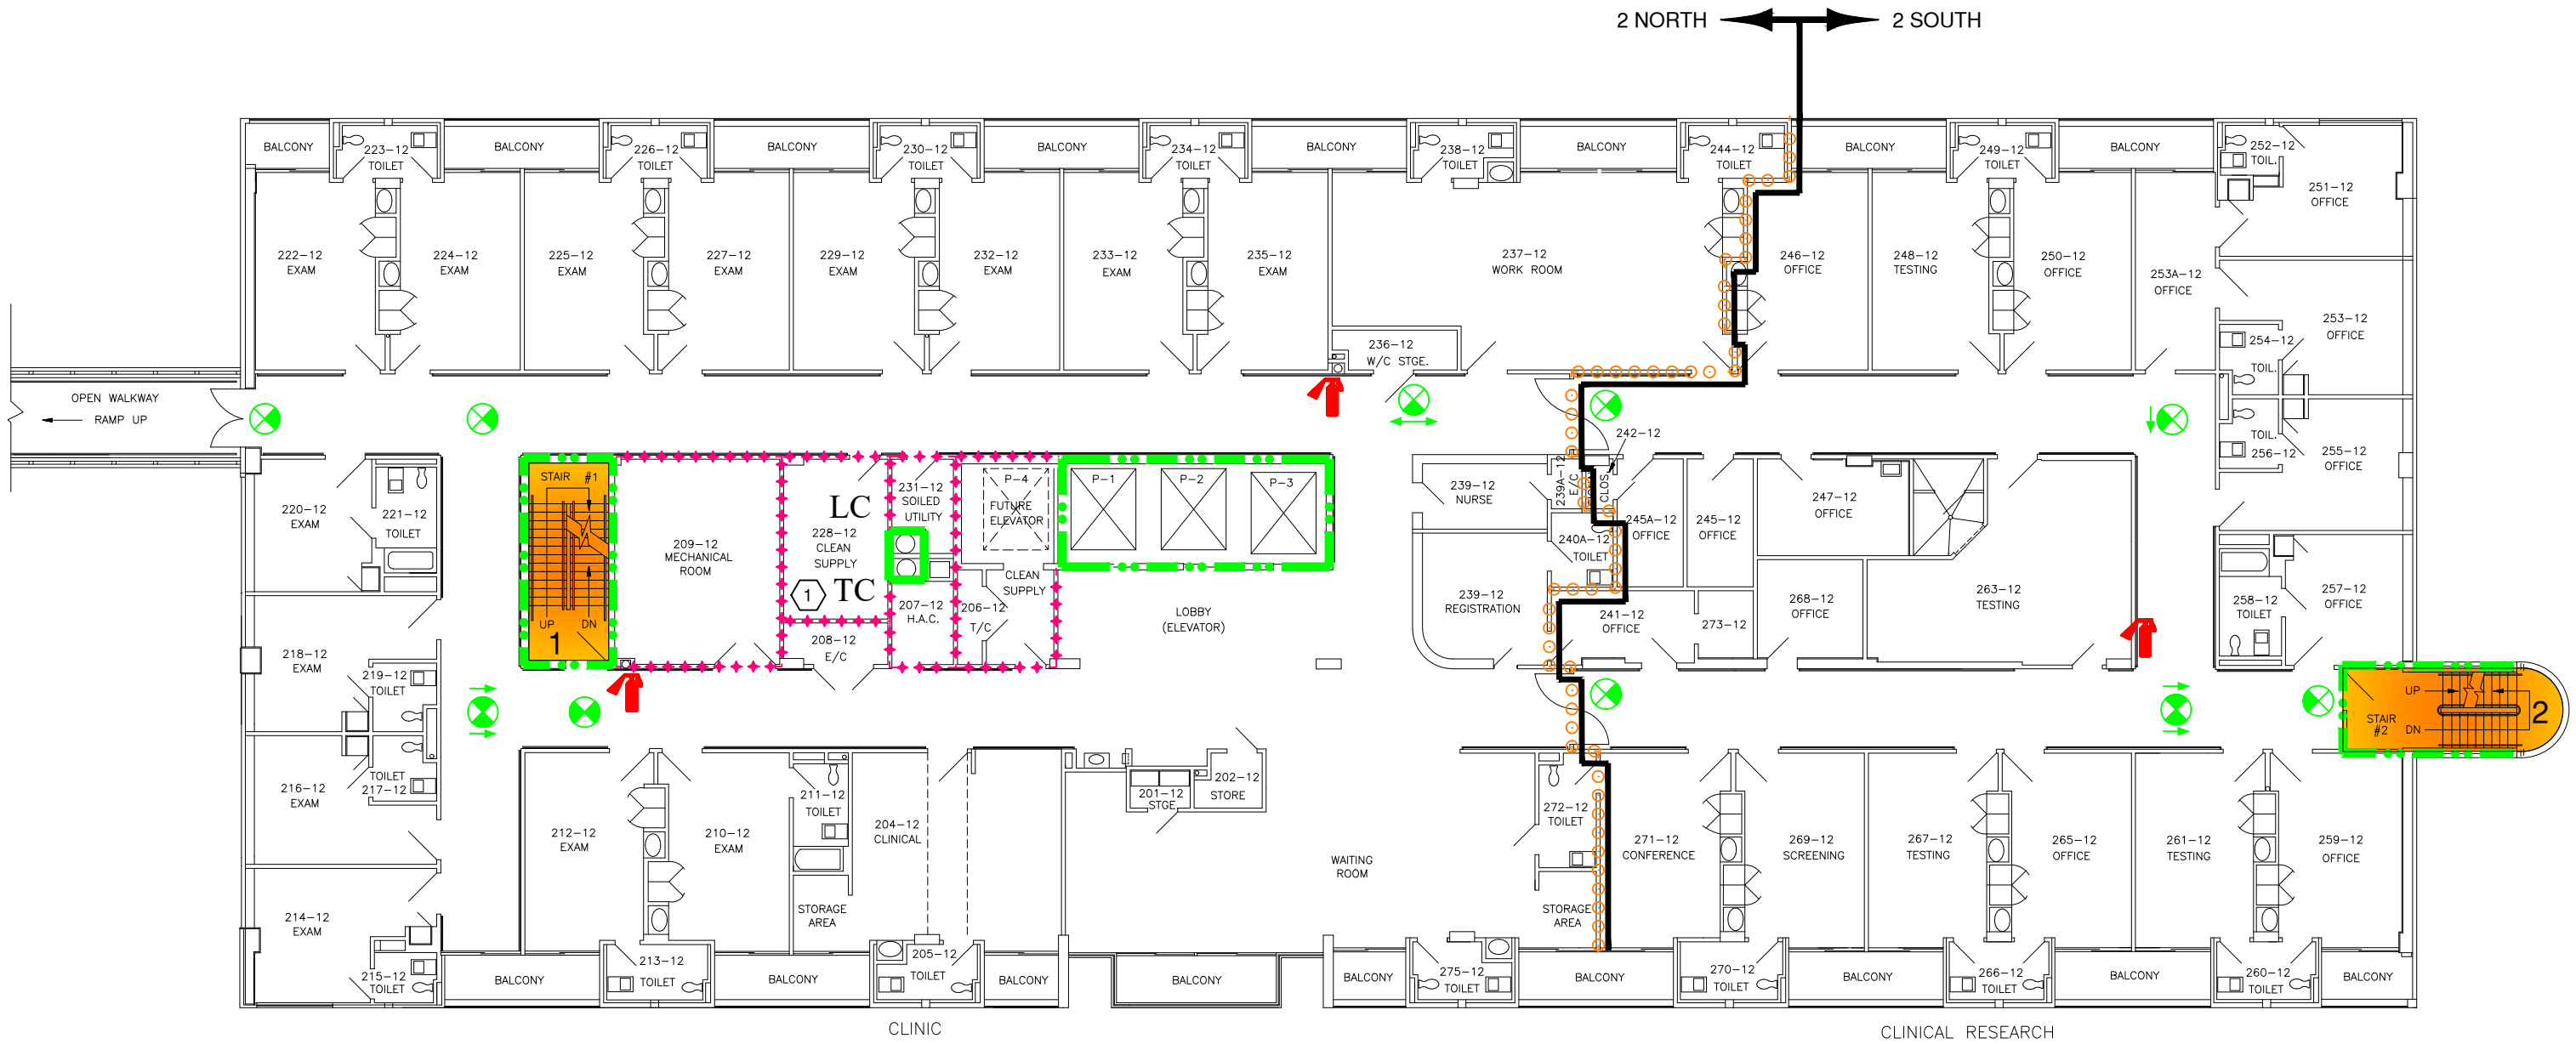

SECOND FLOOR
COMMUNITY LIVING CENTER
FULLY SPRINKLERED
BUSINESS OCCUPANCY

Revisions	Date:
FP&C Project Number: 3032.02	

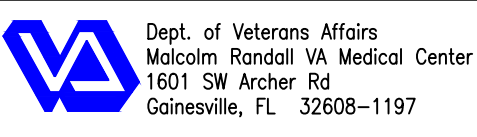

FIRE PROTECTION & CODE
CONSULTANTS, LLC.
1520 MAIN STREET
INDIANAPOLIS, IN 46224
(317)486-5188

Project Title:
**FIRE AND LIFE
SAFETY SURVEY**

Client Project No.
Building No. 12

Contract No.
AutoCAD File Name
LS03-2

Drawing Title
**SECOND FLOOR
COMMUNITY LIVING CENTER**

Designed By
FVO
Location
VA MEDICAL CENTER
GAINESVILLE, FLORIDA

Drawn By
KW/TK

Checked By
FVO

Date
12/28/2018
Scale:

Drawing No.
LS-31
Sht. 33 Of 35

KEY NOTES:


1 TRASH CHUTE OUT OF SERVICE.

PARTITION LEGEND

- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EYEWASH STATION
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EVACUATION CHAIR
- FIRE HOSE VALVE

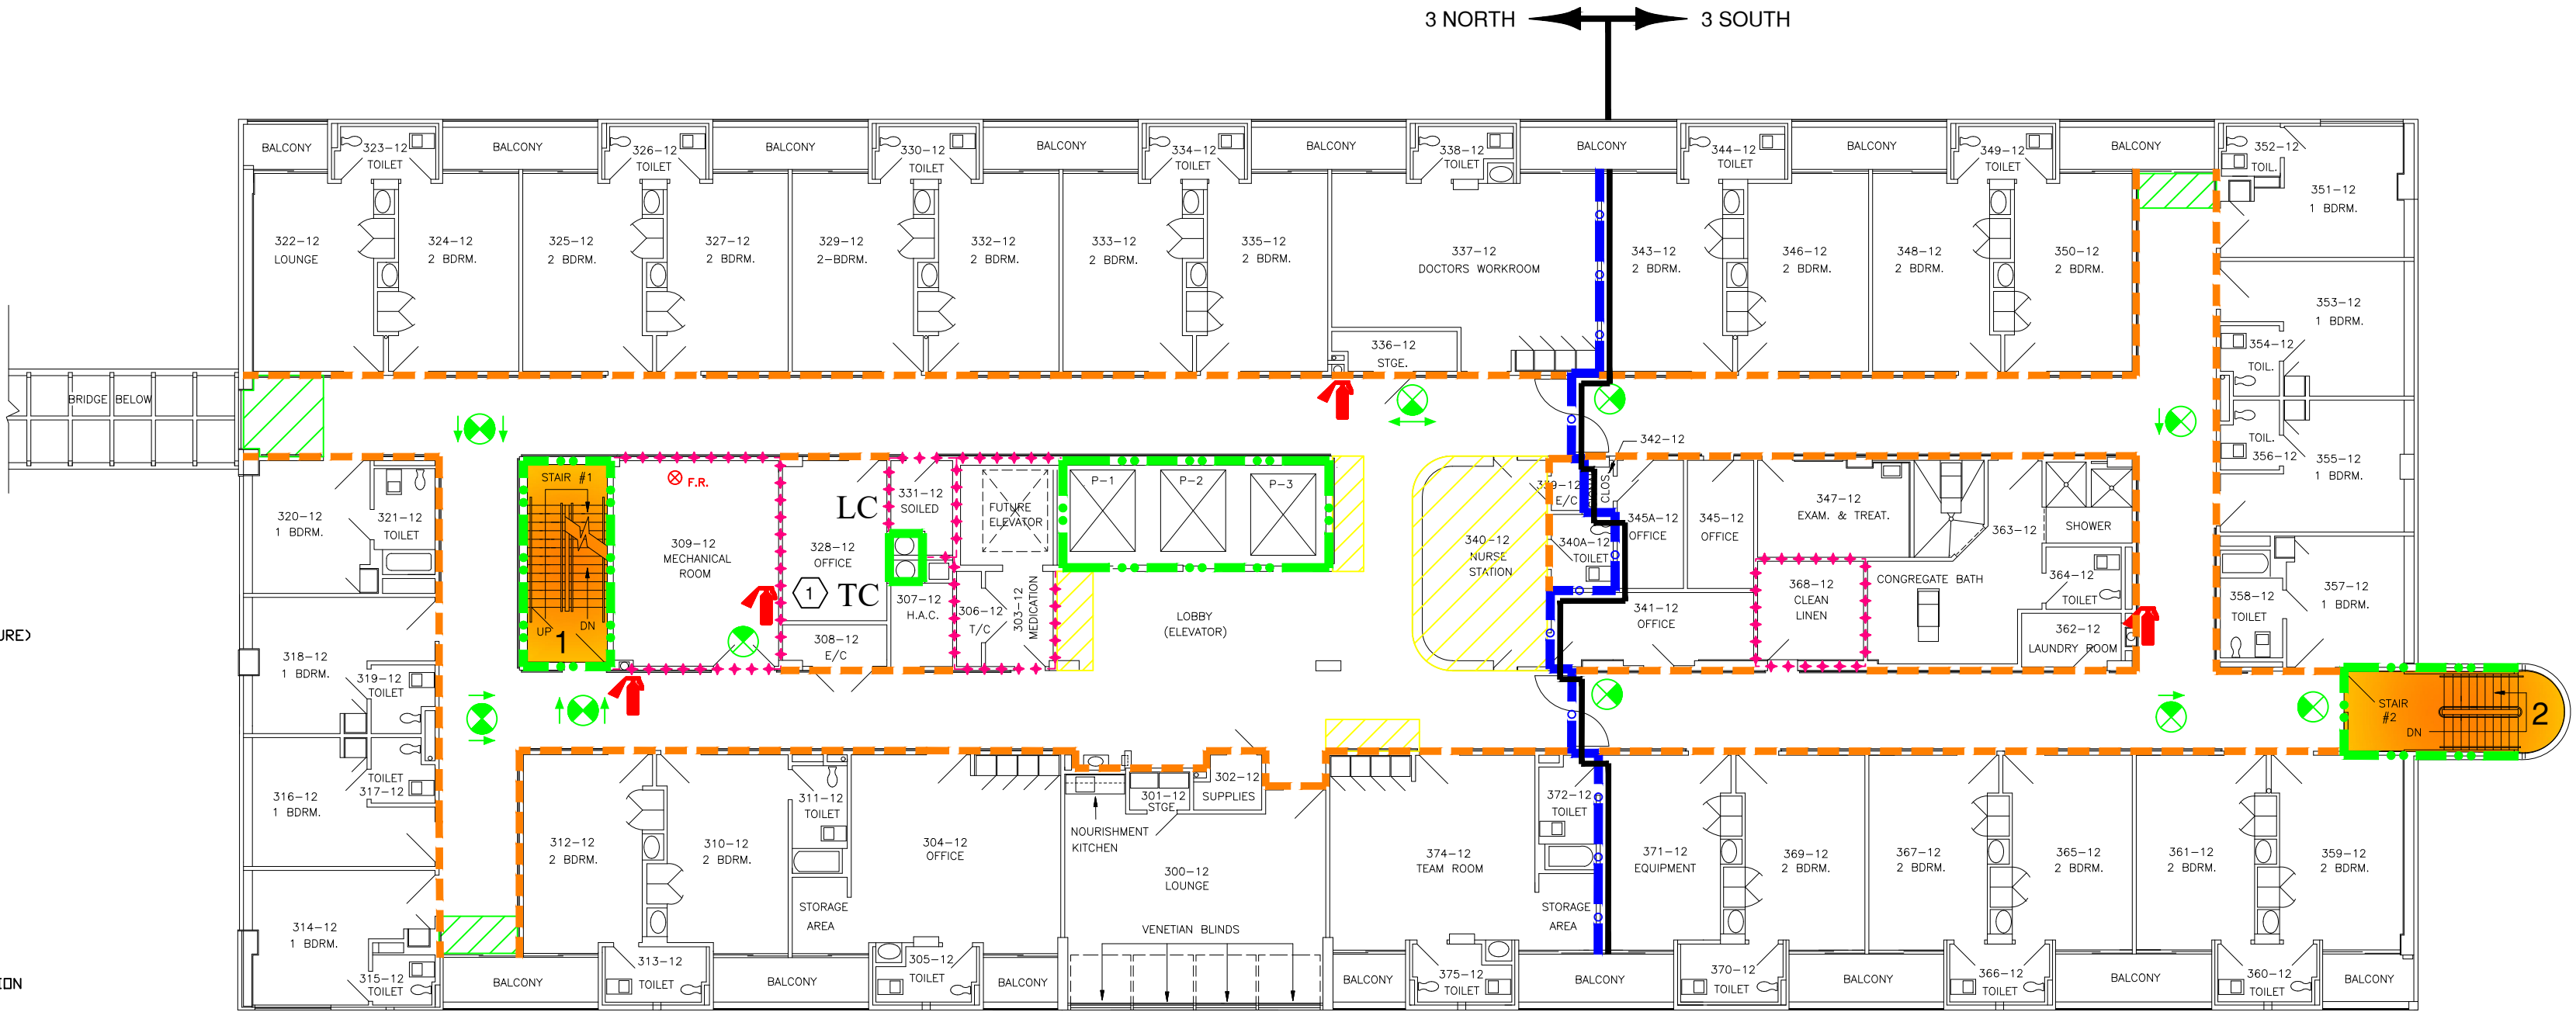

THIRD FLOOR
COMMUNITY LIVING CENTER
FULLY SPRINKLERED
HEALTH CARE OCCUPANCY
(LONG TERM CARE)


Revisions	Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No. Building No. 12	Contract No. AutoCAD File Name LS04-3	Drawing Title THIRD FLOOR COMMUNITY LIVING CENTER	Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-32 Sht. 34 of 35
FP&C Project Number: 3032.02								Location	VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:		

PARTITION LEGEND


- HEALTH CARE OCCUPANCY CORRIDORS
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE PARTITION
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- 2 HOUR FIRE/SMOKE ZONE BARRIER
- SUITE DESIGNATION

SYMBOLS LIST

- HORIZONTAL EXIT PASSAGEWAY
- EXIT
- EXIT PASSAGEWAY
- LINEN CHUTE
- TRASH CHUTE
- AREA OPEN TO CORRIDOR - WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR - NO SMOKE DETECTION REQUIRED
- FIRE EXTINGUISHER
- EXIT SIGN
- EMERGENCY LIGHT
- FIRE ALARM STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- AUTOMATED EXTERNAL DEFIBRILLATOR
- EYEWASH STATION
- SPRINKLER SYSTEM RISER
- SHOWER STATION
- EVACUATION CHAIR
- FIRE HOSE VALVE

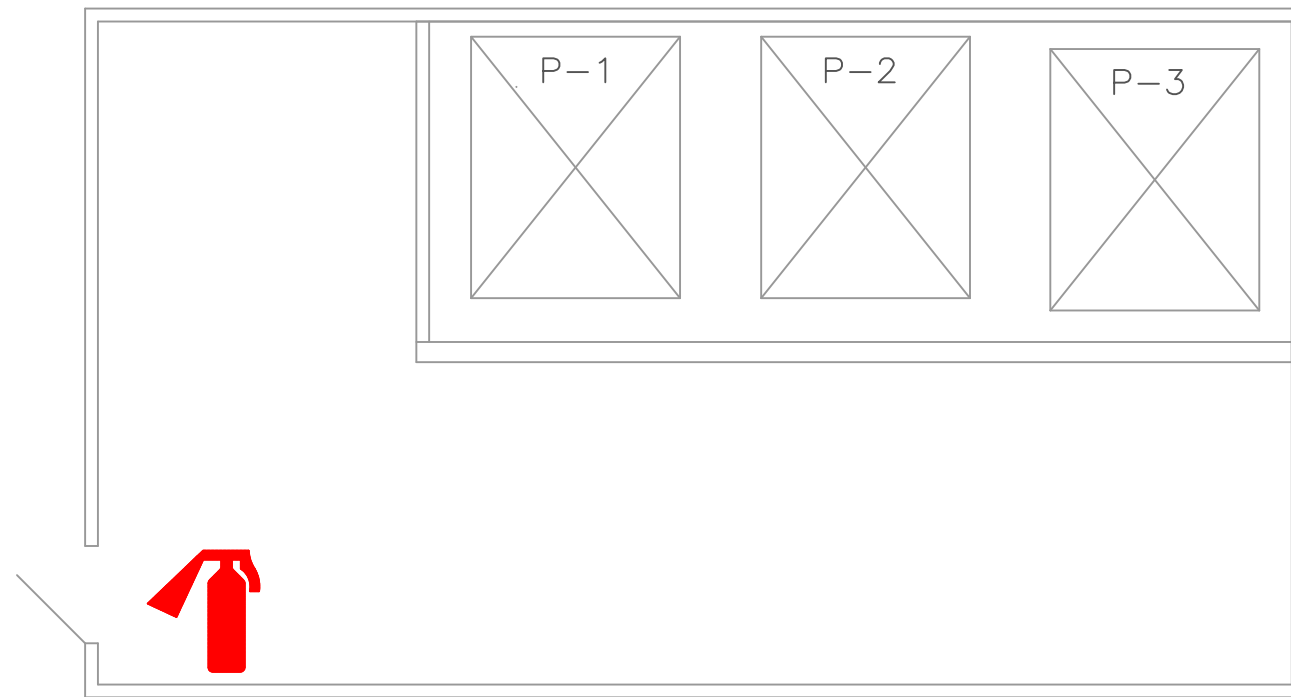

ELEVATOR
PENTHOUSE



PENTHOUSE
COMMUNITY LIVING CENTER
FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

Revisions	Date:	 Dept. of Veterans Affairs Malcolm Randall VA Medical Center 1601 SW Archer Rd Gainesville, FL 32608-1197	 FIRE PROTECTION & CODE CONSULTANTS, LLC. 1520 MAIN STREET INDIANAPOLIS, IN 46224 (317)486-5188	Project Title: FIRE AND LIFE SAFETY SURVEY	Client Project No.	Contract No.	Drawing Title PENTHOUSE COMMUNITY LIVING CENTER	Designed By FVO	Drawn By KW/TK	Checked By FVO	Date 12/28/2018	Drawing No. LS-33
FP&C Project Number: 3032.02					Building No. 12	AutoCAD File Name LS04-PENTHOUSE		Location VA MEDICAL CENTER GAINESVILLE, FLORIDA	Scale:			Sht. 35 of 35