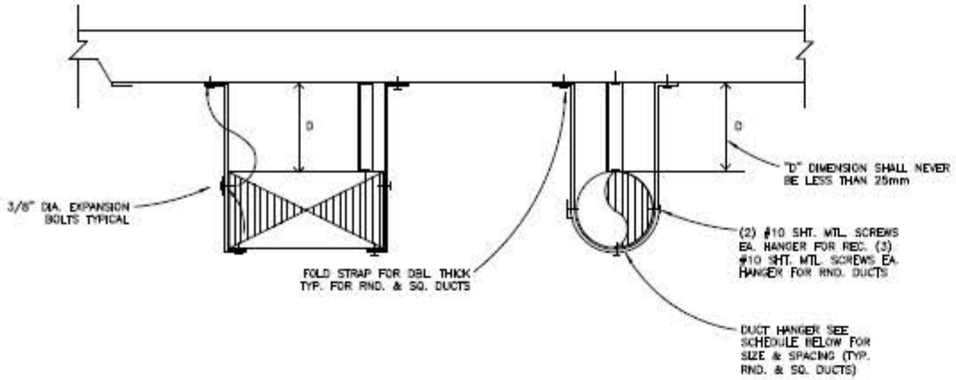

MAX. RECT. DUCT DIM.	MAX. LOAD EA. HANGER	MAX. HANGER SPACING	HANGER SIZE
UP TO 24"	#72	8'	1" x 18 GA.
24" TO 36"	#100	8'	1" x 18 GA.

MAX. ROUND DUCT DIM.	MAX. LOAD EA. HANGER	MAX. HANGER SPACING	HANGER SIZE
UP TO 9"ø	#24	8'	1" x 18 GA.
24 TO 26"ø	#96	8'	1" x 18 GA.

1 VARIES M-504 DUCT SUPPORT DETAIL
NOT TO SCALE

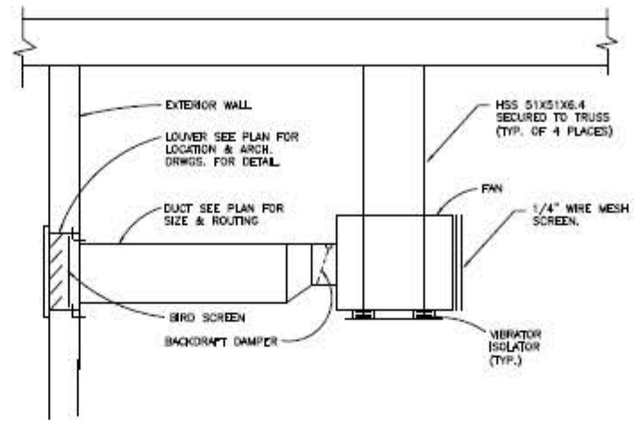

2 VARIES M-504 CABINET FAN SUSPENSION DETAIL
NOT TO SCALE

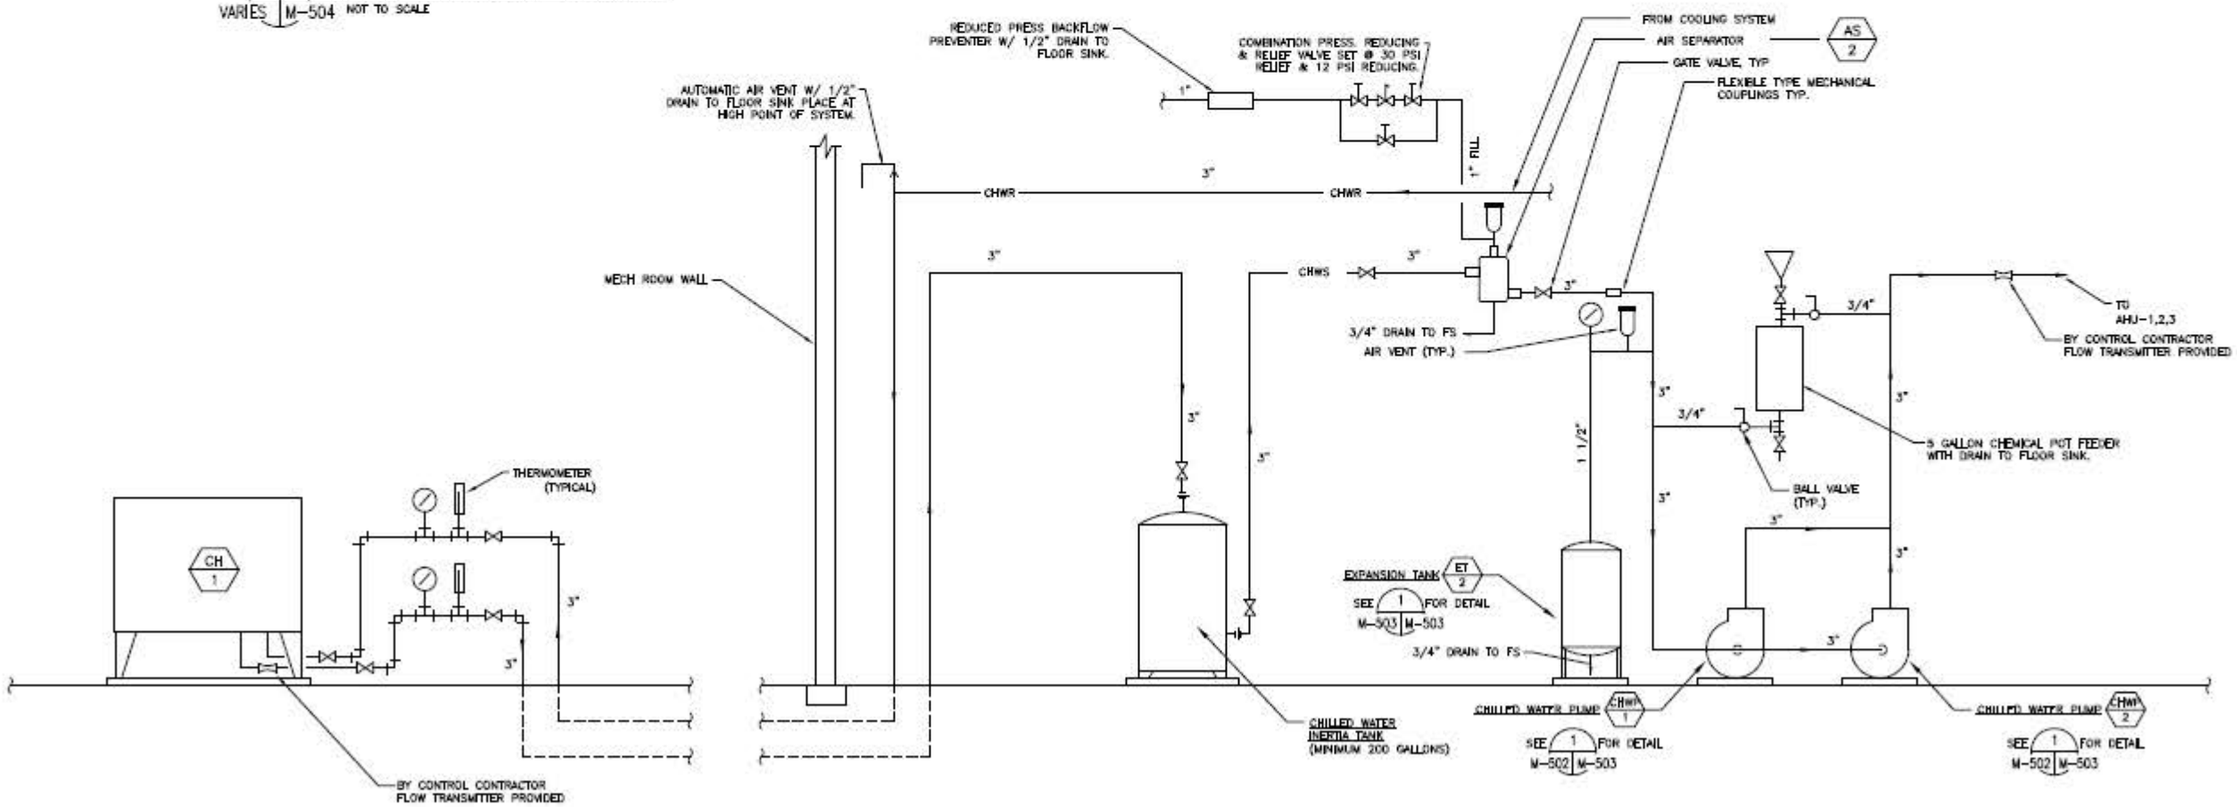

4 VARIES M-504 CHILLED WATER PIPING DETAIL
NOT TO SCALE

NAVFAC

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING COMMAND – MID-ATLANTIC
NAVAL FACILITIES ENGINEERING COMMAND
MARINE CORPS BASE CAMP LEJEUNE
MCB CAMP LEJEUNE, NORTH CAROLINA
JACKSONVILLE, NORTH CAROLINA
FY09 BACHELOR ENLISTED QUARTERS
COURT HOUSE BAY P-1142

MECHANICAL DETAILS

CODE ID. NO. | SIZE D
SCALE AS INDICATED
MMRO NO. –
AS BUILT NO. –
WORK ORDER NO. –
CONTR. DOWN NO. N40085-09-R-3215
DRAFTING DRAWING NO. 12084087
SHEET 181 OF 250
SHEET NO.

REGISTERED PROFESSIONAL ENGINEER
EXP. DEC. 31, 2011
STATE OF CALIFORNIA

DES	MJS	DRW	RT	CHK	MJS
FIRE PROTECTION					
SERVICE MANAGER					
CHIEF ENGINEER					

NOVEMBER 2011 COURT HOUSE BAY RECORD DRAWINGS

SAUEVED ENGINEERING CONSULTING MECHANICAL ENGINEERS