


SYM	REVISIONS	DATE	APPROVED

CONSTRUCTION NOTES:

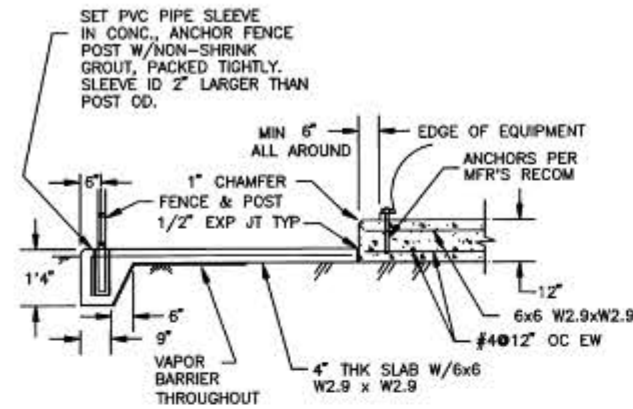

1
M1M1
CONCRETE PAD SECTION
SCALE 1/2"=1'-0"

1. PROVIDE CHILLER COMPOUND ENLARGEMENT AND EQUIPMENT PAD.
2. PROVIDE CHILLER. PROVIDE NEW AND MODIFY EXISTING PIPING TO CHILLERS. CHILLER TO BE :
MINIMUM 112 TONS @ 54°F EWT, 40°F LWT,
192 GPM, 95°F EAT, MAXIMUM WATER PRESSURE
DROP-7', 460V/3ø/60Hz
MINIMUM ADJUSTED EFFICIENCY SHALL BE .98KW/TN,
AS CALCULATED BY:

$$.2 \text{ KW/TN} @ 100\% \text{ CAPACITY}$$

$$+ .3 \text{ KW/TN} @ 85\% \text{ CAPACITY}$$



$$+ .3 \text{ KW/TN} @ 65\% \text{ CAPACITY}$$

$$+ .2 \text{ KW/TN} @ 35\% \text{ CAPACITY}$$

$$= \text{KW/TN ADJUSTED}$$

EFFICIENCY SHALL INCLUDE CONDENSER FAN ENERGY.
3. REUSE EXISTING CHILLED WATER PUMP. TEST, ADJUST, AND BALANCE WATER FLOW FOR 575 GPM @ 107" DISCHARGE HEAD. AFTER TOTAL SYSTEM BALANCE, TRIM IMPELLOR TO ACTUAL CONDITIONS + 10% DISCHARGE PRESSURE. EXISTING PUMP IS ARMSTRONG 3/4/10, MODEL 4600, 3485 RPM.

4. REUSE EXISTING HOT WATER PUMP. MODIFY AS FOLLOWS:
REMOVE EXISTING 25 HP MOTOR AND PROVIDE 10 HP 1750 RPM MOTOR. PROVIDE SHIMS AND ADAPTERS TO CONVERT MOTOR FRAME SIZES. PROVIDE NEW IMPELLOR FOR 380 GPM @ 60' DISCHARGE HEAD. TEST, ADJUST, AND BALANCE WATER FLOW. AFTER TOTAL SYSTEM BALANCE, TRIM IMPELLOR TO ACTUAL CONDITIONS + 10% DISCHARGE PRESSURE. EXISTING PUMP IS ARMSTRONG 3/4/10, MODEL 4600, 3485 RPM.
5. RELOCATE FENCE TO ENLARGE CHILLER COMPOUND. PROVIDE NEW POSTS. REMOVE EXISTING POSTS AND FILL HOLES WITH NONSHRINK GROUT.
6. REGRADE AREA AROUND CHILLER COMPOUND ENLARGEMENT TO PROVIDE DRAINAGE TO EXISTING CATCH BASIN
- 7) PROVIDE MODIFICATIONS TO EXISTING ENERGY MONITORING AND CONTROL SYSTEM (EMCS). PROVIDE WATER TEMPERATURE SENSORS IN THE SUPPLY AND RETURN WATER TO EACH OF THE CHILLERS (2 EXISTING AND 1 NEW). PROVIDE DEMAND LIMIT ON NEW CHILLER, (ON/OFF FOR EACH COMPRESSOR CIRCUIT). PROVIDE CONDUCTORS AND CONDUIT TO DTC. FINAL CONNECTION BETWEEN EXISTING DTC AND EXISTING IMUX WILL BE MADE BY THE GOVERNMENT.

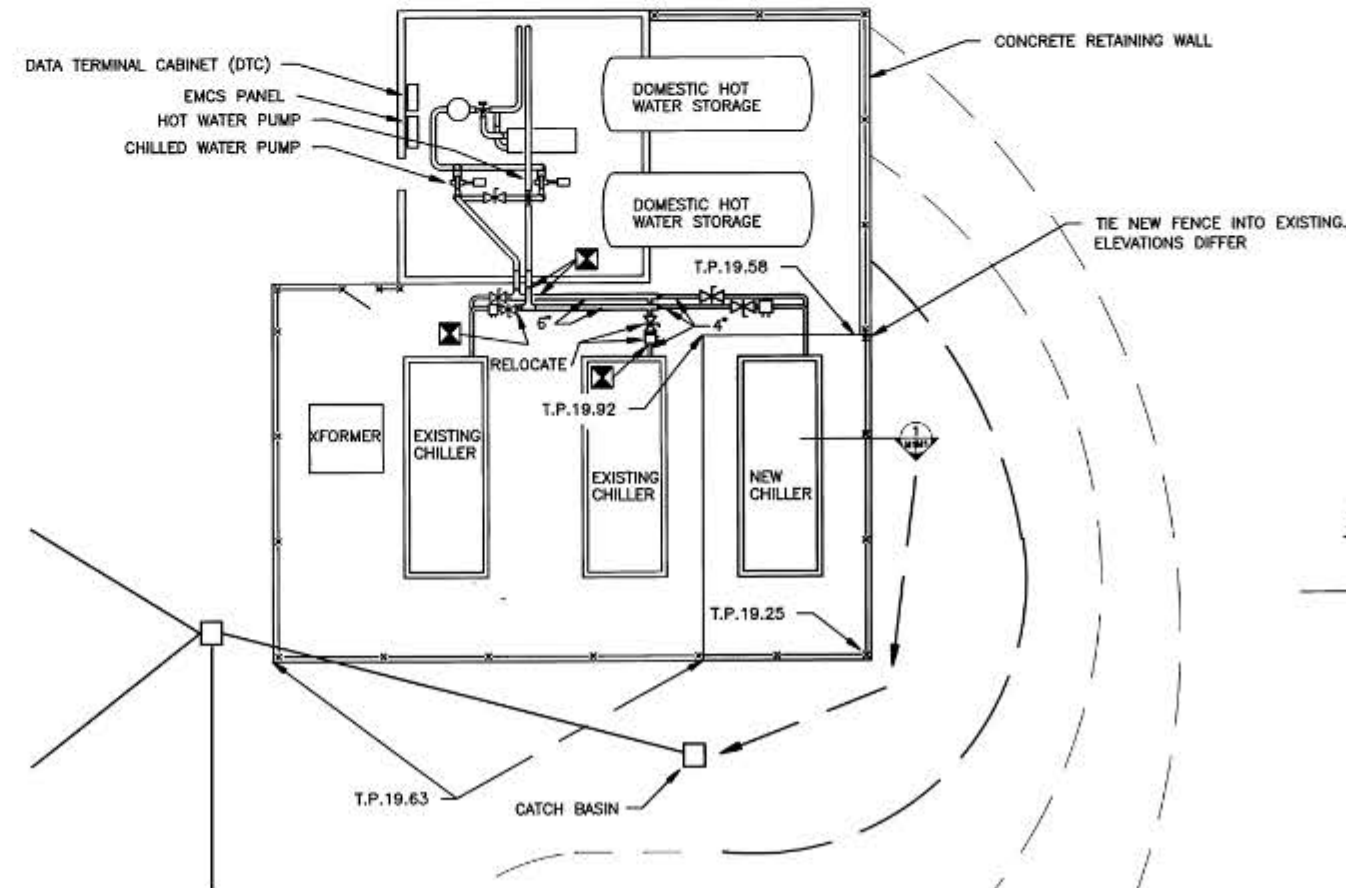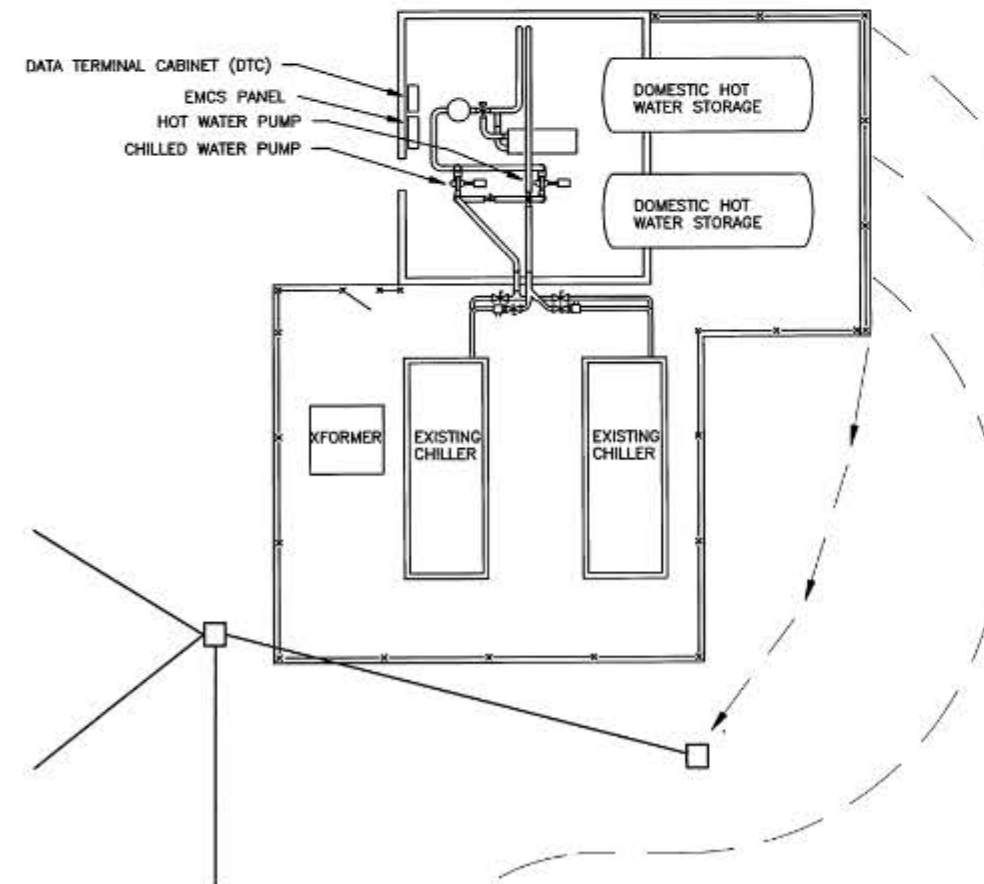

LEGEND

- 6' HIGH CHAIN LINK FENCE
- T.P.19.25 TOP OF PAVEMENT ELEVATION
- CONTOUR LINES
- PROVIDE NEW TO THIS POINT