

ISAF PROJECT NO. 011116 20-1012


FILE NAME: V:\DDONIS\Moron\B\2024_1679361_P1012 EDI Munitions Storage\B_Design\DWGS\Sheet\07_STRUCT\15-501 TYPICAL DETAILS.dwg LAYOUT NAME: S-501 TYPICAL DETAILS PLOTTED: Tuesday, February 03, 2026 - 9:14am USER: iselle.corsino

D

C


B

A

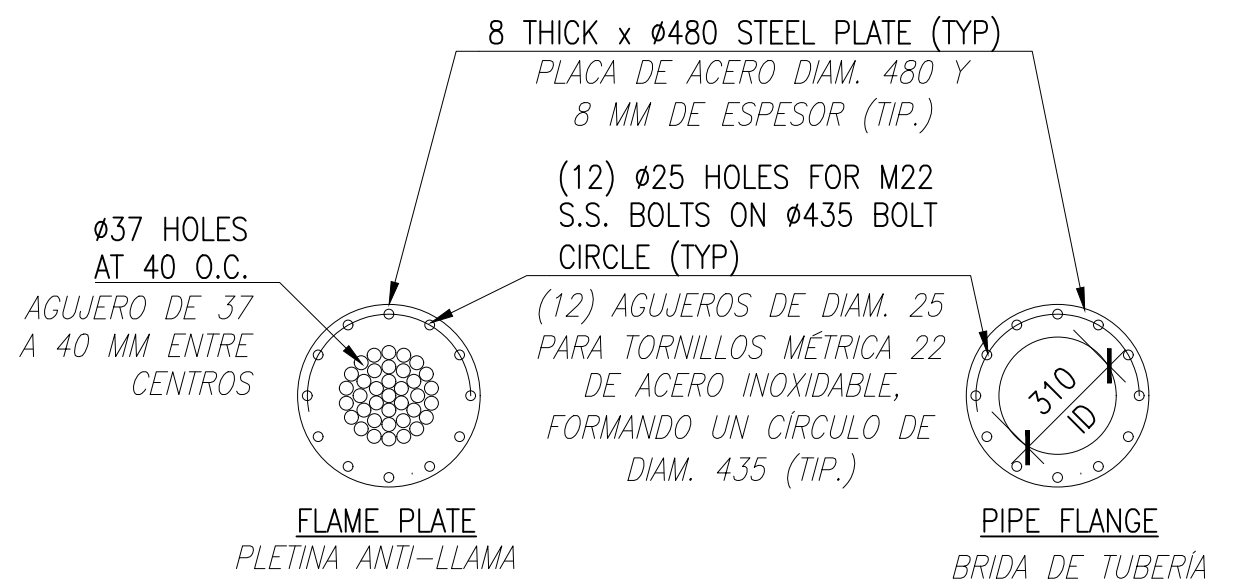

VENTILATOR FLAME PLATE DETAIL DETALLE DE PLETINA


A **ANTI-LLAMA DE VENTEO**
SCALE: 1:20

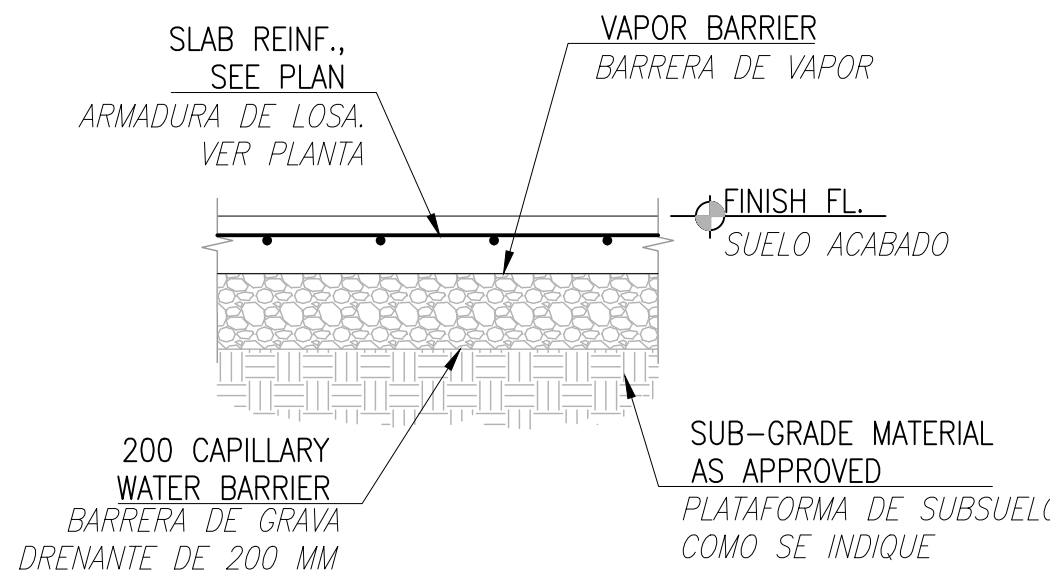

SLAB-ON-GRADE DETAILS DETALLES DE LOSA SOBRE EL

B **TERRENO**
SCALE: 1:20

NOTES: REFER TO GEOTECHNICAL REPORT FOR THE SUBGRADE PREPARATION AND EARTHWORK RECOMMENDATIONS
NOTAS: REFERIRSE AL INFORME DE GEOTECNIA PARA LA PREPARACIÓN DEL SUBSUELO Y RECOMENDACIONES DE MOVIMIENTO DE TIERRAS

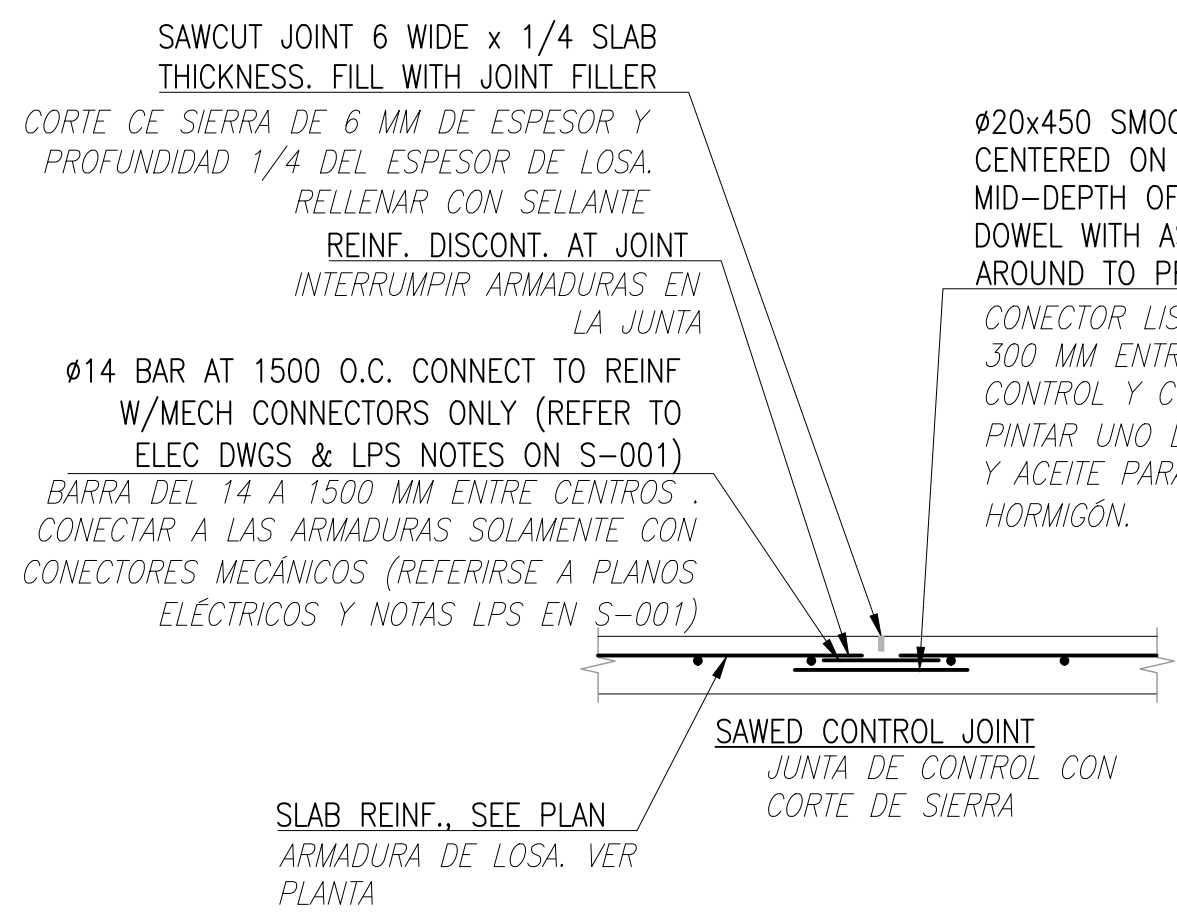


SLAB CONTROL JOINT DETAIL DETALLE DE JUNTA DE CONTROL EN LOSA

SCALE: 1:20
NOTE: USE EITHER AT CONTRACTOR'S OPTION SAWCUT JOINTS AS EARLY AS ALLOWED HAND-TOOL AREAS INACCESSIBLE BY SAW
NOTA: REALIZAR AL CRITERIO DEL CONTRATISTA LOS CORTES DE SIERRA TAN PRONTO COMO SE PUEDAN REALIZAR. REALIZARLOS CON ÚTILES MANUALES EN ZONAS INACCESIBLES A LA SIERRA.

SPlice LENGTHS						DEVELOPMENT LENGTHS	
BAR SIZE	C30/37 (f _{ck} = 30 MPa)					C30/37 (f _{ck} = 30 MPa)	
	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS		TOP BARS	OTHER BARS
Ø10	500	650	380	500		500	380
Ø12	600	770	460	600		600	460
Ø14	700	900	540	700		700	540
Ø16	790	1050	610	790		790	610
Ø20	1250	1610	950	1250		1250	950
Ø25	1550	2010	1200	1550		1550	1200
Ø28	1750	2250	1350	1750		1750	1350

TOP BARS ARE HORIZONTAL REINF. WITH MORE THAN 300 ON CONCRETE CAST BELOW THE REINF.
CONCRETE LAP LENGTHS MUST BE INCREASED 20 PERCENT WHERE EPOXY COATING IS USED.
WHEN LAPPING TWO DIFFERENT SIZE BARS, USE THE LARGER OF THE LAP SPlice DIMENSION OF THE SMALLER BAR OR THE DEVELOPMENT LENGTH OF THE LARGER BARS.


LAS BARRAS SUPERIORES SE ENTIENDEN LAS HORIZONTALES CON MÁS DE 300 mm DE HORMIGÓN POR DEBAJO.
LA LONGITUD DE SOLAPE SE DEBERÁ INCREMENTAR UN 20% CUANDO SE UTILICEN ARMADURAS RECUBIERTAS CON EPOXY.
CUANDO SE SOLAPEN DOS BARRAS DE DISTINTO TAMAÑO, UTILIZAR LA DIMENSIÓN MAYOR ENTRE LA LONGITUD DE SOLAPE DE LA BARRA MENOR Y LA LONGITUD DE ANCLAJE DE LA BARRA MAYOR.

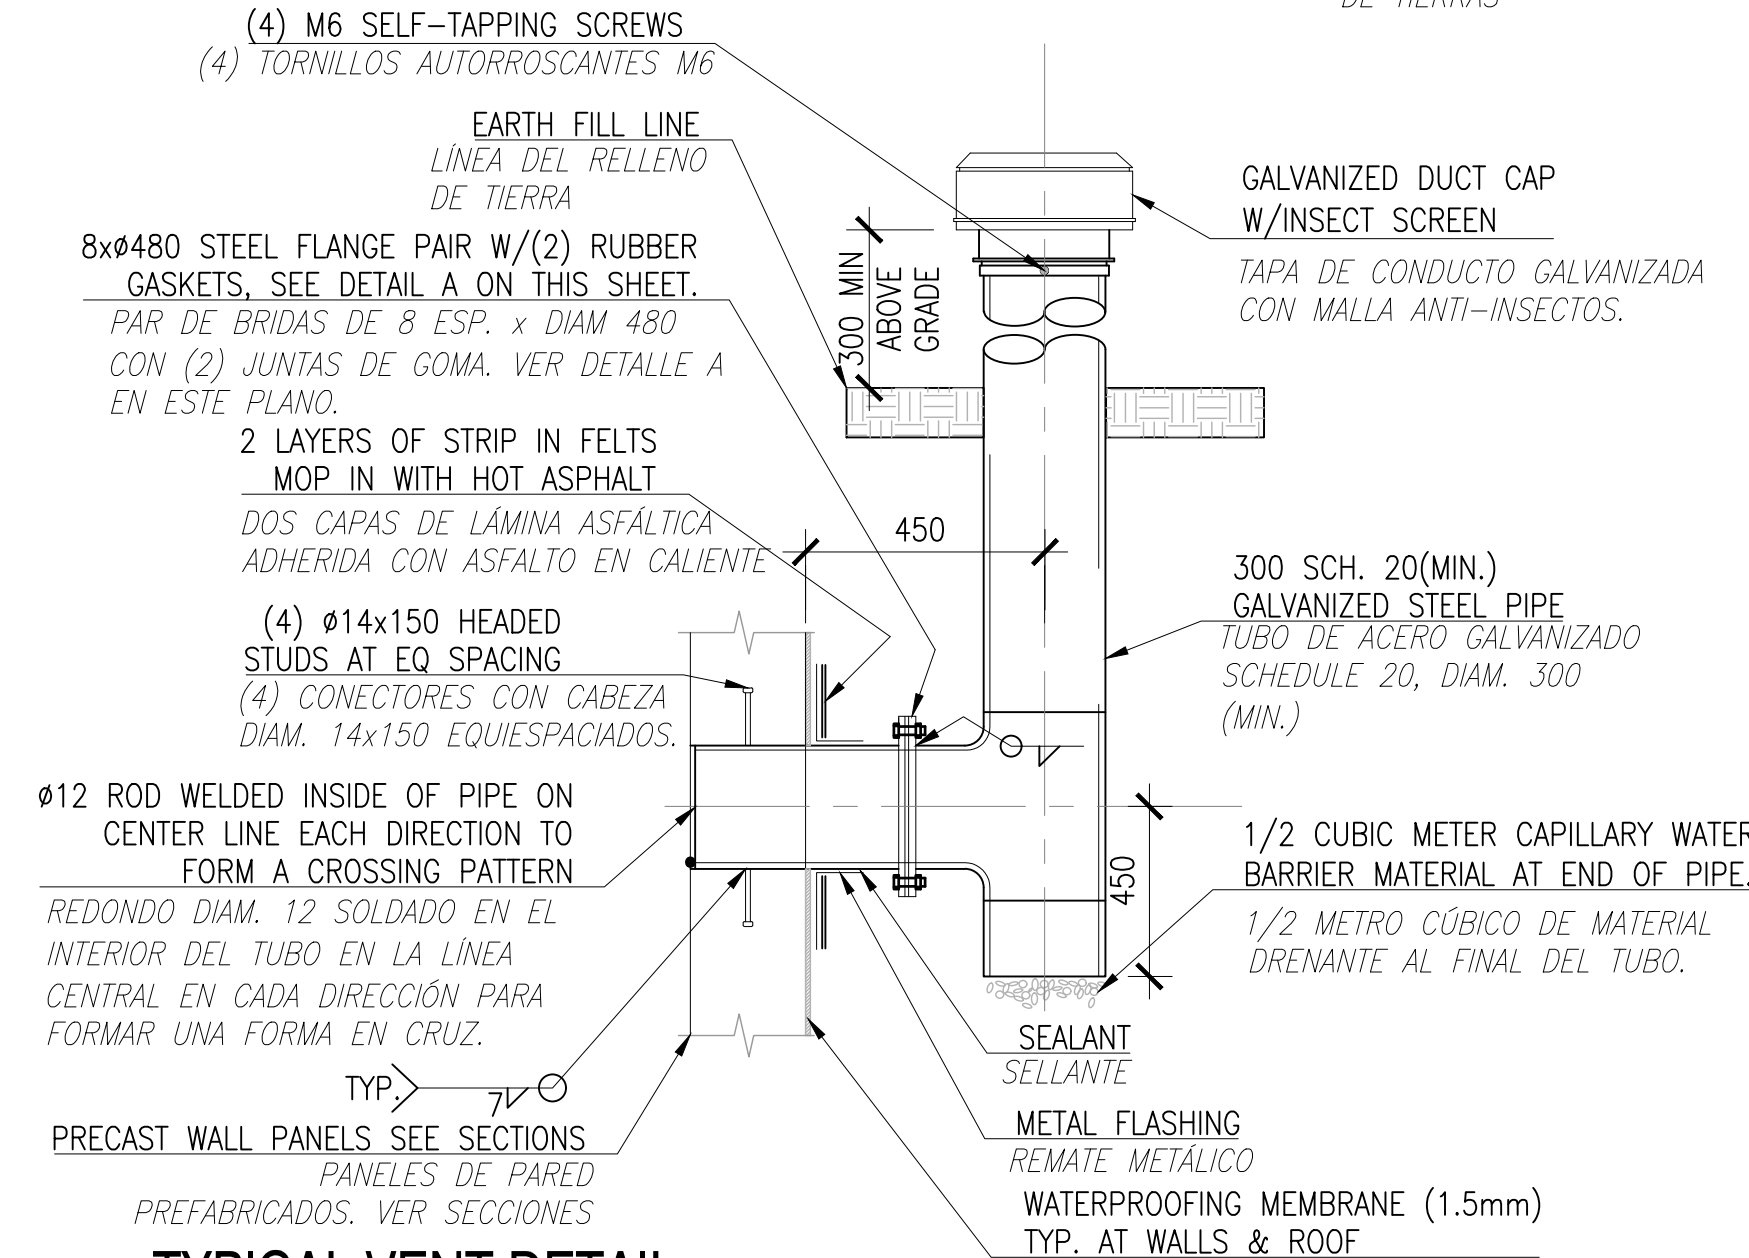

TYPICAL VENT DETAIL DETALLE TÍPICO DE VENTEO

D SCALE: 1:20

NOTE: PROVIDE ELECTRICAL CONTINUITY BY WELDING VERTICAL AND HORZ. REINFORCEMENT TO VENT PIPE
NOTA: PROVEER CONTINUIDAD ELÉCTRICA SOLDANDO LAS ARMADURAS HORIZONTALES Y VERTICALES AL TUBO DEL VENTEO.

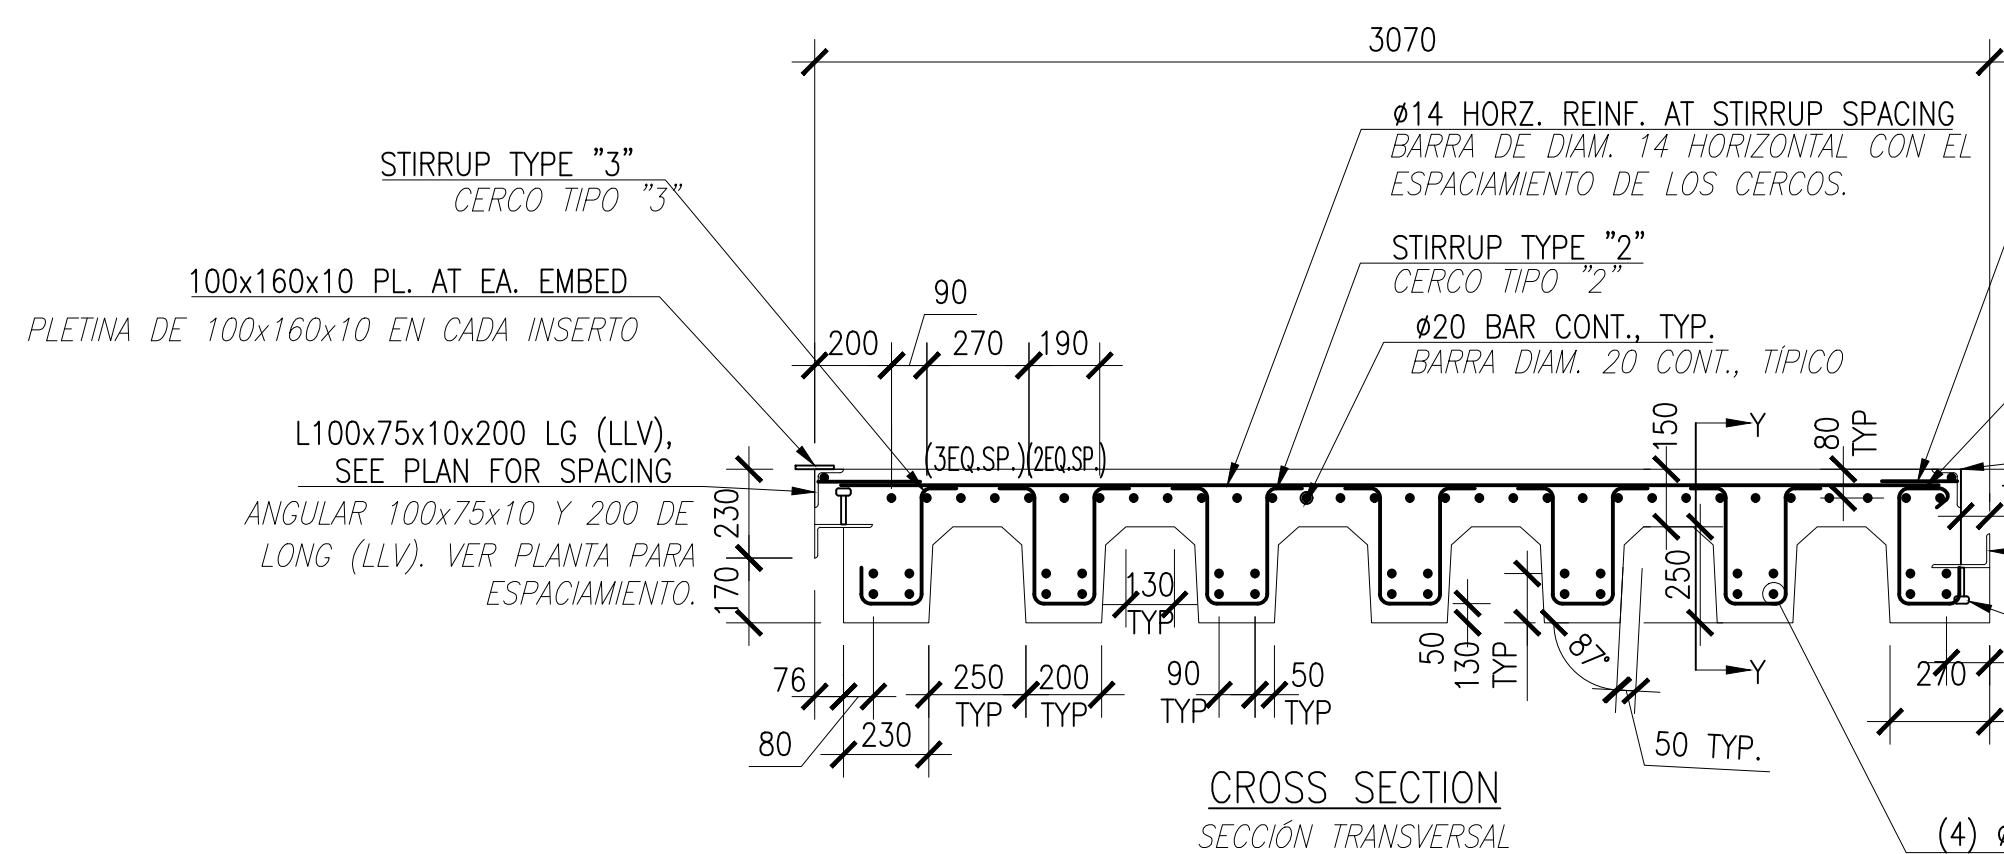


PRECAST ROOF PANEL DETAIL DETALLE DE PANEL PREFABRICADO DE CUBIERTA

E SCALE: 1:20


NOTES: PROVIDE ELECTRICAL CONTINUITY WITHIN THE PRECAST ROOF PANEL BY BONDING AT 1500 INTERVALS ACROSS TOP OF STIRRUPS TO END ANGLES IN ONE DIRECTION. IN THE OTHER DIRECTION, FROM BOTTOM PLATE TO Ø14 REINFORCEMENT. BOND REINFORCEMENT TO REINFORCEMENT USING MECHANICAL CONNECTORS ONLY (SEE ELEC DWGS & LPS NOTES ON S-001).

PROVEER CONTINUIDAD ELÉCTRICA EN EL INTERIOR DEL PANEL PREFABRICADO DE CUBIERTA MEDIANTE CONEXIONES A TRAVÉS DE LA PARTE SUPERIOR DE LOS CERCOS HASTA EL ANGULAR EN EL EXTREMO EN UNA DIRECCIÓN. EN LA OTRA DIRECCIÓN, DESDE LA PLETINA DE FONDO A LAS ARMADURAS DE DIAM. 14. UNIR ARMADURAS CON ARMADURAS UTILIZANDO CONECTORES MECÁNICOS SOLAMENTE (VER PLANOS ELÉCTRICOS Y NOTAS LPS EN S-001).

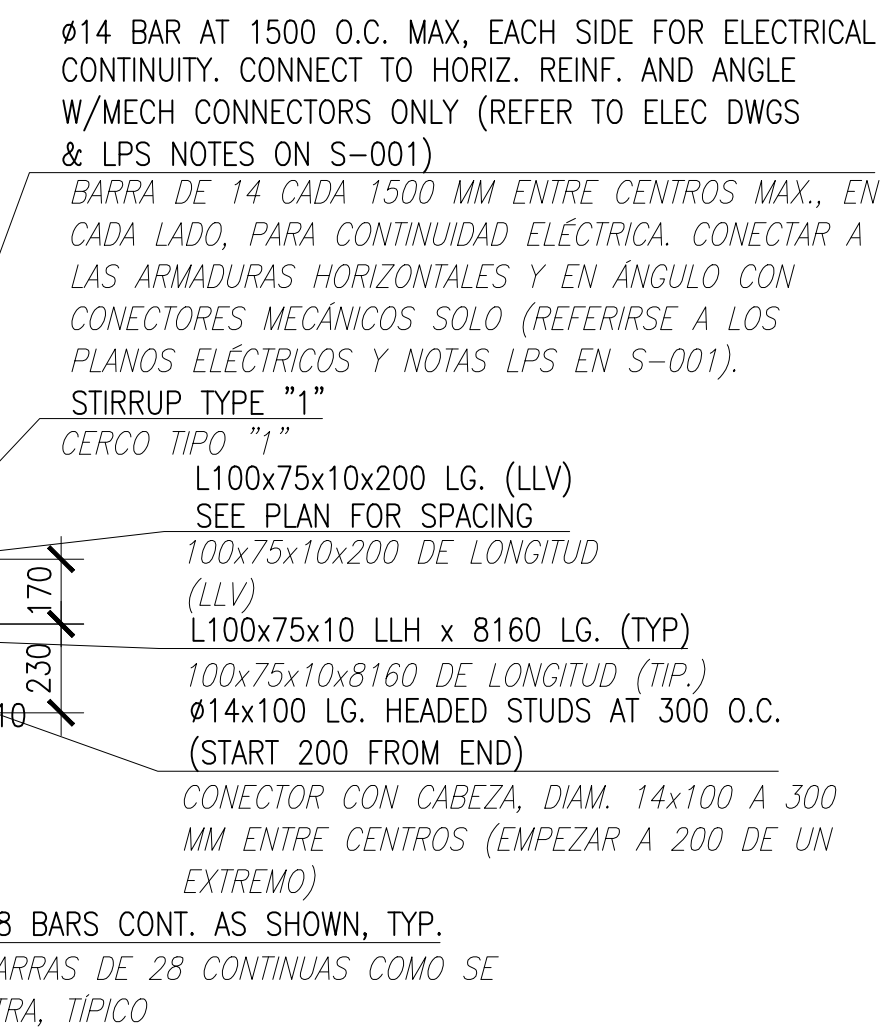


DEPTH GAUGE DETAIL DETALLE DE CALIBRE DE PROFUNDIDAD

F SCALE: 1:20

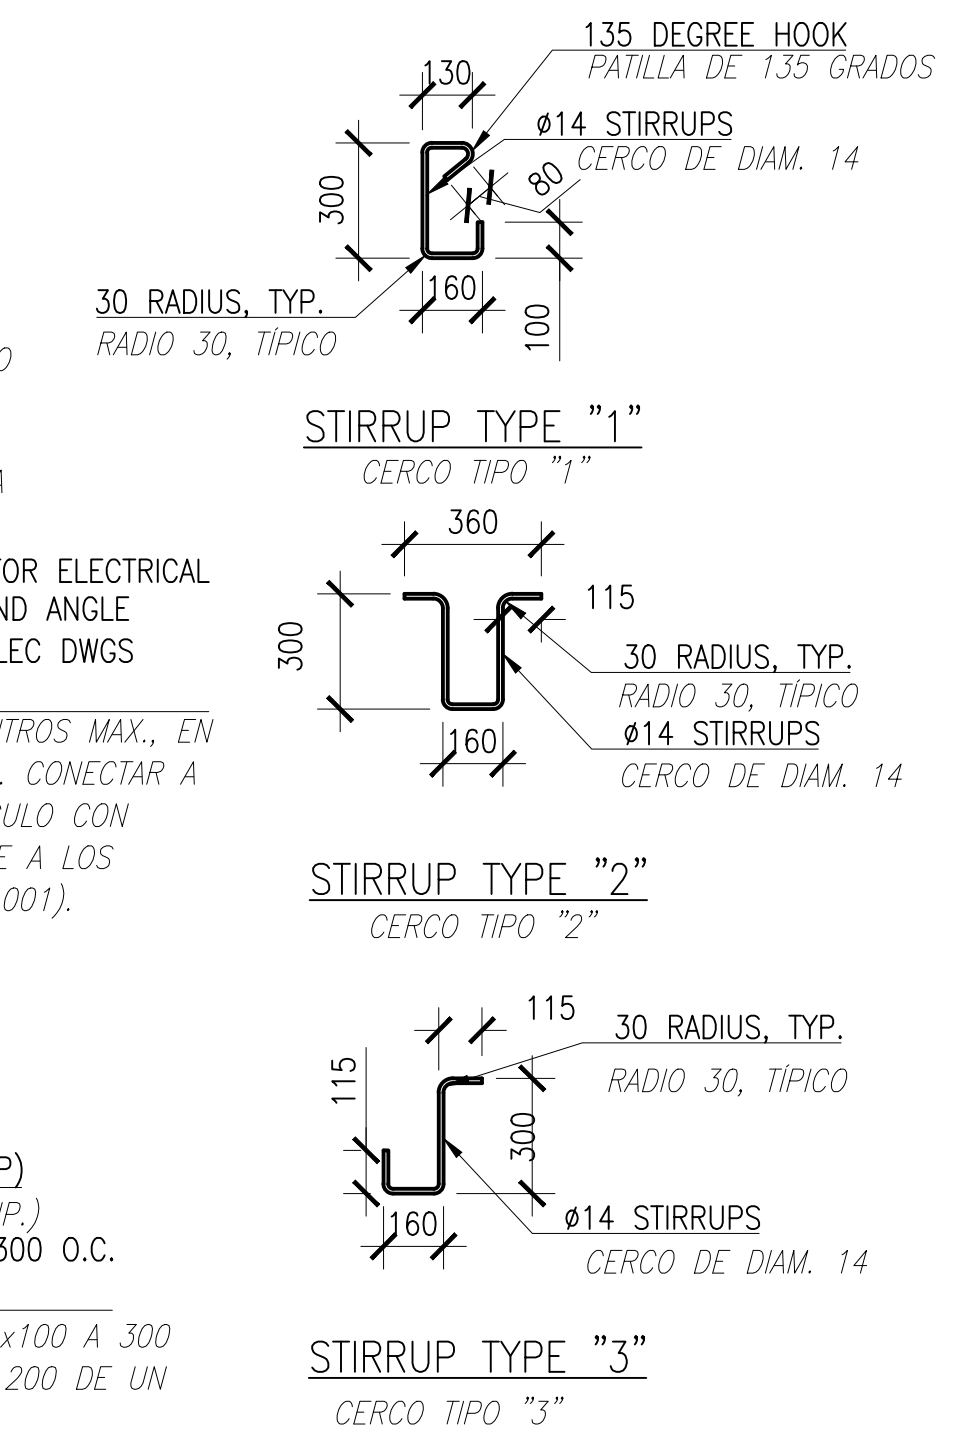

GRAPHIC SCALE ESCALA GRÁFICA

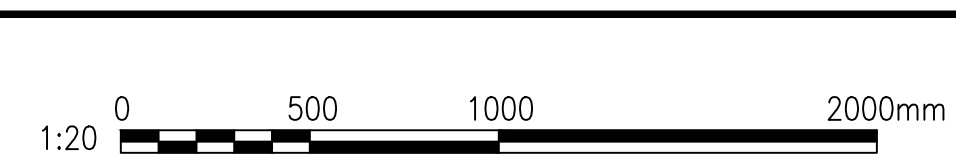

APPROVED

FOR COMMANDER NAFAC

ACTIVITY

APPROVED BY CAPT JARRETT KRISTOPHER USAF VIA SAT-TO FORM

SATISFACTORY TO DATE 2024.04.26

DES LGC DRW LGC CHK JTW

PM/DM LMM/SMD

BRANCH MANAGER JTW

DESIGN DIRECTOR RICHARD L STEPHENS, P.E. JTW

FIRE PROTECTION ENGINEER DPS

NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND

NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - ATLANTIC

ATLANTIC DESIGN AND CONSTRUCTION

MORON AIR BASE

MORON, SPAIN

P-1012 EDI MUNITIONS STORAGE

TYPICAL DETAILS

DETALLES TÍPICOS

SCALE: AS NOTED

PROJECT NO.: 1679361

CONSTR. CONTR. NO.

NAVFAC DRAWING NO. 14119066

SHEET 122 OF 177

S-501

USAF PROJECT NO. QUIG 20-102

NAVFAC METRIC DRAWING REVISION: 01 OCTOBER 2018