

Fire Hydrant and PIV Locations for 630A4-26-406 [12-18-2025]



Pump House: knocked over hydrant



Empty Field Near Pump House: Hydrant, not functional




Building 89 Loading Dock: PIV, not functional



Building 89 Loading Dock: Fire Hydrant 1, not functional



Building 89 Loading Dock: Fire Hydrant 1 Isolation Valve, to be replaced

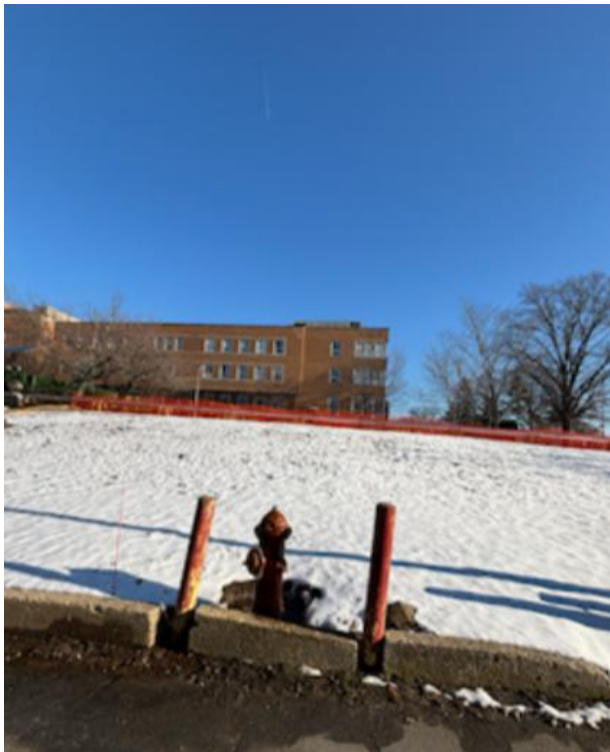

Building 89 Loading Dock: Fire Hydrant 2, not functional



Building 64 Boiler Plant: PIV, not functional



Building 64 Boiler Plant: Fire Hydrant, knocked over



Building 85: Damaged Fire Hydrant



Building 89 West-side Parking Lot: PIV, not functional