



A proposal for temp power ground fault protection for personnel

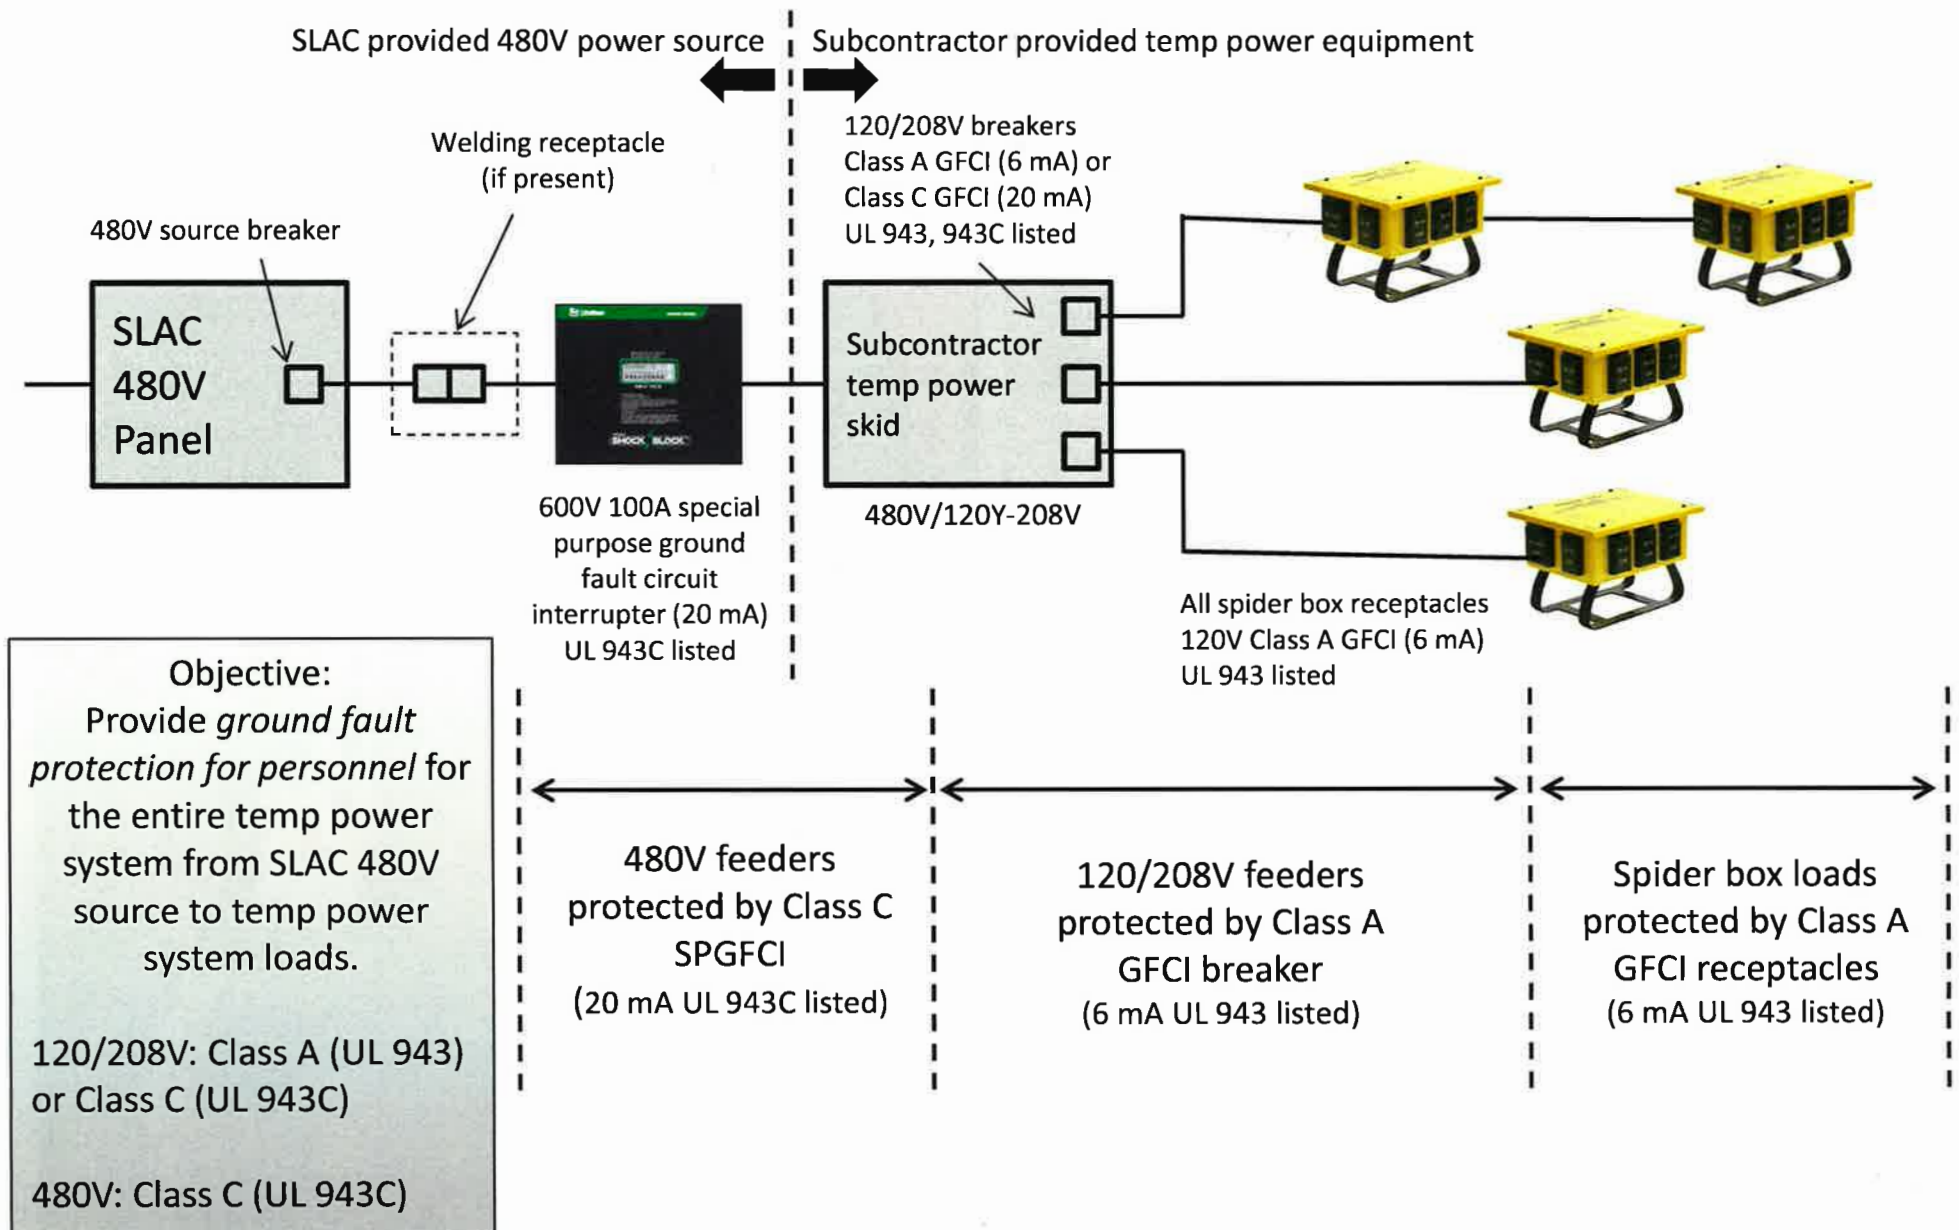

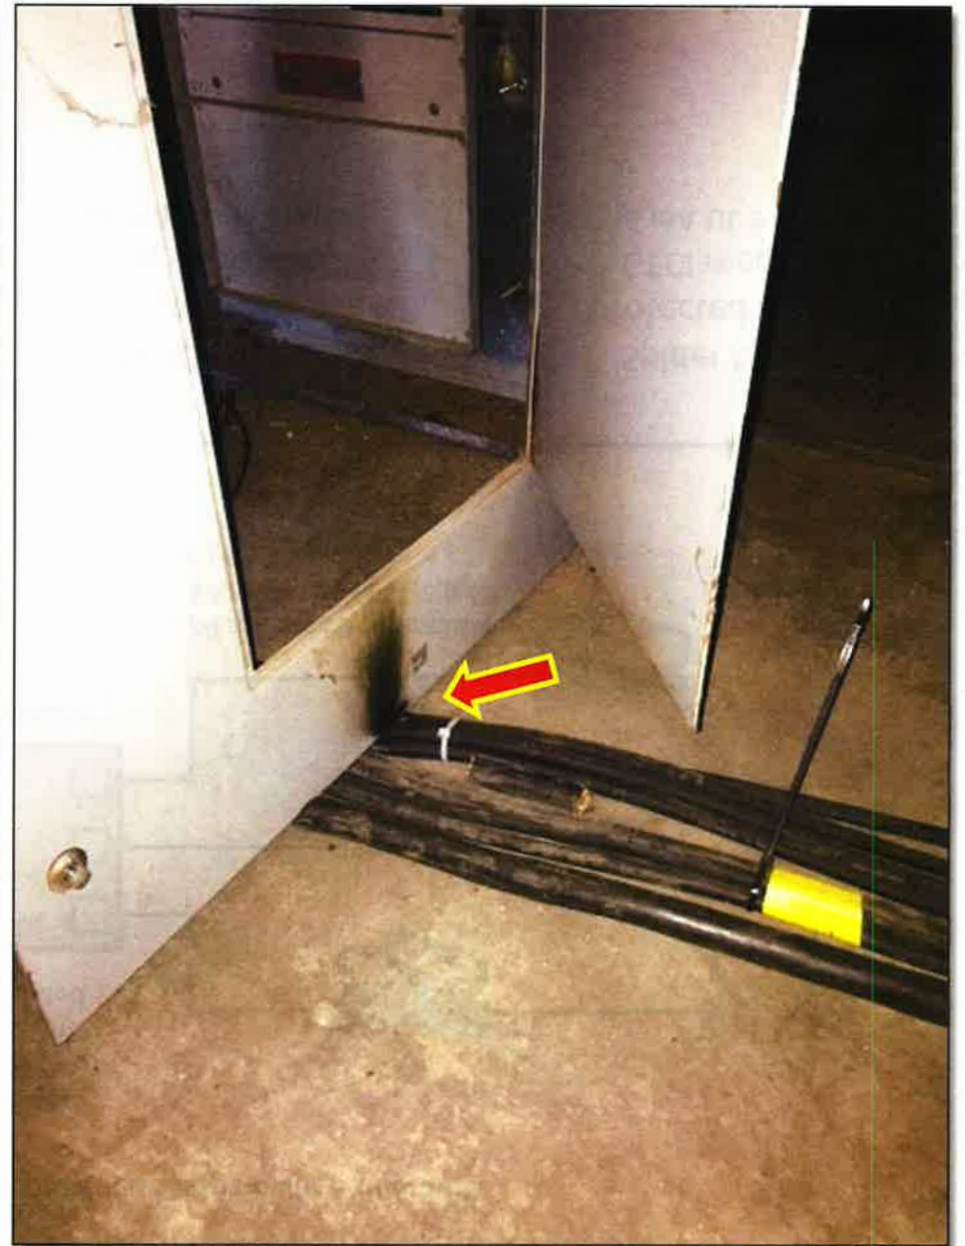

208V and 480V cables damaged