



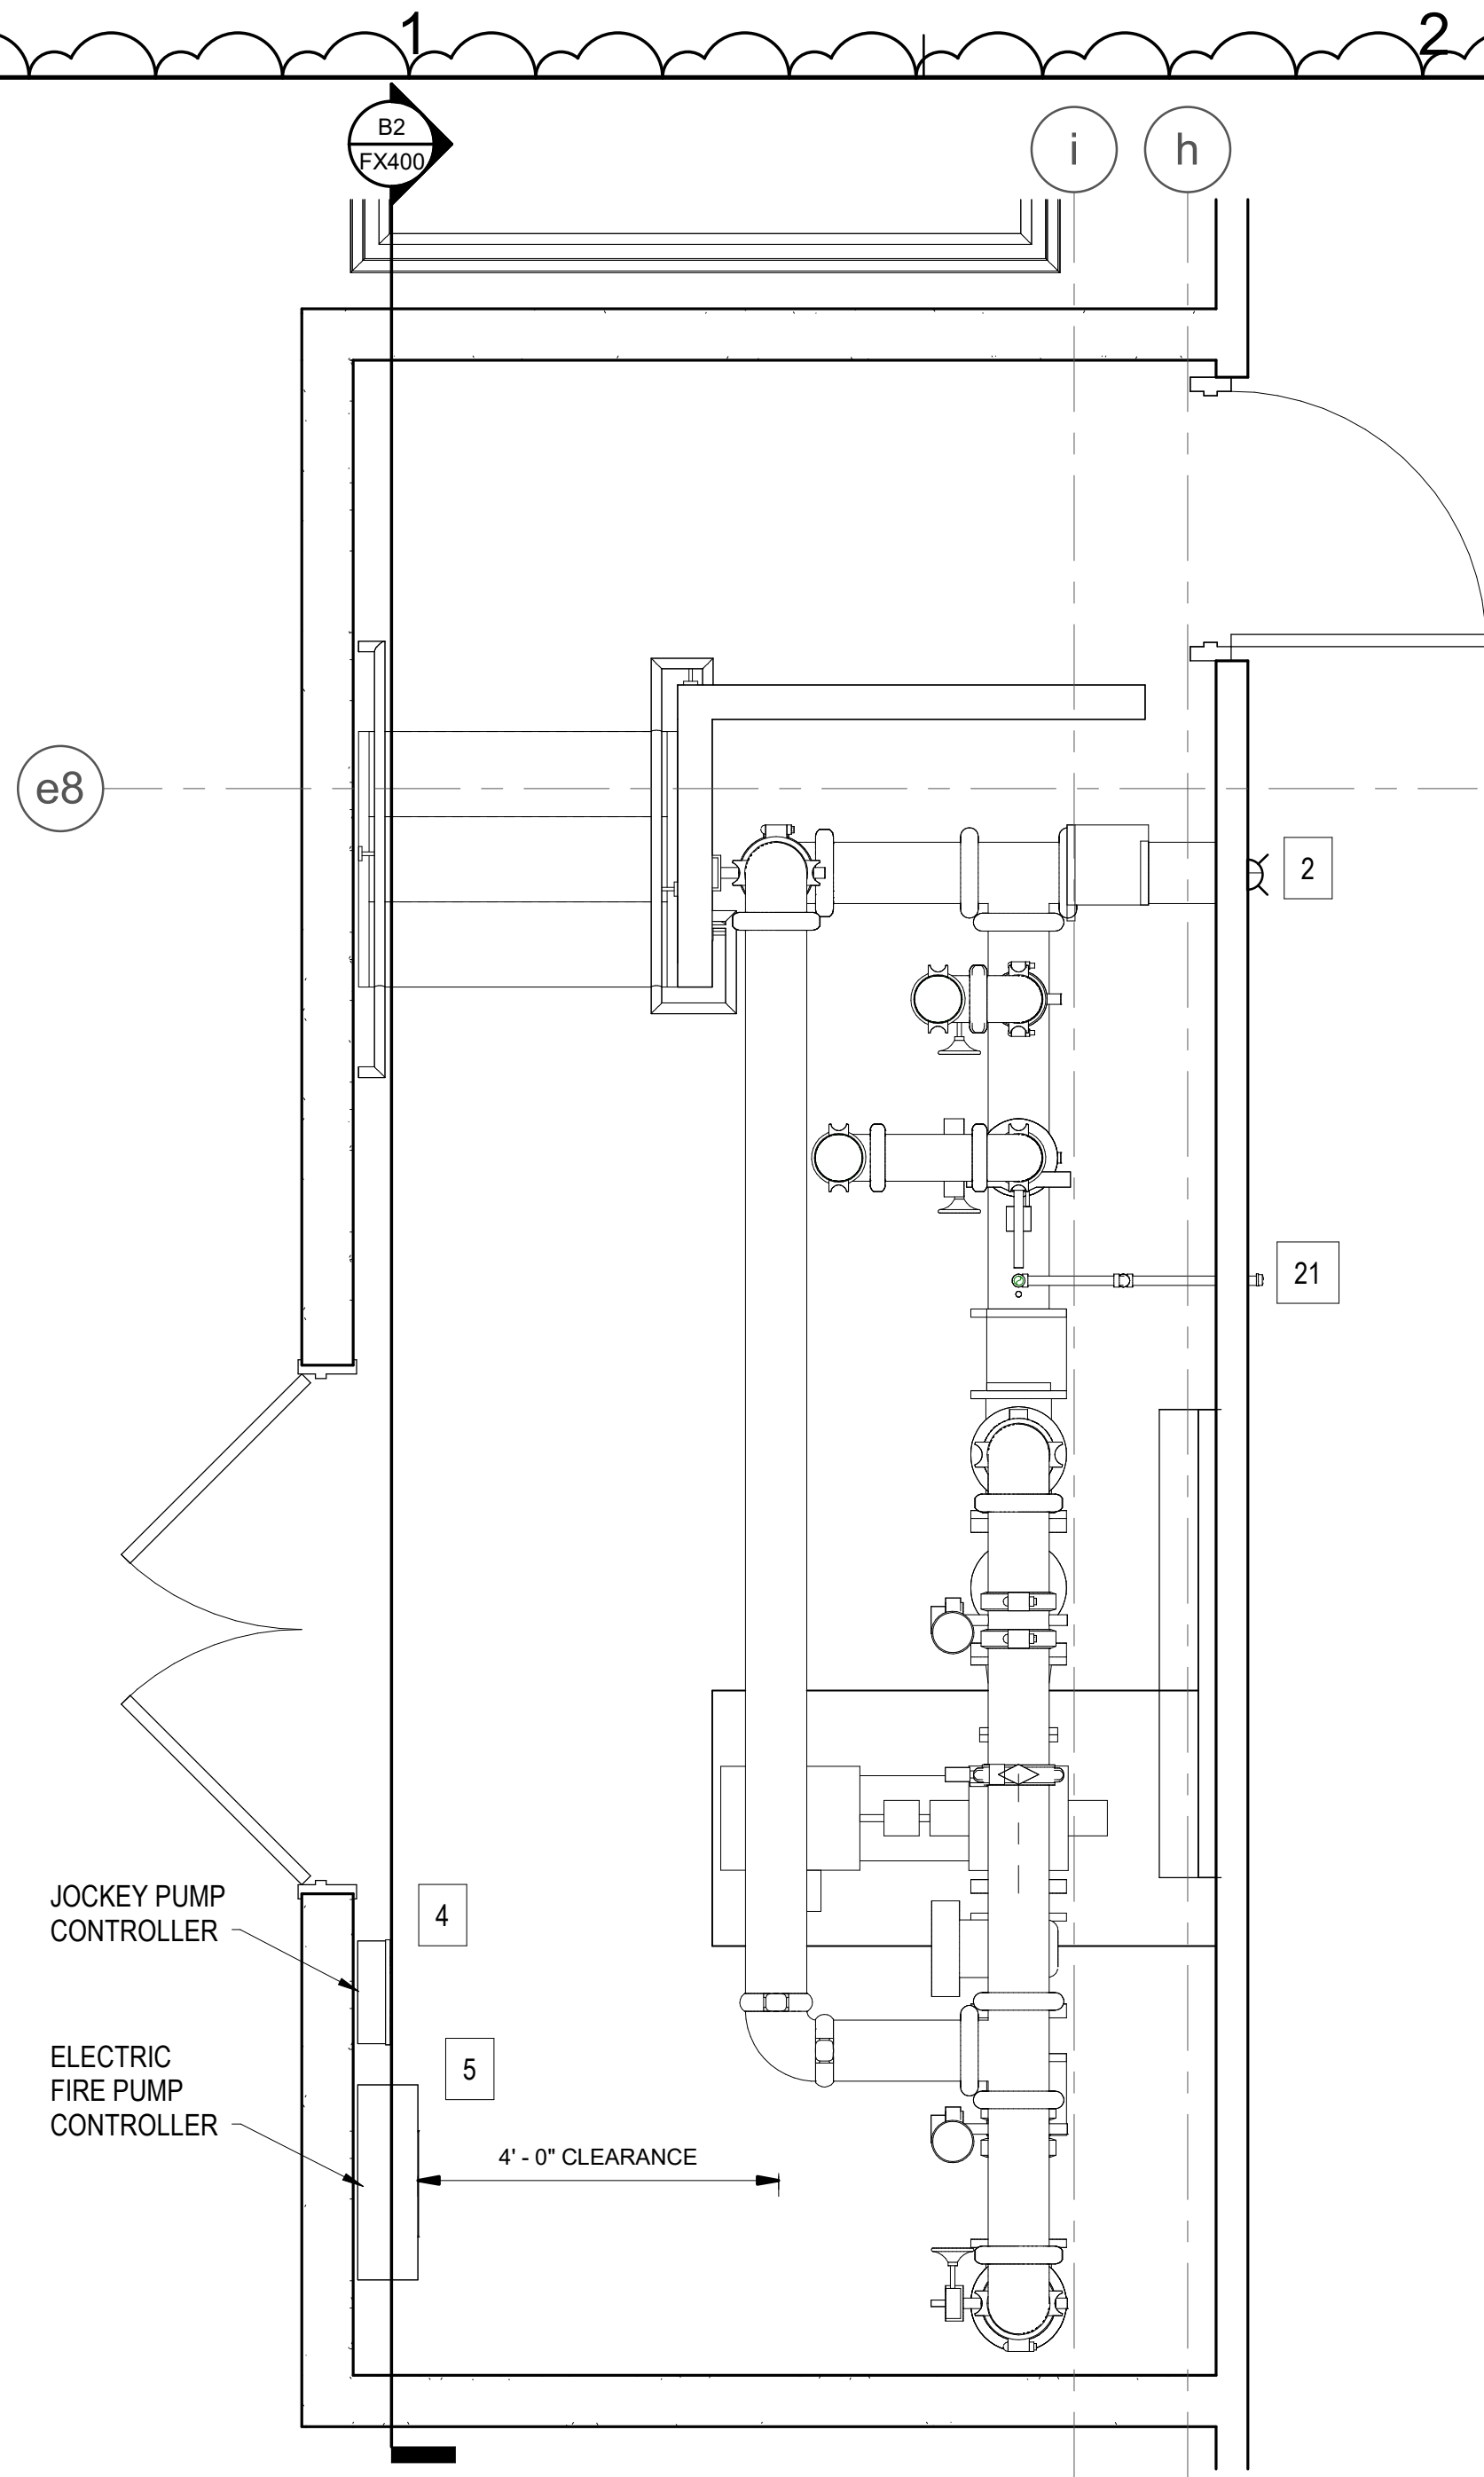

B1 **ENLARGED FIRE PUMP ROOM**
SCALE: 1/2" = 1'-0"

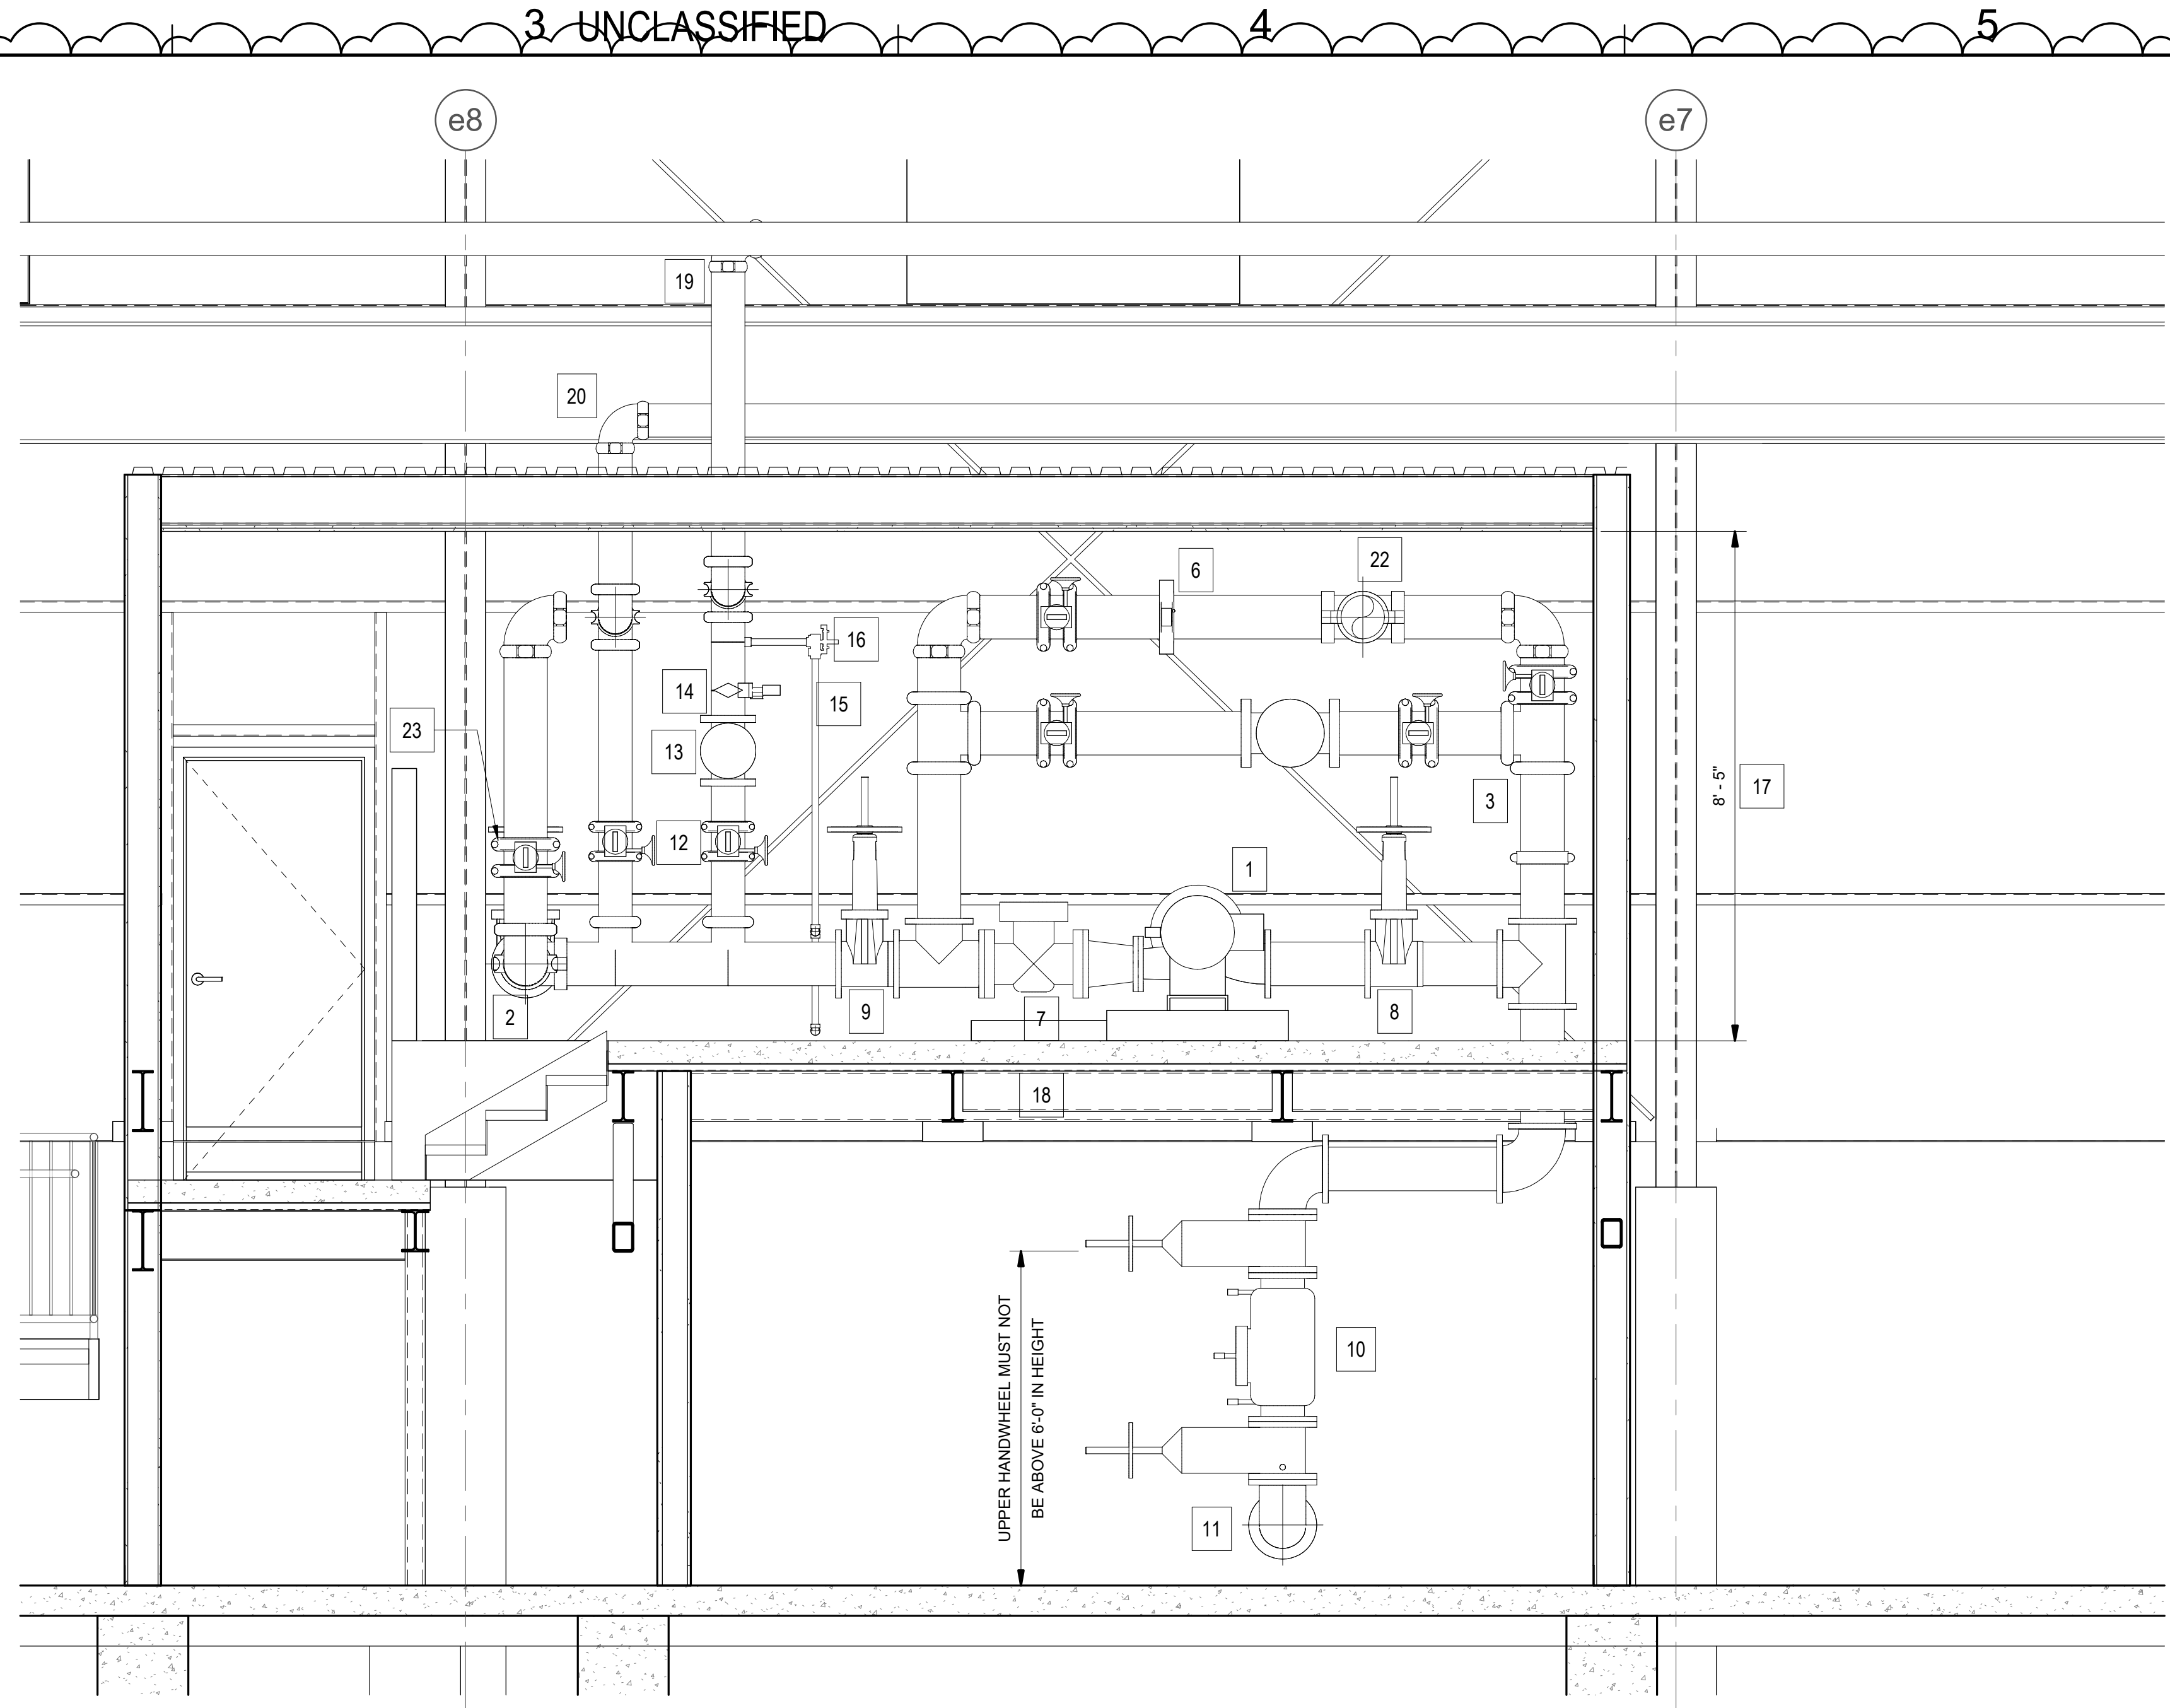

B2 FIRE PUMP ROOM SECTION
SCALE: 1/2" = 1'-0"


GENERAL NOTES

1. SEE SHEET FX001, FX400, AND FX501 FOR FIRE PROTECTION NOTES AND DETAILS.
2. HANGERS AND PIPE SUPPORTS ARE NOT SHOWN. HANGERS AND PIPE SUPPORTS MUST BE PROVIDED IN ACCORDANCE WITH NFPA 13, NFPA 20, AND SPECIFICATION.


FIRE PUMP KEYNOTES

1	NEW ELECTRIC FIRE PUMP, 1,500 GPM WITH 50-PSI BOOST	9	6" DISCHARGE ISOLATION VALVE	17	CEILING HEIGHT
2	6" FEED TO TEST HEADER (SEE FX501/A4)	10	8" BACKFLOW PREVENTER	18	NEW 1-HOUR FIRE PUMP ROOM ENCLOSURE
3	8" FIRE PUMP BYPASS	11	8" INCOMING FROM UNDERGROUND SUPPLY	19	6" TO FIRST FLOOR OVERHEAD SPRINKLER SYSTEM
4	JOCKEY PUMP CONTROL PANEL	12	FIRST FLOOR SPRINKLER RISER OS&Y VALVE W/TAMPER SWITCH	20	6" TO SECOND FLOOR SPRINKLER CONTROL VALVE ASSEMBLY (SEE FX501)
5	FIRE PUMP CONTROL PANEL	13	FIRST FLOOR SPRINKLER RISER CHECK VALVE	21	LOCATE CONCRETE SPLASH BLOCK FOR EXTERIOR DRAIN
6	FLOW METER	14	FIRST FLOOR SPRINKLER RISER WATERFLOW SWITCH	22	TO TEST HEADER
7	NEW CONCRETE PAD	15	FIRST FLOOR SPRINKLER RISER DRAIN TO EXTERIOR	23	8" ISOLATION VALVE (NORMALLY CLOSED)
8	8" SUCTION ISOLATION VALVE	16	FIRST FLOOR SPRINKLER RISER INSPECTORS TEST AND DRAIN		

KEY PLAN

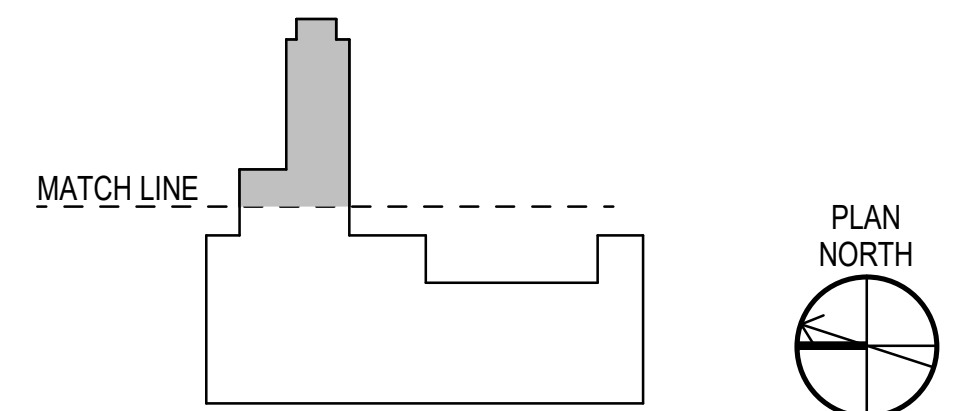

GRAPHIC SCALE(S)



Bowman
FIRE & LIFE SAFETY

APPROVED	
OR COMMANDER NAVFAC	
ACTIVITY	
SATISFACTORY TO DATE	MM/DD/YYYY
DESIGNER	J. DEMAINE
DRAWN BY	C. MANTSCH
CHECKED BY	J. MCLEAN
DESIGN MANAGER	T. CARLETON
PROJECT MANAGER	L. LYONS
LEAD/PM&E	
PIRE PROTECTION	S. RUCINSKI

ATLANTIC
RD - KITTERY, ME
KITTERY, ME

NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND
PORTSMOUTH NAVAL SHIPYARD

B60 REPAIRS

ENLARGED FIRE PUMP ROOM

PROJECT NO.:		1740579	
NAVFAC DRAWING NO.			
SHEET		238	OF 282
FX400			