



3/16/2026 11:42:25 AM EL102 C:\Users\bdagle\Documents\22103.25\_BLDG00\_ELEC-V23\_bdaigle\QUG8.rvt

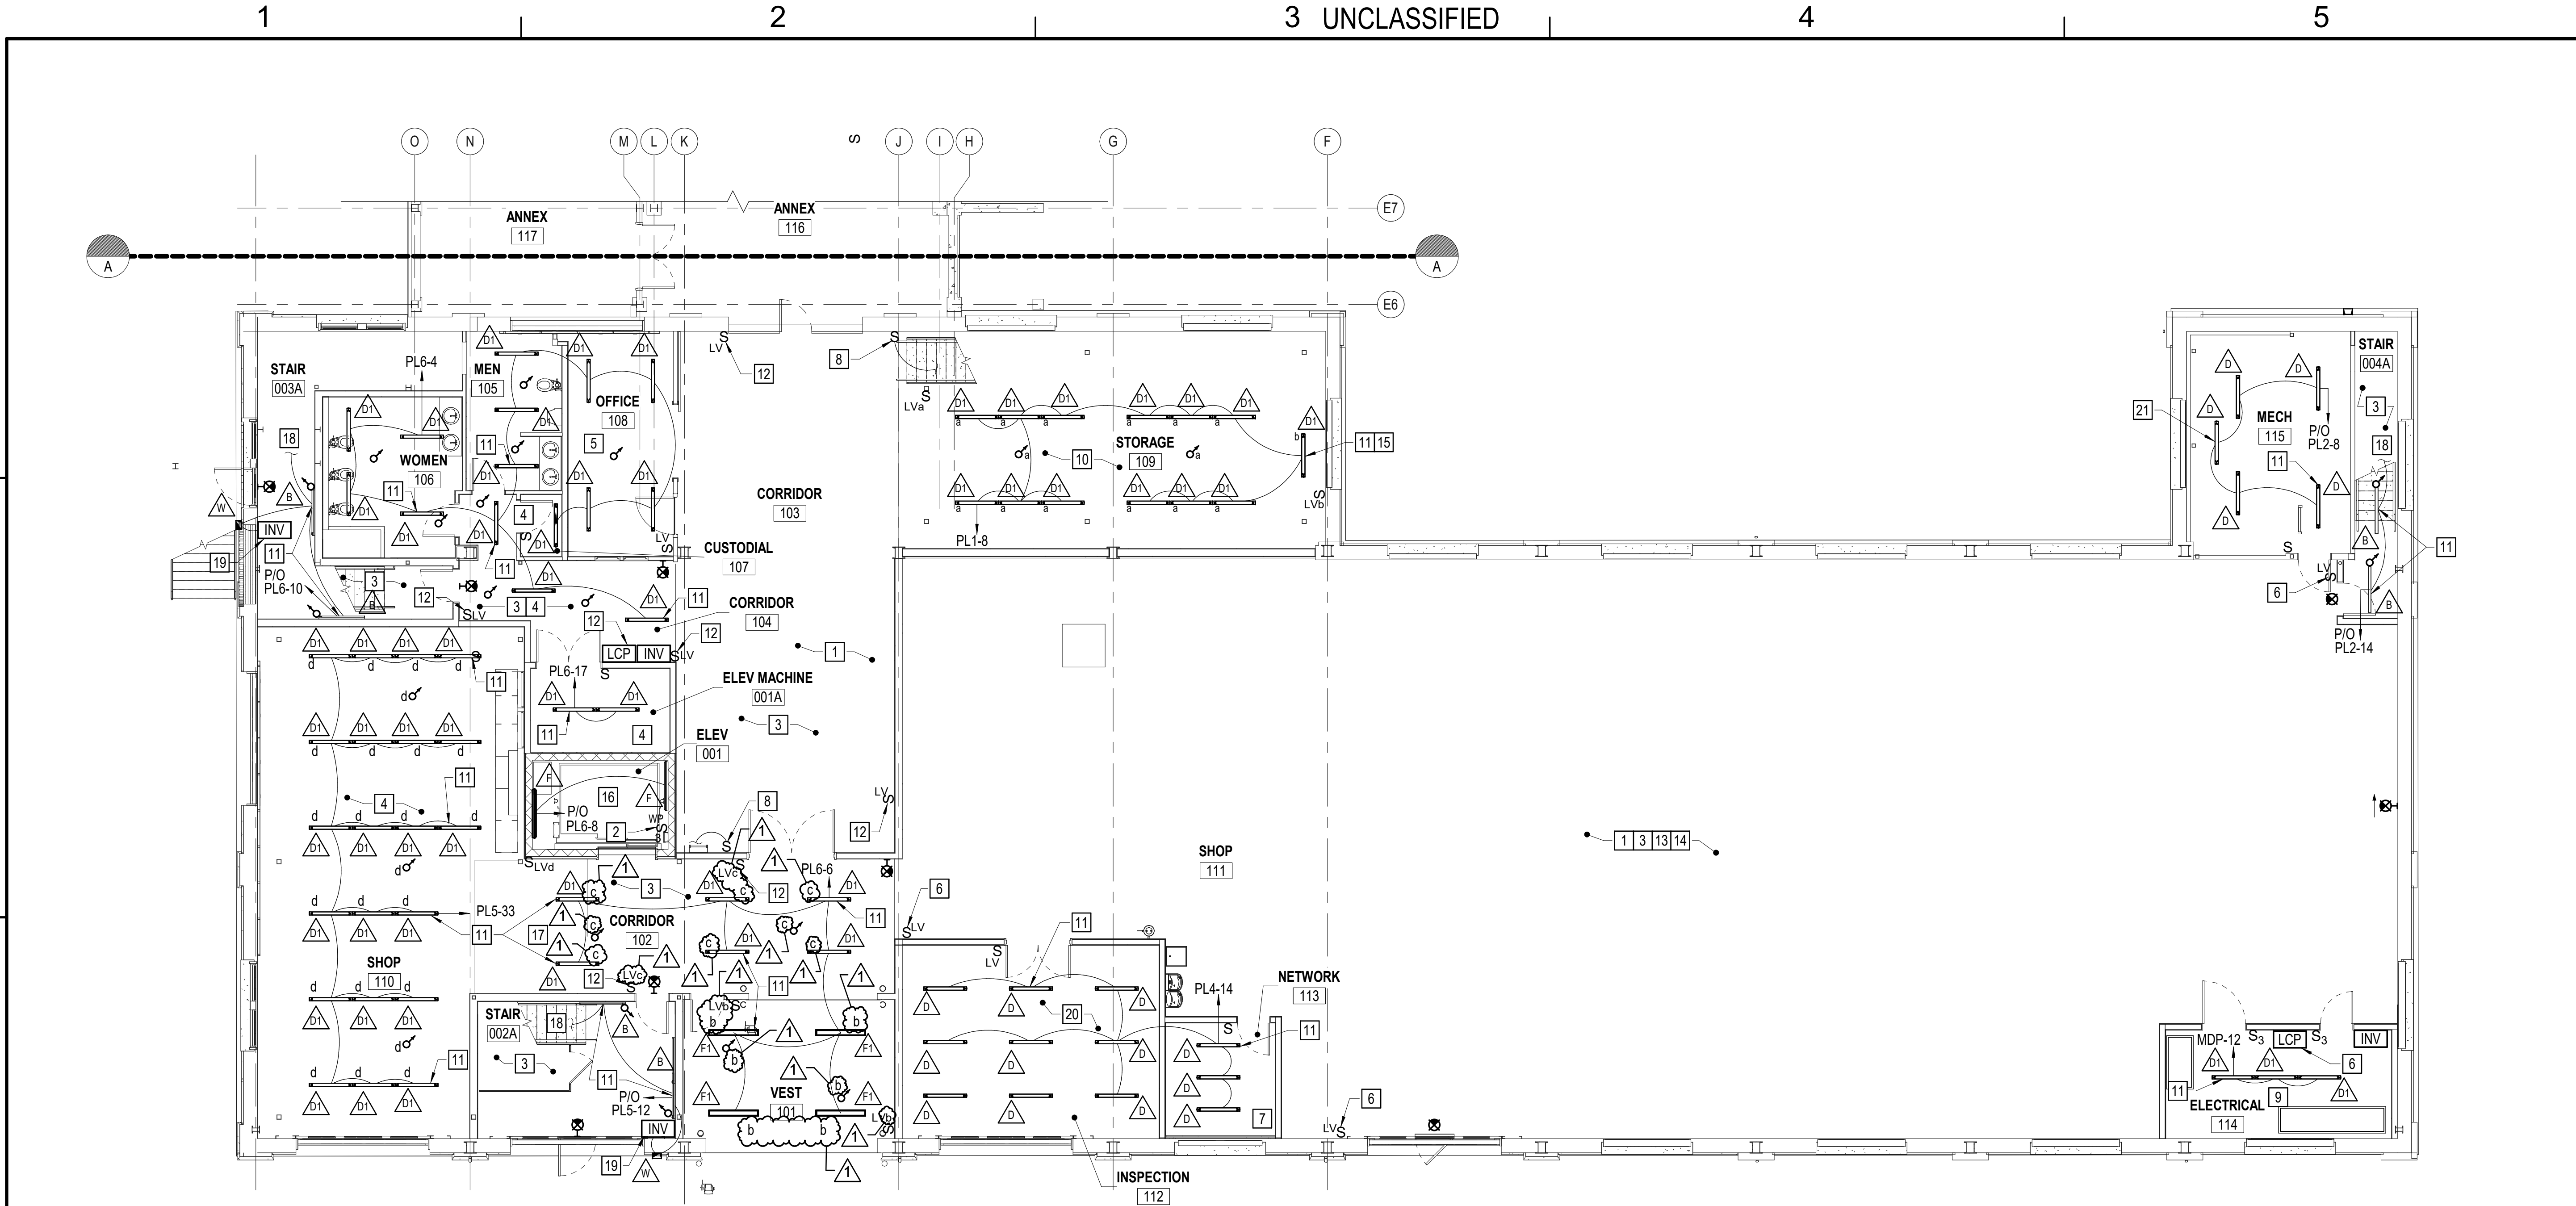

**B1** FIRST FLOOR LIGHTING PART PLAN - WEST  
SCALE: 1/8" = 1'-0"

- ### GENERAL NOTES
- REFER TO SHEETS EL701 AND EL702 FOR LIGHTING FIXTURE SCHEDULE AND DETAILS.
  - EXPOSED CONDUIT AT EXTERIOR LIGHTING FIXTURES IS NOT PERMITTED. ROUTE CONDUIT THROUGH THE BACK OF THE FIXTURES.
  - CONNECT EMERGENCY LIGHTING AND EXIT SIGNS TO LOCAL LIGHTING BRANCH CIRCUIT AHEAD OF SWITCHES, OCCUPANCY SENSORS, AND LIGHTING CONTROLS.

- ### KEYNOTES
- REFER TO SHEET EL104 FOR LIGHTING ABOVE.
  - INSTALL ADJACENT TO THE PIT LADDER. COORDINATE EXACT LOCATION IN THE FIELD.
  - PROVIDE LIGHTING BYPASS RELAY WITHIN THE PATHS OF EGRESS TO TURN LIGHTS ON UPON FIRE ALARM ACTIVATION. REFER TO DETAIL A2/EL702.
  - MOUNT FIXTURES AT 9' AFF. PROVIDE ACCESSORIES FOR PENDANT MOUNTING, AND COORDINATE WITH MECHANICAL EQUIPMENT, PIPING AND DUCTWORK.
  - MOUNT FIXTURES AT 8' AFF. PROVIDE ACCESSORIES FOR PENDANT MOUNTING, AND COORDINATE WITH MECHANICAL EQUIPMENT, PIPING AND DUCTWORK.
  - REFER TO LOCAL AREA CONTROLLER DIAGRAM A1/EL702. THIS CONTROLLER AND ASSOCIATED SWITCHES MUST CONTROL THE FIXTURES WITHIN SHOP 111.
  - COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH THE COMMUNICATIONS CABINETS AND CABLE TRAY.
  - TO LIGHTING FIXTURES ON THE MEZZANINE. PROVIDE ENGRAVED LABEL INDICATING "MECHANICAL MEZZANINE LIGHTING". ADJACENT TO THE ANNEX, COORDINATE EXACT LOCATION TO AVOID THE SLIDING DOOR.
  - MOUNT FIXTURES AT APPROXIMATELY 9' AFF. PROVIDE ACCESSORIES FOR PENDANT MOUNTING AND COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH THE EQUIPMENT WITHIN THE ROOM.
  - MOUNT FIXTURES AT 9' AFF, BELOW MEZZANINE.
  - PROVIDE INTEGRAL EMERGENCY DRIVER.
  - REFER TO LOCAL AREA CONTROLLER DIAGRAM A3/EL702. THIS CONTROLLER AND ASSOCIATED SWITCHES MUST CONTROL THE FIXTURES WITHIN CORRIDORS 102, 103, AND 104. EACH CORRIDOR MUST HAVE THE ABILITY TO BE SEPARATELY CONTROLLED.
  - ROUTE CONDUIT A MINIMUM OF 15 FEET AWAY FROM THE HEAT SEALERS IN SHOP 111.
  - PROVIDE SHIELDED LOW VOLTAGE LIGHTING CONTROL CABLES IN SHOP 111.
  - WIRE FIXTURE TO TOGGLE SWITCH, NOT OCCUPANCY SENSOR, FOR USE AT THE PANELBOARD.
  - PROVIDE TWO LIGHTING FIXTURES IN THE ELEVATOR PIT. PROVIDE ADDITIONAL LIGHTING FIXTURES EVERY 10 FEET, VERTICALLY, UP THE HOISTWAY. COORDINATE EXACT LOCATION WITH THE ELEVATOR INSTALLER. REFER TO SHEET AE411.
  - WIRE FIXTURE AS ALWAYS ON FOR ELEVATOR LOBBY LIGHTING.
  - FOR CONTINUATION, SEE SHEET EL104.
  - PROVIDE EMERGENCY POWER VIA INVERTER. INSTALL WITHIN MANUFACTURER'S RECOMMENDED DISTANCE. COORDINATE EXACT LOCATION IN THE FIELD. PROVIDE LABEL.
  - MOUNT LIGHTING FIXTURE AT APPROXIMATELY 9' AFF. COORDINATE EXACT LIGHTING FIXTURE PLACEMENT AND MOUNTING HEIGHT WITH THE CONTRACTING OFFICER TO AVOID CONFLICTS WITH THE INSPECTION RINGS LOCATED WITHIN THIS ROOM. PROVIDE ACCESSORIES FOR PENDANT MOUNTING.
  - INSTALL ABOVE PLATFORM. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT IN THE FIELD.

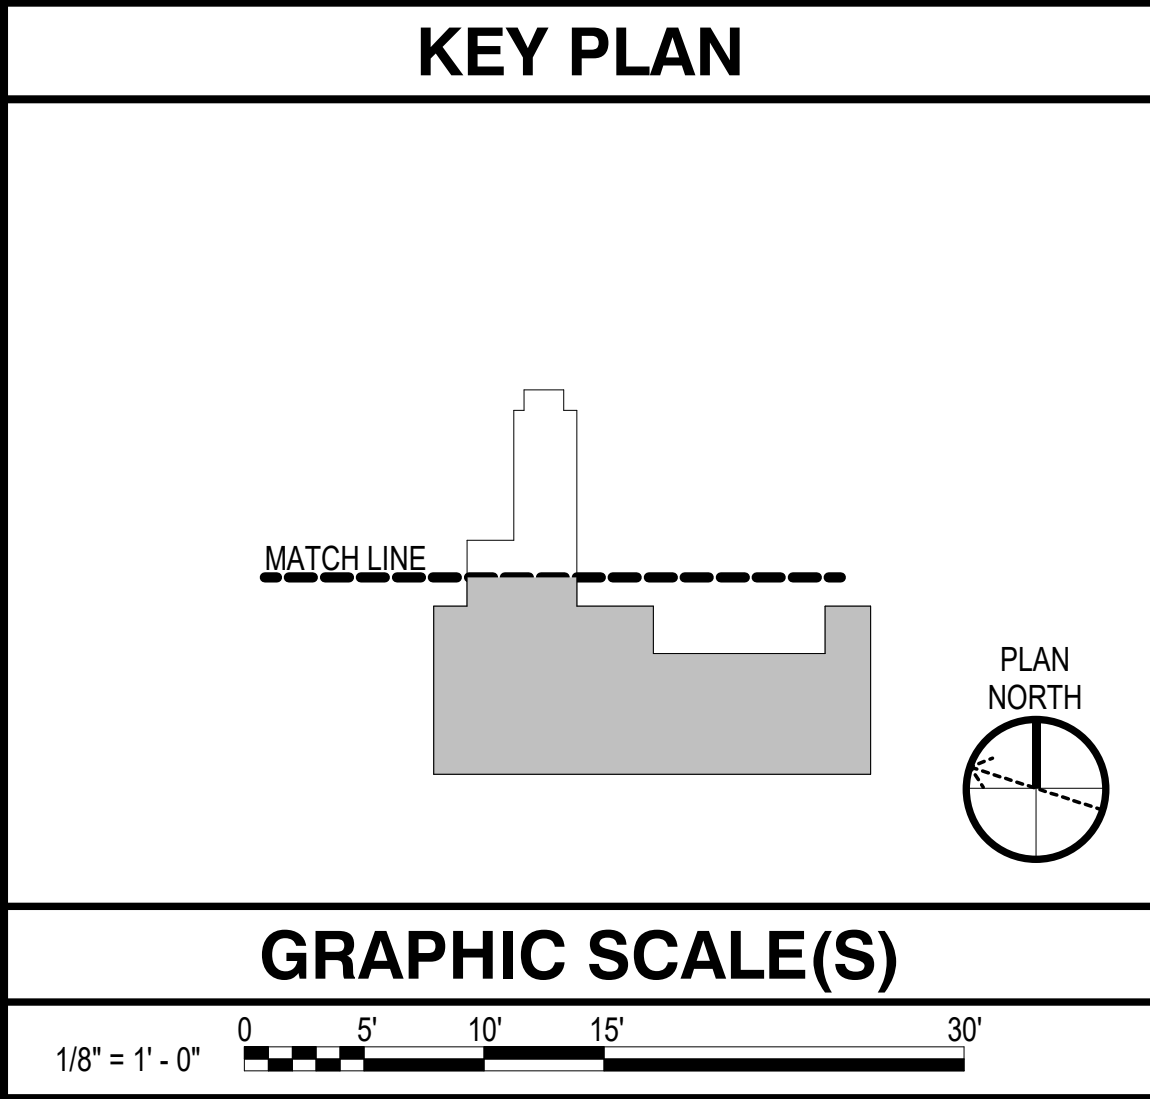

|                                              |                                                             |                                         |      |            |
|----------------------------------------------|-------------------------------------------------------------|-----------------------------------------|------|------------|
| APPROVED                                     | DESIGNER                                                    | HRM                                     | DATE | 03/16/2026 |
| FOR COMMANDER NAVFAC                         | DRAWN BY                                                    | RSW                                     | DATE | 10/07/2025 |
| SATISFACTORY TO DATE                         | CHECKED BY                                                  | DCL                                     | DATE | 10/07/2025 |
| DESIGN MANAGER                               | T. CARLETON                                                 | DATE                                    |      |            |
| PROJECT MANAGER                              | L. LYONS                                                    | DATE                                    |      |            |
| HEADLINE                                     | S. RUCINSKI                                                 | DATE                                    |      |            |
| FIRE PROTECTION                              | S. RUCINSKI                                                 | DATE                                    |      |            |
| NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND | NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - MID-ATLANTIC | PORTSMOUTH NAVAL SHIPYARD - KITTERY, ME |      |            |
| DEPARTMENT OF THE NAVY                       | NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND                | PORTSMOUTH NAVAL SHIPYARD               |      |            |
| ROCC-ME                                      | B60 REPAIRS                                                 | FIRST FLOOR LIGHTING PART PLAN - WEST   |      |            |
| PROJECT NO.                                  | 1740579                                                     |                                         |      |            |
| NAV-FAC DRAWING NO.                          |                                                             |                                         |      |            |
| SHEET                                        | 266                                                         | OF                                      | 282  |            |
| EL102                                        |                                                             |                                         |      |            |
| DRAWN FORM REVISION: 14 SEP 2023             |                                                             |                                         |      |            |