


3/16/2026 1:01:34 PM M-505
C:\Users\lhm\Documents\22103.25 BLDG80 MECHANICAL-V23_lhm\SLM6.rvt

D

C

B

A

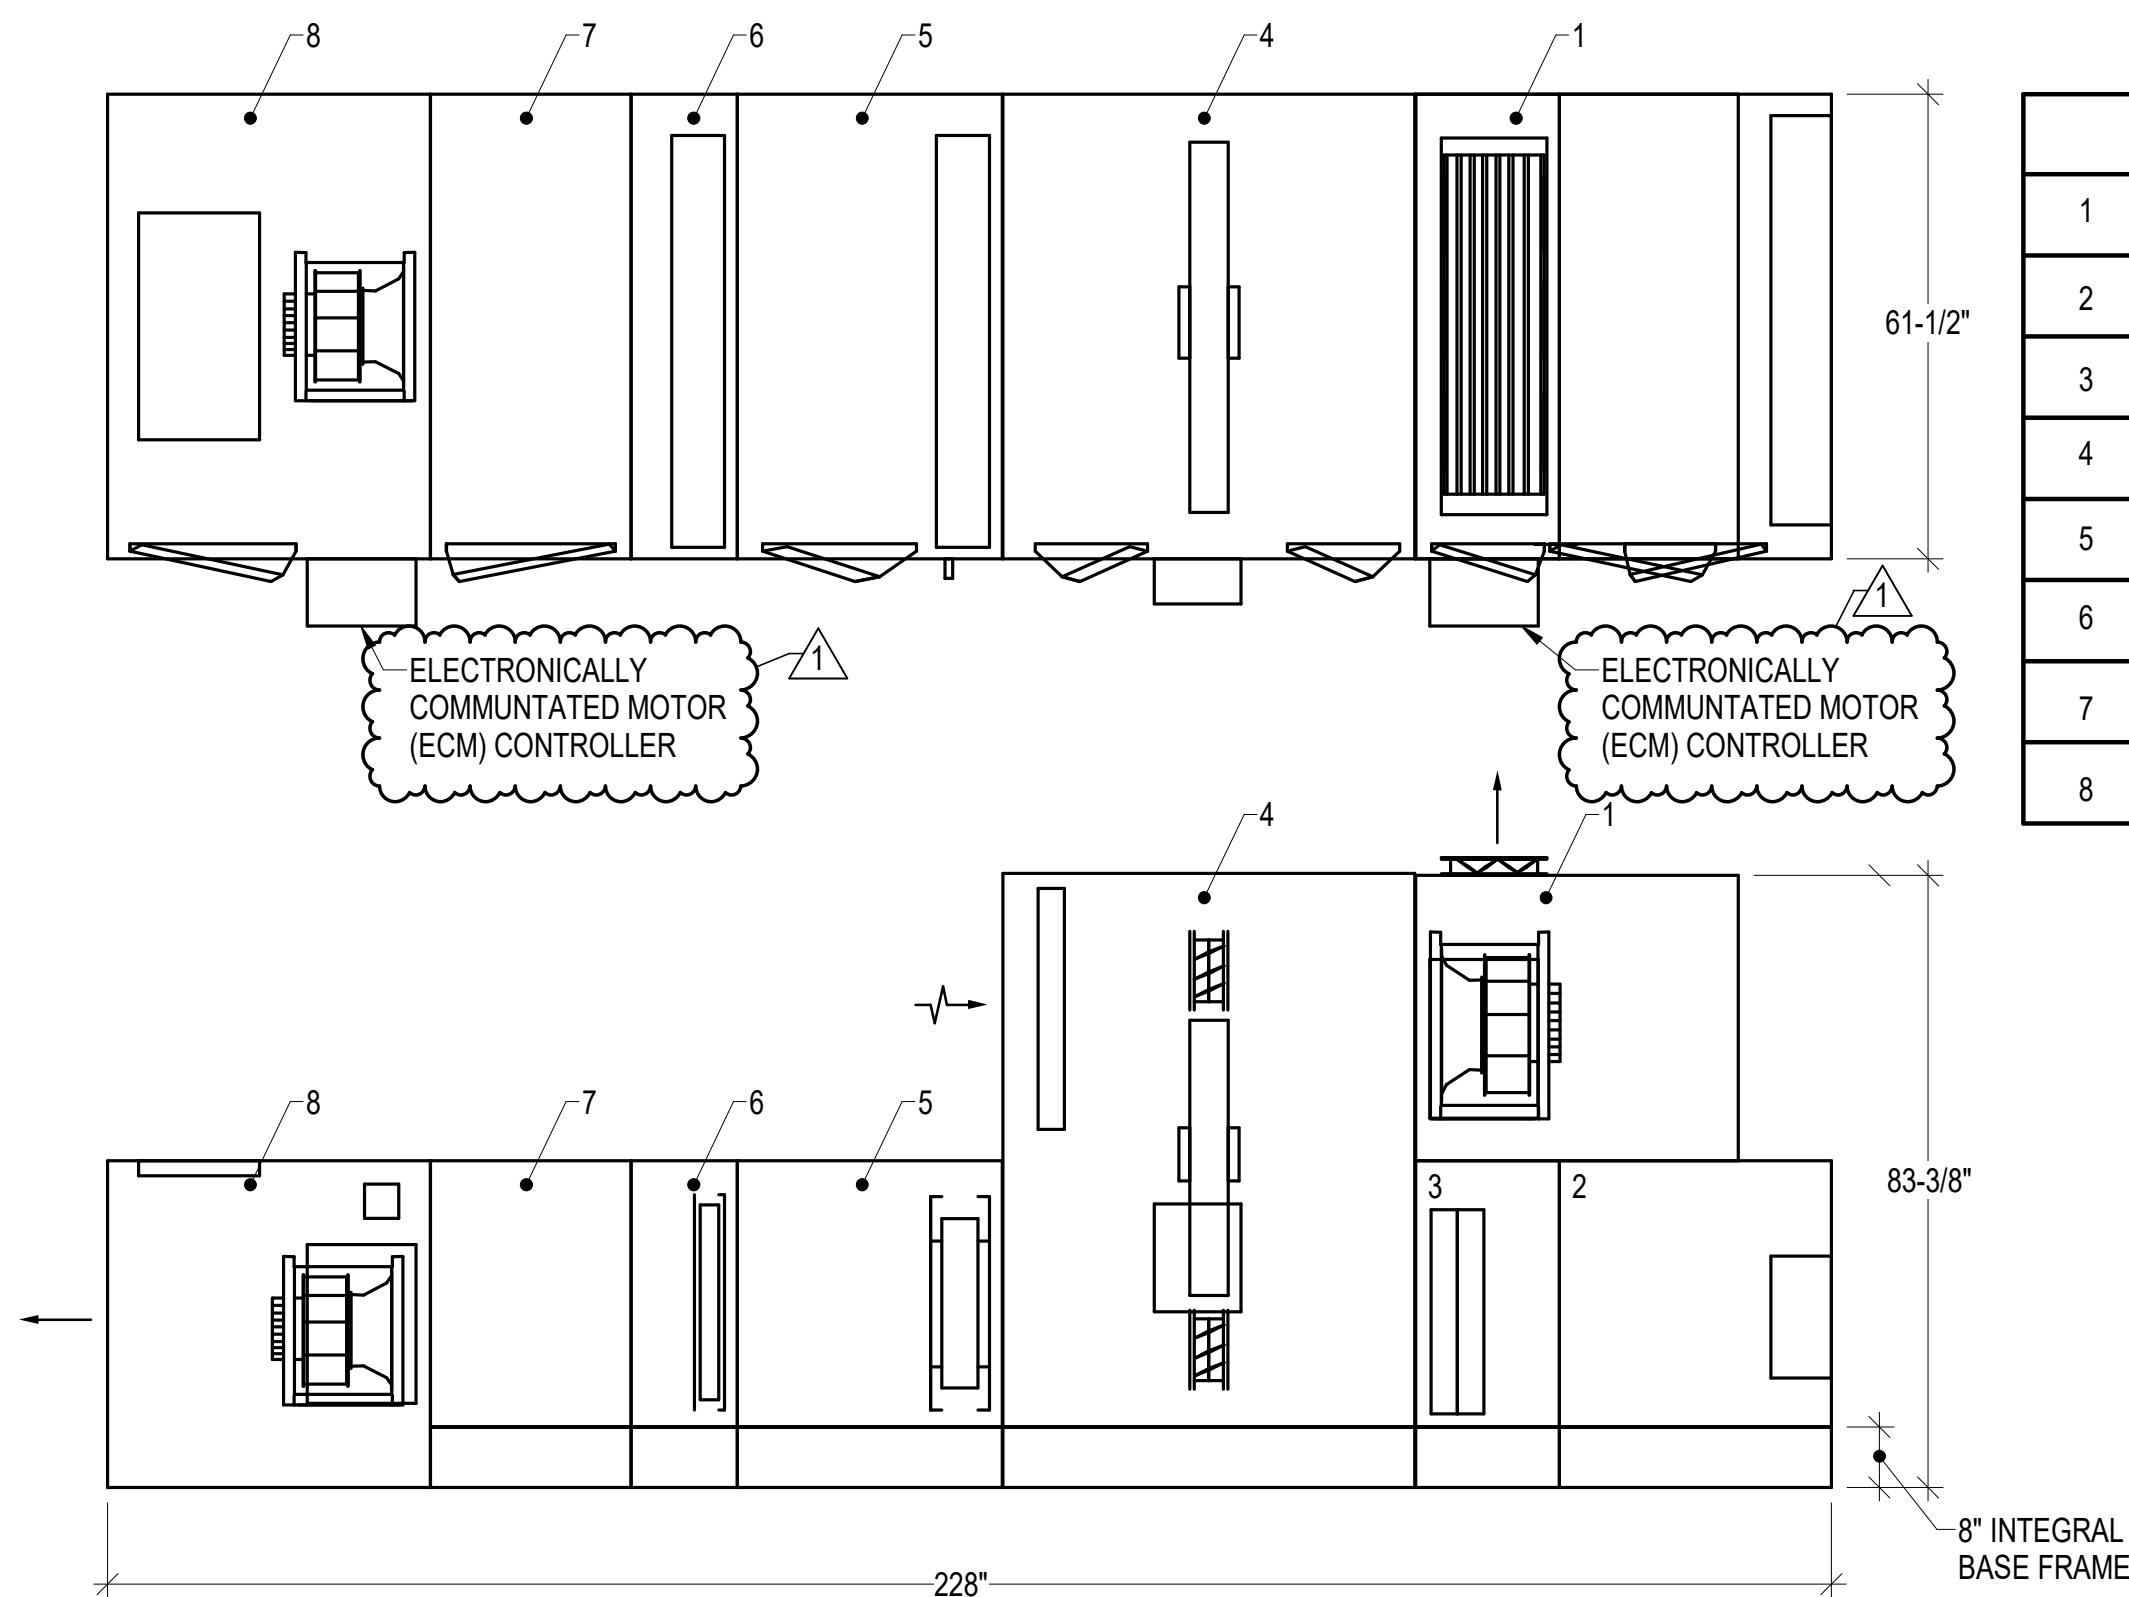


C1 DOAS-1 AIR HANDLING UNIT DIAGRAM (BOD)
SCALE: NOT TO SCALE (MH102, MP104)

DOAS-1 COMPONENT SCHEDULE	
1	PLENUM EXHAUST FAN SECTION
2	AIR MIXING SECTION
3	FILTER SECTION
4	ENERGY WHEEL W/ BYPASS DAMPER
5	DX COOLING COIL SECTION
6	WATER HEATING COIL SECTION
7	ACCESS SECTION
8	PLENUM SUPPLY FAN SECTION

NOTE
PROVIDE SUPPORTS EVERY 10 LINEAR FEET MINIMUM

A1 WALL MOUNTED PIPE SUPPORT SCHEMATIC
SCALE: NOT TO SCALE

A2 DUCTED SPLIT SYSTEMS BCU-1/CU-1, BCU-2/CU-2, AND BCU-3/CU-3 REFRIGERANT COIL PIPING SCHEMATIC - SINGLE CIRCUIT
SCALE: NOT TO SCALE (MP104, MP105, MP106)

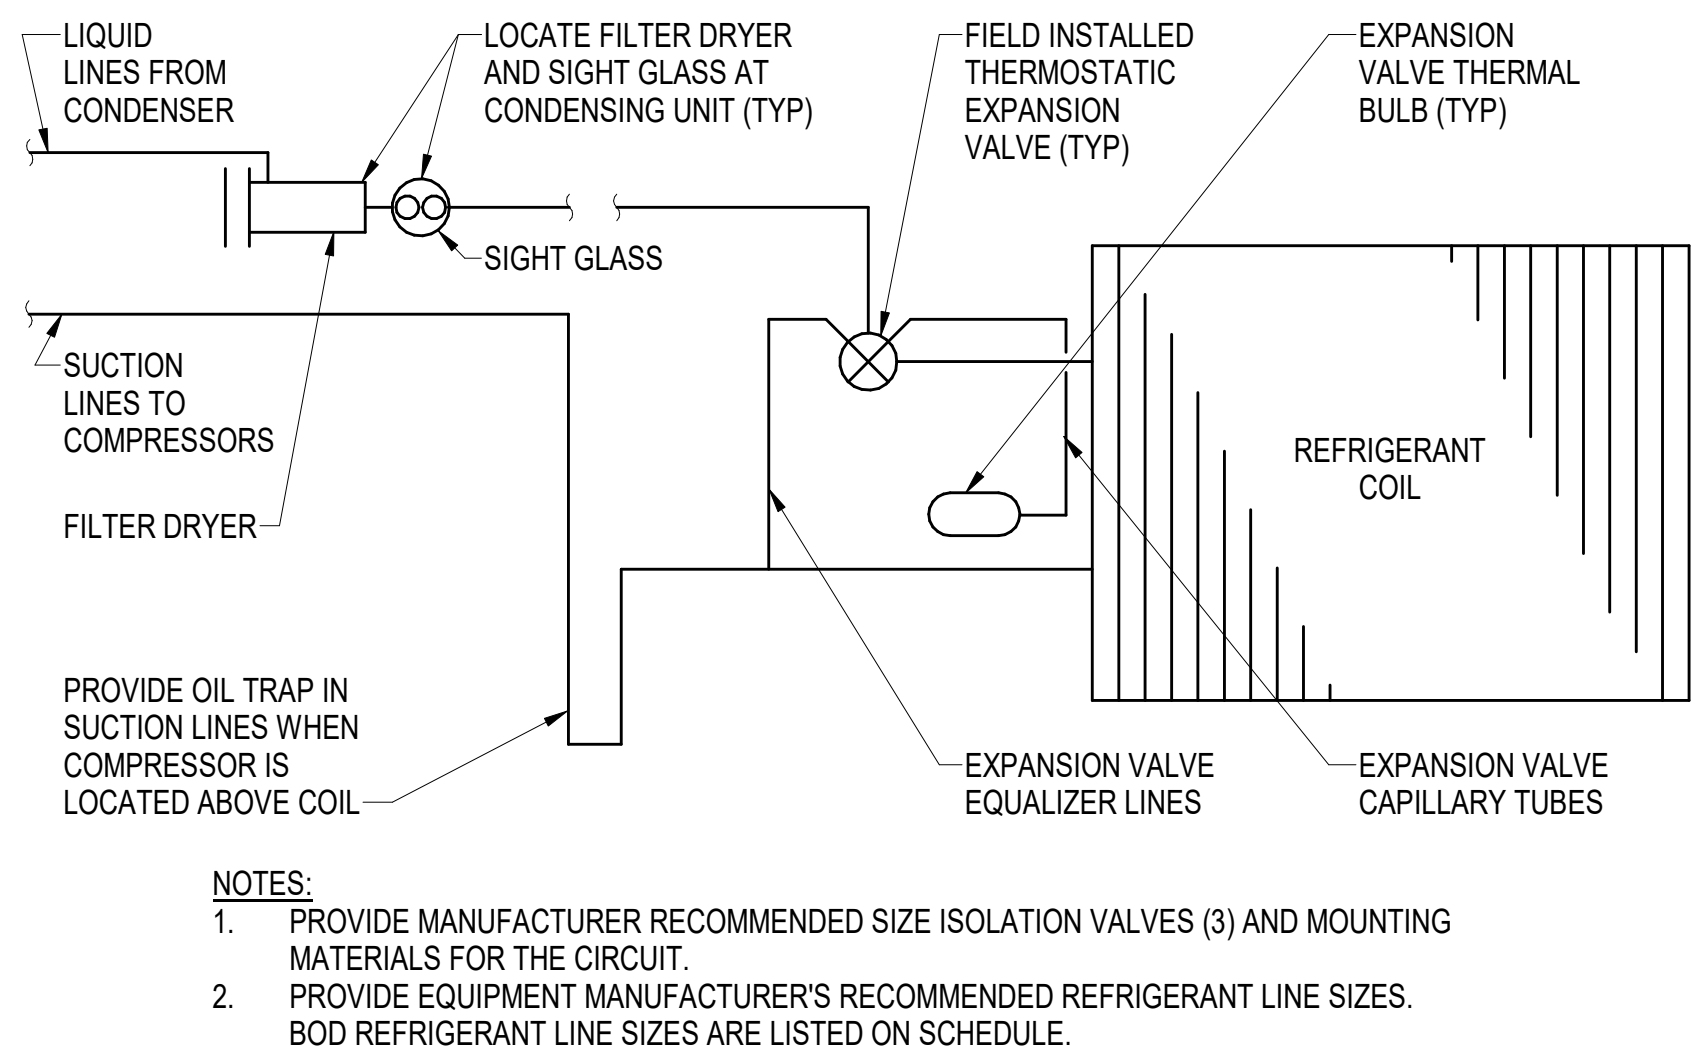


- NOTES:
1. PROVIDE MANUFACTURER RECOMMENDED SIZE ISOLATION VALVES (3) AND MOUNTING MATERIALS FOR THE CIRCUIT.
 2. PROVIDE EQUIPMENT MANUFACTURER'S RECOMMENDED REFRIGERANT LINE SIZES. BOD REFRIGERANT LINE SIZES ARE LISTED ON SCHEDULE.


3 UNCLASSIFIED

4

5

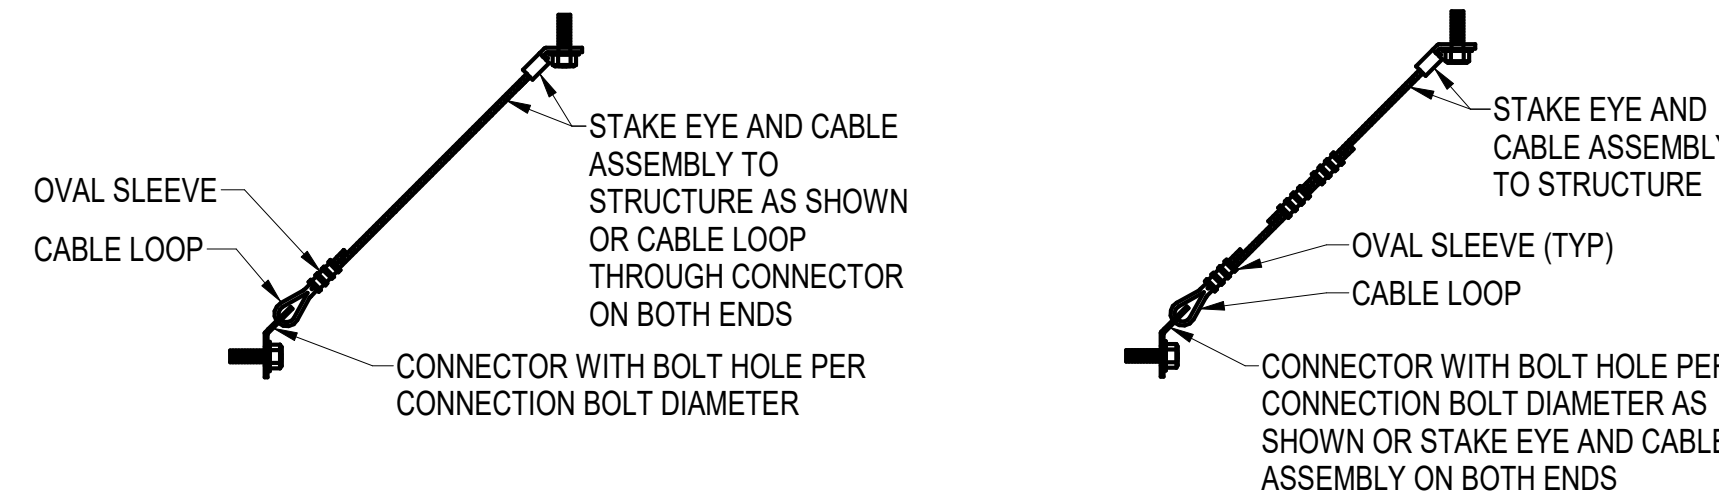


D4 ATFP CABLE BRACING ASSEMBLY DETAIL
SCALE: NOT TO SCALE

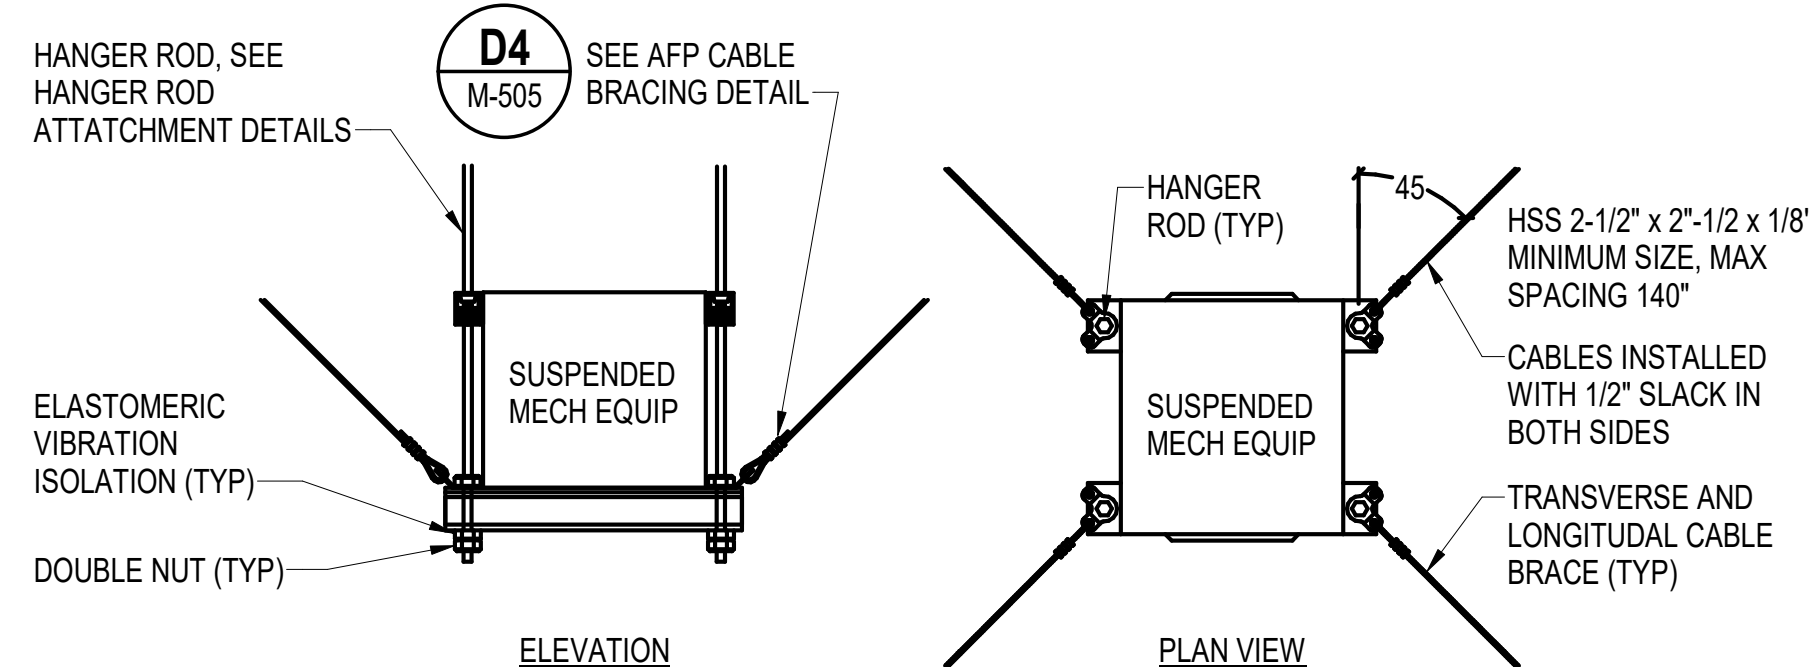

- NOTES:
1. PROVIDE BRACING ON ALL OVERHEAD MOUNTED EQUIPMENT WEIGHING OVER 31 LBS PER UFC 4-010-01 DOD MINIMUM ANTI-TERRORISM STANDARDS FOR BUILDINGS, STANDARD 19
 2. BRACING DESIGN SHALL BE PERFORMED BY A REGISTERED DESIGN PROFESSIONAL (REGISTERED IN THE PROJECT'S JURISDICTION) AND SUBMITTED TO THE CONTRACTING OFFICER FOR REVIEW AND APPROVAL
 3. BRACING SHALL BE DESIGNED TO RESIST FORCES OF 0.5 TIMES THE EQUIPMENT WEIGHT IN ANY HORIZONTAL DIRECTION AND 1.5 TIMES THE EQUIPMENT WEIGHT IN THE DOWNWARD DIRECTION
 4. DETAIL PROVIDED AS GUIDANCE ONLY FOR THE SUPPORT OF SUSPENDED EQUIPMENT AND DOES NOT RELIEVE THE CONTRACTOR FROM THE DELEGATED DESIGN RESPONSIBILITY IN MEETING THE ATFP STANDARD REQUIREMENTS

B4 ATFP BRACING DETAIL FOR SUSPENDED MECHANICAL EQUIPMENT
SCALE: NOT TO SCALE

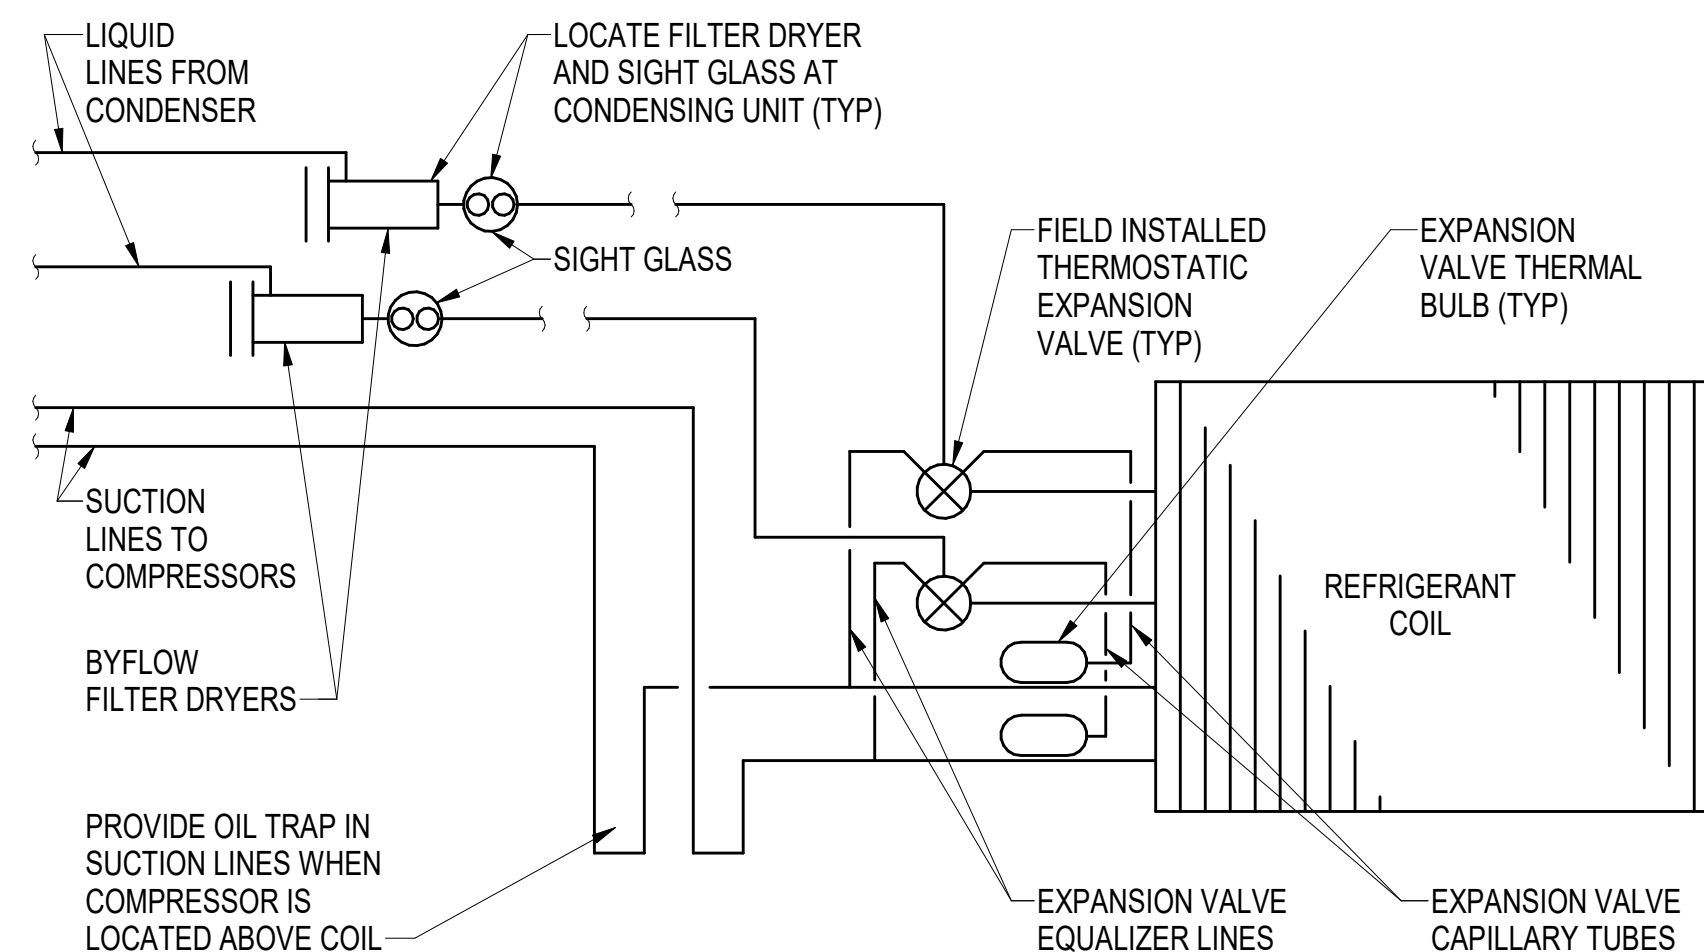

- NOTES:
1. PROVIDE MANUFACTURER RECOMMENDED SIZE ISOLATION VALVES (3) AND MOUNTING MATERIALS FOR EACH CIRCUIT.
 2. PROVIDE RAWAL SERVICES, INC APR CONTROL, SIZED AND INSTALLED IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS.
 3. PROVIDE EQUIPMENT MANUFACTURER'S RECOMMENDED REFRIGERANT LINE SIZES. ADD LINE SIZE ESTIMATE; RS: 1-1/8", RL: 0.5"

A4 DOAS-1 / C-4 REFRIGERANT COIL PIPING SCHEMATIC-2 CIRCUIT
SCALE: NOT TO SCALE (MP104)

4

5

APR	DATE	10/07/2025	RSH	03/16/2026	RSH
AMENDMENT 009	DESCRIPTION	FINAL SUBMISSION	MARK	DATE	DATE
APPROVED					
FOR COMMANDER NAVFAC					
ACTIVITY					
SATISFACTORY TO DATE					
DESIGNER RNC					
DRAWN BY SRW					
CHECKED BY MSA					
DESIGN MANAGER T. CARLETON					
PROJECT MANAGER L. LYONS					
HEADLINE					
FIRE PROTECTION S. RUCINSKI					
DEPARTMENT OF THE NAVY					
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND					
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - MID-ATLANTIC					
PORTSMOUTH NAVAL SHIPYARD - KITTERY, ME					
B60 REPAIRS					
MECHANICAL DETAILS 5					
PROJECT NO. 1740579					
NAVFAC DRAWING NO.					
SHEET 216 OF 282					
M-505					
DRAWING REVISION: 14 SEP 2023					

B UNCLASSIFIED

A