


3/2/2026 12:16:38 PM MP107
C:\Users\mdonovan\Documents\22103.25_BLDG00_MECHANICAL-V23_mdonovan8VFXR.mxd

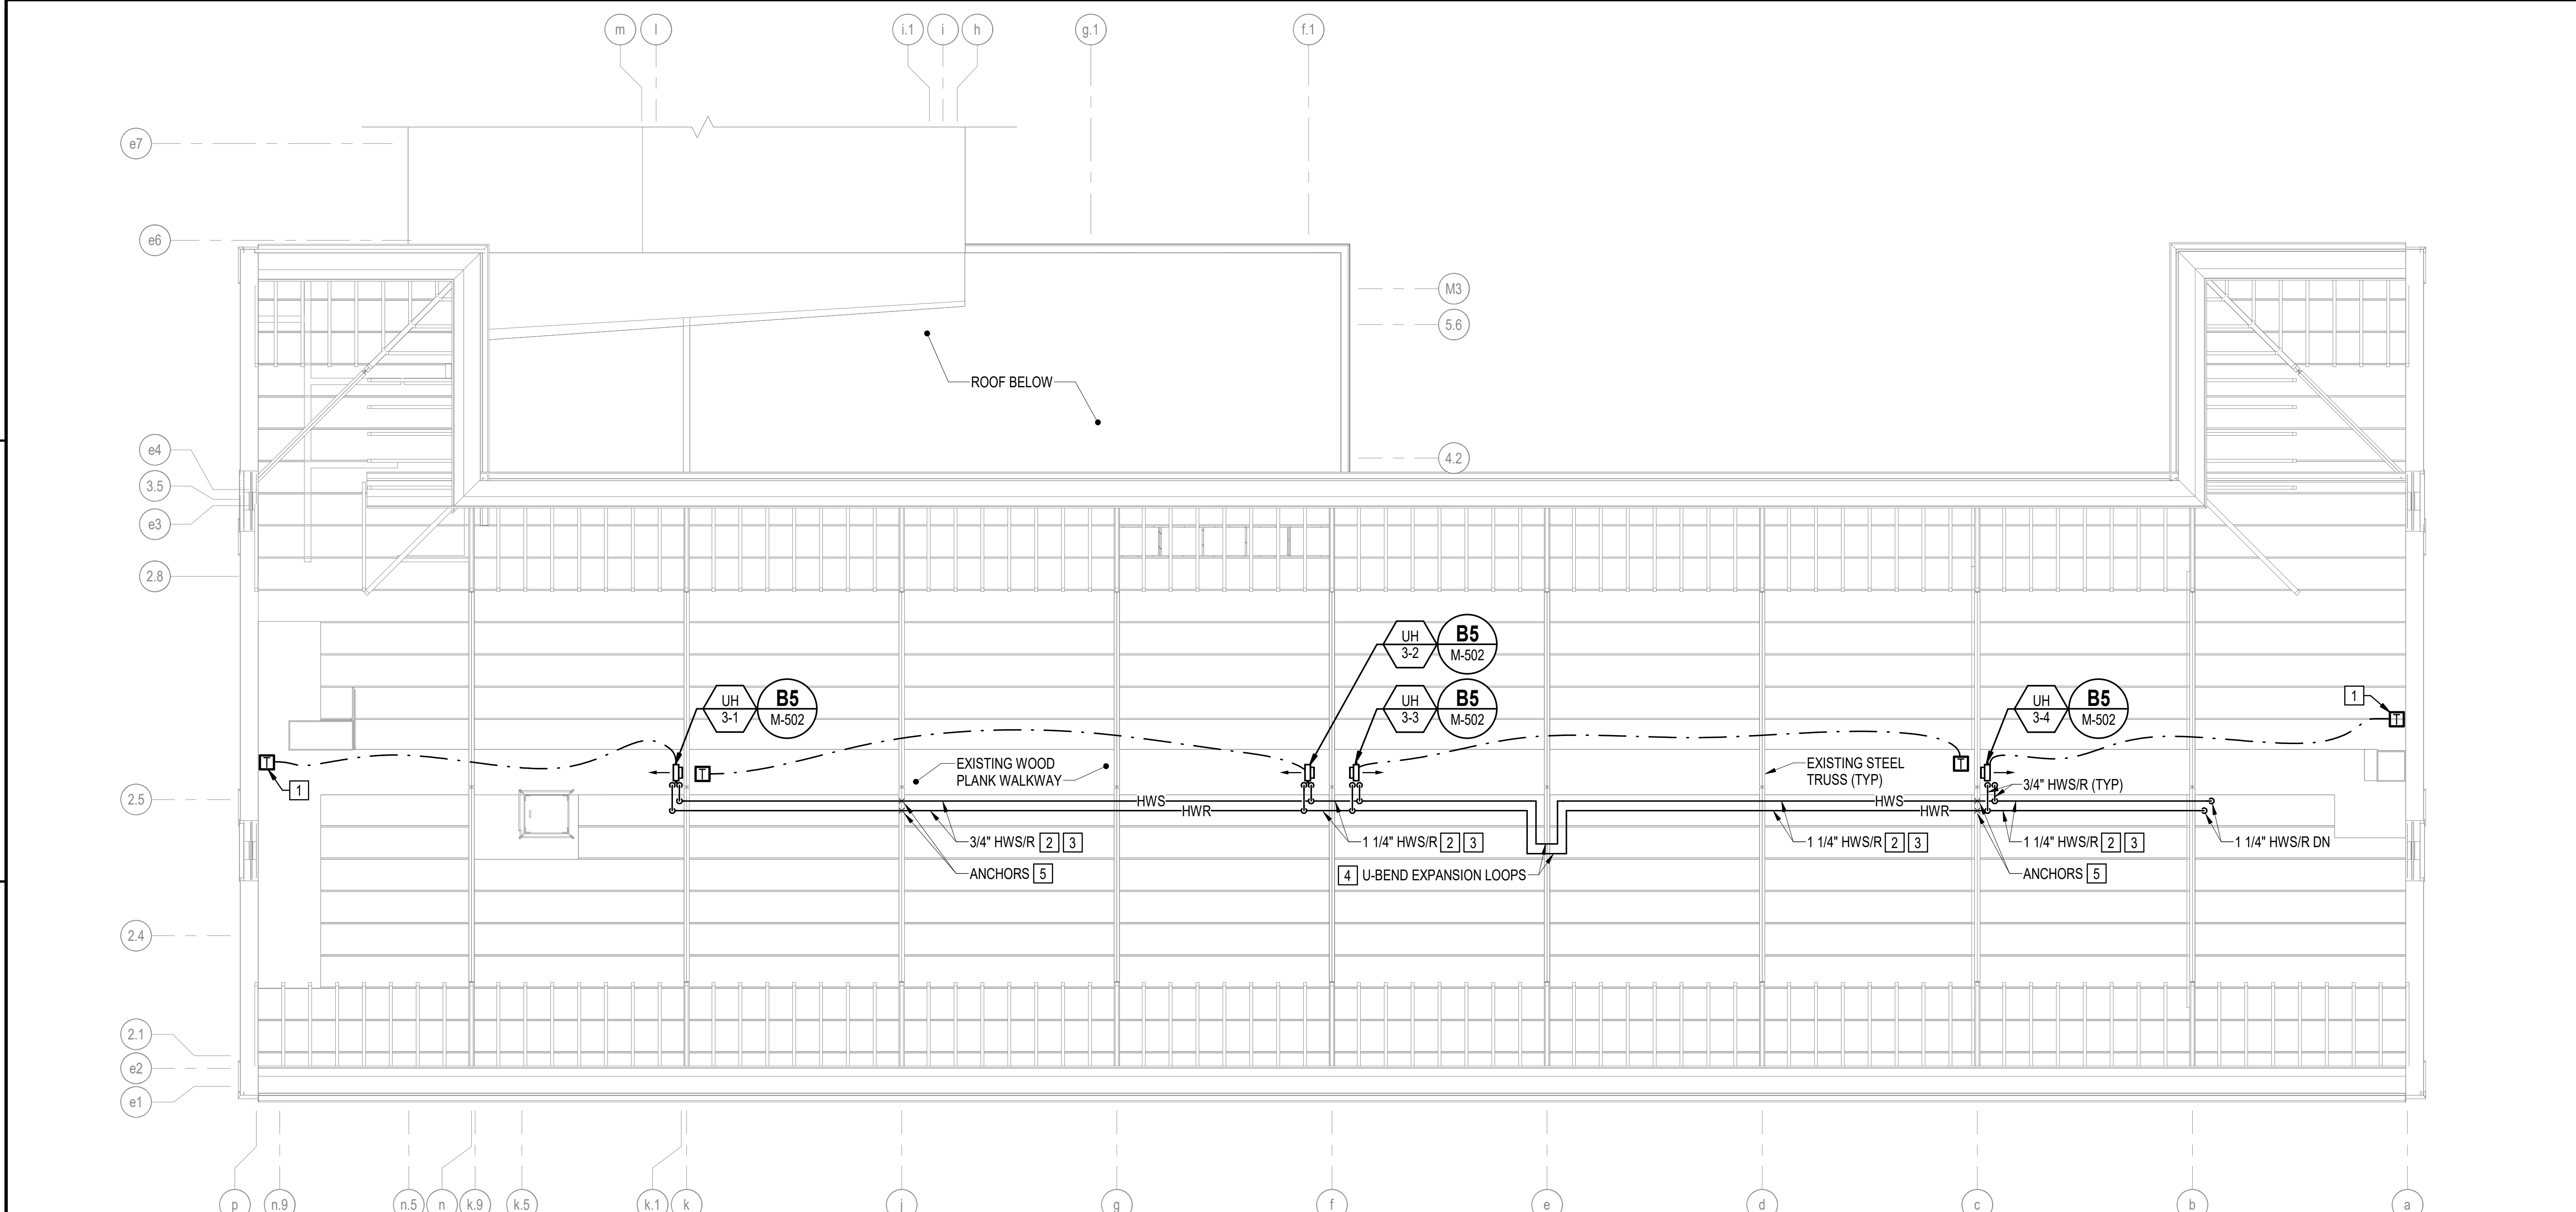

B1 ATTIC MECHANICAL PIPING PLAN - WEST
SCALE: 1/8" = 1'-0"


GENERAL NOTES

- SEE M-001 FOR MECHANICAL LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
- HWS/R TERMINAL HEATER BRANCH PIPING IS 3/4" UNLESS OTHERWISE INDICATED.


KEYNOTES (THIS SHEET ONLY)

- PROVIDE INSULATED BACKER FOR T-STAT SENSOR.
- RUN HWS/R PIPING NEAR ATTIC FLOOR ON STANCHEONS SECURED TO SUPPORT FRAMING FROM HWS/R RISERS TO ATTIC UNIT HEATER 3-1. REFER TO STRUCTURAL DRAWING SF 105 FOR SUPPORT FRAMING DETAILS.
- PROVIDE PVC JACKET ON HWS/R PIPING UP TO 6'-0" ABOVE WALKWAY.
- PROVIDE NESTED U-BEND EXPANSION LOOPS WITH HWS HAVING 48" SIDES AND A 24" END. HWR U-BEND TO HAVE 48" SIDES.
- PROVIDE DELEGATED DESIGN FOR EXPANSION ANCHOR POINTS FOR REVIEW AND APPROVAL.

KEY PLAN

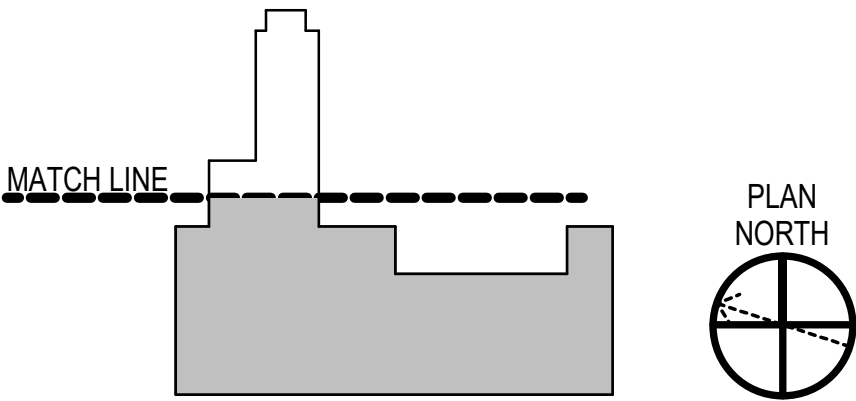

GRAPHIC SCALE

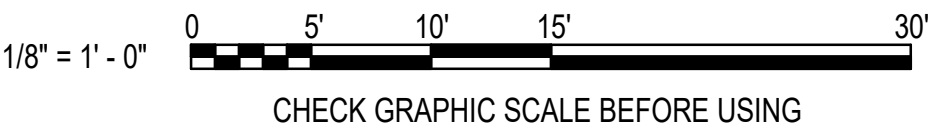

APPROVED		DATE	
FOR COMMANDER NAVFAC		DATE	
ACTIVITY		DATE	
SATISFACTORY TO DATE		DATE	
DESIGNER	RNC	AMENDMENT 008	03/12/2026
DRAWN BY	SRW	FINAL SUBMISSION	10/07/2025
CHECKED BY	MSA	MARK	DESCRIPTION
DESIGN MANAGER	T. CARLETON		
PROJECT MANAGER	L. LYONS		
HEADLINE			
FIRE PROTECTION	S. RUCINSKI		
DEPARTMENT OF THE NAVY		NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND	
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - MID-ATLANTIC		PORTSMOUTH NAVAL SHIPYARD - KITTERY, ME	
PORTSMOUTH NAVAL SHIPYARD		B60 REPAIRS	
ATTIC MECHANICAL PIPING PLAN			
PROJECT NO. 1740579			
NAVFAC DRAWINGS NO.			
SHEET 210 OF 282			
MP107			
DRAWING REVISION: 14 SEP 2023			

