


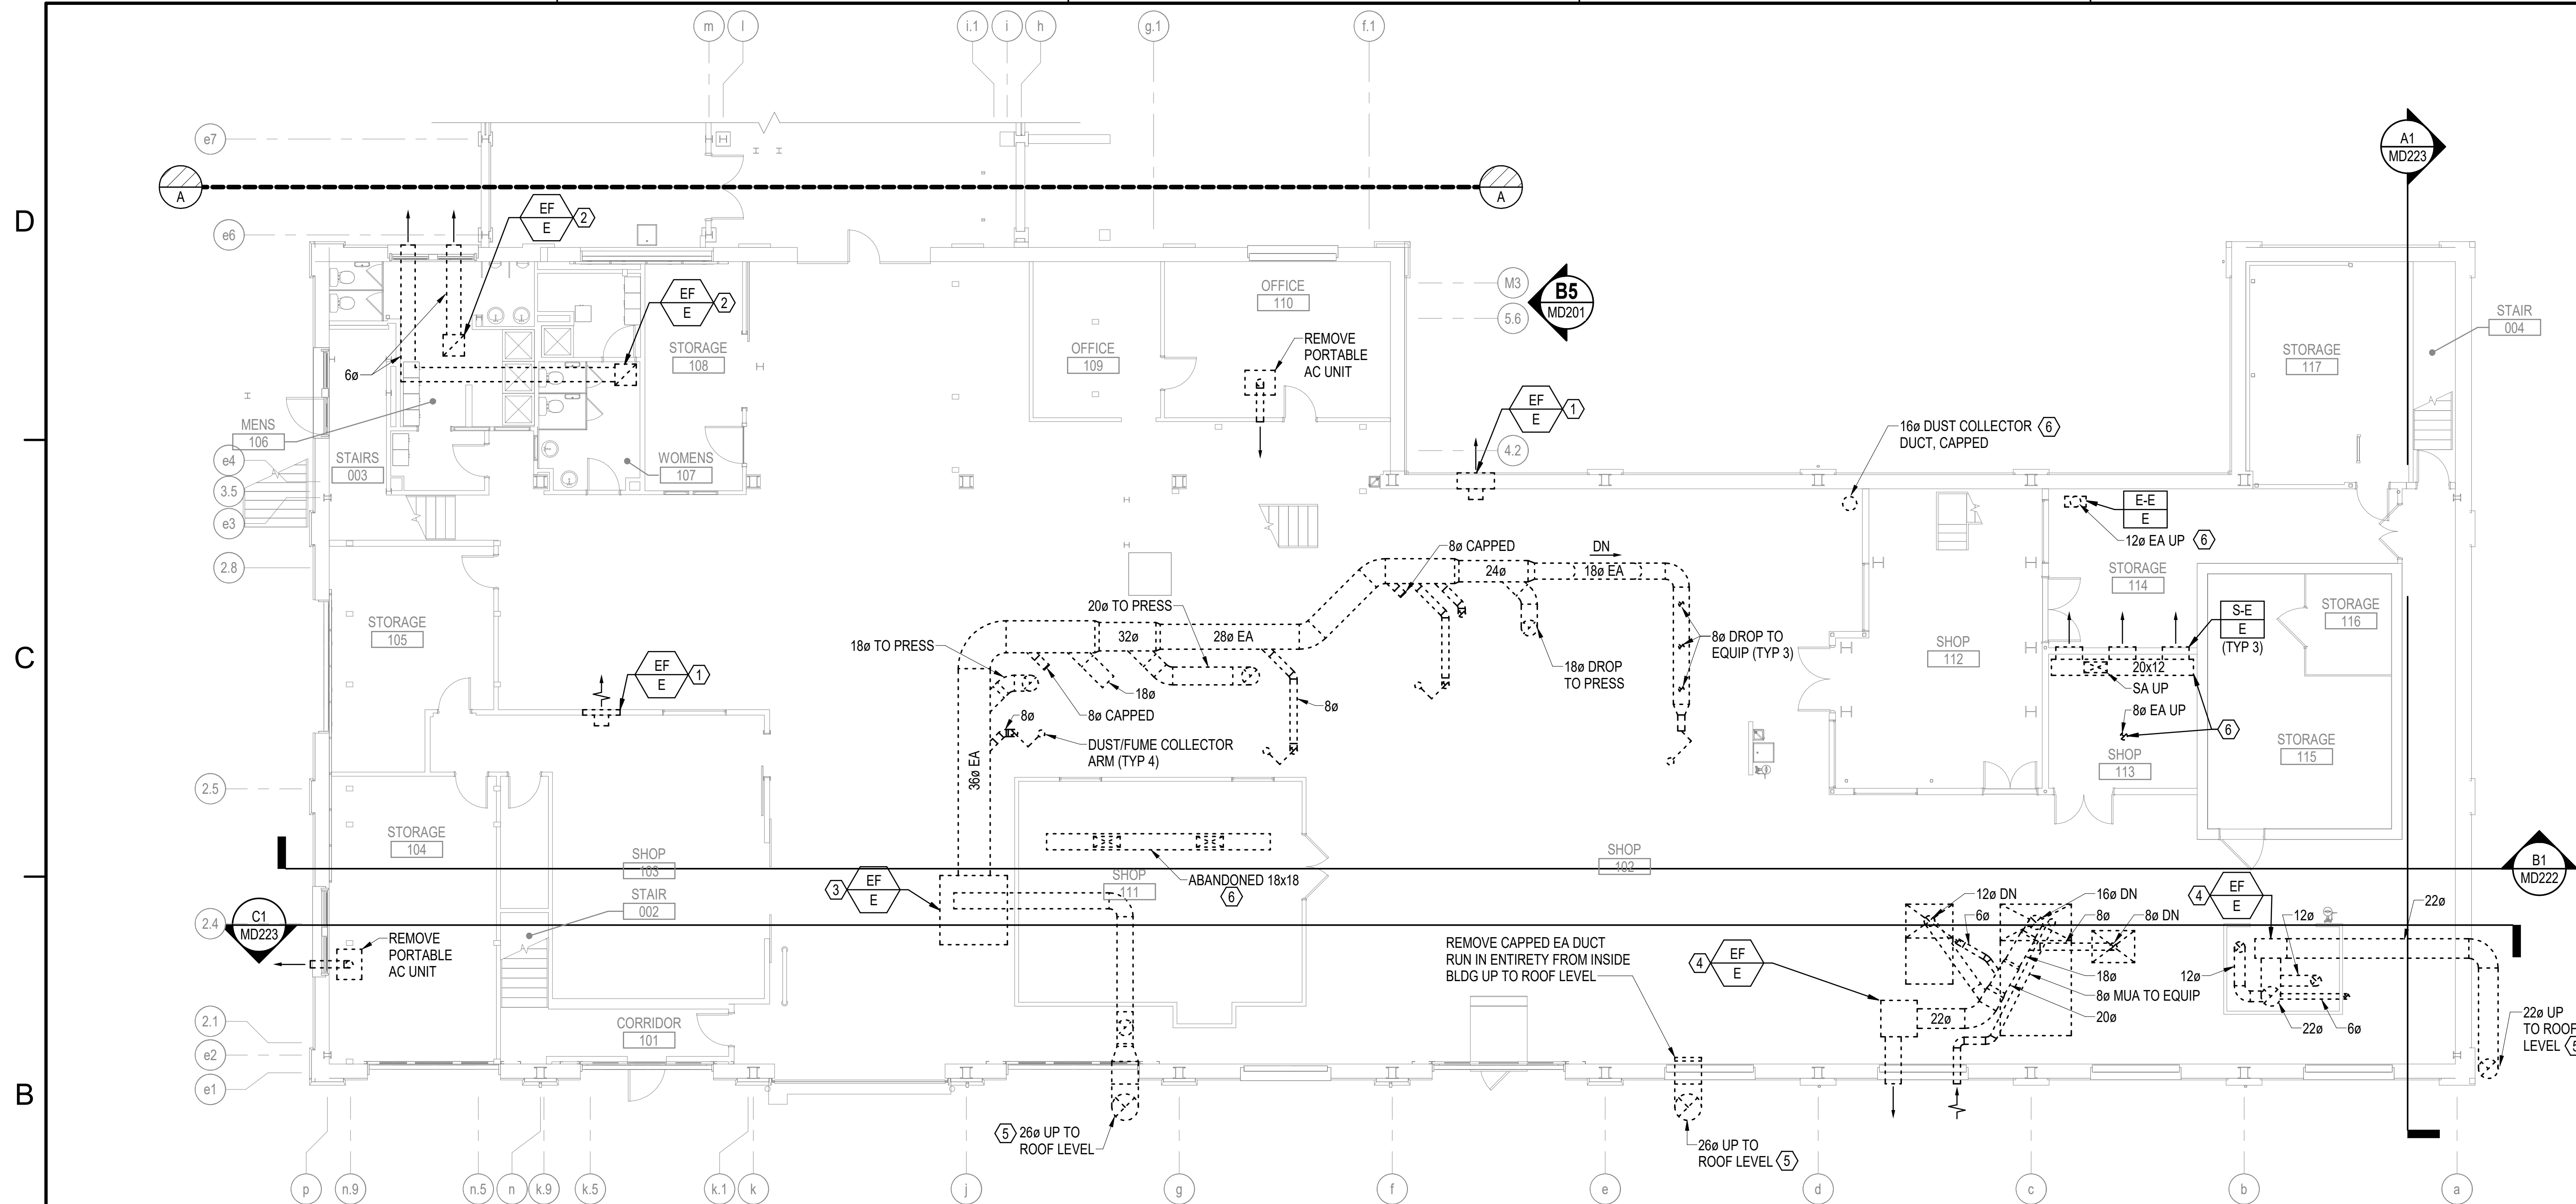

B1 **FIRST FLOOR MECHANICAL DUCTWORK REMOVALS PLAN - WEST**
SCALE: 1/8" = 1'-0"


GENERAL NOTES

1. SEE M-001 FOR MECHANICAL LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
2. REMOVE ALL HVAC AND INDUSTRIAL PROCESS EQUIPMENT AND ASSOCIATED CONTROLS, WIRING AND DUCTWORK THROUGHOUT THE SPACES SHOWN ON THIS SHEET UNLESS OTHERWISE NOTED.
3. COORDINATE WITH ARCHITECTURAL DRAWINGS FOR PATCHING OF OPEN FLOOR, WALL AND CEILING PENETRATIONS ASSOCIATED WITH REMOVALS.
4. MECHANICAL SUBCONTRACTOR SHALL IDENTIFY, MAKE SAFE, CUT LOOSE AND CAP ALL ITEMS SPECIFIED TO BE DEMOLISHED. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR DEMOLITION AND REMOVAL OFF SITE TO AN AUTHORIZED SALVAGE FACILITY.
5. REFER TO CLIN 002 FOR LIST OF INDUSTRIAL EQUIPMENT REMOVAL REQUIREMENTS.
6. COORDINATE REMOVAL WITH HAZMAT DRAWINGS AND REQUIREMENTS.
7. EXISTING MECHANICAL EQUIPMENT, DUCTWORK, AND PIPING THROUGHOUT THE BUILDING TO BE REMOVED, UNLESS OTHERWISE NOTED.
8. CONDUCT TESTING OF EXISTING PUMPED STEAM CONDENSATE SYSTEM RETURN LINE BACK PRESSURE AND REPORT RESULTS TO CONTRACTING OFFICE PRIOR TO COMMENCING WORK WITH REMOVALS IN BUILDING 60.

REMOVALS KEYNOTES (THIS SHEET ONLY)

- ① REMOVE THROUGH-WALL EXHAUST FAN, AND ASSOCIATED CONTROLS AND WIRING.
- ② REMOVE EXHAUST FAN AND ASSOCIATED DUCTWORK, LOUVERS AND CONTROLS.
- ③ [CLIN002] REMOVE EXHAUST FAN AND ASSOCIATED DUCTWORK, HOODS, VFD, CONTROLS, AND WIRING.
- ④ [CLIN002] REMOVE EXHAUST FAN AND ASSOCIATED DUCTWORK, ENCLOSURES, HOODS, CONTROLS, AND WIRING.
- ⑤ [CLIN002] REMOVE ENTIRE EXHAUST DUCT RISER AND ASSOCIATED SUPPORTS.
- ⑥ [CLIN002] REMOVE DUCTWORK ASSEMBLY.

KEY PLAN

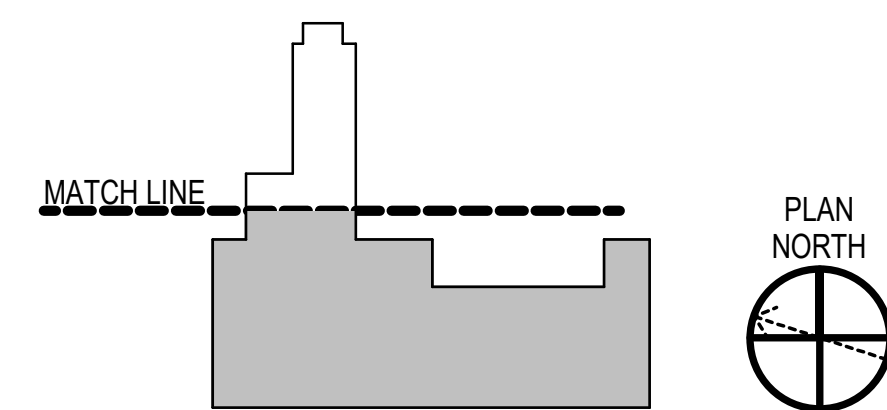

GRAPHIC SCALE

1/8" = 1' - 0"



CHECK GRAPHIC SCALE BEFORE USING