


3/20/2026 1:38:22 PM P-107
C:\Users\richards\Documents\22103.25_BLDG60_MECHANICAL-V23_swhitec82ZD.rvt

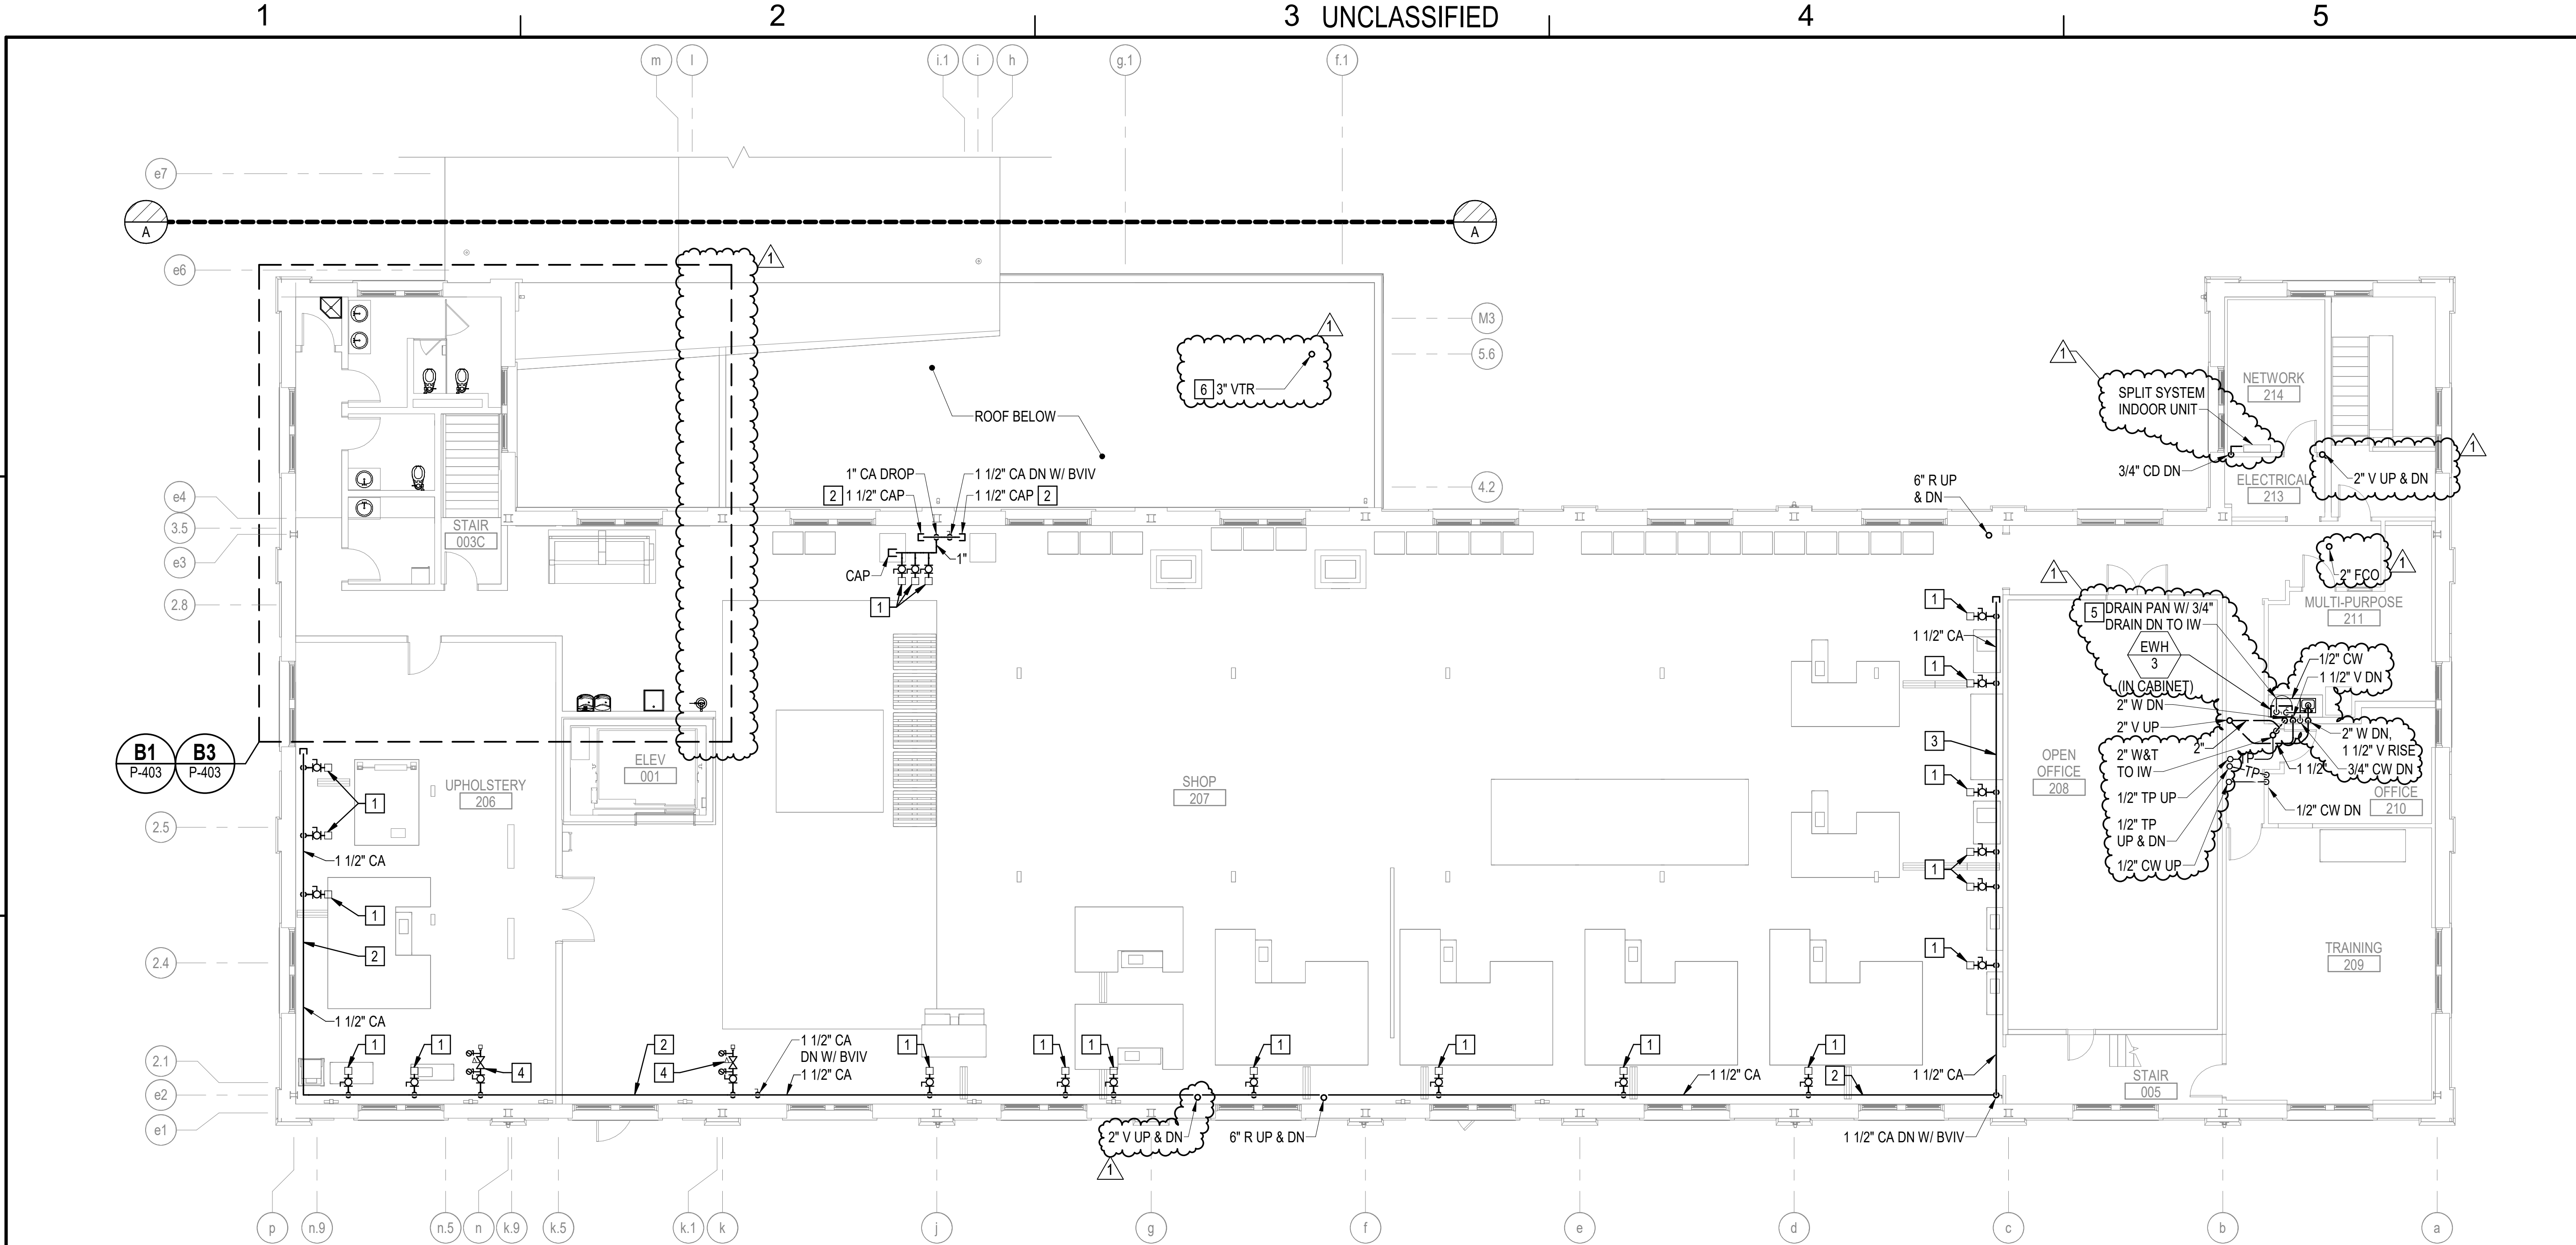

B1 SECOND FLOOR PLUMBING PLAN - WEST
SCALE: 1/8" = 1'-0"


GENERAL NOTES

- SEE P-001 FOR PLUMBING LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
- CORRDINATE WITH CONTRACTING OFFICER THE LOCATIONS FOR COMPRESSED AIR BRANCH SERVICE PIPING OUTLETS, CONSISTENT WITH THE FINAL SHOP EQUIPMENT LAYOUT.


KEYNOTES (THIS SHEET ONLY)

- PROVIDE CA OUTLET WITH DIRT LEG AND 1/2" PIPED OUTLET WITH ISOLATION BALL VALVE AND QUICK CONNECT FEMALE FITTING TO RECEIVE A 3/8" CA HOSE W/ CONNECTING MALE COMPONENT OF QUICK CONNECT FITTING. COORDINATE WITH CONTRACTING OFFICER TO ESTABLISH QUICK CONNECT FITTING SELECTIONS. PLACE OUTLETS 48" AFF.
- RUN HORIZONTAL CA PIPE AT 84" AFF.
- RUN HORIZONTAL CA PIPE AT 108" AFF.
- PROVIDE CA OUTLET 48" AFF WITH ISOLATION BALL VALVE, CA PRESSURE REGULATOR, PRESSURE GAUGES UPSTREAM AND DOWNSTREAM OF REGULATOR AND QUICK CONNECT HOSE FITTING. COORDINATE QUICK CONNECT FITTING SELECTION AND OUTLET LOCATIONS WITH CONTRACTING OFFICER TO ALIGN WITH FINAL SHOP EQUIPMENT LAYOUT.
- PROVIDE AUXILIARY DRAIN PAN FOR EWH-3. PIPE 3/4" DRAIN TO AIR GAP FITTING BELOW (SEE SHEET P-106).
- 3" VTR MUST BE A MINIMUM OF 10 FEET AWAY FROM EDGE DOAS-1 ROOF CURB MOUNTED GRAVITY INLET HOOD GIV-1. SEE SHEET MH103 FOR INLET HOOD LOCATION REFERENCE.

KEY PLAN

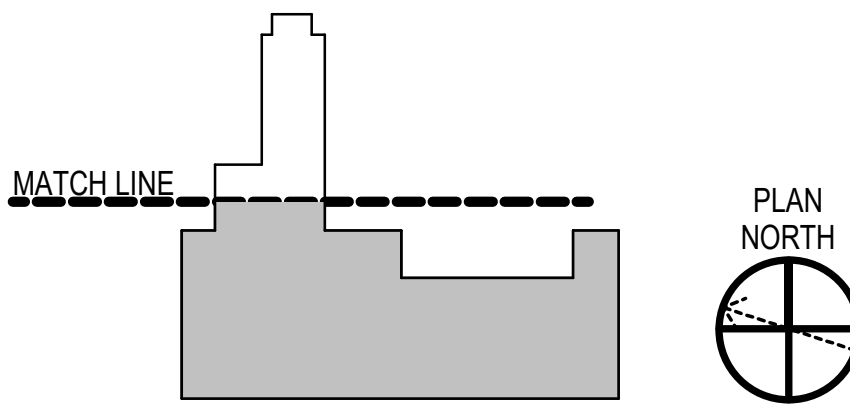

GRAPHIC SCALE

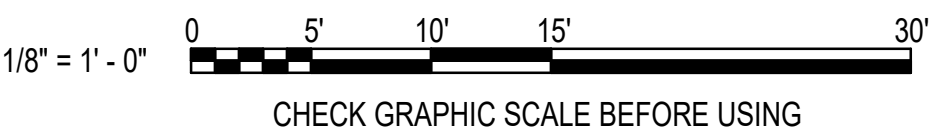

APPROVED	FOR COMMANDER NAVFAC	ACTIVITY	NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - MID-ATLANTIC	PORTSMOUTH NAVAL SHIPYARD - KITTERY, ME	ROCC-ME								
SATISFACTORY TO DATE	DESIGNER	RNC	DRAWN BY	SRW	CHECKED BY	MSA	DESIGN MANAGER	T. CARLETON	L. LYONS	HEADLINE	S. RUCINSKI		
PROJECT NO.	1740579	NAV-FAC DRAWINGS NO.	SHEET	175	OF	282	P-107	DATE	03/20/2026	DATE	10/07/2025	DATE	APR
AMENDMENT 010	FINAL SUBMISSION	MARK	DESCRIPTION	DATE	DATE	DATE	DATE	DATE	DATE	DATE	DATE	DATE	DATE

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING SYSTEMS COMMAND - MID-ATLANTIC
PORTSMOUTH NAVAL SHIPYARD - KITTERY, ME
ROCC-ME
B60 REPAIRS
SECOND FLOOR PLUMBING PLAN
A