

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT				1. CONTRACT ID CODE		PAGE 1 OF 5 PAGES									
2. AMENDMENT/MODIFICATION NO. AMENDMENT NO. 0005		3. EFFECTIVE DATE 04/10/26		4. REQUISITION/PURCHASE REQ. NO.		5. PROJECT NO. (If applicable) 26-0409									
6. ISSUED BY CODE		N40085		7. ADMINISTERED BY (If other than Item 6) CODE											
NAVFAC Mid-Atlantic Resident Officer in Charge of Construction 1107A Birch Street Camp Lejeune, NC 28547-2521				See Item 6											
8. NAME AND ADDRESS OF CONTRACTOR (No., street, county, State and ZIP Code)				(X)		9A. AMENDMENT OF SOLICITATION NO.									
				X		N40085-26-R-9017									
						9B. DATED (SEE ITEM 11) 02/05/26									
						10A. MODIFICATION OF CONTRACT/ORDER NO.									
						10B. DATED (SEE ITEM 11)									
CODE		FACILITY CODE													
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS															
☒ The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers ☐ is extended, ☒ is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing items 8 and 15, and returning <u>1</u> copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment your desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.															
12. ACCOUNTING AND APPROPRIATION DATA (If required)															
13. THIS ITEM ONLY APPLIES TO MODIFICATION OF CONTRACTS/ORDERS. IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.															
<table border="1" style="width:100%; border-collapse: collapse;"><tr><td style="width:10%;">CHECK ONE</td><td>A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.</td></tr><tr><td></td><td>B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b).</td></tr><tr><td></td><td>C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:</td></tr><tr><td></td><td>D. OTHER (Specify type of modification and authority)</td></tr></table>								CHECK ONE	A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.		B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b).		C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:		D. OTHER (Specify type of modification and authority)
CHECK ONE	A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.														
	B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b).														
	C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:														
	D. OTHER (Specify type of modification and authority)														
E. IMPORTANT: Contractor ☐ is not, ☐ is required to sign this document and return _____ copies to the issuing office.															
14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.) 26-0409 - Roof Repairs Bldgs HP215, 225, 235, 245, 275, 285, 295 Amendment 0005, Provide Responses to RFIs Proposal due date remains April 16, 2026 at 3:00PM. This amendment should be acknowledged when your proposal is submitted. Failure to acknowledge the amendment may constitute grounds for rejection of a proposal.															
Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.															
15A. NAME AND TITLE OF SIGNER (Type or print)				16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)											
15B. CONTRACTOR/OFFEROR		15C. DATE SIGNED		16B. UNITED STATES OF AMERICA		16C. DATE SIGNED									
(Signature of person authorized to sign)				(Signature of Contracting Officer)											

NSN 7540-01-152-8070
Previous edition unusable

STANDARD FORM 30 (REV. 10-83)
Prescribed by GSA FAR (48 CFR) 53.243

CONTINUATION SHEET

1. **QUESTION:** The RFP dated 2/23/2026 has listed 7 barracks that need new roofs to include demo of the existing roofs and installing new standing seam metal roofs. The Contract completion date is shown as 360 days after award. There are typically 60 days needed after the award to hold the Preconstruction conference, issue all Purchase Orders and get Admin and Technical submittals in, and approved to allow procurement of materials needed to start work. This only leaves 300 calendar days to complete all 7 buildings to include punch out and final inspections. $300/7 = 42.8$ calendar days per building. Actual workdays estimating 5 workdays a week leave only 30 workdays to complete all scopes on each building to avoid completing late and incurring LDs. Our Experience with the 3 story barracks with this scope of work will require a minimum of 3 to 4 months per building taking consideration for inclement weather and other mitigating factors. Will the Government consider increasing the time allowed to do all 7 buildings to a minimum of 720 days?

ANSWER: Yes, completion in 720 days is acceptable.

2. **QUESTION:** There are 21 total barracks projects out for bid at the same time this project is bid. Is it possible that the bid due dates can be spaced out over the fiscal year so that all 21 buildings are not awarded at the same time? If that is not an option, can the government consider delaying the award of each project with a 4 to 6 week delay between each project award? This will help with the assignment of manpower required for each scope of work. This will also help with the internal load placed on Government personnel to get all projects awarded and started.

ANSWER: No

3. **QUESTION:** Note 2 under General Requirements on 275, 285, 295 “Remove existing Lightning Protection If Applicable”. There are no notes to reinstall the existing lightning protection. Is the intent to leave the Lightning protection off the building? Is the intent to reinstall the existing lightning protection? Is the intent to install new lightning protection? If new lightning protection is required, please provide design requirements.

ANSWER: The intent will be to remove the lightning protection as required to install the new roofing system as required. The lightning protection system will be re-installed upon the installation of the new roof system.

4. **QUESTION:** Note 9 under General Requirements for Building 275, 285, 295 states “Install panel clips as per the manufactures recommendation for a 150 mph Wind in accordance with the Uniform Building Code for North Carolina”. Panel clip spacing based

on the Wind Uplift Calculations takes into consideration the pull-out strength of the roof deck substrate. Does the Government know if the plywood roof decks are 5/8" plywood or 3/4" plywood?

ANSWER: All Roof sheathing is 19/32" OSB for HP275, HP285, HP295. (See attached existing typical roof detail)

5. **QUESTION:** Note 10 under General Requirements for Building 215, 225, 235, 245 states "Install panel clips as per the manufactures recommendation for a 150 mph Wind in accordance with the Uniform Building Code for North Carolina". Panel clip spacing based on the Wind Uplift Calculations takes into consideration the pull-out strength of the roof deck substrate. Does the Government know if the plywood roof decks are 5/8" plywood or 3/4" plywood?

ANSWER: All Roof sheathing is 19/32" OSB for HP215, HP225, HP235, HP245. (See attached existing typical roof detail)

6. **QUESTION:** During our site visit we noticed some differences regarding the downspouts on the 7 different buildings. Building HP-215, 224, 235, 245, 275, and 285 show the downspouts dropping out of the bottom of the gutters, running down the parapet wall about 2 feet and turning back into and through the existing parapet wall piping the rainwater back into the building into pvc piping installed in the attic. Our experience over the last 10 to 15 years has included provisions in the contract drawings to provide 6"x6"x1/4" Steel Downspouts to channel the water out of the building down and tying into a rain leader below grade. The Tubular Steel provides protection of the downspout from potential damages that could crush or bend the typical light gauge aluminum downspouts.


There is currently no work included in this projects scope of work to do anything with the existing gutters and downspout's other than to clean them. Does the government want to leave the downspouts turning back into the attic space or are 6X6 tubular steel downspouts needed on these 6 buildings?

ANSWER: Please proceed with the install of the requested 6x6 tubular steel downspouts on these 6 buildings. The detail mention for typical Tubular Steel DS will suffice. (HP215, HP225, HP235, HP245, HP275, HP285).

7. All other terms and conditions remain unchanged.

SECTION AT GABLE

3/4" = 1'-0"




1
A8 A11
A9


SECTION AT GABLE

3/4" = 1'-0"






7
A11

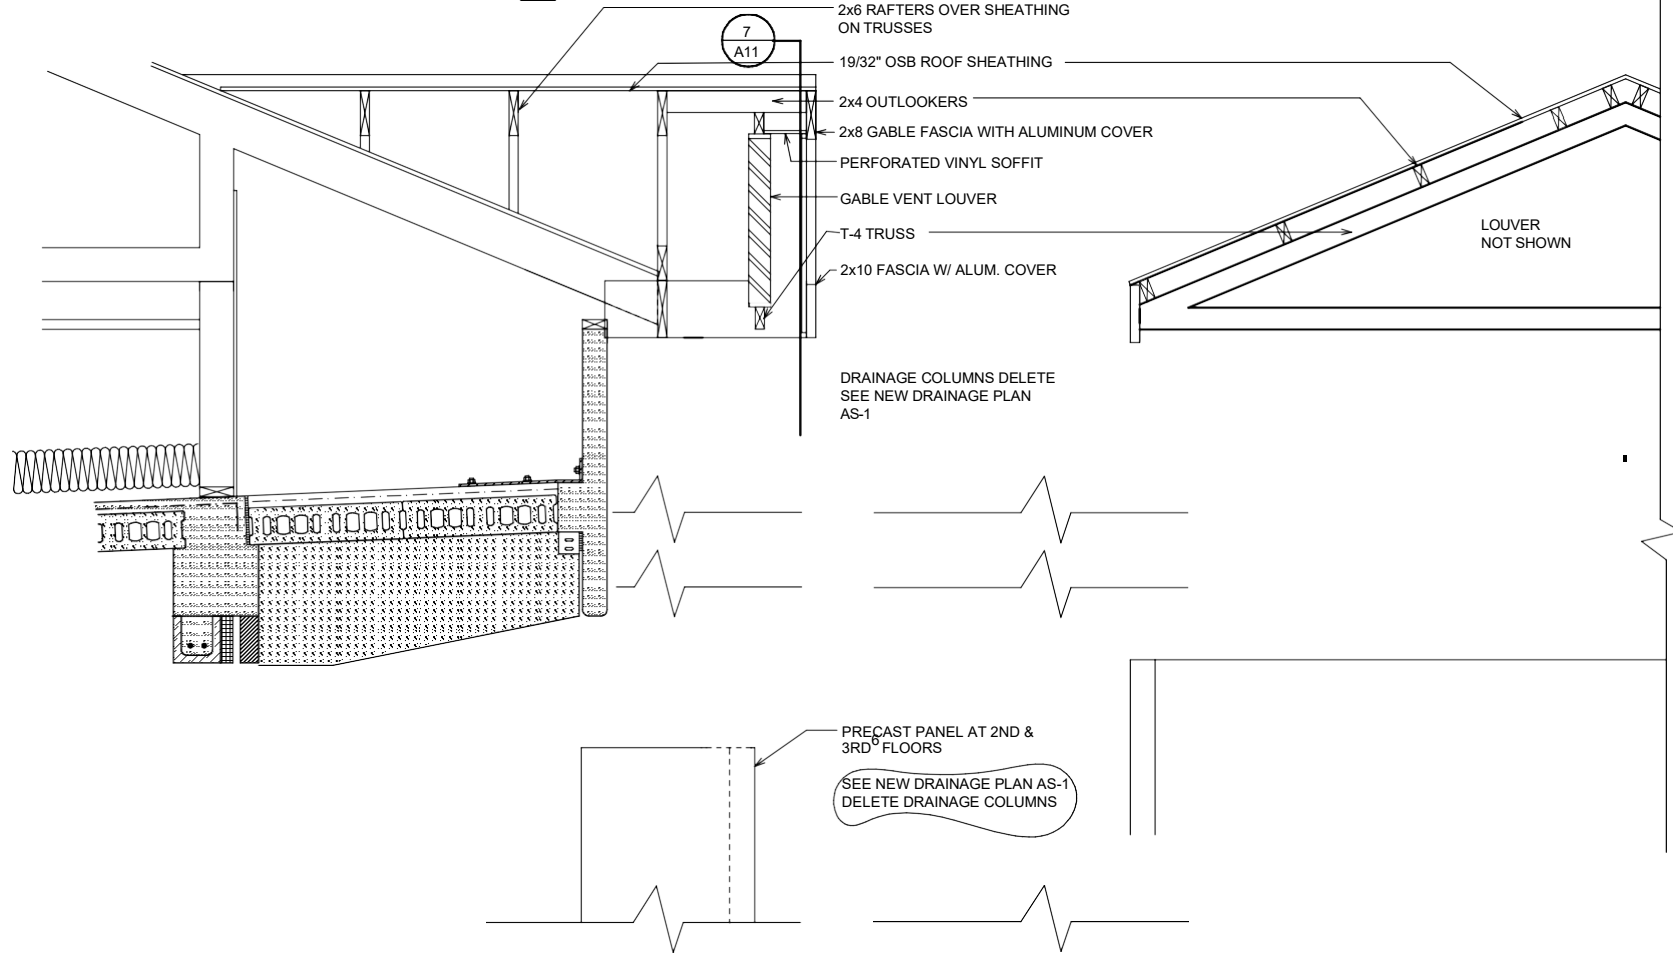



METAL GUARDRAIL AT
EXTENDED BALCONY IN
PLACE OF REMOVED
CONCRETE GUARD (TYP).
SEE SHEET A-504 FOR
ADDITIONAL
INFORMATION

NEW CONCRETE
SIDEWALK

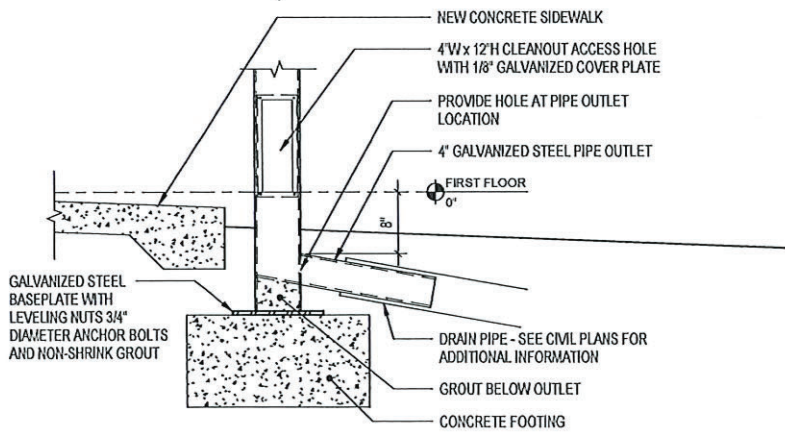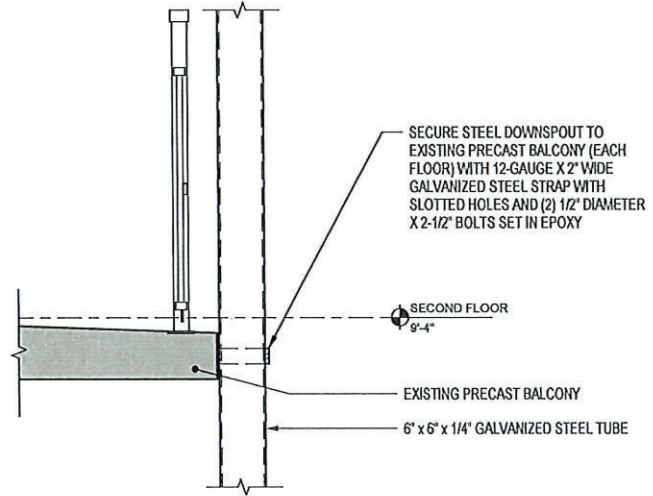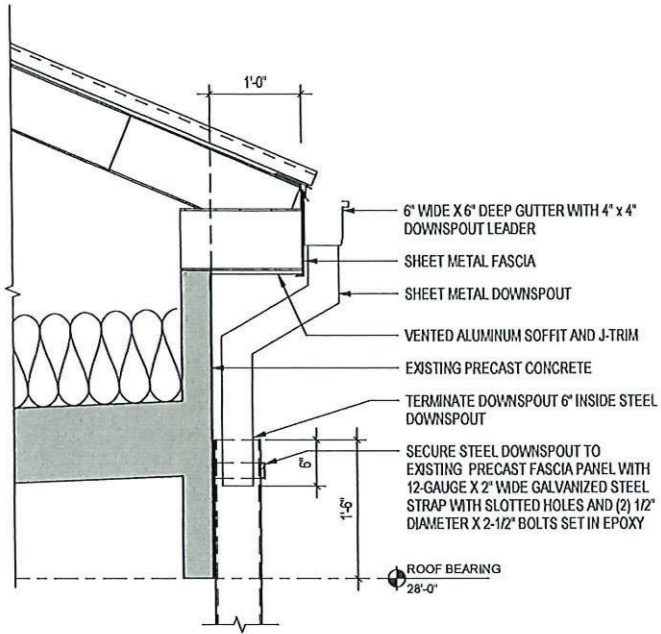

A5 DOWNSPOUT SECTION
SCALE: 1" = 1'-0"

