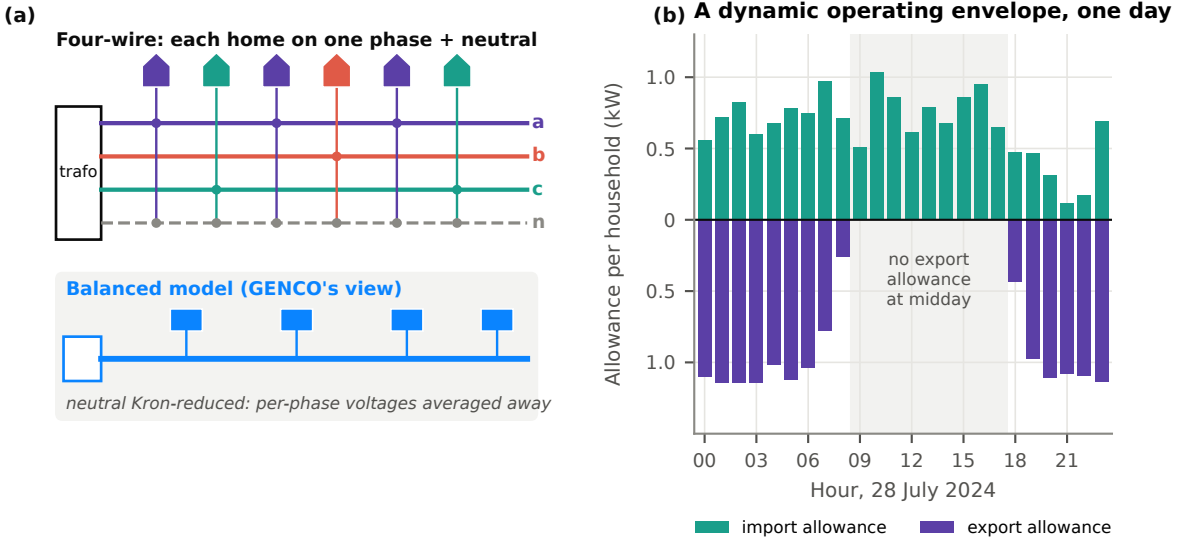
(a)
Four-wire: each home on one phase + neutral
trafo
a
b
c
n
Balanced model (GENCO's view)
neutral Kron-reduced: per-phase voltages averaged away
(b) A dynamic operating envelope, one day
Allowance per household (kW)
1.0
0.5
0
0.5
1.0
no export
allowance
at midday
00
03
06
09
12
15
18
21
Hour, 28 July 2024
import allowance
export allowance