Dynamic envelopes free capacity a constant add-on cannot
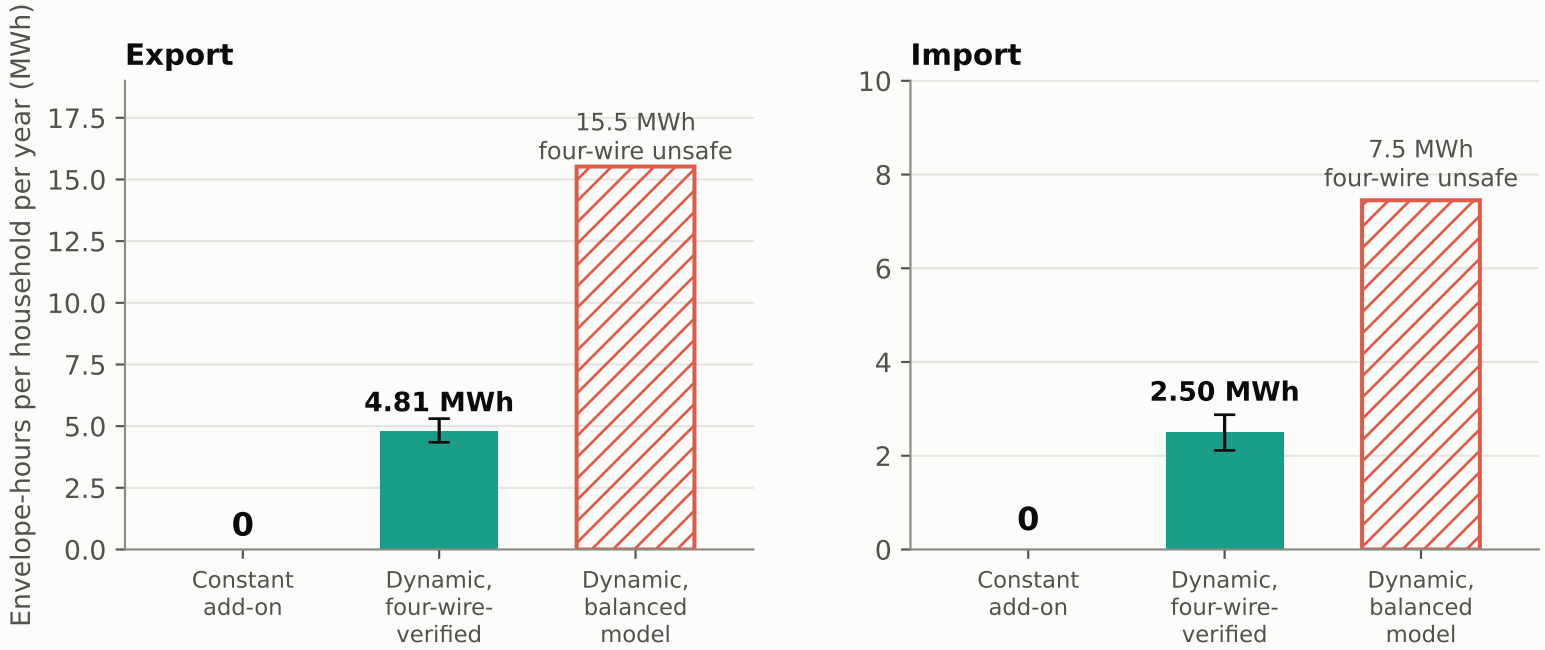
ENWL1 four-wire benchmark, Fluvius 2024 households, 36 test-split days; constant add-on = one optional allowance above the passive demand, valid in every interval; bars = annual estimate, whisker = season-stratified day-bootstrap 95% interval