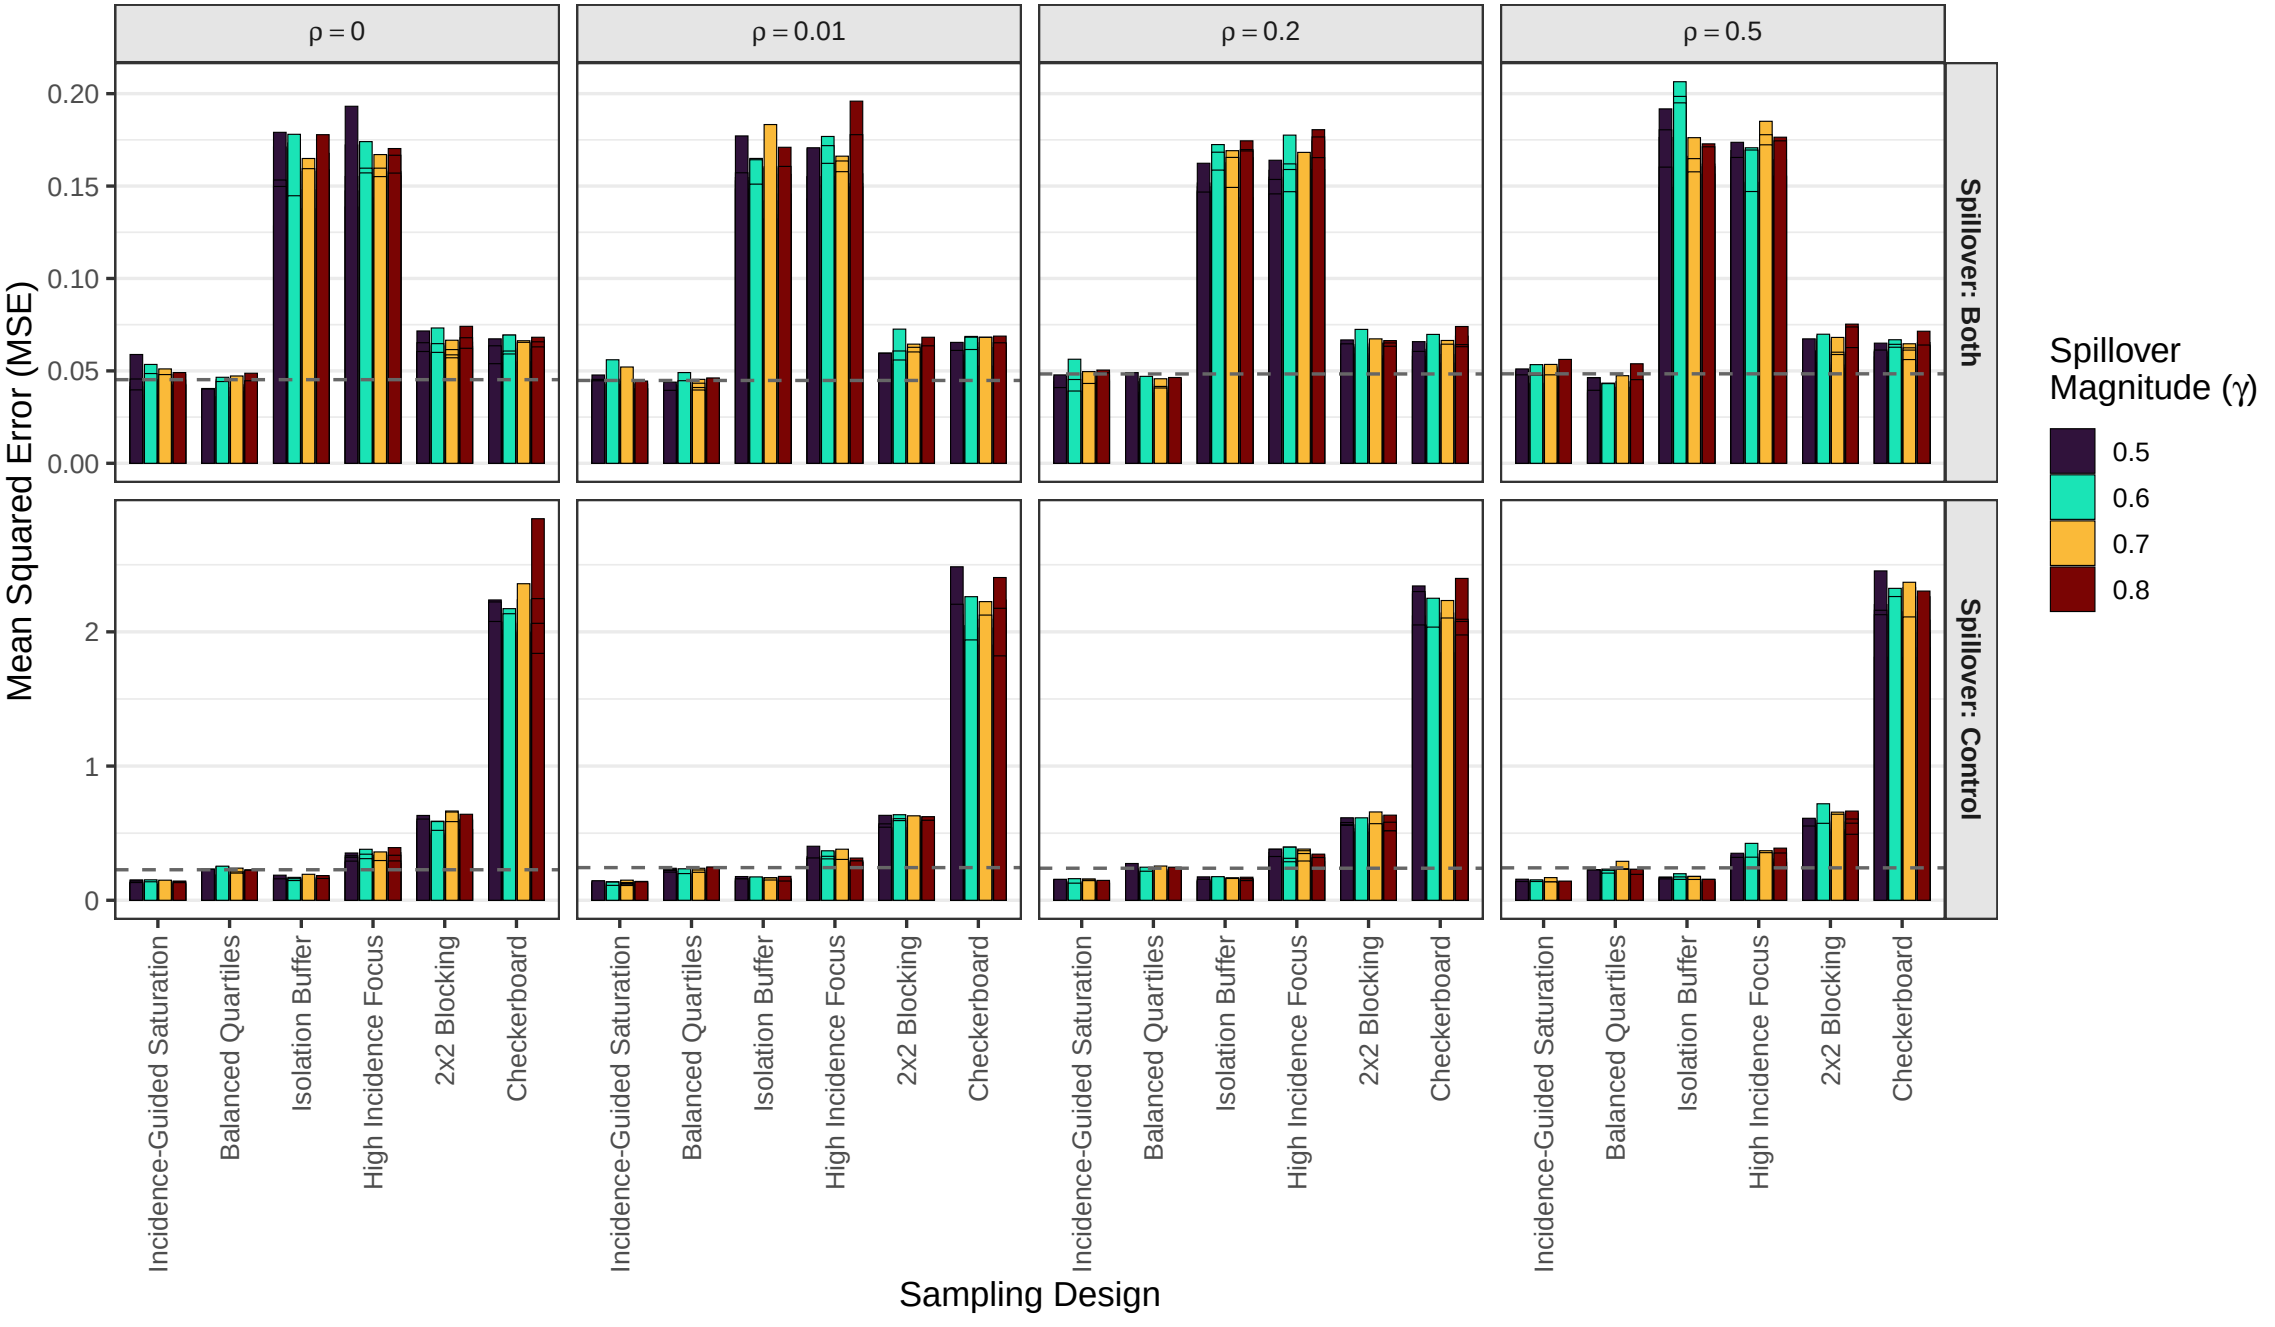
ρ = 0
ρ = 0.01
ρ = 0.2
ρ = 0.5
Spillover: Both
Spillover: Control
Mean Squared Error (MSE)
0.00
0.05
0.10
0.15
0.20
0
1
2
Incidence-Guided Saturation
Balanced Quartiles
Isolation Buffer
High Incidence Focus
2x2 Blocking
Checkerboard
Sampling Design
Spillover Magnitude (γ)
0.5
0.6
0.7
0.8