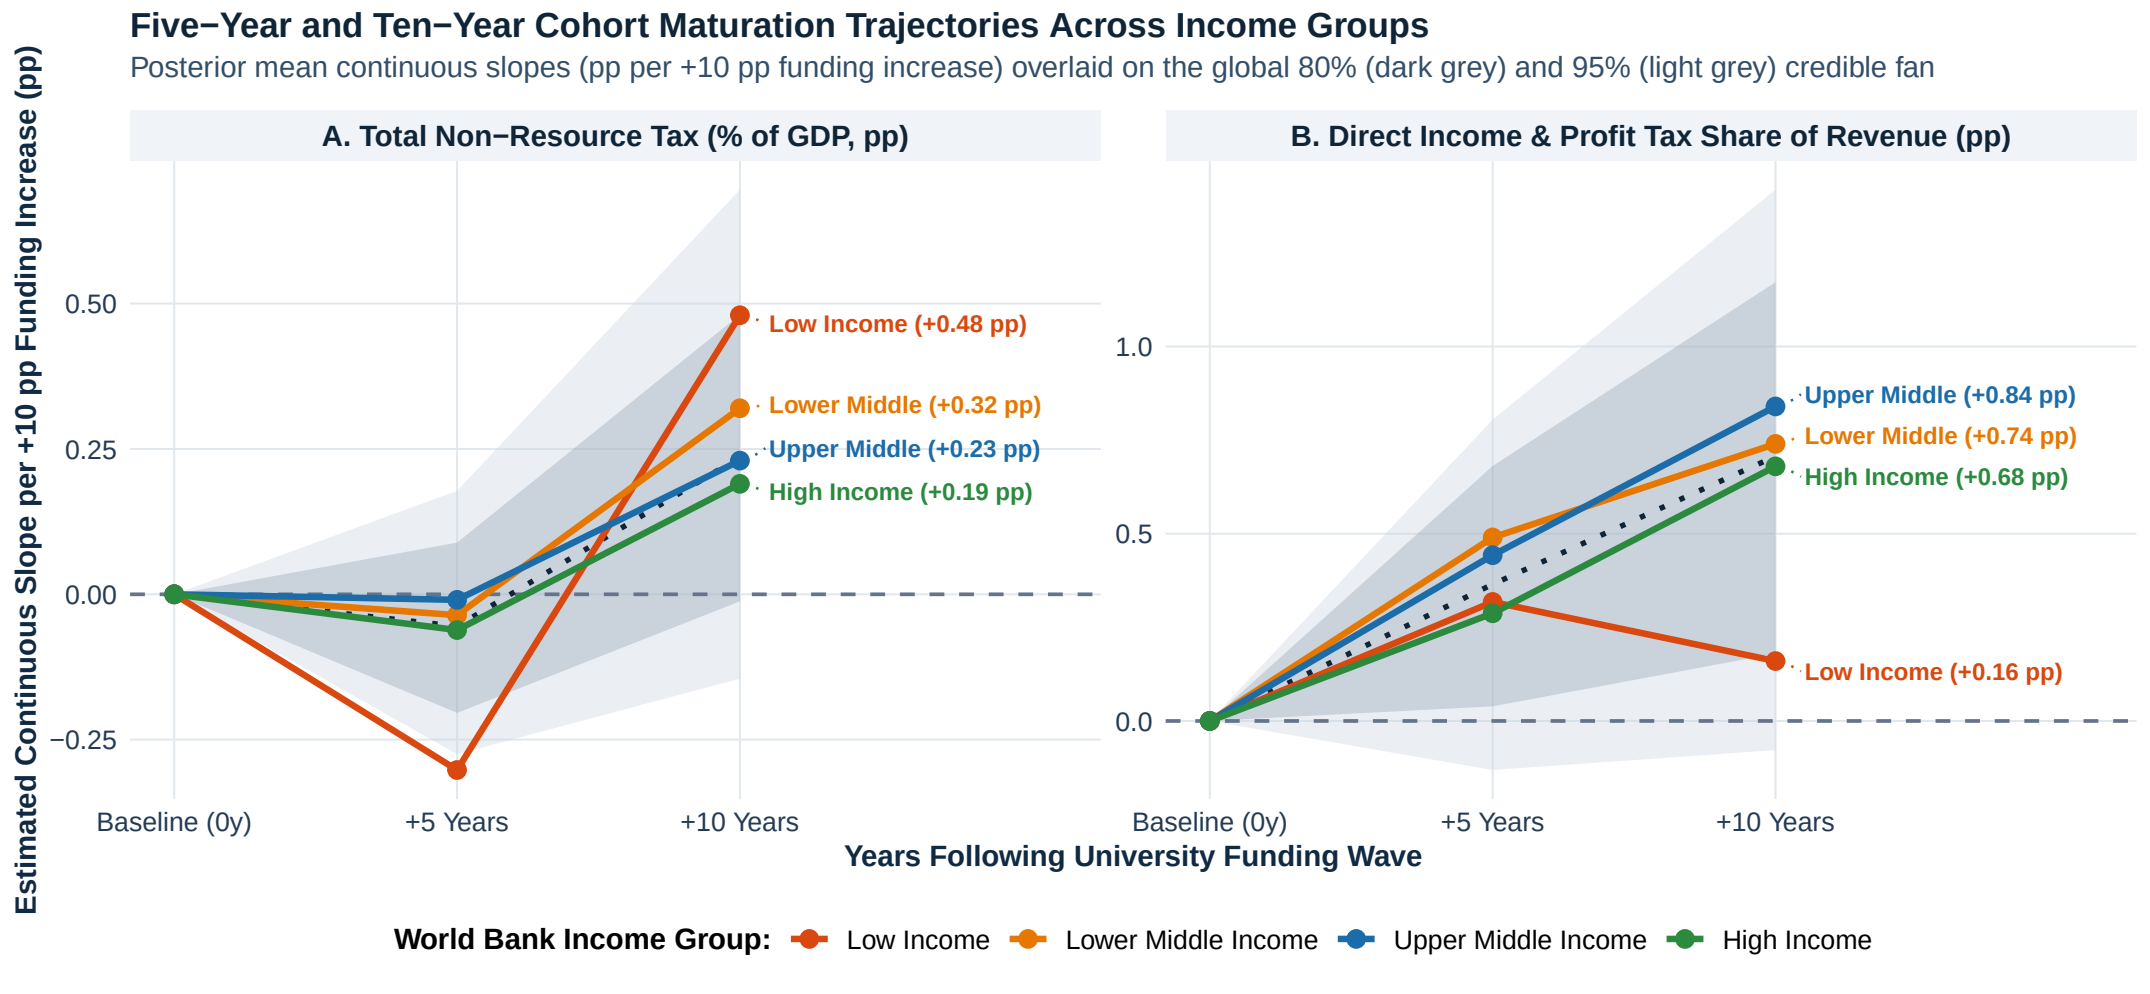

Note: Dotted black line and grey ribbons show the global posterior mean and 80%/95% credible fan (−0.06 to +0.24 pp in Panel A; +0.36 to +0.71 pp in Panel B).