



Note 1: The Chroma input and Chroma output is not a common neutral
 Note 2: The Chroma output and E-Loads 1-3 is not a common neutral
 Note 3: E-Loads 1-3 share a common neutral
 Note 4: The E-Load is earthed by its mains supply cable
 Note 5: Link between these terminals shown when removing Chroma PSU (with 16A wire)

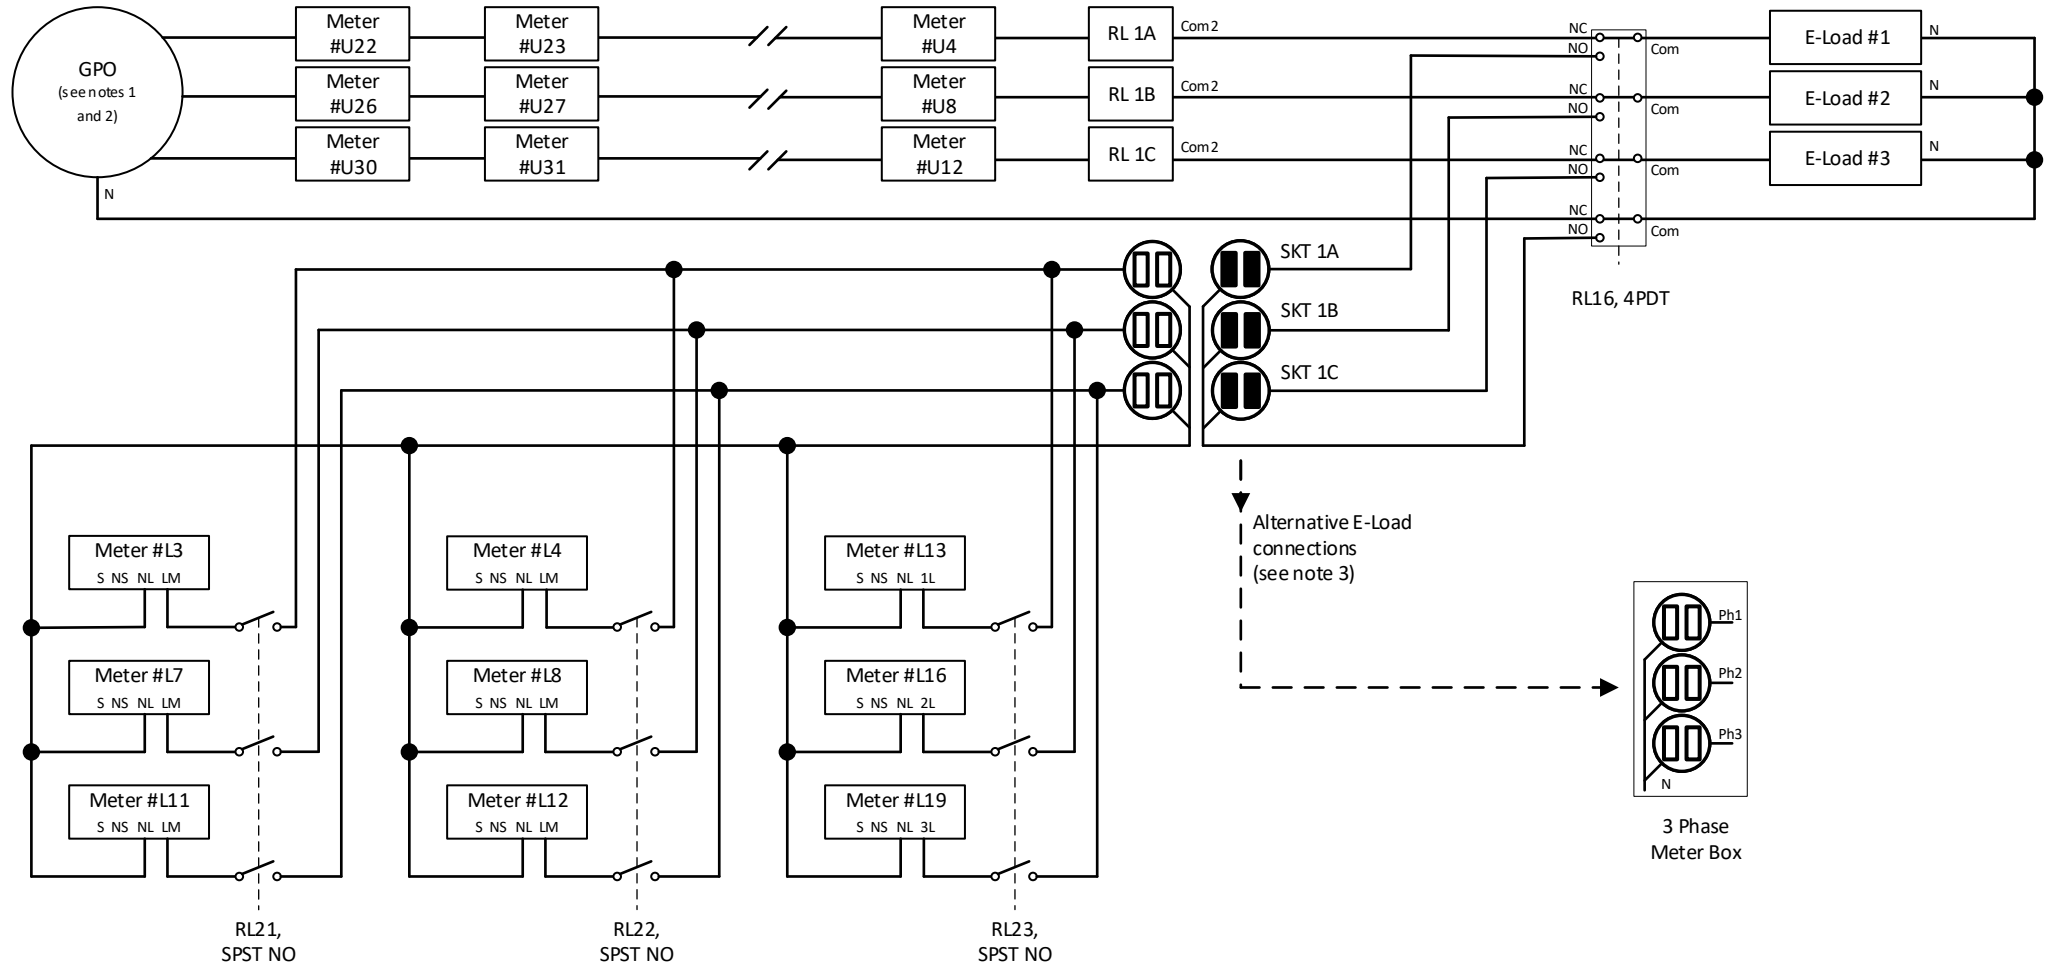

Note 1: The series circuit supply should bypass any UPS (to implement power factor changes)

Note 2: Supplied from distribution board AC-DB1, CB; 31, 33, and 35

Note 3: Connect only one single phase meter box at a time as 2 meter boxes will trigger RCDs

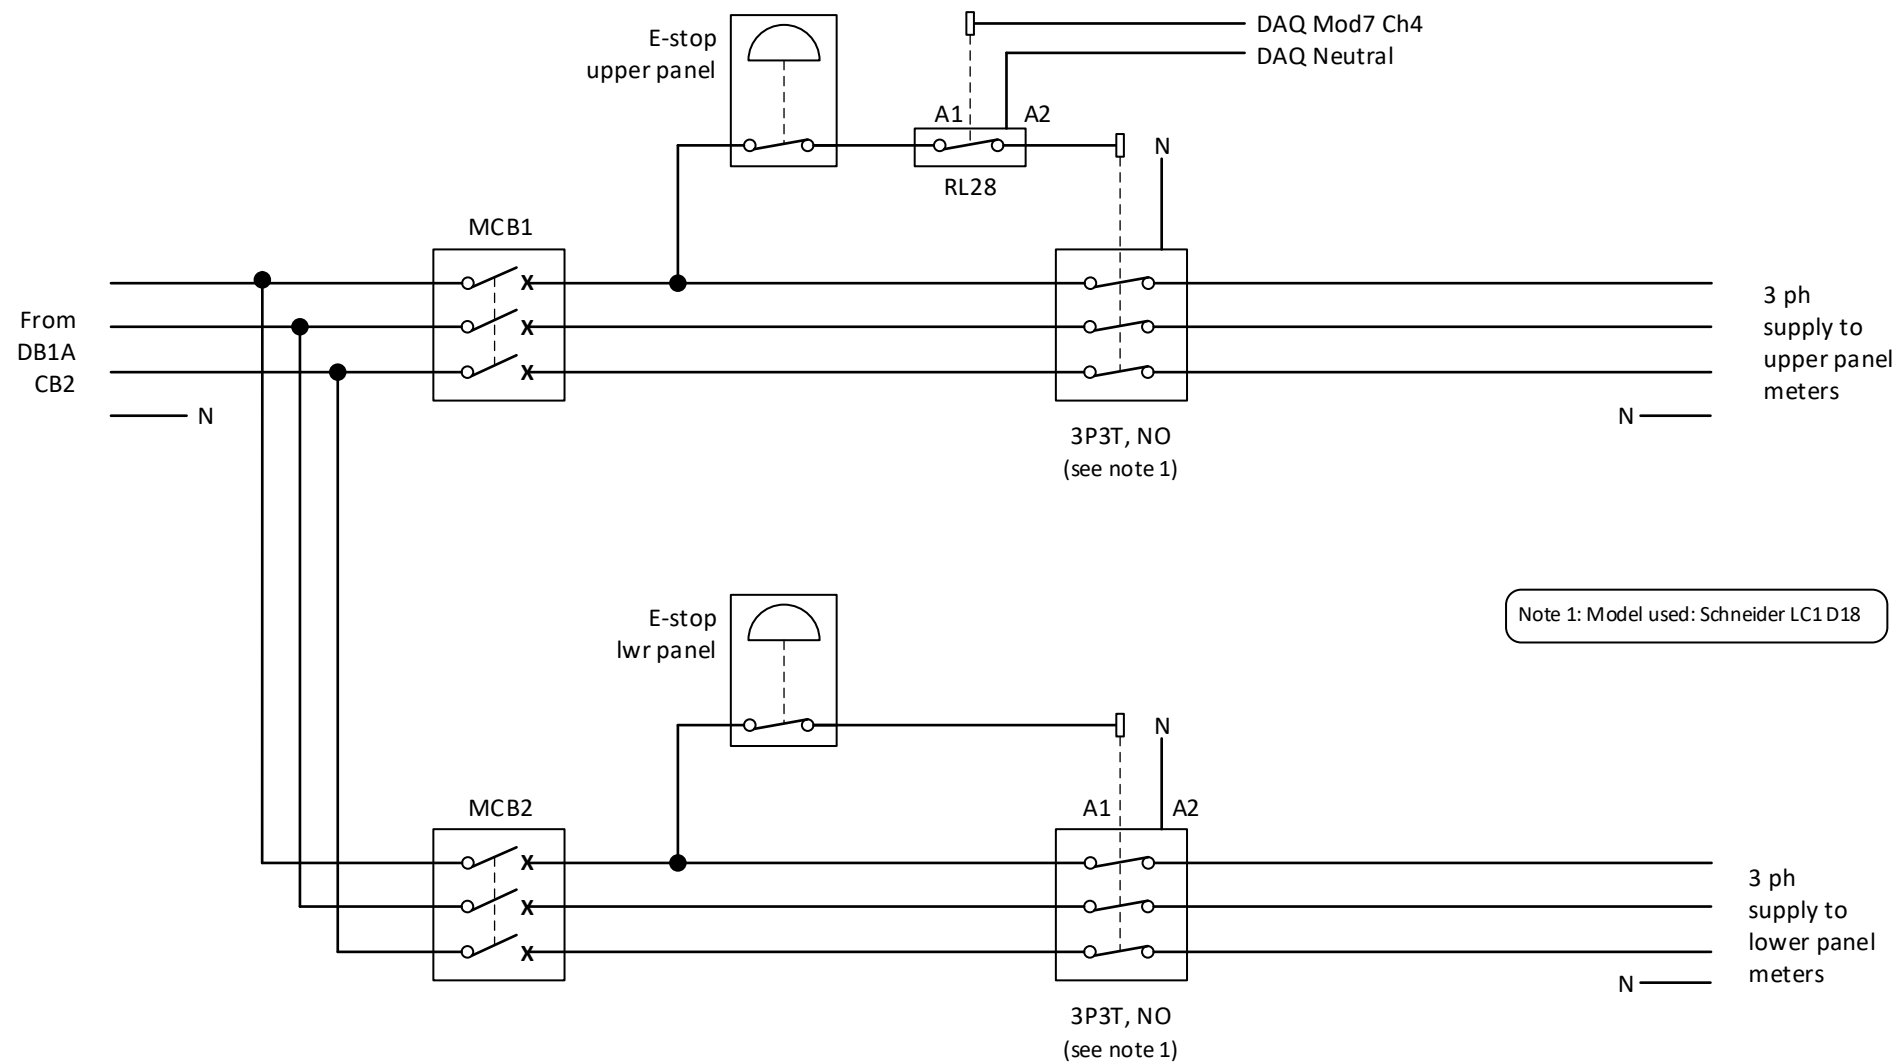

Note 1: Model used: Schneider LC1D18