

MFG. By
ARK Scientific
5-83, Drithi Towers, Prasanthi Nagar IDA,
Kukatpally, Near Naina Garden Lane,
Hyderabad, Telangana 500072
Tel :- +91 90106 31144 / 040-45315435
[Web :- www.arkscientific.in](http://www.arkscientific.in)



Customer Name:

Project Title :FBD Machine Control Panel

Drawing No. : LE-20/159

Scale : 1:1

Page Title : Table of Contents

Drawing Rev. : 00

Page No. :1 of 8

Serial No. :


Drawing Rev.Date :

Used pages : 8


Project Date :

Approved By : Jinan Lodaya

Main Power

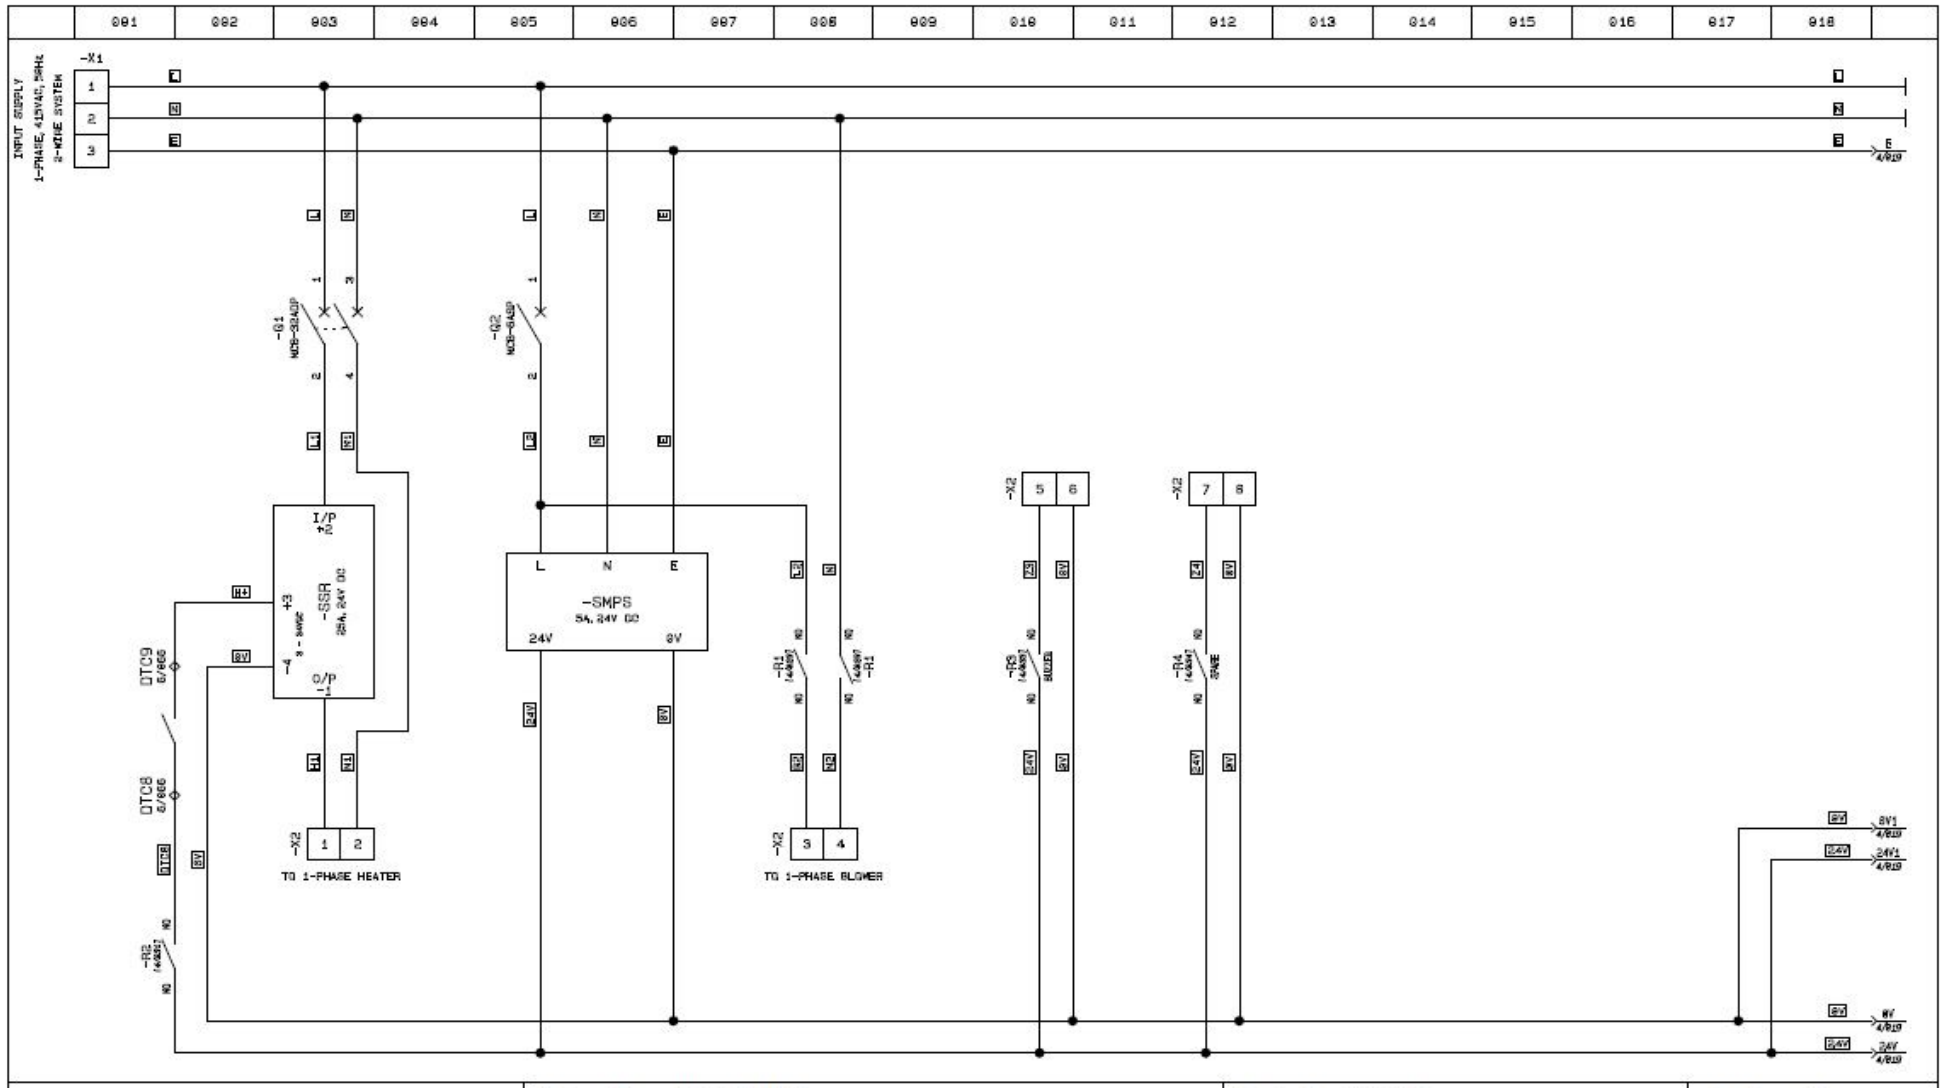

Customer Name:		
Project Title FBD Machine Control Panel	Drawing No. : LE-20/159	Scale : 1:1
Page Title : Main Power & Metering Wiring Diagram	Drawing Rev. : 00	Page No. :3 of 8
Serial No. :	Drawing Rev.Date :	Used pages : 8
Project Date :	Approved By : Jinan Lodaya	

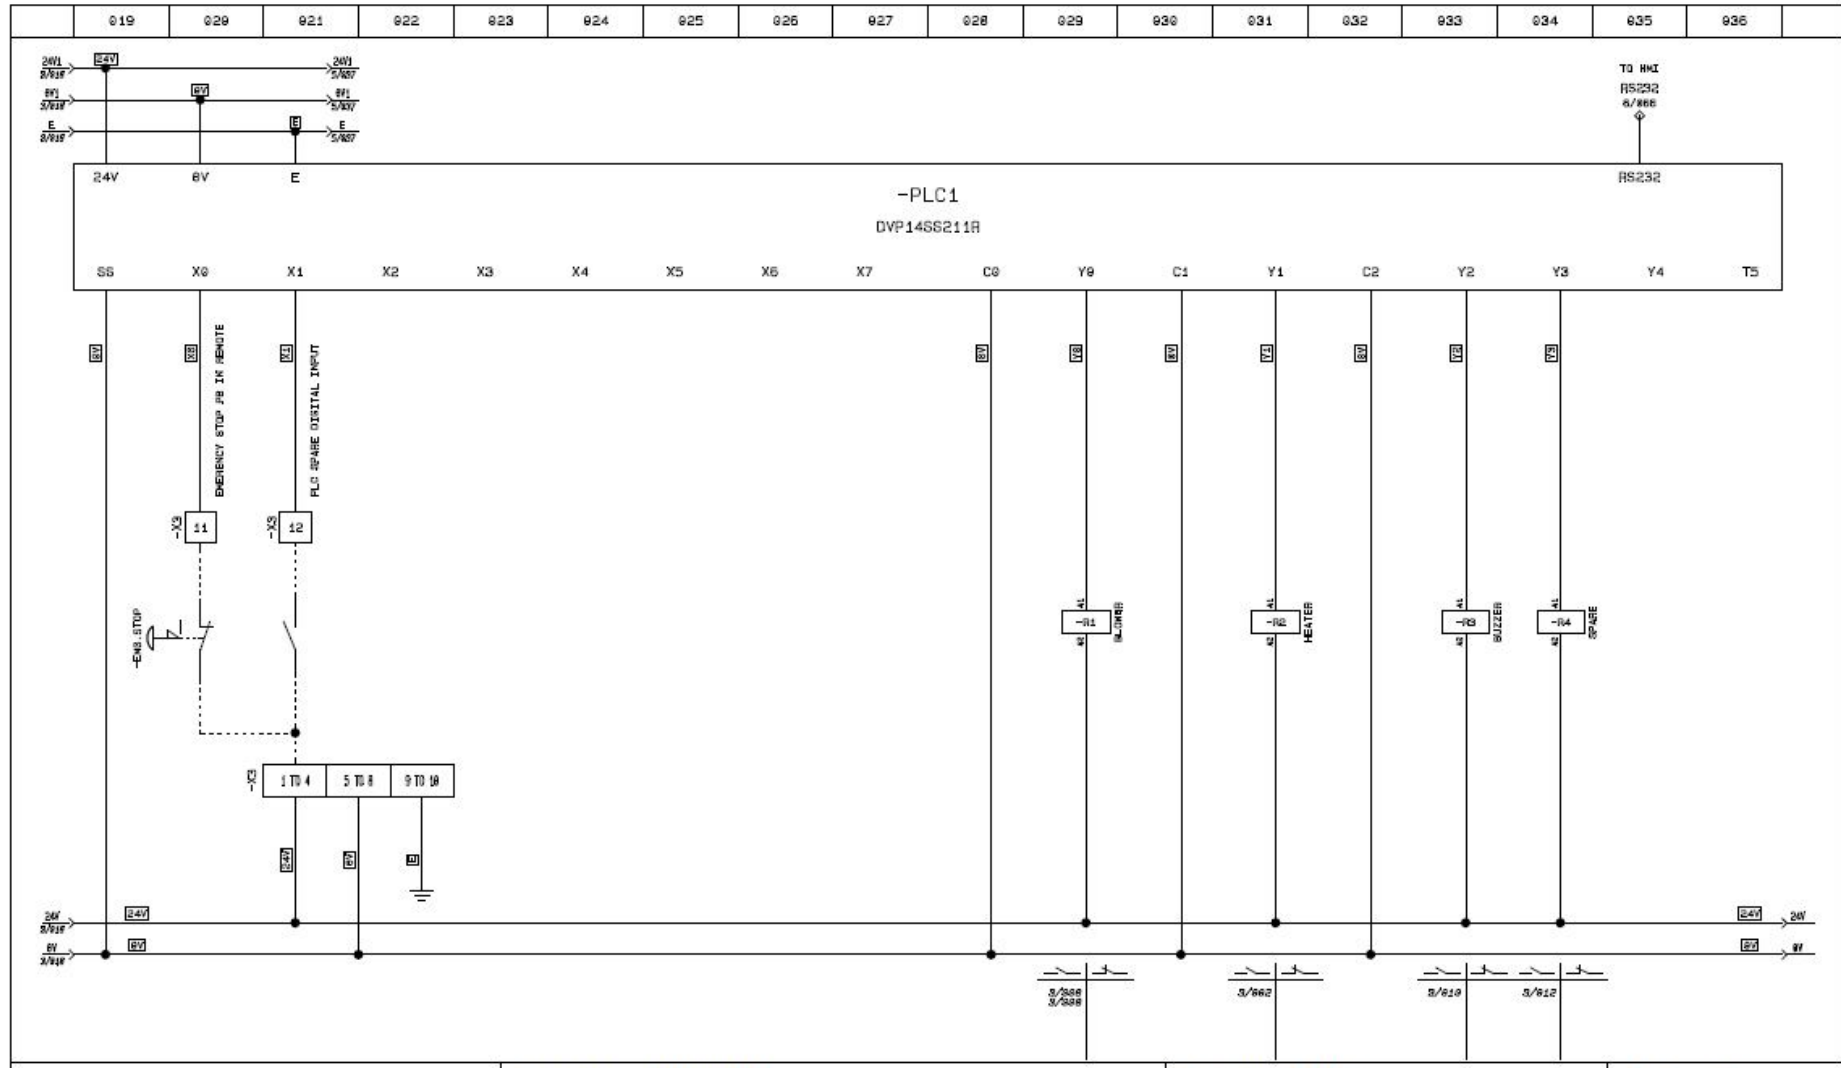

ARK SCIENTIFIC
Pioneers in Solids

Customer Name:

Project Title : FBD Machine Control Panel

Page Title : PLC-01 Input & Output Wiring Diagram

Serial No. :

Project Date :

Drawing No. : LE-20/159

Drawing Rev. : 00


Drawing Rev.Date :

Approved By : Jinan Lodaya

Scale : 1:1

Page No. :4 of 8

Used pages : 8

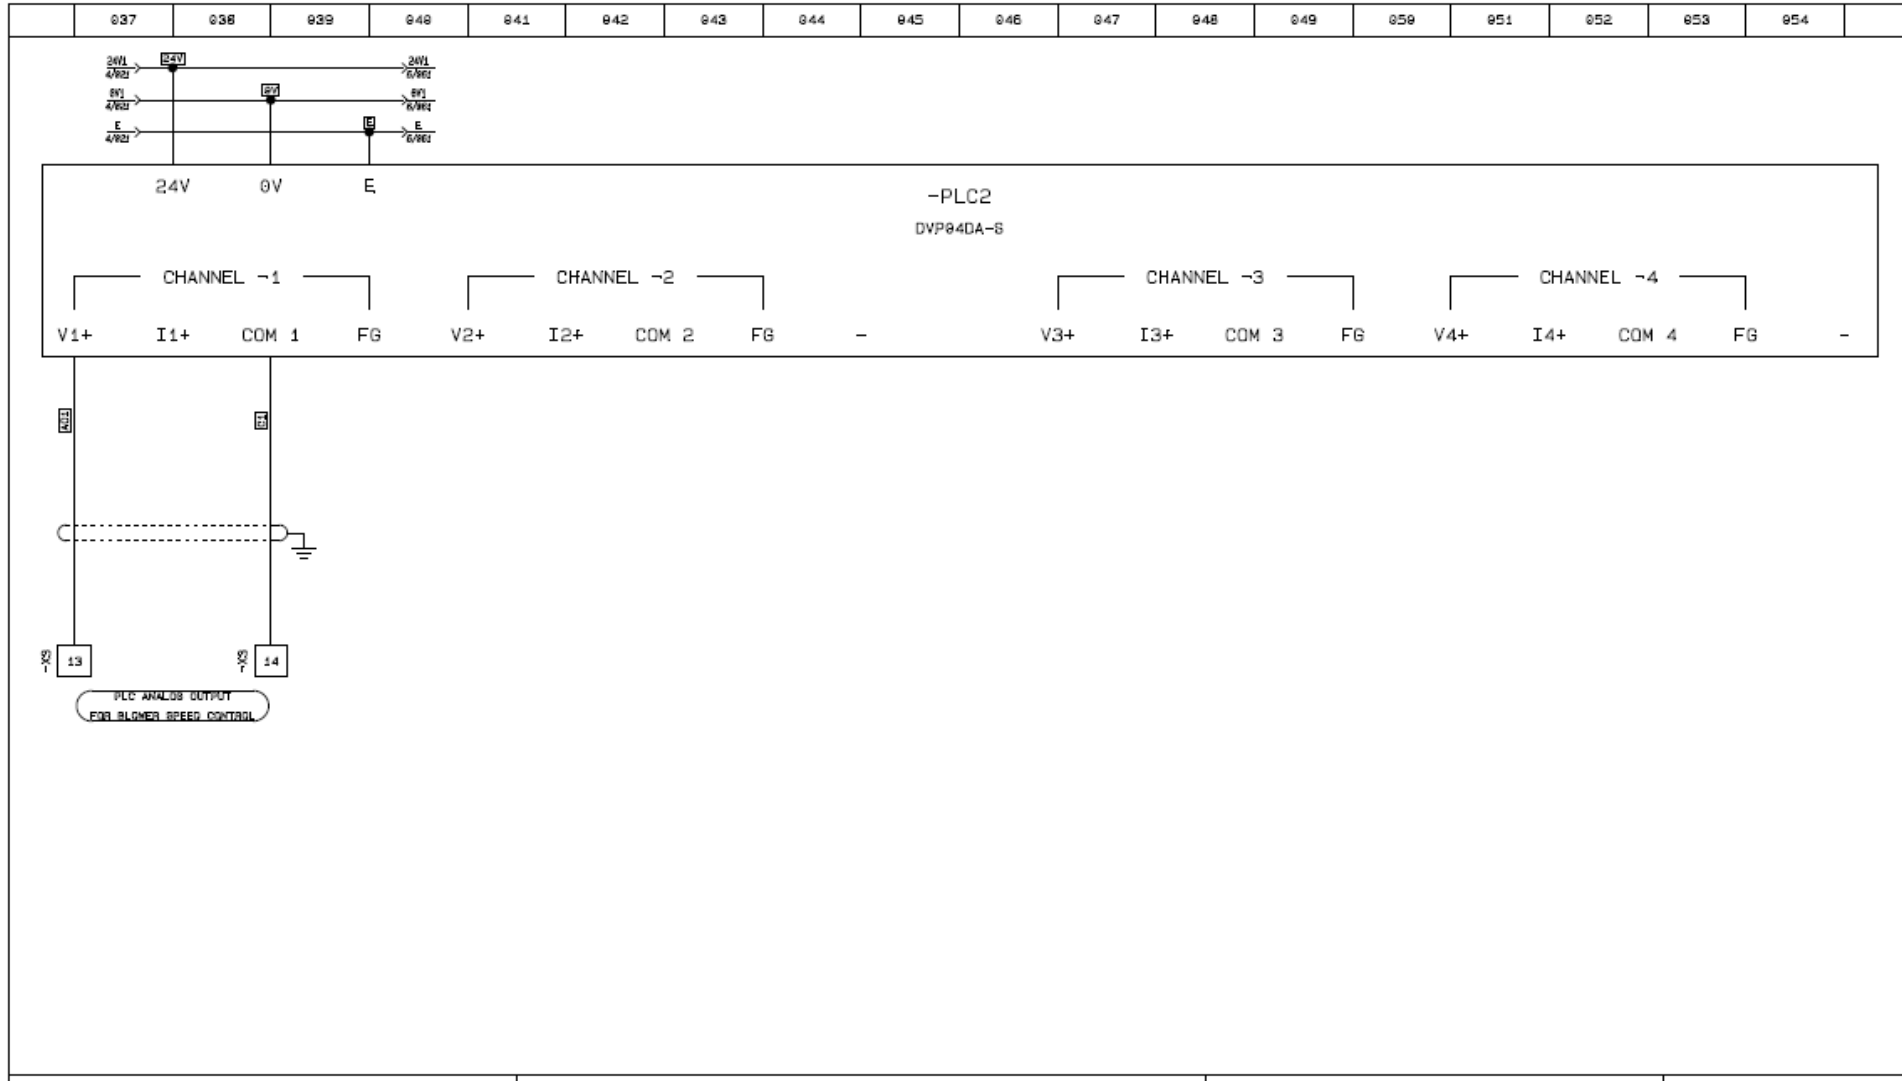

ARK SCIENTIFIC
Pioneers in Solids

Customer Name:

Project Title : FBD Machine Control Panel

Page Title : PLC-02 Input & Output Wiring Diagram

Serial No. :

Project Date :

Drawing No. : LE-20/159

Drawing Rev. : 00

Drawing Rev.Date :

Approved By : Jinan Lodaya

Scale : 1:1


Page No. :5 of 8

Used pages : 8

The diagram illustrates the electrical connections for the PLC3 DTC1000V unit. At the top, a power supply section shows 24V, 0V, and E lines. The PLC3 unit is labeled with 24V, 0V, and E terminals. It features an RS 485 communication port with + and - terminals. Below the unit, a terminal block with 9 positions is shown. Connections include:

- Terminal 1: Connected to a 24V supply line.
- Terminal 2: Connected to a 0V supply line.
- Terminal 3: Connected to an E (ground) line.
- Terminal 8: Connected to DTC8 3/002.
- Terminal 9: Connected to DTC9 3/002.

 A dashed line indicates a connection between terminals 1, 2, and 3. A note 'TO HEATER SER. CONTROL' is present near the DTC8 and DTC9 connections. A 'THERMOCOUPLE SENSOR FOR PRODUCT' is connected to terminals 15, 16, and 17.

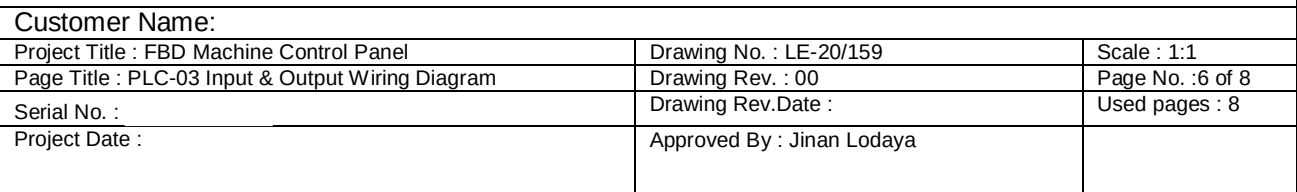

[illegible]

GI Drawing

