

225 Building Environment Report

NEU Seattle Devs (Hot Sauce)

2025-04-23

Table of contents

1	Sensor Charts	2
1.1	Temperature	2
1.2	Humidity	2
1.3	CO2	3
1.4	PM2.5	3
2	Comfort Level & Indoor Climate Score	3
3	Indoor Comfort Score (ICS) Calculation	4
3.1	Comfort Levels	4
3.2	Scoring Logic	4
3.2.1	How the Score is Calculated	4

Sensor Data Summary

Start Time: 00:00 | End Time: 23:59

Sensor Name	Temperature		Humidity		CO2		PM2.5	
	min	max	min	max	min	max	min	max
Sensor 5 - Courtyard	11	17	40	65	393	433	6	6

1 Sensor Charts

1.1 Temperature

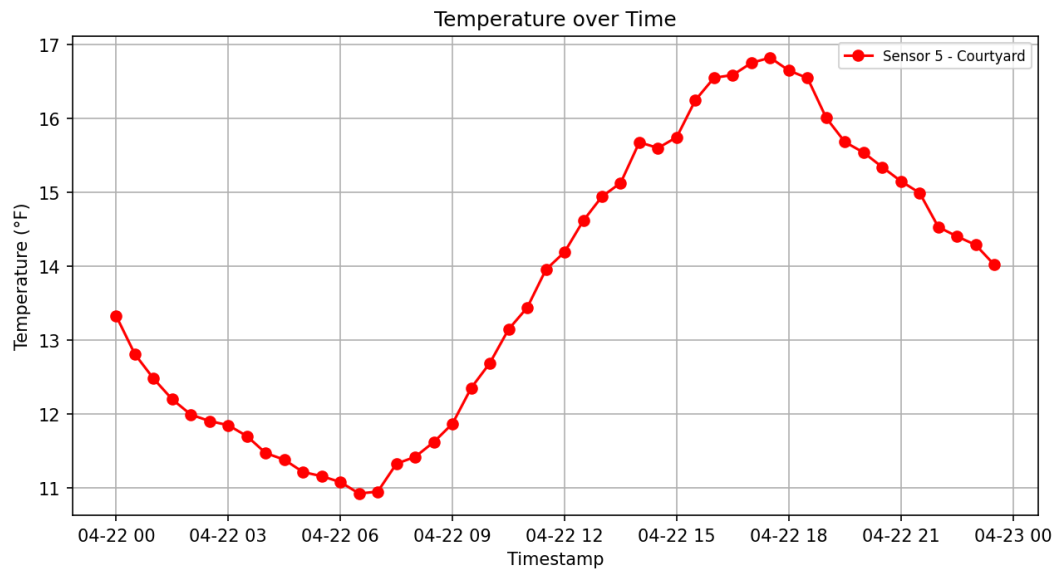


Figure 1: Temperature

1.2 Humidity

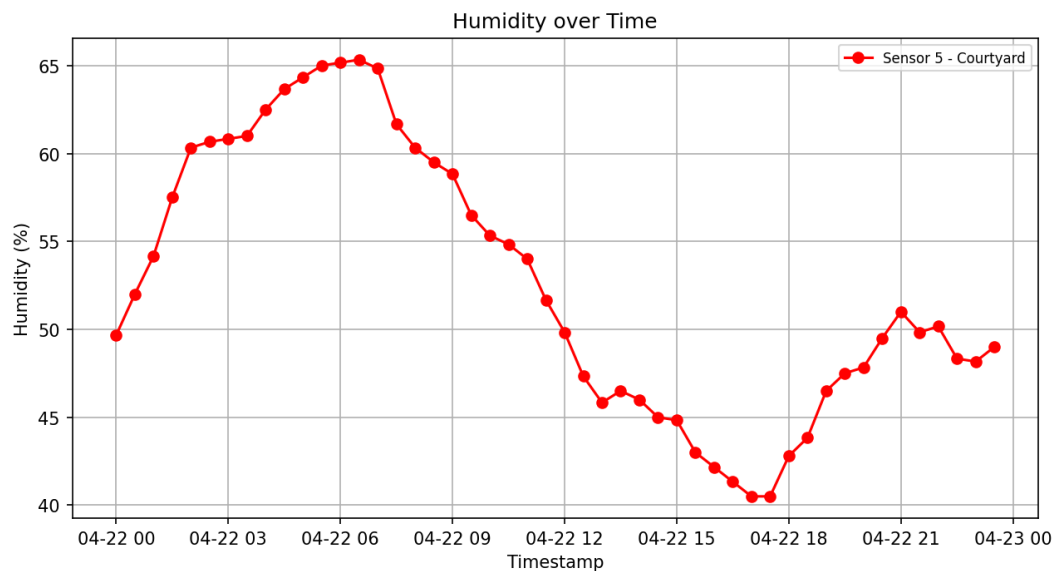


Figure 2: Humidity

1.3 CO2

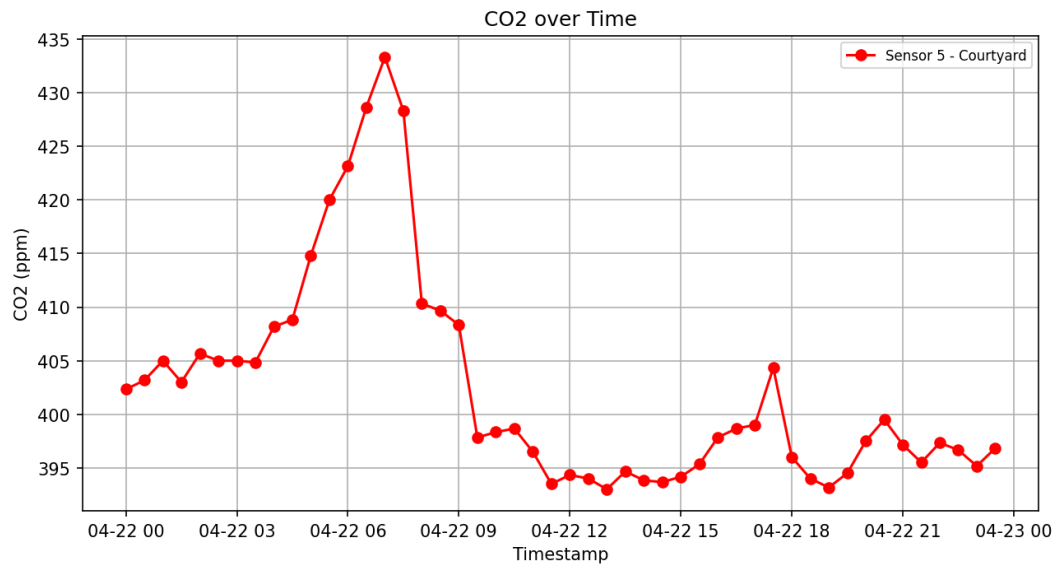


Figure 3: CO2

1.4 PM2.5

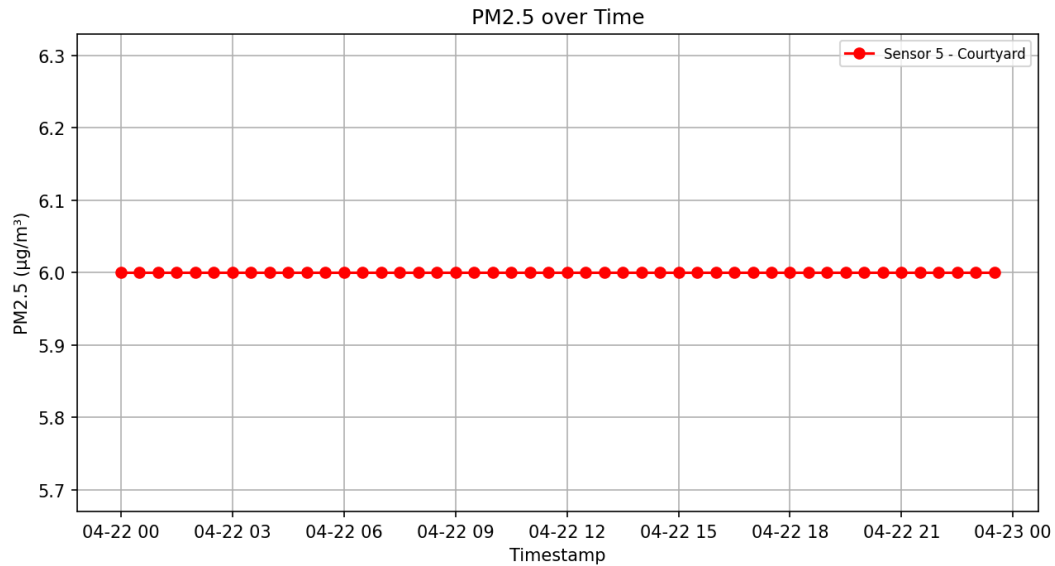


Figure 4: PM2.5

2 Comfort Level & Indoor Climate Score

Indoor Comfort Score: 0.04

3 Indoor Comfort Score (ICS) Calculation

3.1 Comfort Levels

- **Excellent (90-100)** – Ideal indoor conditions, highly comfortable.
 - **Good (75-89)** – Slight deviations, but still comfortable.
 - **Moderate (50-74)** – Noticeable discomfort, but tolerable.
 - **Poor (25-49)** – Significant discomfort, action needed.
 - **Unacceptable (0-24)** – Severe discomfort, unhealthy conditions.
-

3.2 Scoring Logic

The **Indoor Comfort Score (ICS)** is based on four key indoor environmental factors:

Factor	Optimal Range
Temperature (°F)	69.8 - 77
Humidity (%)	40 - 60
CO2 (ppm)	400 - 800
PM2.5 (µg/m³)	0 - 12

3.2.1 How the Score is Calculated

1 Ideal Conditions:

- If a value falls **within the optimal range**, no penalty is applied.

2 Penalty for Deviations:

- If a value is **outside the optimal range**, a **sigmoid-based penalty** is applied:
- **Small deviations** → **minimal penalty**
- **Larger deviations** → **exponentially stronger penalty**

3 Final Score Calculation:

- The **Indoor Comfort Score (ICS)** is computed using a **weighted geometric mean**:
 - Ensures **no single factor dominates**
 - Balances **all environmental parameters proportionally**
 - Generates a **realistic comfort score**
-

Sensor Models: ESP8266, PMS5003(PM2.5), SHT31-D(Temp/Hum), S8(CO2)

Calibration Date: January 15, 2025

Sampling Interval: 5 minutes