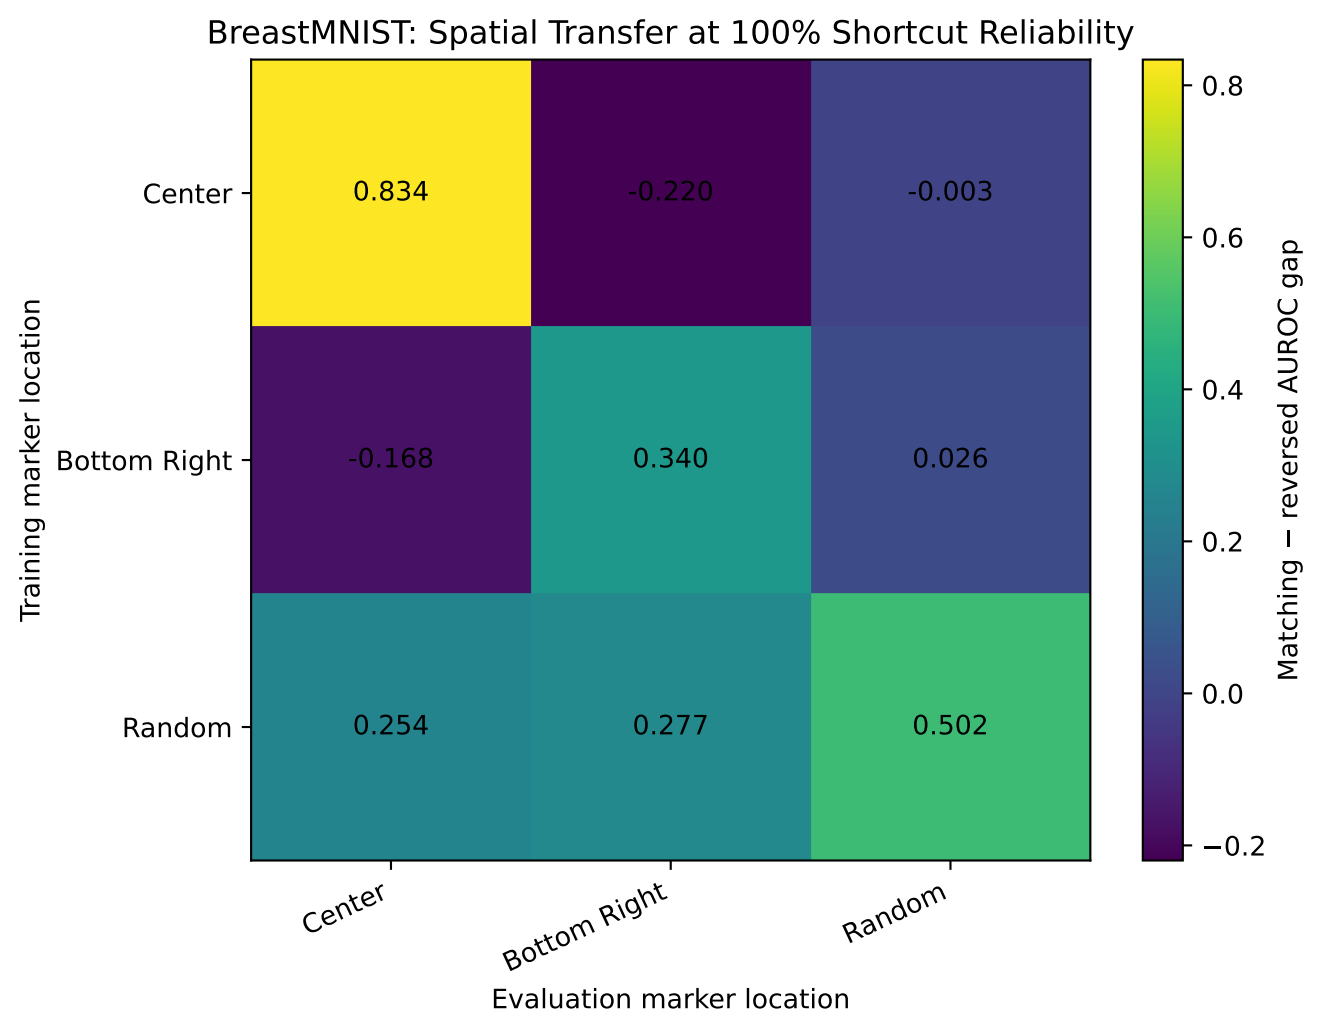
BreastMNIST: Spatial Transfer at 100% Shortcut Reliability
Training marker location
Evaluation marker location
Center
Bottom Right
Random
0.834
-0.220
-0.003
-0.168
0.340
0.026
0.254
0.277
0.502
Matching − reversed AUROC gap
0.8
0.6
0.4
0.2
0.0
−0.2