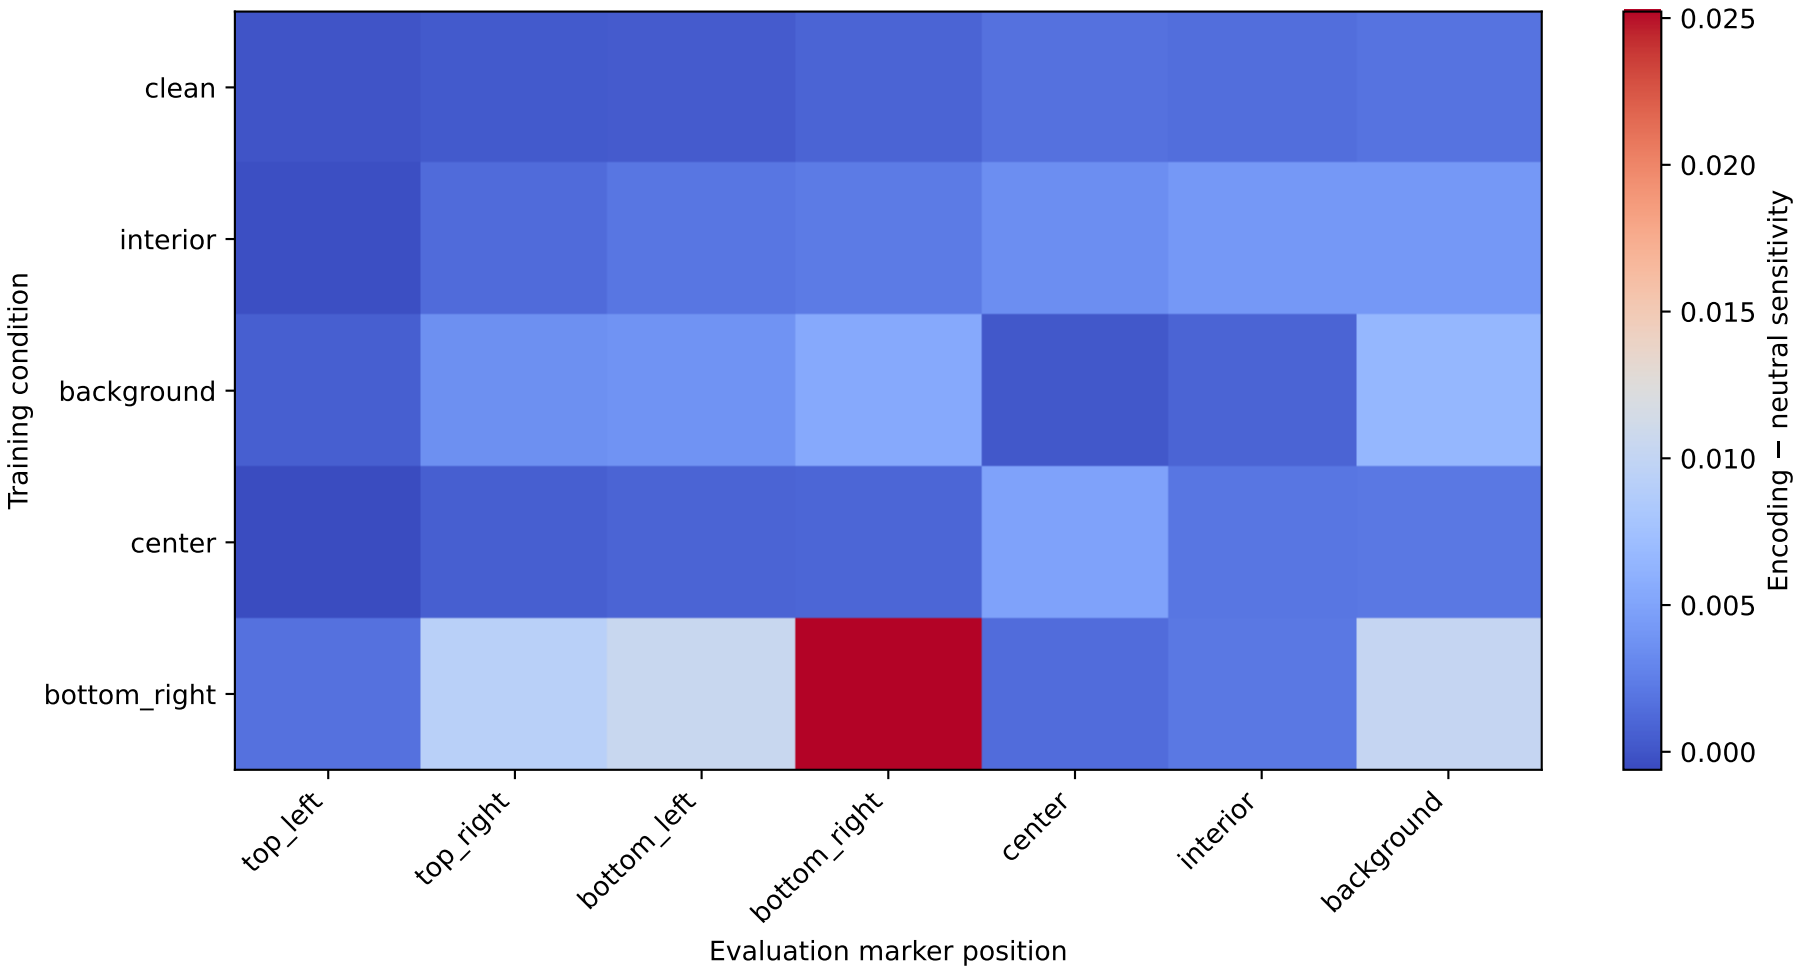
Oxford-IIIT Pet: encoded versus neutral marker
Training condition
clean
interior
background
center
bottom_right
top_left
top_right
bottom_left
bottom_right
center
interior
background
Evaluation marker position
Encoding − neutral sensitivity
0.025
0.020
0.015
0.010
0.005
0.000