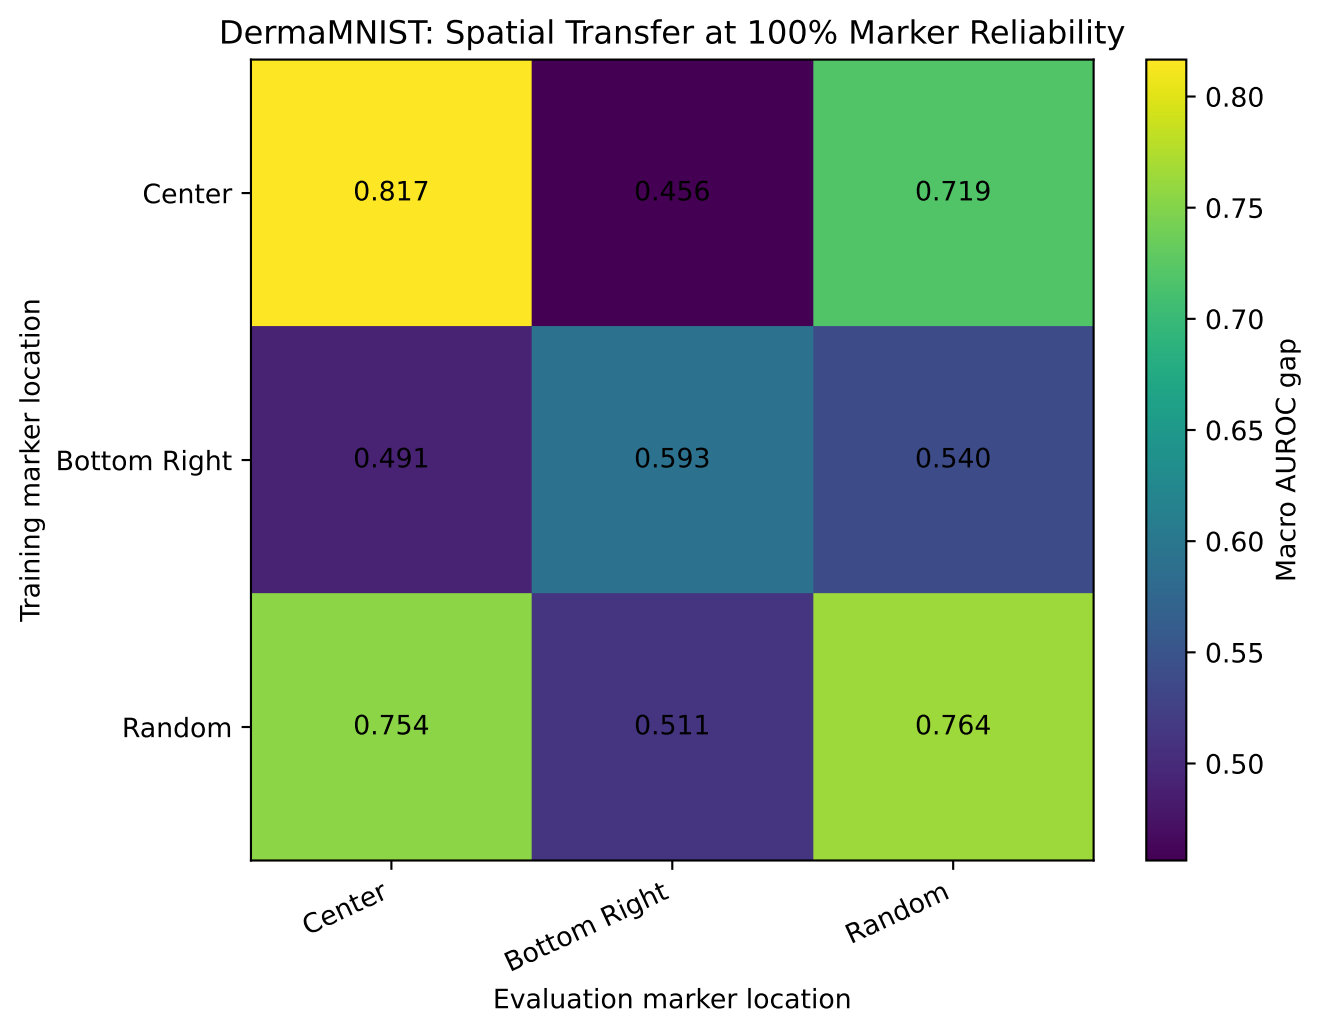
DermaMNIST: Spatial Transfer at 100% Marker Reliability
Training marker location
Center
Bottom Right
Random
0.817
0.456
0.719
0.491
0.593
0.540
0.754
0.511
0.764
Center
Bottom Right
Random
Evaluation marker location
Macro AUROC gap
0.80
0.75
0.70
0.65
0.60
0.55
0.50