



Temperature calibration: exploratory late-validation audit

Before calibration · ECE 0.1645

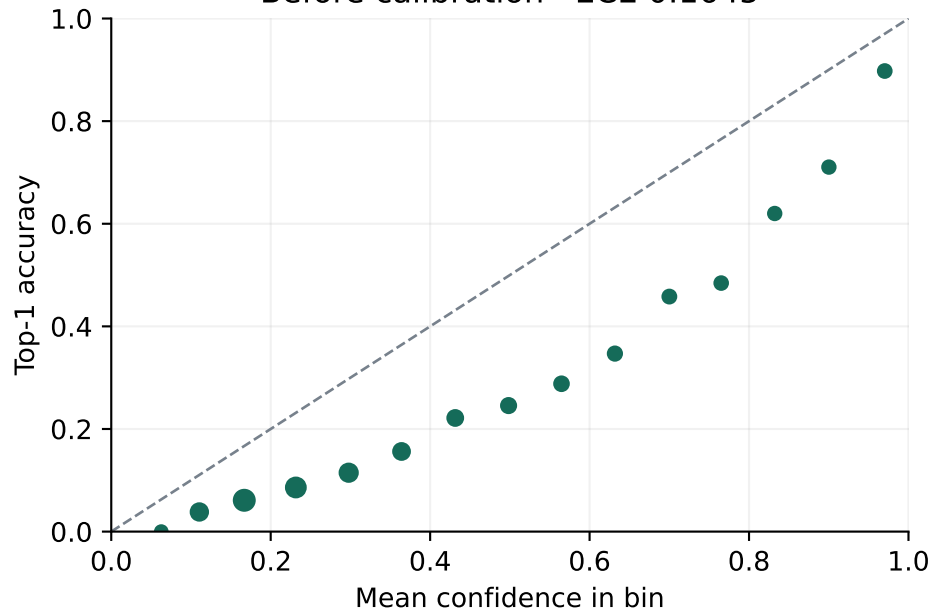

After calibration · ECE 0.0415

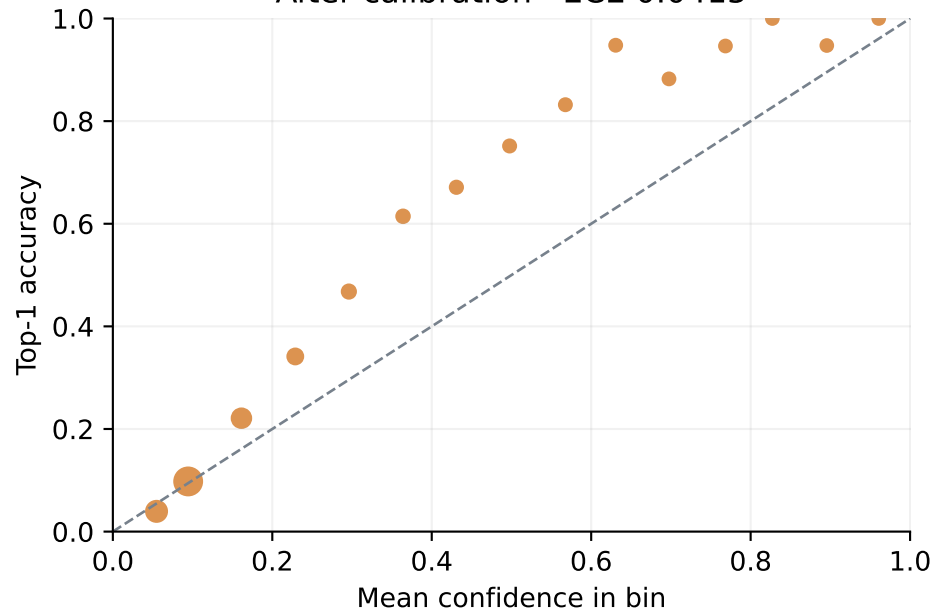

Fit 20,000 early cases; audit 20,000 late cases. Checkpoint selection used all validation.
Confidence is conditional on sampled candidates; bubble area indicates bin support.