

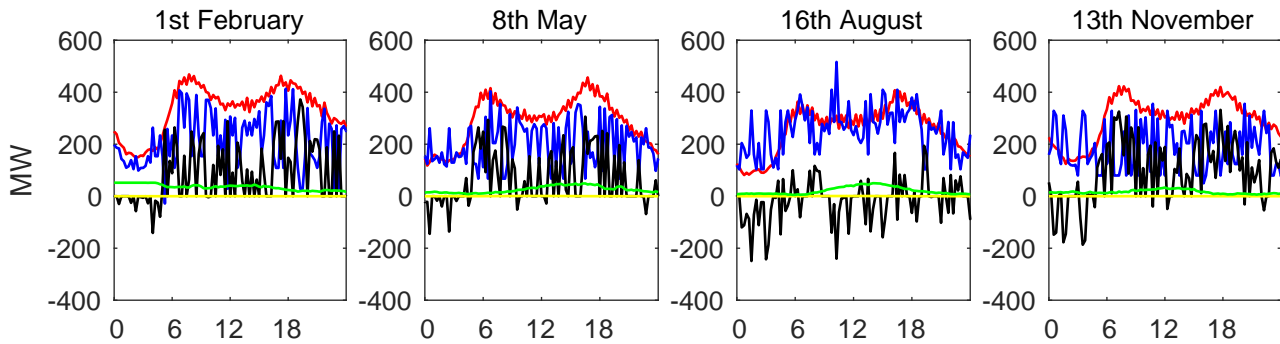


Scenario 6



Power Demand and Supply

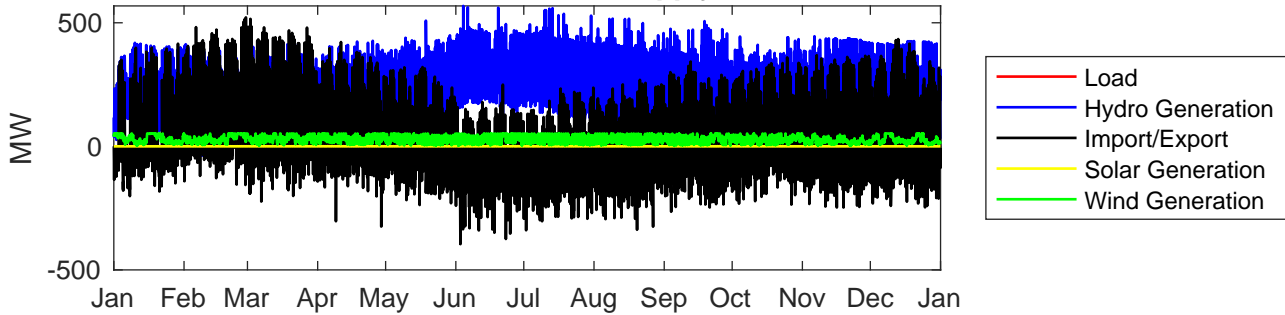

Water Volume

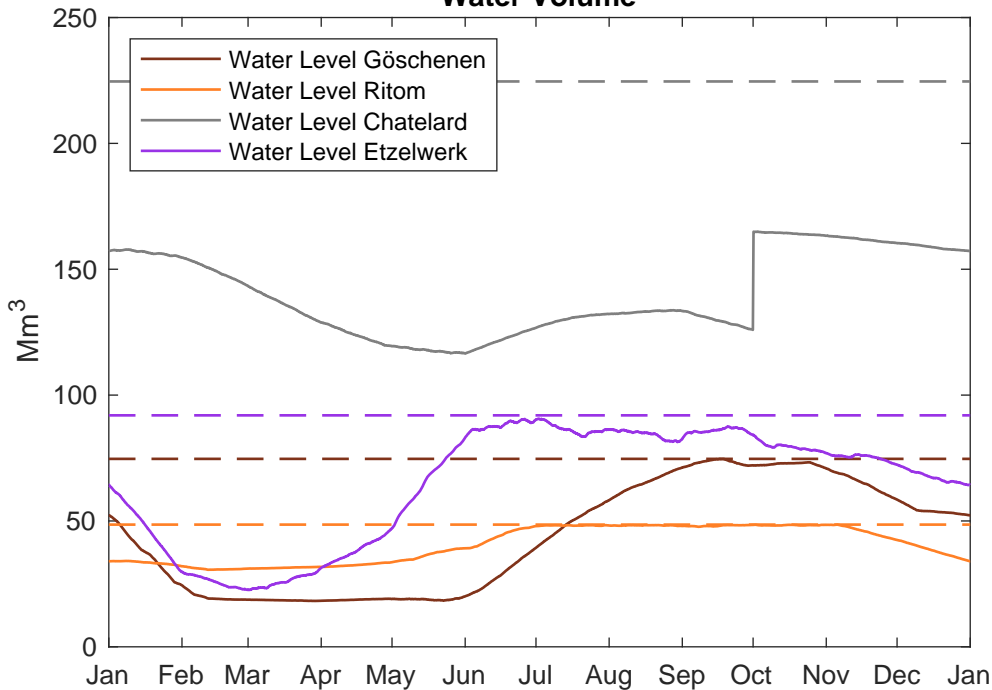

Energy Dispatch

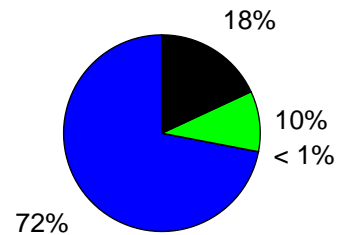

Scenario Parameters

Year of load profile: 2018
 Location of solar panels: CH
 Share of renewables: 10%. The distribution between wind and solar was chosen by the model.
 The weighting factors are 1 for solar, 1 for wind and 1e-20 for cost.

Investment in solar: 1 MW
 Investment in wind: 52 MW (173 turbines à 300 kW)

This scenario causes a curtailment of :
 0 MWh in solar, 0 MWh in wind and a total exchange cost of 61 Mio CHF.