1. Standard

localhost:3000/?layout=standard

OC OpsCrew | Live Incident | Tonight's Plan | Approvals 3 | Buildings | History | Memory | The Agents | 1 · Standard | Demo mode

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

NEW REPORT · AVON DC1

← Problem 2 of 4 → | Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	$1,010	18 hours

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- → Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- → Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- → Lonestar Cloud gets a heads-up email.
- → MedRecords Health gets a heads-up email.

Reasoning

- ✓ The main chiller will hit its safe limit in about 18 hours.
- ✓ Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- ✓ 3 recent complaints all point to the same equipment.
- ✓ Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

✓ Approve and Send | Review Each Action | Nothing is sent until you approve.

What the AI Did | Agent Map | Full Log

done · working · needs you · not yet | Technical Details

What the AI did, in order. Click any step to open its details.

1. **Something Was Reported** — Why: Every run starts from a real signal, not a question someone typed. — New report →
2. **Checked the Building's History** — Why: Past problems help spot a repeat failure. — 2 past notes →
3. **Investigated with 3 AI Agents at Once** — Why: Each agent reads a different kind of information, so nothing is missed. — All reported back →
4. **Worked Out the Cost** — Why: To decide whether fixing it now is worth it. — $113,525 if we wait · $1,010 to fix →
5. **Prepared the Fix** — Why: So a manager only has to say yes or no. — 4 actions ready →
6. **Waiting for Your OK** — Why: The AI never acts on its own. A person decides. — 4 need your OK →
7. Fixed Before It Broke

2. Light Bar

localhost:3000/?layout=light

OC OpsCrew | Live Incident | Tonight's Plan | Approvals 3 | Buildings | History | Memory | The Agents | 2 · Light bar | Demo mode

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

NEW REPORT · AVON DC1

← Problem 2 of 4 → | Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	$1,010	18 hours

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- → Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- → Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- → Lonestar Cloud gets a heads-up email.
- → MedRecords Health gets a heads-up email.

Reasoning

- ✓ The main chiller will hit its safe limit in about 18 hours.
- ✓ Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- ✓ 3 recent complaints all point to the same equipment.
- ✓ Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

✓ Approve and Send | Review Each Action | Nothing is sent until you approve.

What the AI Did | Agent Map | Full Log

● done ○ working ● needs you ○ not yet | Technical Details

What the AI did, in order. Click any step to open its details.

✓	1	**Something Was Reported** **Why:** Every run starts from a real signal, not a question someone typed.	New report →
✓	2	**Checked the Building's History** **Why:** Past problems help spot a repeat failure.	2 past notes →
✓	3	**Investigated with 3 AI Agents at Once** **Why:** Each agent reads a different kind of information, so nothing is missed.	All reported back →
✓	4	**Worked Out the Cost** **Why:** To decide whether fixing it now is worth it.	$113,525 if we wait · $1,010 to fix →
✓	5	**Prepared the Fix** **Why:** So a manager only has to say yes or no.	4 actions ready →
○	6	**Waiting for Your OK** **Why:** The AI never acts on its own. A person decides.	**4 need your OK** →

3. Two-Tier Header

localhost:3000/?layout=twotier

OC **OpsCrew**
BUILDING OPERATIONS

3 · Two-tier header | Demo mode

Live Incident | Tonight's Plan | Approvals 3 | Buildings | History | Memory | The Agents

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

NEW REPORT · AVON DC1

← Problem 2 of 4 → Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	**$1,010**	**18 hours**

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- → Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- → Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- → Lonestar Cloud gets a heads-up email.
- → MedRecords Health gets a heads-up email.

Reasoning

- ✓ The main chiller will hit its safe limit in about 18 hours.
- ✓ Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- ✓ 3 recent complaints all point to the same equipment.
- ✓ Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

✓ Approve and Send | Review Each Action | Nothing is sent until you approve.

What the AI Did | Agent Map | Full Log

done · working · needs you · not yet | Technical Details

What the AI did, in order. Click any step to open its details.

1. **Something Was Reported** — **Why:** Every run starts from a real signal, not a question someone typed. — New report →
2. **Checked the Building's History** — **Why:** Past problems help spot a repeat failure. — 2 past notes →
3. **Investigated with 3 AI Agents at Once** — **Why:** Each agent reads a different kind of information, so nothing is missed. — All reported back →
4. **Worked Out the Cost** — **Why:** To decide whether fixing it now is worth it. — $113,525 if we wait · $1,010 to fix →
5. **Prepared the Fix** — **Why:** So a manager only has to say yes or no. — 4 actions ready →
6. **Waiting for Your OK** — **Why:** The AI never acts on its own. A person decides. — **4 need your OK** →

4. Decision Rail

localhost:3000/?layout=decision

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

NEW REPORT · AVON DC1

Problem 2 of 4 | Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	$1,010	18 hours

What the AI Did | Agent Map | Full Log | Technical Details

What the AI did, in order. Click any step to open its details.

1. **Something Was Reported** — New report
   Why: Every run starts from a real signal, not a question someone typed.
2. **Checked the Building's History** — 2 past notes
   Why: Past problems help spot a repeat failure.
3. **Investigated with 3 AI Agents at Once** — All reported back
   Why: Each agent reads a different kind of information, so nothing is missed.
4. **Worked Out the Cost** — $113,525 if we wait · $1,010 to fix
   Why: To decide whether fixing it now is worth it.
5. **Prepared the Fix** — 4 actions ready
   Why: So a manager only has to say yes or no.
6. **Waiting for Your OK** — 4 need your OK
   Why: The AI never acts on its own. A person decides.
7. **Fixed Before It Broke**
   Why: Everything you approved has been sent.
8. **Checked the Fix Worked**
   Why: Approving is not the end. The AI re-reads the sensors to confirm the problem is gone.

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- Lonestar Cloud gets a heads-up email.
- MedRecords Health gets a heads-up email.

Reasoning

- The main chiller will hit its safe limit in about 18 hours.
- Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- 3 recent complaints all point to the same equipment.
- Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

Approve and Send | Review Each Action

Nothing is sent until you approve.

5. Dashboard

localhost:3000/?layout=dashboard

OC OpsCrew | Live Incident | Tonight's Plan | Approvals 3 | Buildings | History | Memory | The Agents | 5 · Dashboard | Demo mode

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

NEW REPORT · AVON DC1

← Problem 2 of 4 → | Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

COULD COST IF WE WAIT	COST TO FIX NOW	TIME LEFT BEFORE IT FAILS
$113,525	$1,010	18 hours

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- → Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- → Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- → Lonestar Cloud gets a heads-up email.
- → MedRecords Health gets a heads-up email.

Reasoning

- ✓ The main chiller will hit its safe limit in about 18 hours.
- ✓ Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- ✓ 3 recent complaints all point to the same equipment.
- ✓ Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

✓ Approve and Send | Review Each Action | Nothing is sent until you approve.

What the AI Did | Agent Map | Full Log | Technical Details

What the AI did, in order. Click any step to open its details.

1. **Something Was Reported** — New report
   Why: Every run starts from a real signal, not a question someone typed.
2. **Checked the Building's History** — 2 past notes
   Why: Past problems help spot a repeat failure.
3. **Investigated with 3 AI Agents at Once** — All reported back
   Why: Each agent reads a different kind of information, so nothing is missed.
4. **Worked Out the Cost** — $113,525 if we wait · $1,010 to fix
   Why: To decide whether fixing it now is worth it.
5. **Prepared the Fix** — 4 actions ready
   Why: So a manager only has to say yes or no.
6. **Waiting for Your OK** — 4 need your OK
   Why: The AI never acts on its own. A person decides.
7. **Fixed Before It Broke**
   Why: Everything you approved has been sent.
8. **Checked the Fix Worked**
   Why: Approving is not the end. The AI re-reads the sensors to confirm the problem is gone.

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

NEW REPORT · AVON DC1

Problem 2 of 4 | Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	$1,010	18 hours

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- → Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- → Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- → Lonestar Cloud gets a heads-up email.
- → MedRecords Health gets a heads-up email.

Reasoning

- ✓ The main chiller will hit its safe limit in about 18 hours.
- ✓ Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- ✓ 3 recent complaints all point to the same equipment.
- ✓ Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

✓ Approve and Send | Review Each Action | Nothing is sent until you approve.

What the AI Did | Agent Map | Full Log

done · working · needs you · not yet | Technical Details

What the AI did, in order. Click any step to open its details.

1. **Something Was Reported** — New report
   Why: Every run starts from a real signal, not a question someone typed.
2. **Checked the Building's History** — 2 past notes
   Why: Past problems help spot a repeat failure.
3. **Investigated with 3 AI Agents at Once** — All reported back
   Why: Each agent reads a different kind of information, so nothing is missed.
4. **Worked Out the Cost** — $113,525 if we wait · $1,010 to fix
   Why: To decide whether fixing it now is worth it.
5. **Prepared the Fix** — 4 actions ready
   Why: So a manager only has to say yes or no.
6. **Waiting for Your OK** — 4 need your OK
   Why: The AI never acts on its own. A person decides.

Fixed Before It Broke

7. Hero Band

localhost:3000/?layout=hero

OC OpsCrew | Live Incident | Tonight's Plan | Approvals 3 | Buildings | History | Memory | The Agents | 7 · Hero band | Demo mode

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

NEW REPORT · AVON DC1

← Problem 2 of 4 → Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	$1,010	18 hours

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- → Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- → Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- → Lonestar Cloud gets a heads-up email.
- → MedRecords Health gets a heads-up email.

Reasoning

- ✓ The main chiller will hit its safe limit in about 18 hours.
- ✓ Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- ✓ 3 recent complaints all point to the same equipment.
- ✓ Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

✓ Approve and Send | Review Each Action | Nothing is sent until you approve.

What the AI Did | Agent Map | Full Log

done · working · needs you · not yet | Technical Details

What the AI did, in order. Click any step to open its details.

1. **Something Was Reported** — New report →
   Why: Every run starts from a real signal, not a question someone typed.
2. **Checked the Building's History** — 2 past notes →
   Why: Past problems help spot a repeat failure.
3. **Investigated with 3 AI Agents at Once** — All reported back →
   Why: Each agent reads a different kind of information, so nothing is missed.
4. **Worked Out the Cost** — $113,525 if we wait · $1,010 to fix →
   Why: To decide whether fixing it now is worth it.
5. **Prepared the Fix** — 4 actions ready →
   Why: So a manager only has to say yes or no.
6. **Waiting for Your OK** — 4 need your OK →
   Why: The AI never acts on its own. A person decides.

8. Step Board

localhost:3000/?layout=board

OC OpsCrew | Live Incident | Tonight's Plan | Approvals 3 | Buildings | History | Memory | The Agents | 8 · Step board | Demo mode

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

NEW REPORT · AVON DC1

← Problem 2 of 4 → Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	$1,010	18 hours

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- → Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- → Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- → Lonestar Cloud gets a heads-up email.
- → MedRecords Health gets a heads-up email.

Reasoning

- ✓ The main chiller will hit its safe limit in about 18 hours.
- ✓ Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- ✓ 3 recent complaints all point to the same equipment.
- ✓ Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

✓ Approve and Send | Review Each Action | Nothing is sent until you approve.

What the AI Did | Agent Map | Full Log

done · working · needs you · not yet | Technical Details

What the AI did, in order. Click any step to open its details.

Something Was Reported →
Why: Every run starts from a real signal, not a question someone typed.
New report

Checked the Building's History →
Why: Past problems help spot a repeat failure.
2 past notes

Investigated with 3 AI Agents at Once →
Why: Each agent reads a different kind of information, so nothing is missed.
All reported back

Worked Out the Cost →
Why: To decide whether fixing it now is worth it.
$113,525 if we wait · $1,010 to fix

Prepared the Fix →
Why: So a manager only has to say yes or no.
4 actions ready

Waiting for Your OK →
Why: The AI never acts on its own. A person decides.
4 need your OK

Fixed Before It Broke →
Why: Everything you approved has been sent.

Checked the Fix Worked →
Why: Approving is not the end. The AI re-reads the sensors to confirm the problem is gone.

9. Split Panel

localhost:3000/?layout=split

OC OpsCrew | Live Incident | Tonight's Plan | Approvals 3 | Buildings | History | Memory | The Agents | 9 · Split panel | Demo mode

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

← Problem 2 of 4 → Needs Your OK

NEW REPORT · AVON DC1

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	$1,010	18 hours

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- Lonestar Cloud gets a heads-up email.
- MedRecords Health gets a heads-up email.

Reasoning

- The main chiller will hit its safe limit in about 18 hours.
- Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- 3 recent complaints all point to the same equipment.
- Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

Approve and Send | Review Each Action

Nothing is sent until you approve.

What the AI Did | Agent Map | Full Log | Technical Details

What the AI did, in order. Click any step to open its details.

✓	1	**Something Was Reported** **Why:** Every run starts from a real signal, not a question someone typed.	New report →
✓	2	**Checked the Building's History** **Why:** Past problems help spot a repeat failure.	2 past notes →
✓	3	**Investigated with 3 AI Agents at Once** **Why:** Each agent reads a different kind of information, so nothing is missed.	All reported back →
✓	4	**Worked Out the Cost** **Why:** To decide whether fixing it now is worth it.	$113,525 if we wait · $1,010 to fix →
✓	5	**Prepared the Fix** **Why:** So a manager only has to say yes or no.	4 actions ready →
●	6	**Waiting for Your OK** **Why:** The AI never acts on its own. A person decides.	**4 need your OK** →
○	7	Fixed Before It Broke **Why:** Everything you approved has been sent.	→
○	8	Checked the Fix Worked **Why:** Approving is not the end. The AI re-reads the sensors to confirm the problem is gone.	→

Live Incident

AI agents investigate, price the risk and draft the fix. You approve.

Reset | Run Sweep | Cooling cascade | Start Incident

THE AI'S RECOMMENDATION

Fix It Now

What's Going On: a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating.

Who Pays: Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord.

"Tenant shall maintain, repair and replace the supplemental cooling units installed for Tenant's exclusive use in Data Hall A, at Tenant's sole cost."

Action Plan

- → Lone Star Mechanical comes Sunday 12:06 PM to fix it ($1,010).
- → Pre-cool Data hall A to 68F supply tonight and shift batch load to hall B until the repair is verified (for 24 hours).
- → Lonestar Cloud gets a heads-up email.
- → MedRecords Health gets a heads-up email.

Reasoning

- ✓ The main chiller will hit its safe limit in about 18 hours.
- ✓ Lonestar Cloud and MedRecords Health would lose service, costing $37,000 per hour.
- ✓ 3 recent complaints all point to the same equipment.
- ✓ Building history: Oct 2026: compressor bearing replaced after vibration alarm. Vendor said refrigerant was 15% low at the time.

✓ Approve and Send | Review Each Action | Nothing is sent until you approve.

NEW REPORT · AVON DC1

← Problem 2 of 4 → | Needs Your OK

Cooling Cascade

Staff reported a third small problem in Data hall A: water on the floor, a musty smell and warmer air.

Could Cost If We Wait	Cost to Fix Now	Time Left Before It Fails
$113,525	$1,010	18 hours

What the AI Did | Agent Map | Full Log

● done ○ working ● needs you ○ not yet | Technical Details

What the AI did, in order. Click any step to open its details.

1. **Something Was Reported** — **Why:** Every run starts from a real signal, not a question someone typed. — New report →
2. **Checked the Building's History** — **Why:** Past problems help spot a repeat failure. — 2 past notes →
3. **Investigated with 3 AI Agents at Once** — **Why:** Each agent reads a different kind of information, so nothing is missed. — All reported back →
4. **Worked Out the Cost** — **Why:** To decide whether fixing it now is worth it. — $113,525 if we wait · $1,010 to fix →
5. **Prepared the Fix** — **Why:** So a manager only has to say yes or no. — 4 actions ready →
6. **Waiting for Your OK** — 4 need your OK →

Approvals: List of All Problems

applies to every design

OC OpsCrew | Live Incident | Tonight's Plan | Approvals 3 | Buildings | History | Memory | The Agents | 1 · Standard | Demo mode

Approvals

Every problem the AI found, in one list. Open one to review and approve its actions.

Total Problems	Need Your OK	AI Working	Resolved	At Risk If Nobody Acts
4	3	0	1	$274,751

All 4 | Needs Your OK 3 | AI Working 0 | Resolved 1


Search problems | All buildings | Sort: Most at risk

Showing 4 of 4 problems

STATUS	PROBLEM	ACTIONS WAITING	COULD COST IF WE WAIT	COST TO FIX	TIME LEFT	REPORTED
Needs Your OK	**Avon DC1 · Utility Sag + Storms** a weak power line during storms could push the site onto a backup generator and an aging battery	4	$150,113	$845	–	9s ago
Needs Your OK	**Avon DC1 · Cooling Cascade** a cooling unit in Data hall A is leaking, and the main chiller that cools the building is slowly overheating	4	$113,525	$1,010	18 h	11s ago
Needs Your OK	**Northstar Tower · Northstar Panel** an electrical panel on Floor 12 is overheating and could cut power to the whole floor	3	$11,113	$845	–	11s ago
Resolved	**Avon Center · Office AHU Leak** an air handler on Floor 4 is leaking, and its drain pan was only patched last year	–	$8,513	$845	–	11s ago

Step Details: Slide-In Panel

applies to every design

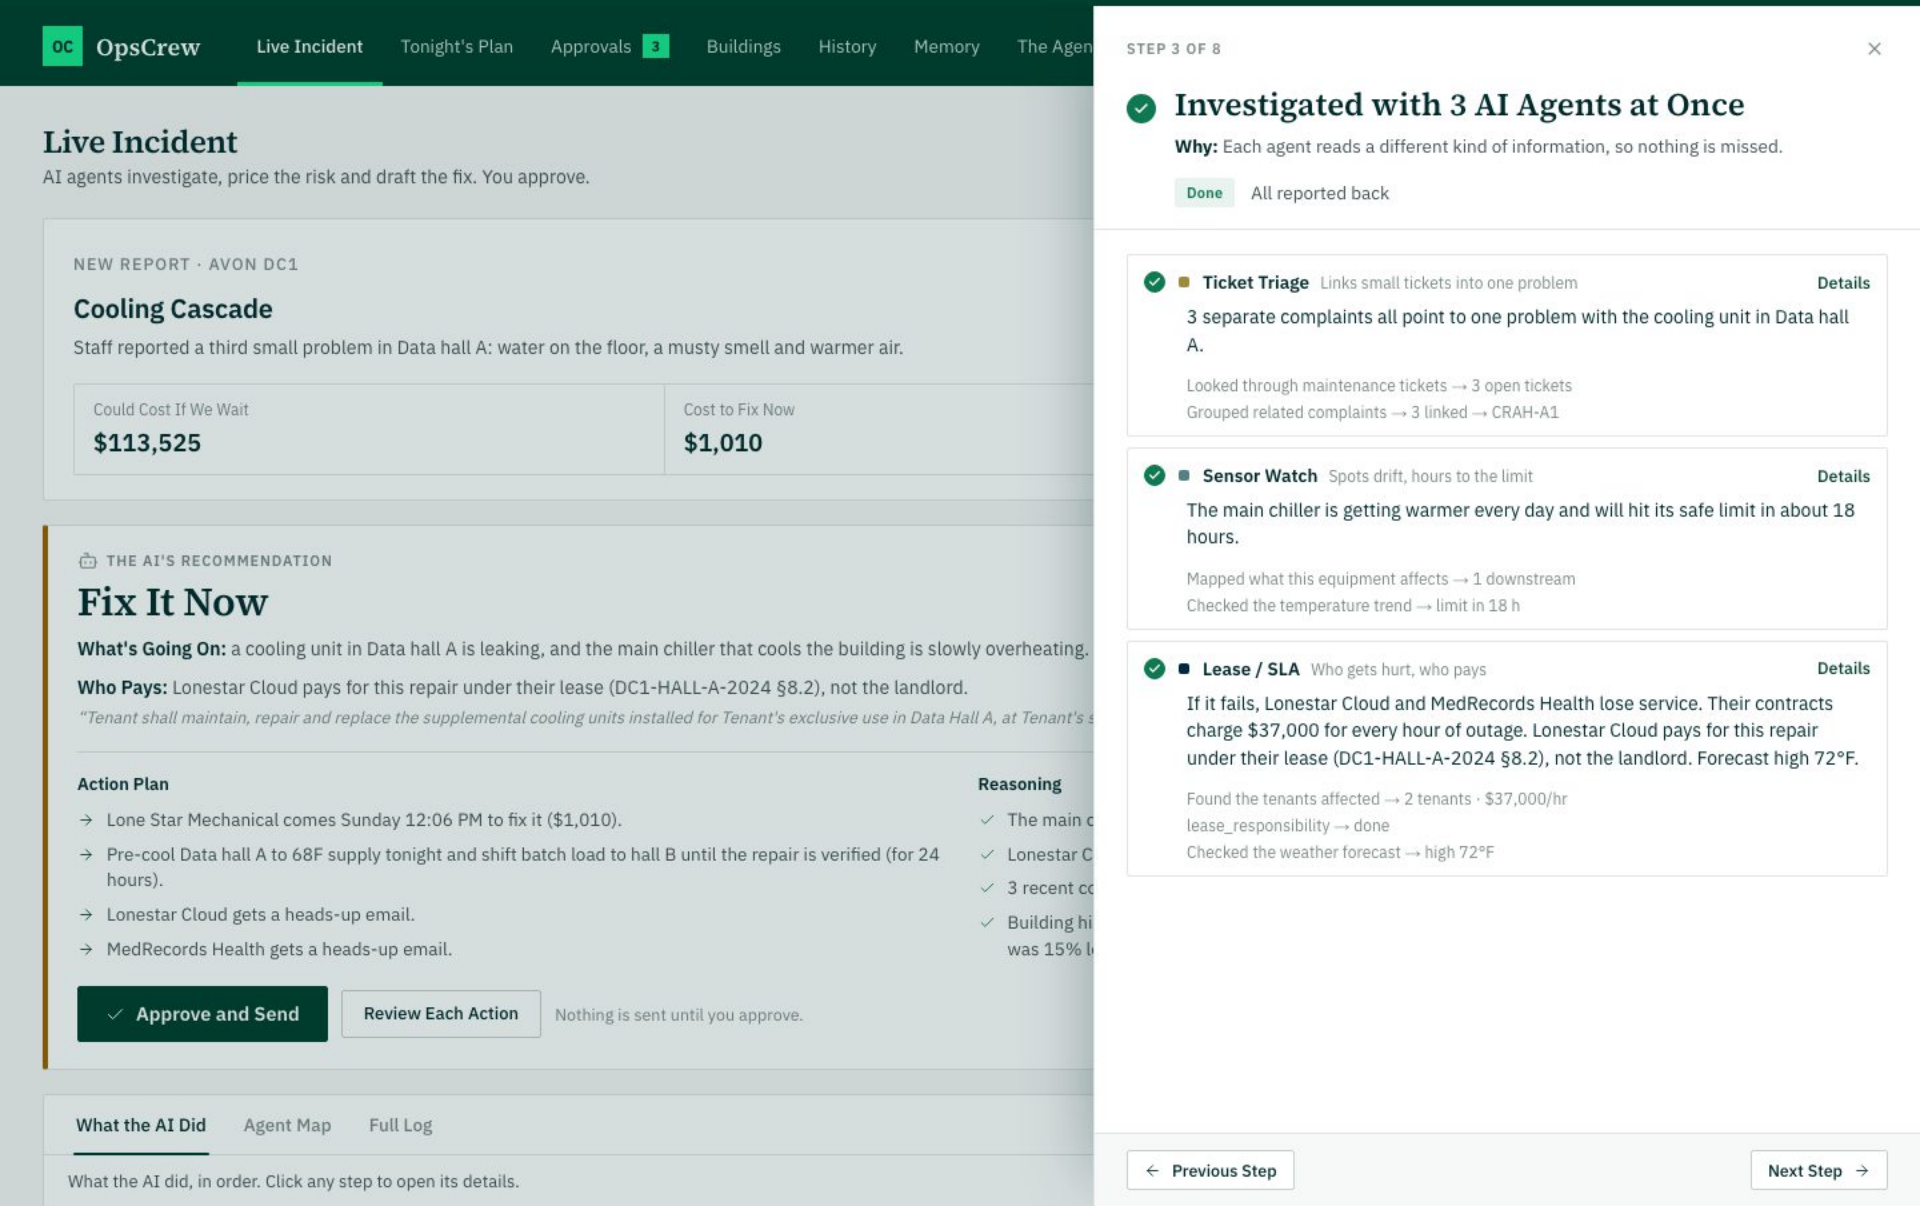

STEP 3 OF 8

Investigated with 3 AI Agents at Once

Why: Each agent reads a different kind of information, so nothing is missed.

Done — All reported back

Ticket Triage — Links small tickets into one problem — Details

3 separate complaints all point to one problem with the cooling unit in Data hall A.

Looked through maintenance tickets → 3 open tickets
Grouped related complaints → 3 linked → CRAH-A1

Sensor Watch — Spots drift, hours to the limit — Details

The main chiller is getting warmer every day and will hit its safe limit in about 18 hours.

Mapped what this equipment affects → 1 downstream
Checked the temperature trend → limit in 18 h

Lease / SLA — Who gets hurt, who pays — Details

If it fails, Lonestar Cloud and MedRecords Health lose service. Their contracts charge $37,000 for every hour of outage. Lonestar Cloud pays for this repair under their lease (DC1-HALL-A-2024 §8.2), not the landlord. Forecast high 72°F.

Found the tenants affected → 2 tenants · $37,000/hr
lease_responsibility → done
Checked the weather forecast → high 72°F

← Previous Step

Next Step →