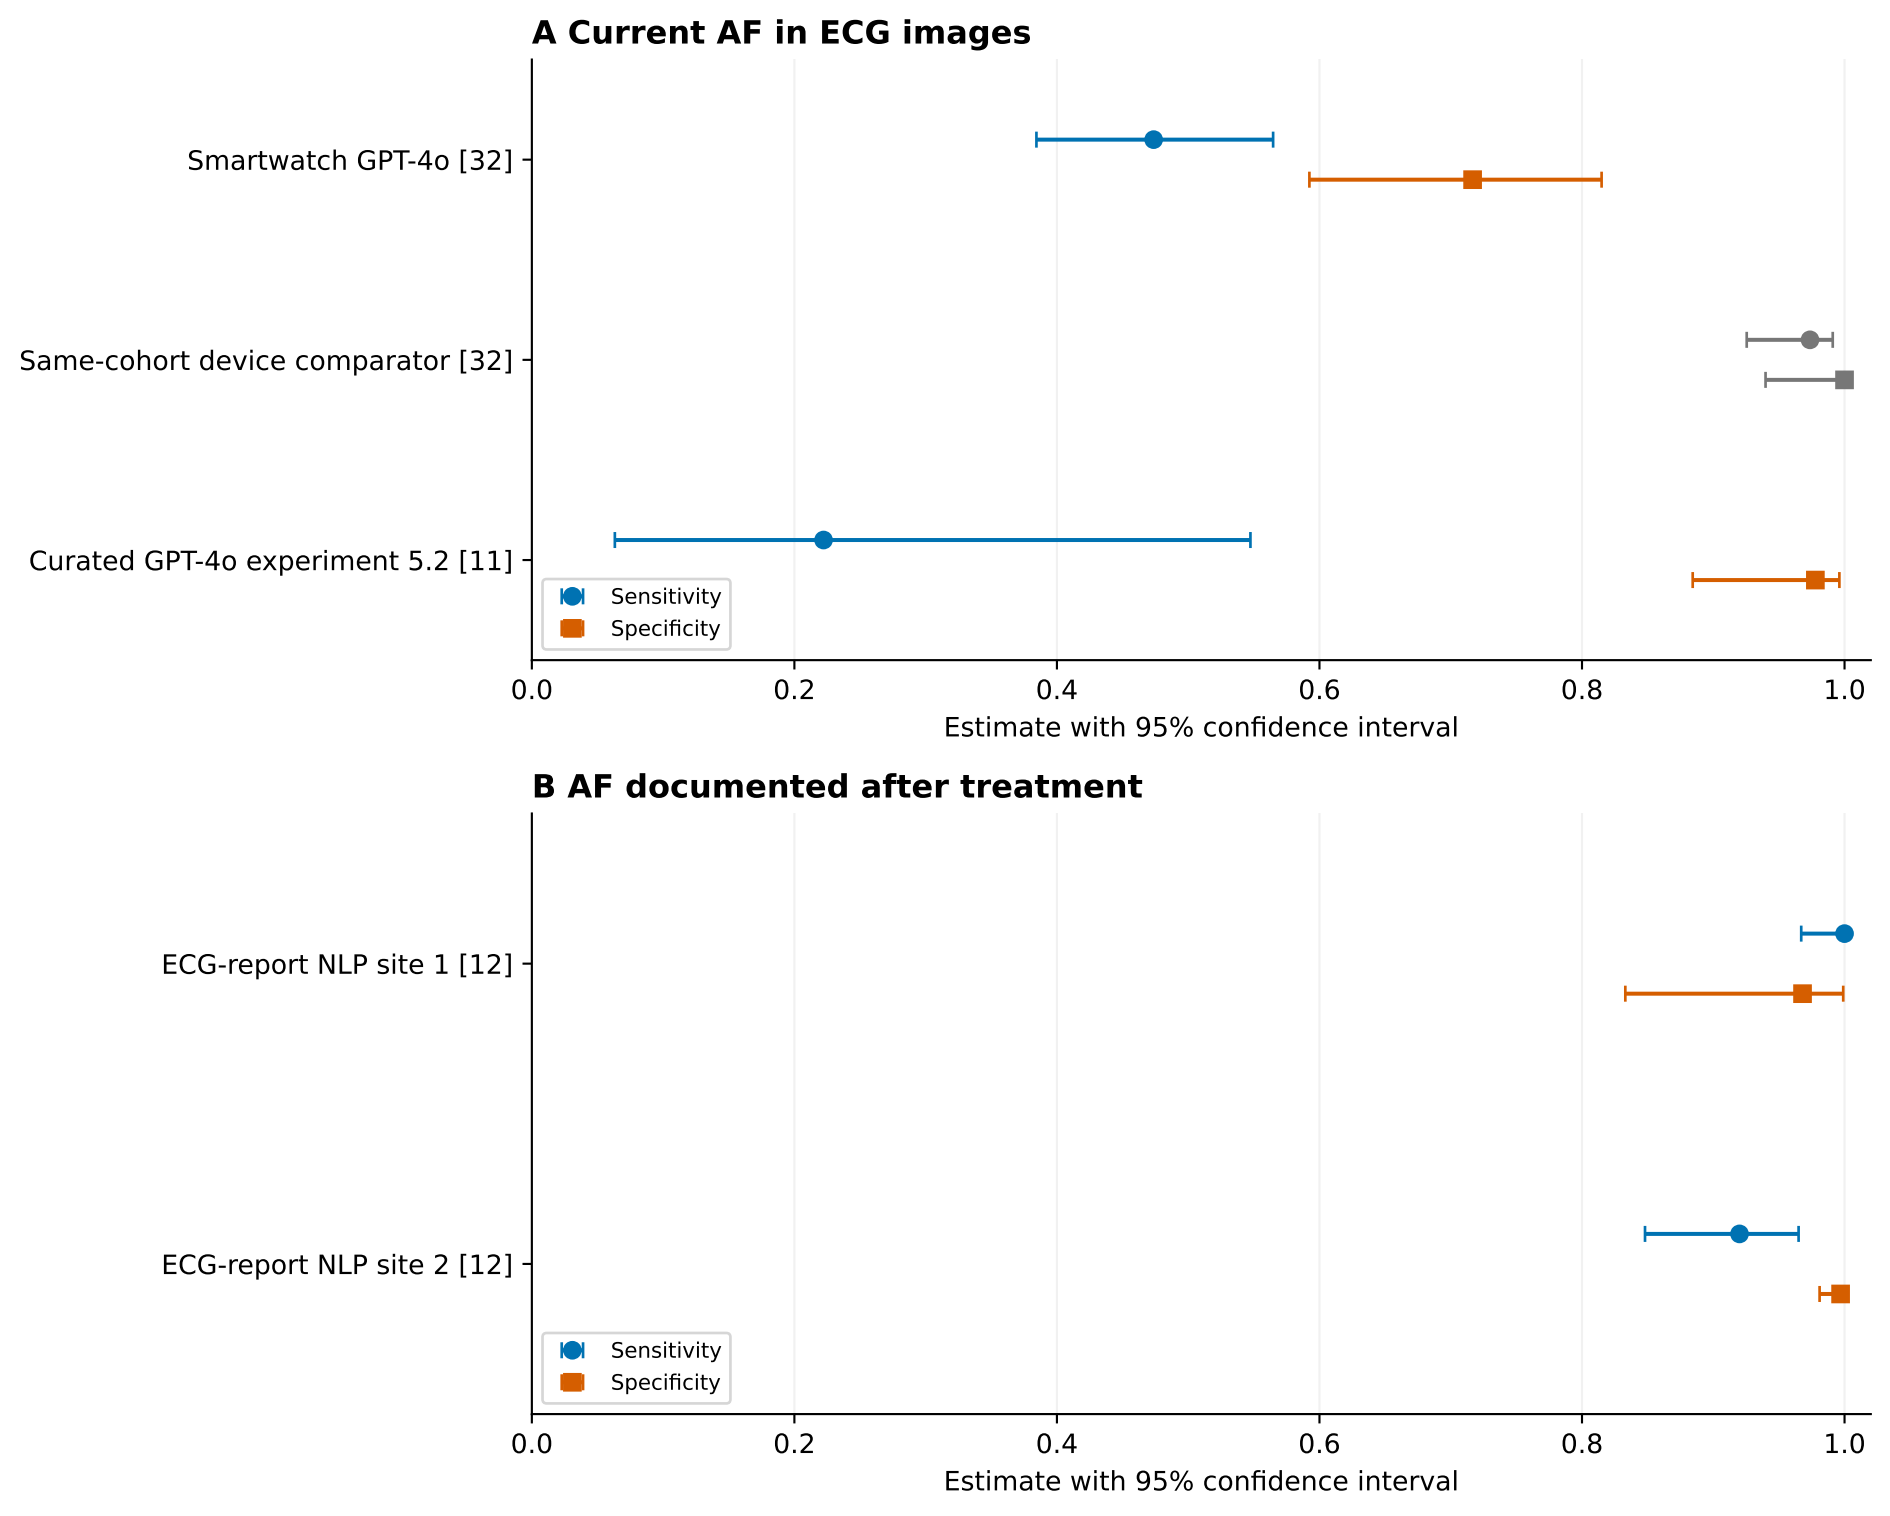
A Current AF in ECG images
Smartwatch GPT-4o [32]
Same-cohort device comparator [32]
Curated GPT-4o experiment 5.2 [11]
Sensitivity
Specificity
0.0
0.2
0.4
0.6
0.8
1.0
Estimate with 95% confidence interval
B AF documented after treatment
ECG-report NLP site 1 [12]
ECG-report NLP site 2 [12]
Sensitivity
Specificity
0.0
0.2
0.4
0.6
0.8
1.0
Estimate with 95% confidence interval