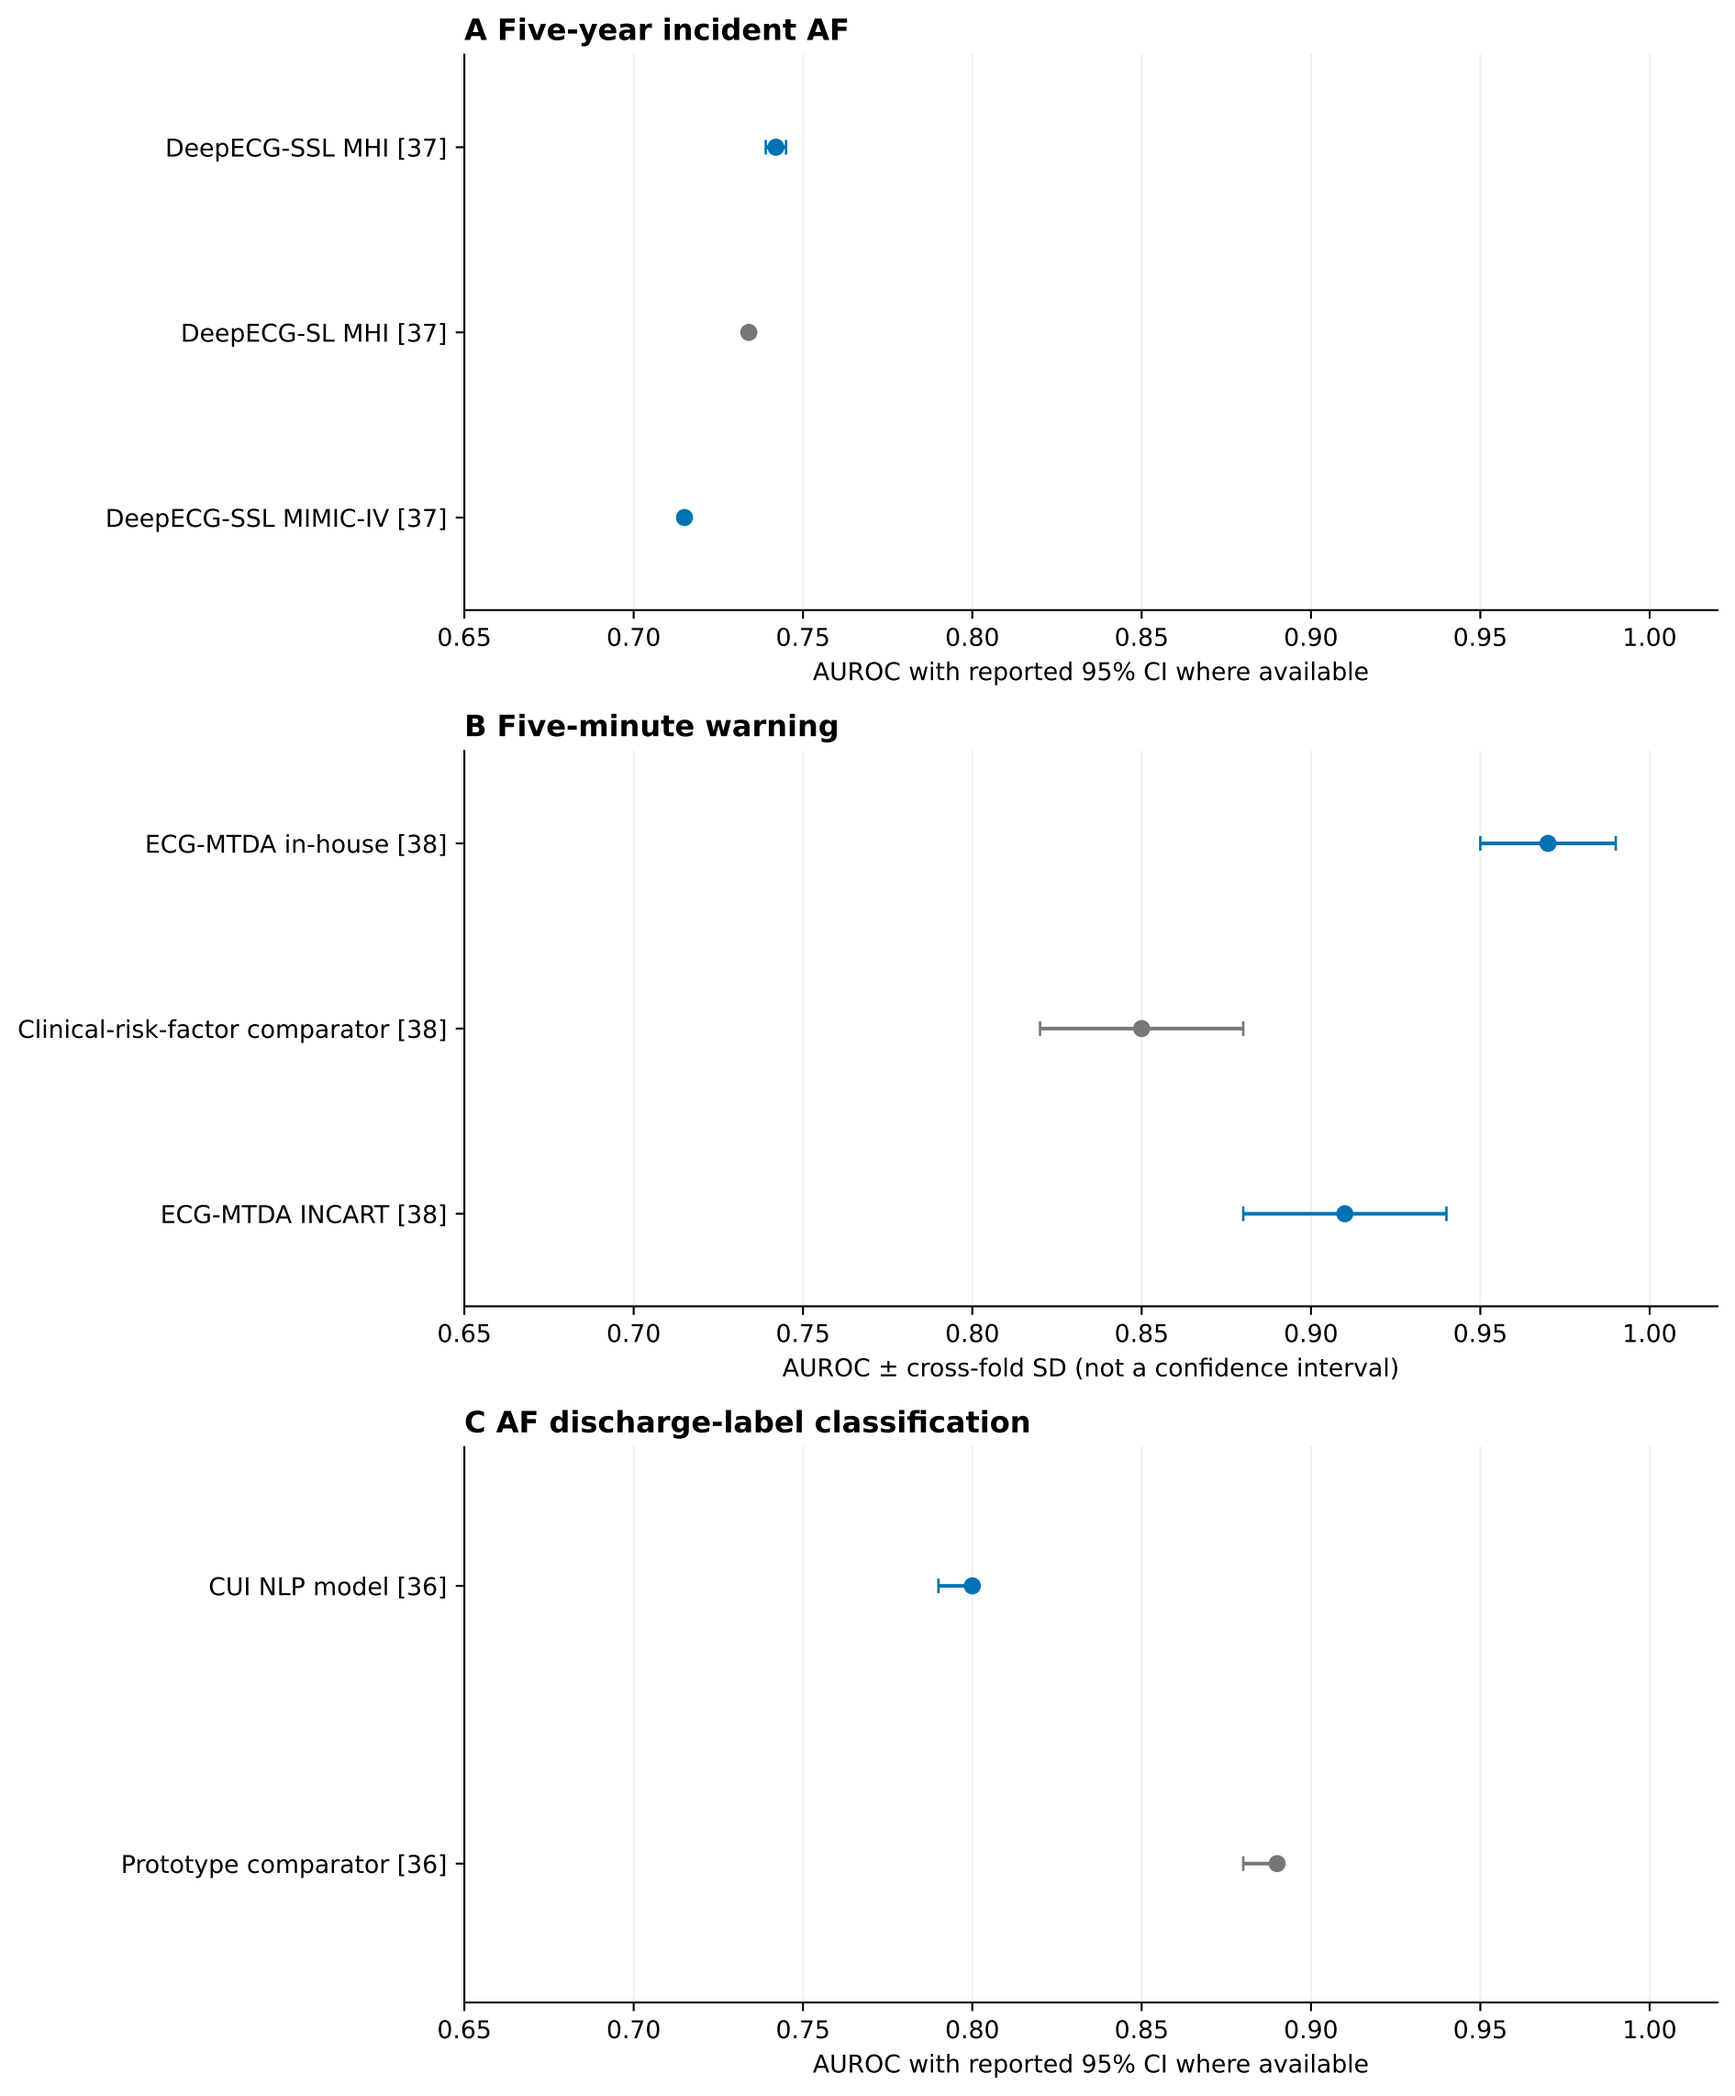
A Five-year incident AF
DeepECG-SSL MHI [37]
DeepECG-SL MHI [37]
DeepECG-SSL MIMIC-IV [37]
0.65
0.70
0.75
0.80
0.85
0.90
0.95
1.00
AUROC with reported 95% CI where available
B Five-minute warning
ECG-MTDA in-house [38]
Clinical-risk-factor comparator [38]
ECG-MTDA INCART [38]
0.65
0.70
0.75
0.80
0.85
0.90
0.95
1.00
AUROC ± cross-fold SD (not a confidence interval)
C AF discharge-label classification
CUI NLP model [36]
Prototype comparator [36]
0.65
0.70
0.75
0.80
0.85
0.90
0.95
1.00
AUROC with reported 95% CI where available