
Optimization result: validation 3

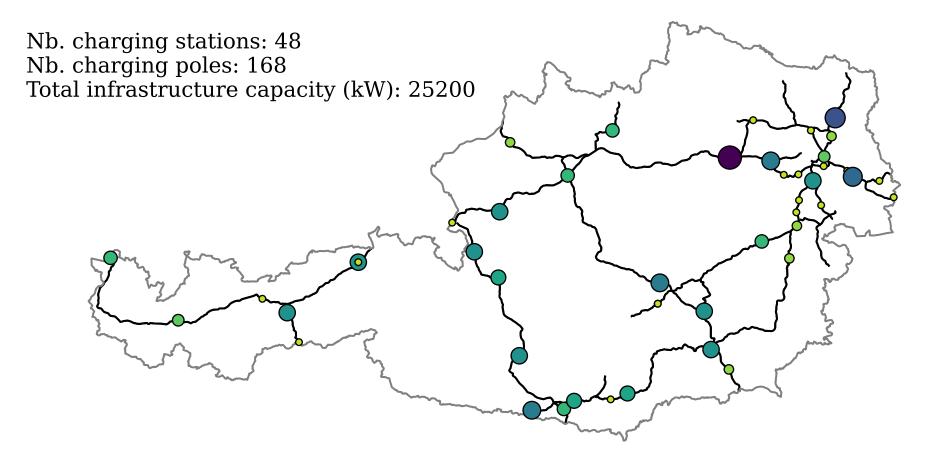

Local peak capacities (kW)
-1200
-1000
-800
-600
-400