
## Optimization result: validation 2

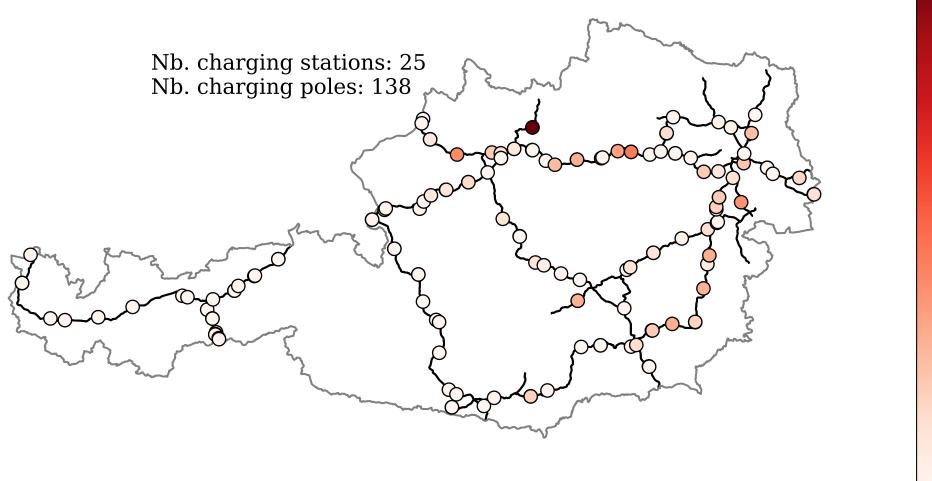

70

60

net covered energy (kW)

10