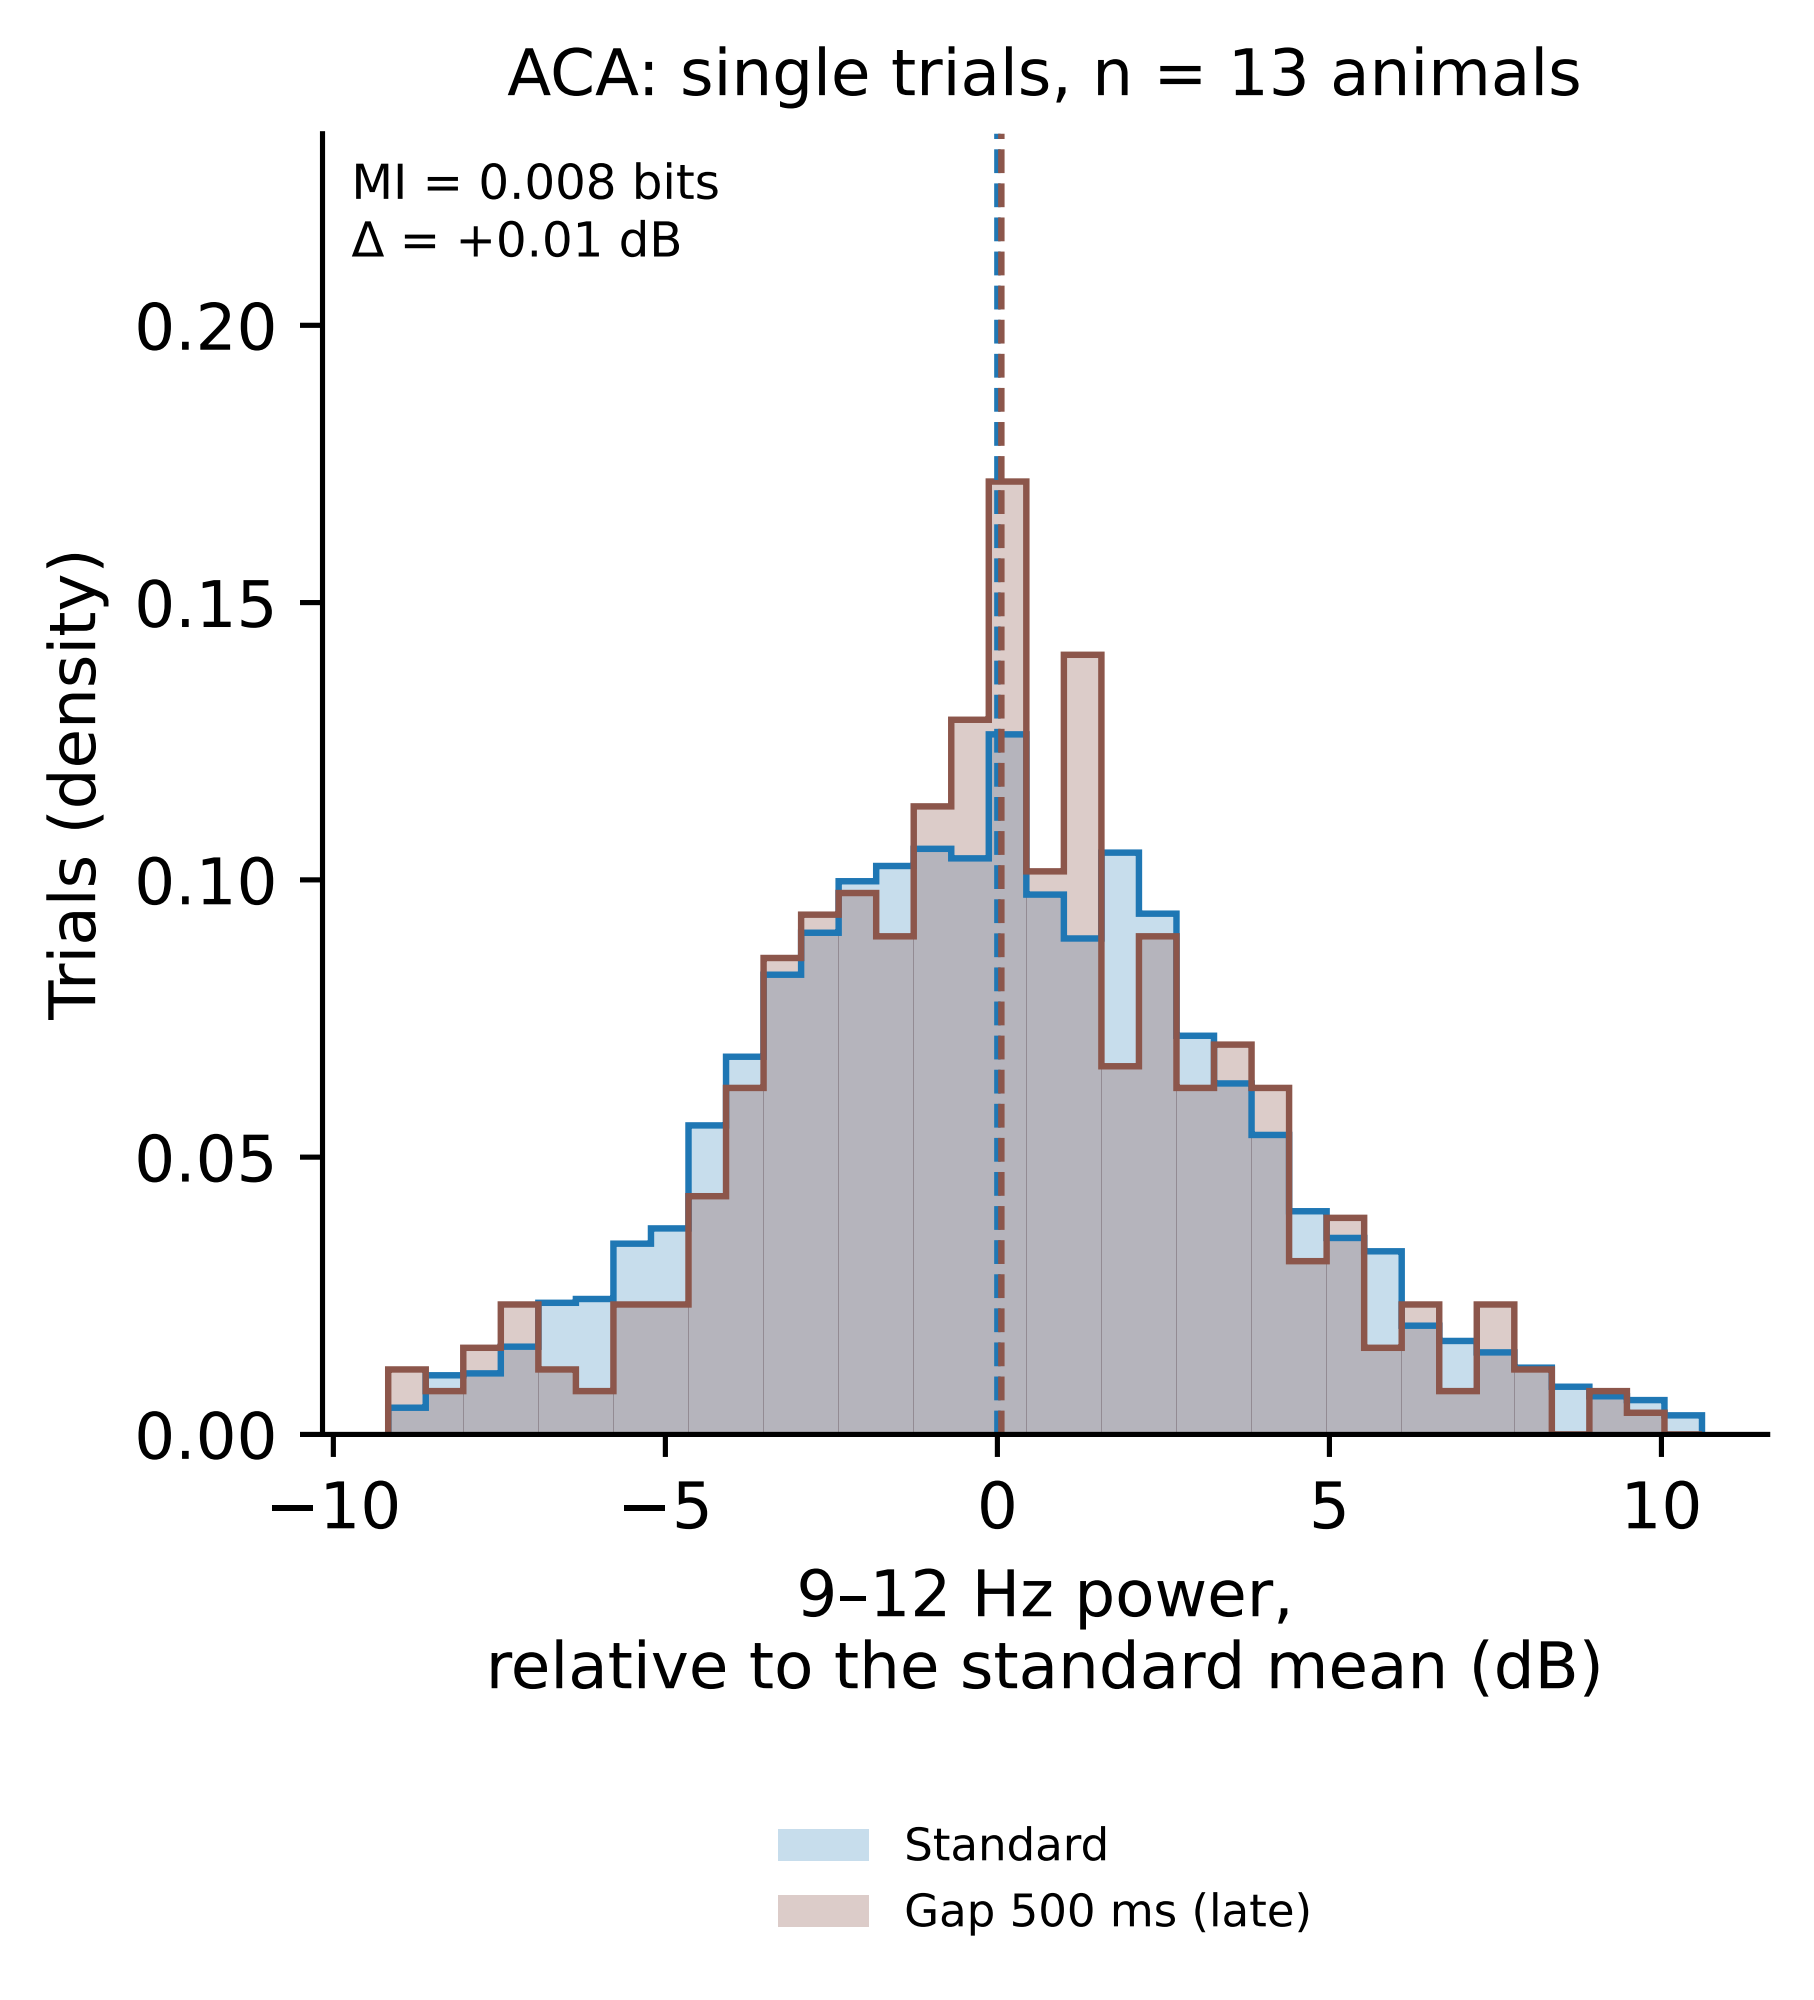
ACA: single trials, n = 13 animals
MI = 0.008 bits
Δ = +0.01 dB
Trials (density)
0.20
0.15
0.10
0.05
0.00
−10
−5
0
5
10
9–12 Hz power,
relative to the standard mean (dB)
Standard
Gap 500 ms (late)