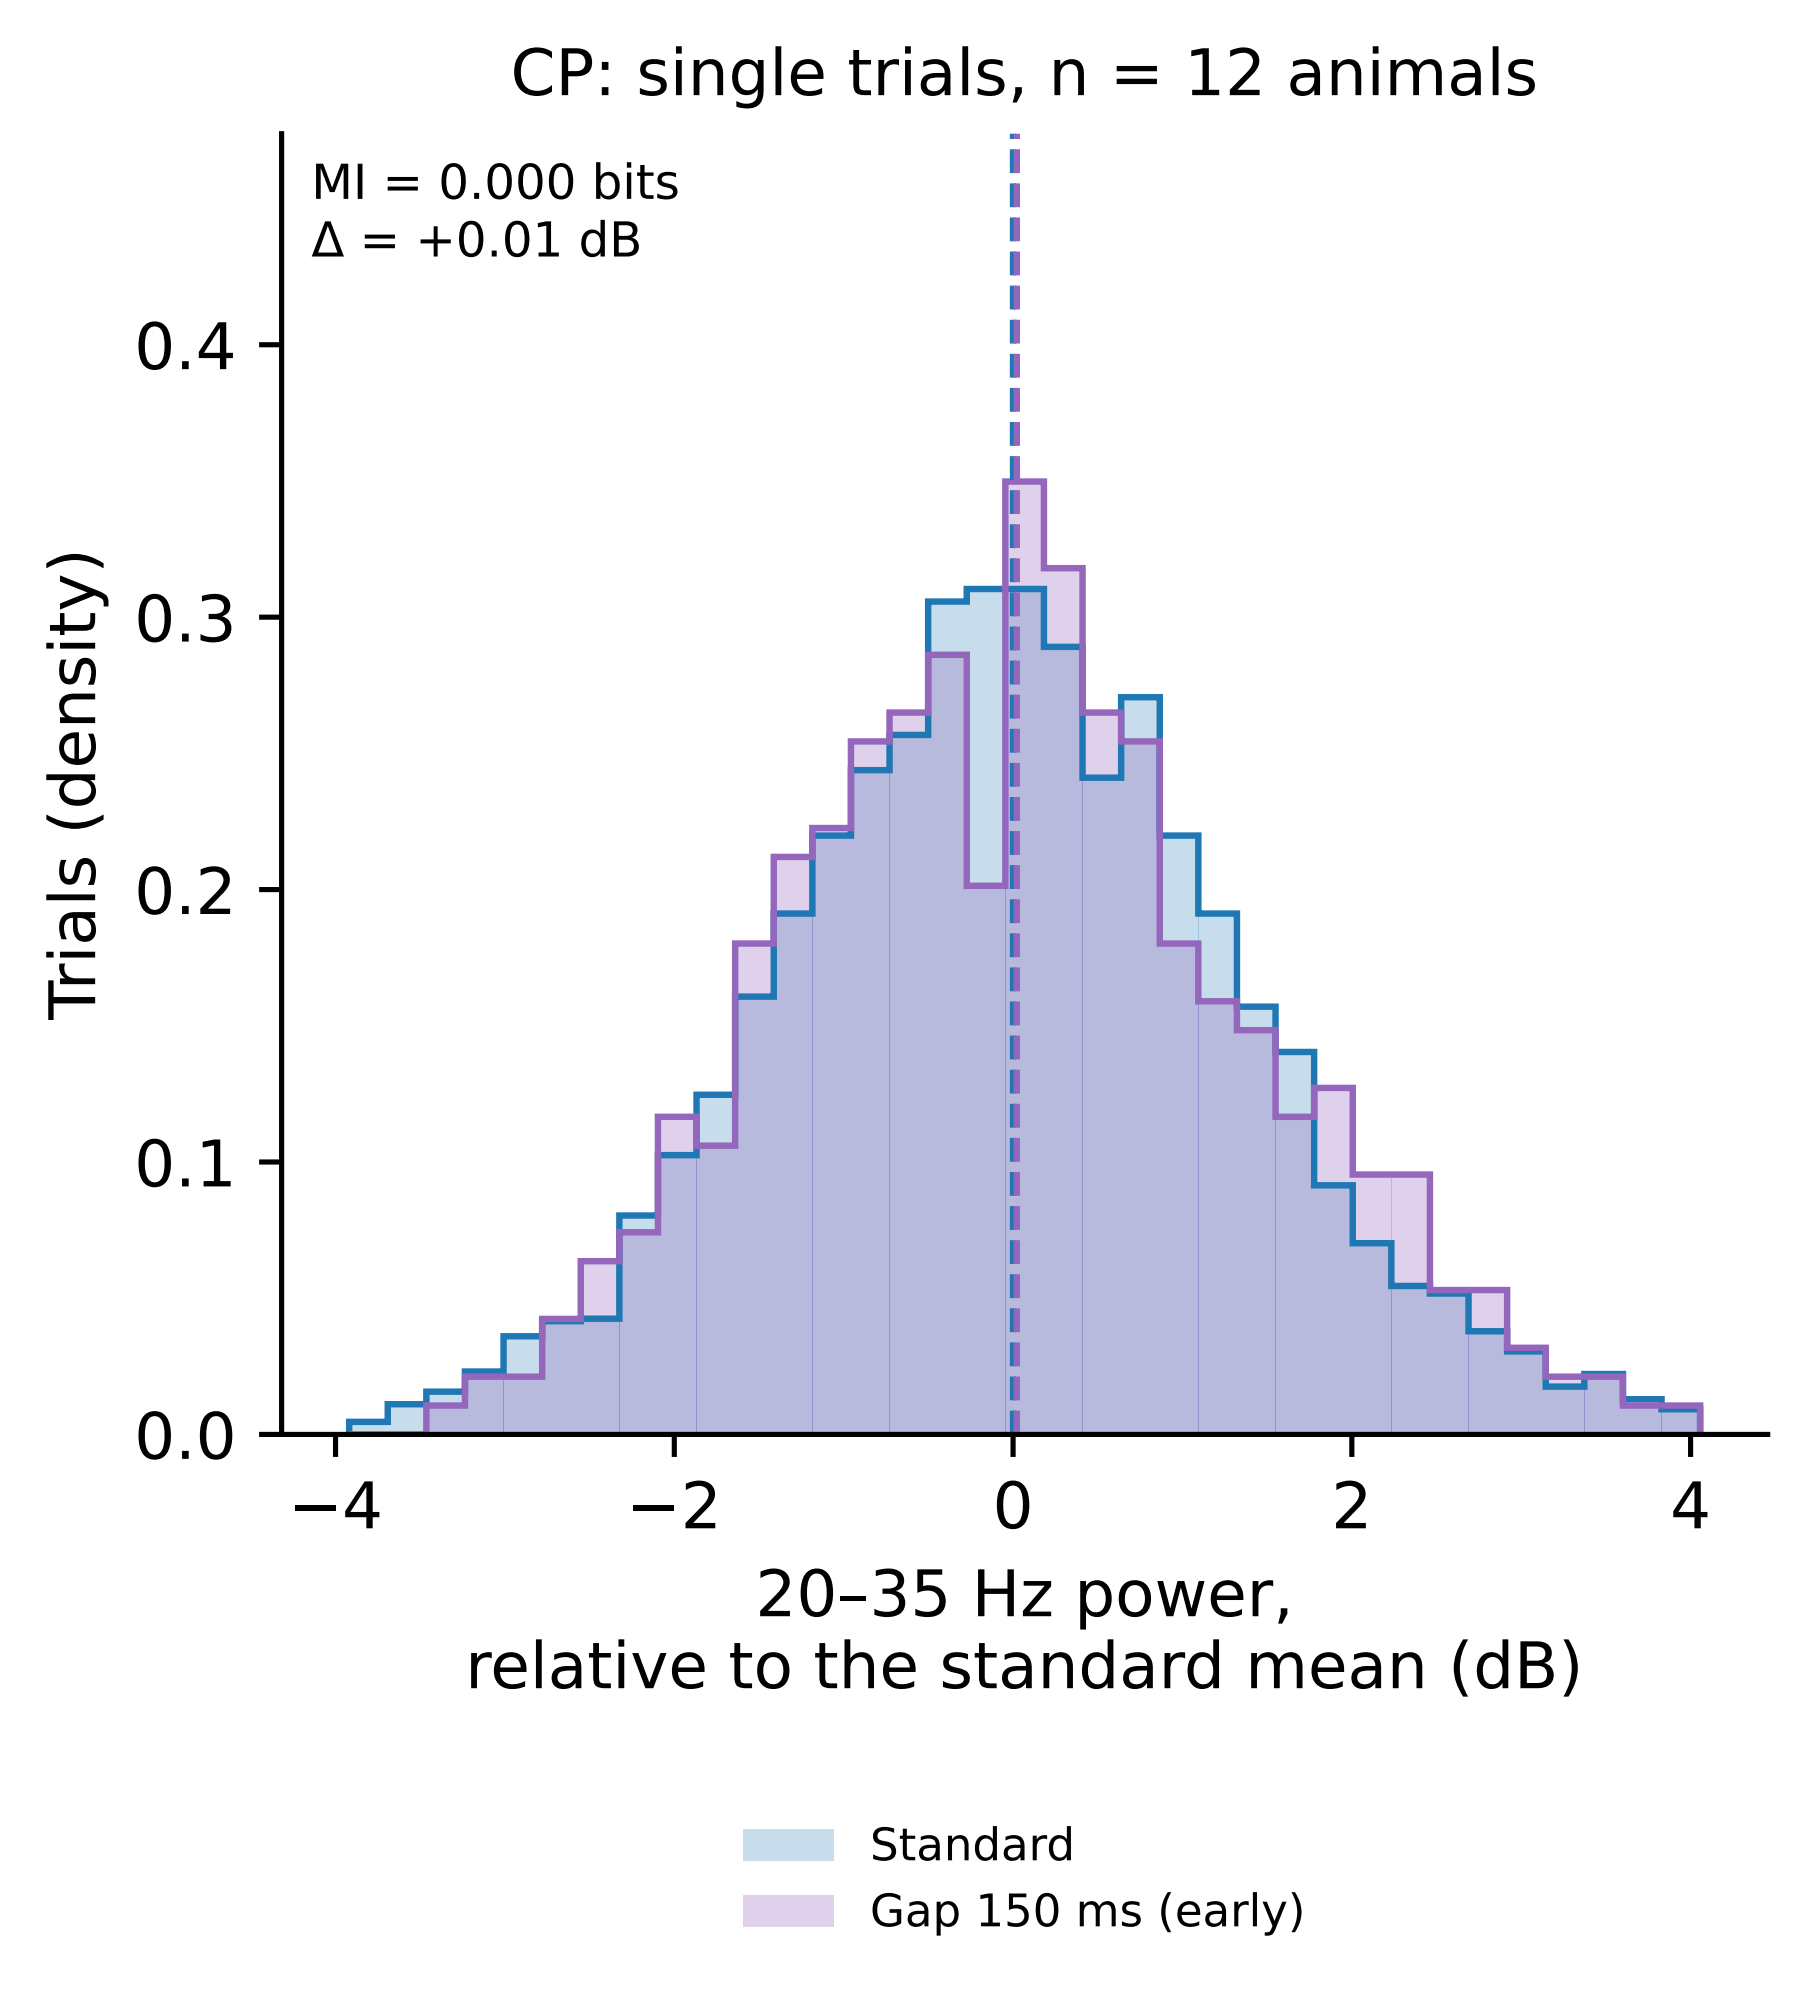
CP: single trials, n = 12 animals
MI = 0.000 bits
Δ = +0.01 dB
Trials (density)
0.0
0.1
0.2
0.3
0.4
−4
−2
0
2
4
20–35 Hz power,
relative to the standard mean (dB)
Standard
Gap 150 ms (early)