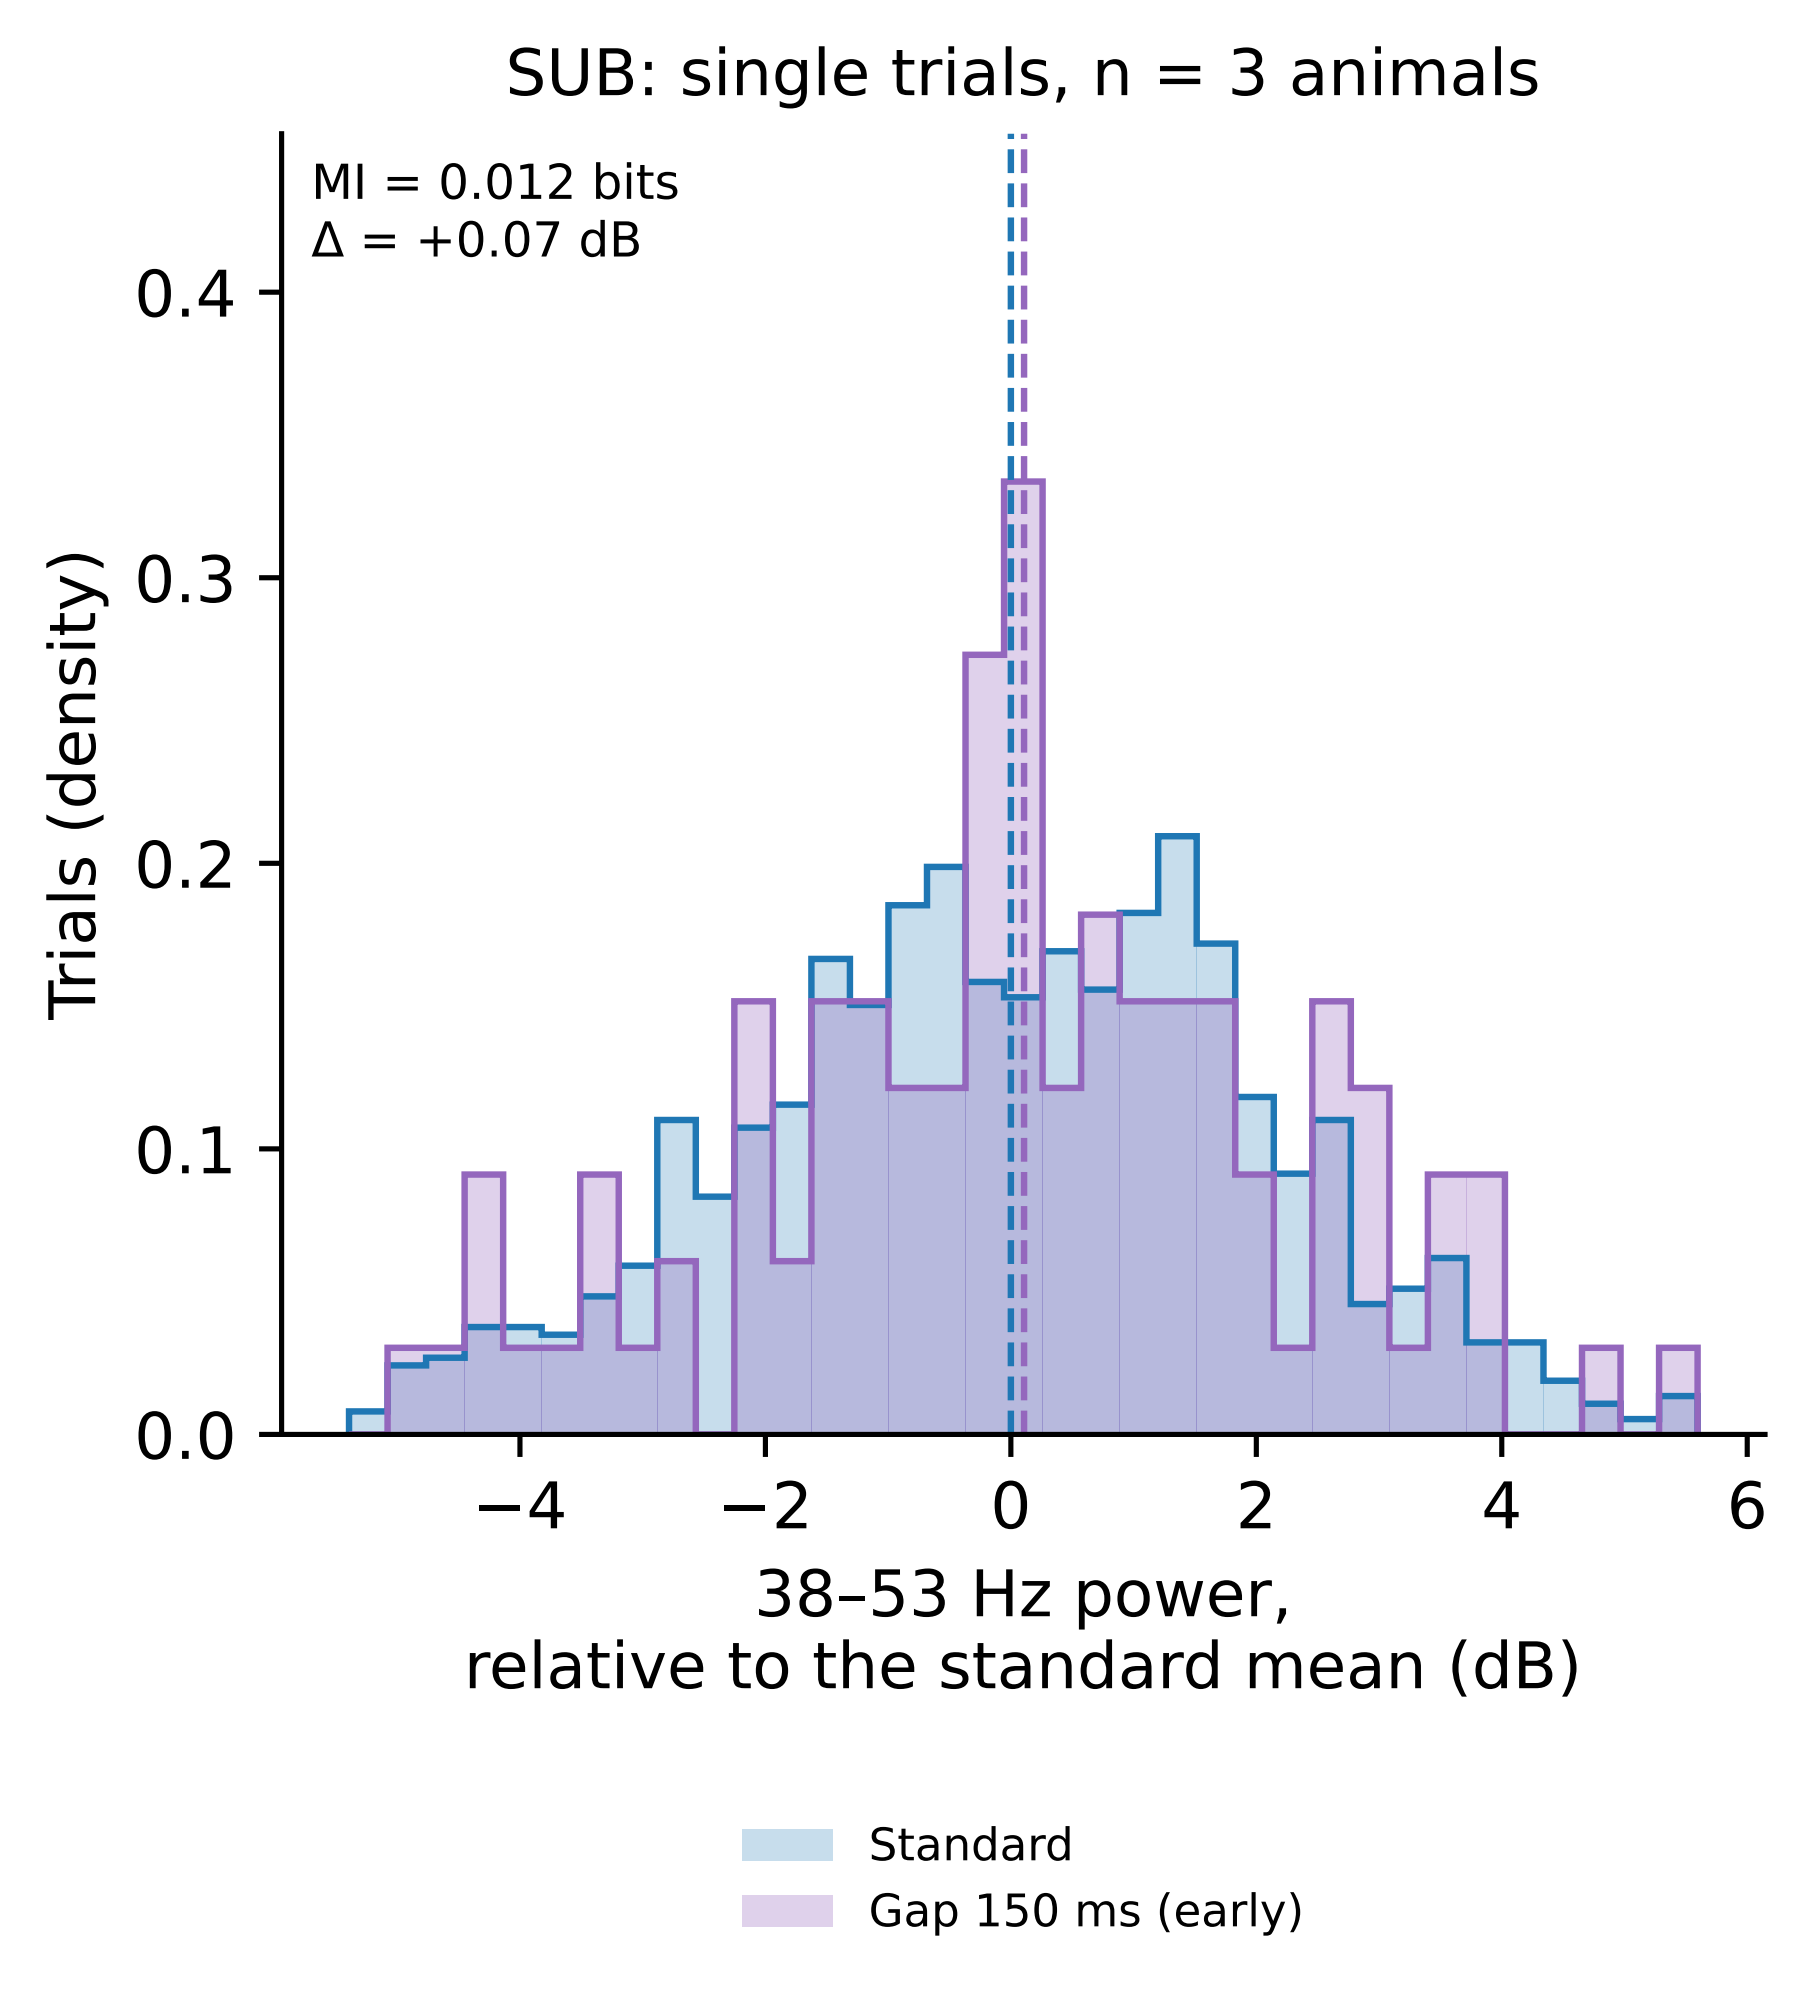
SUB: single trials, n = 3 animals
MI = 0.012 bits
Δ = +0.07 dB
Trials (density)
0.0
0.1
0.2
0.3
0.4
−4
−2
0
2
4
6
38–53 Hz power,
relative to the standard mean (dB)
Standard
Gap 150 ms (early)