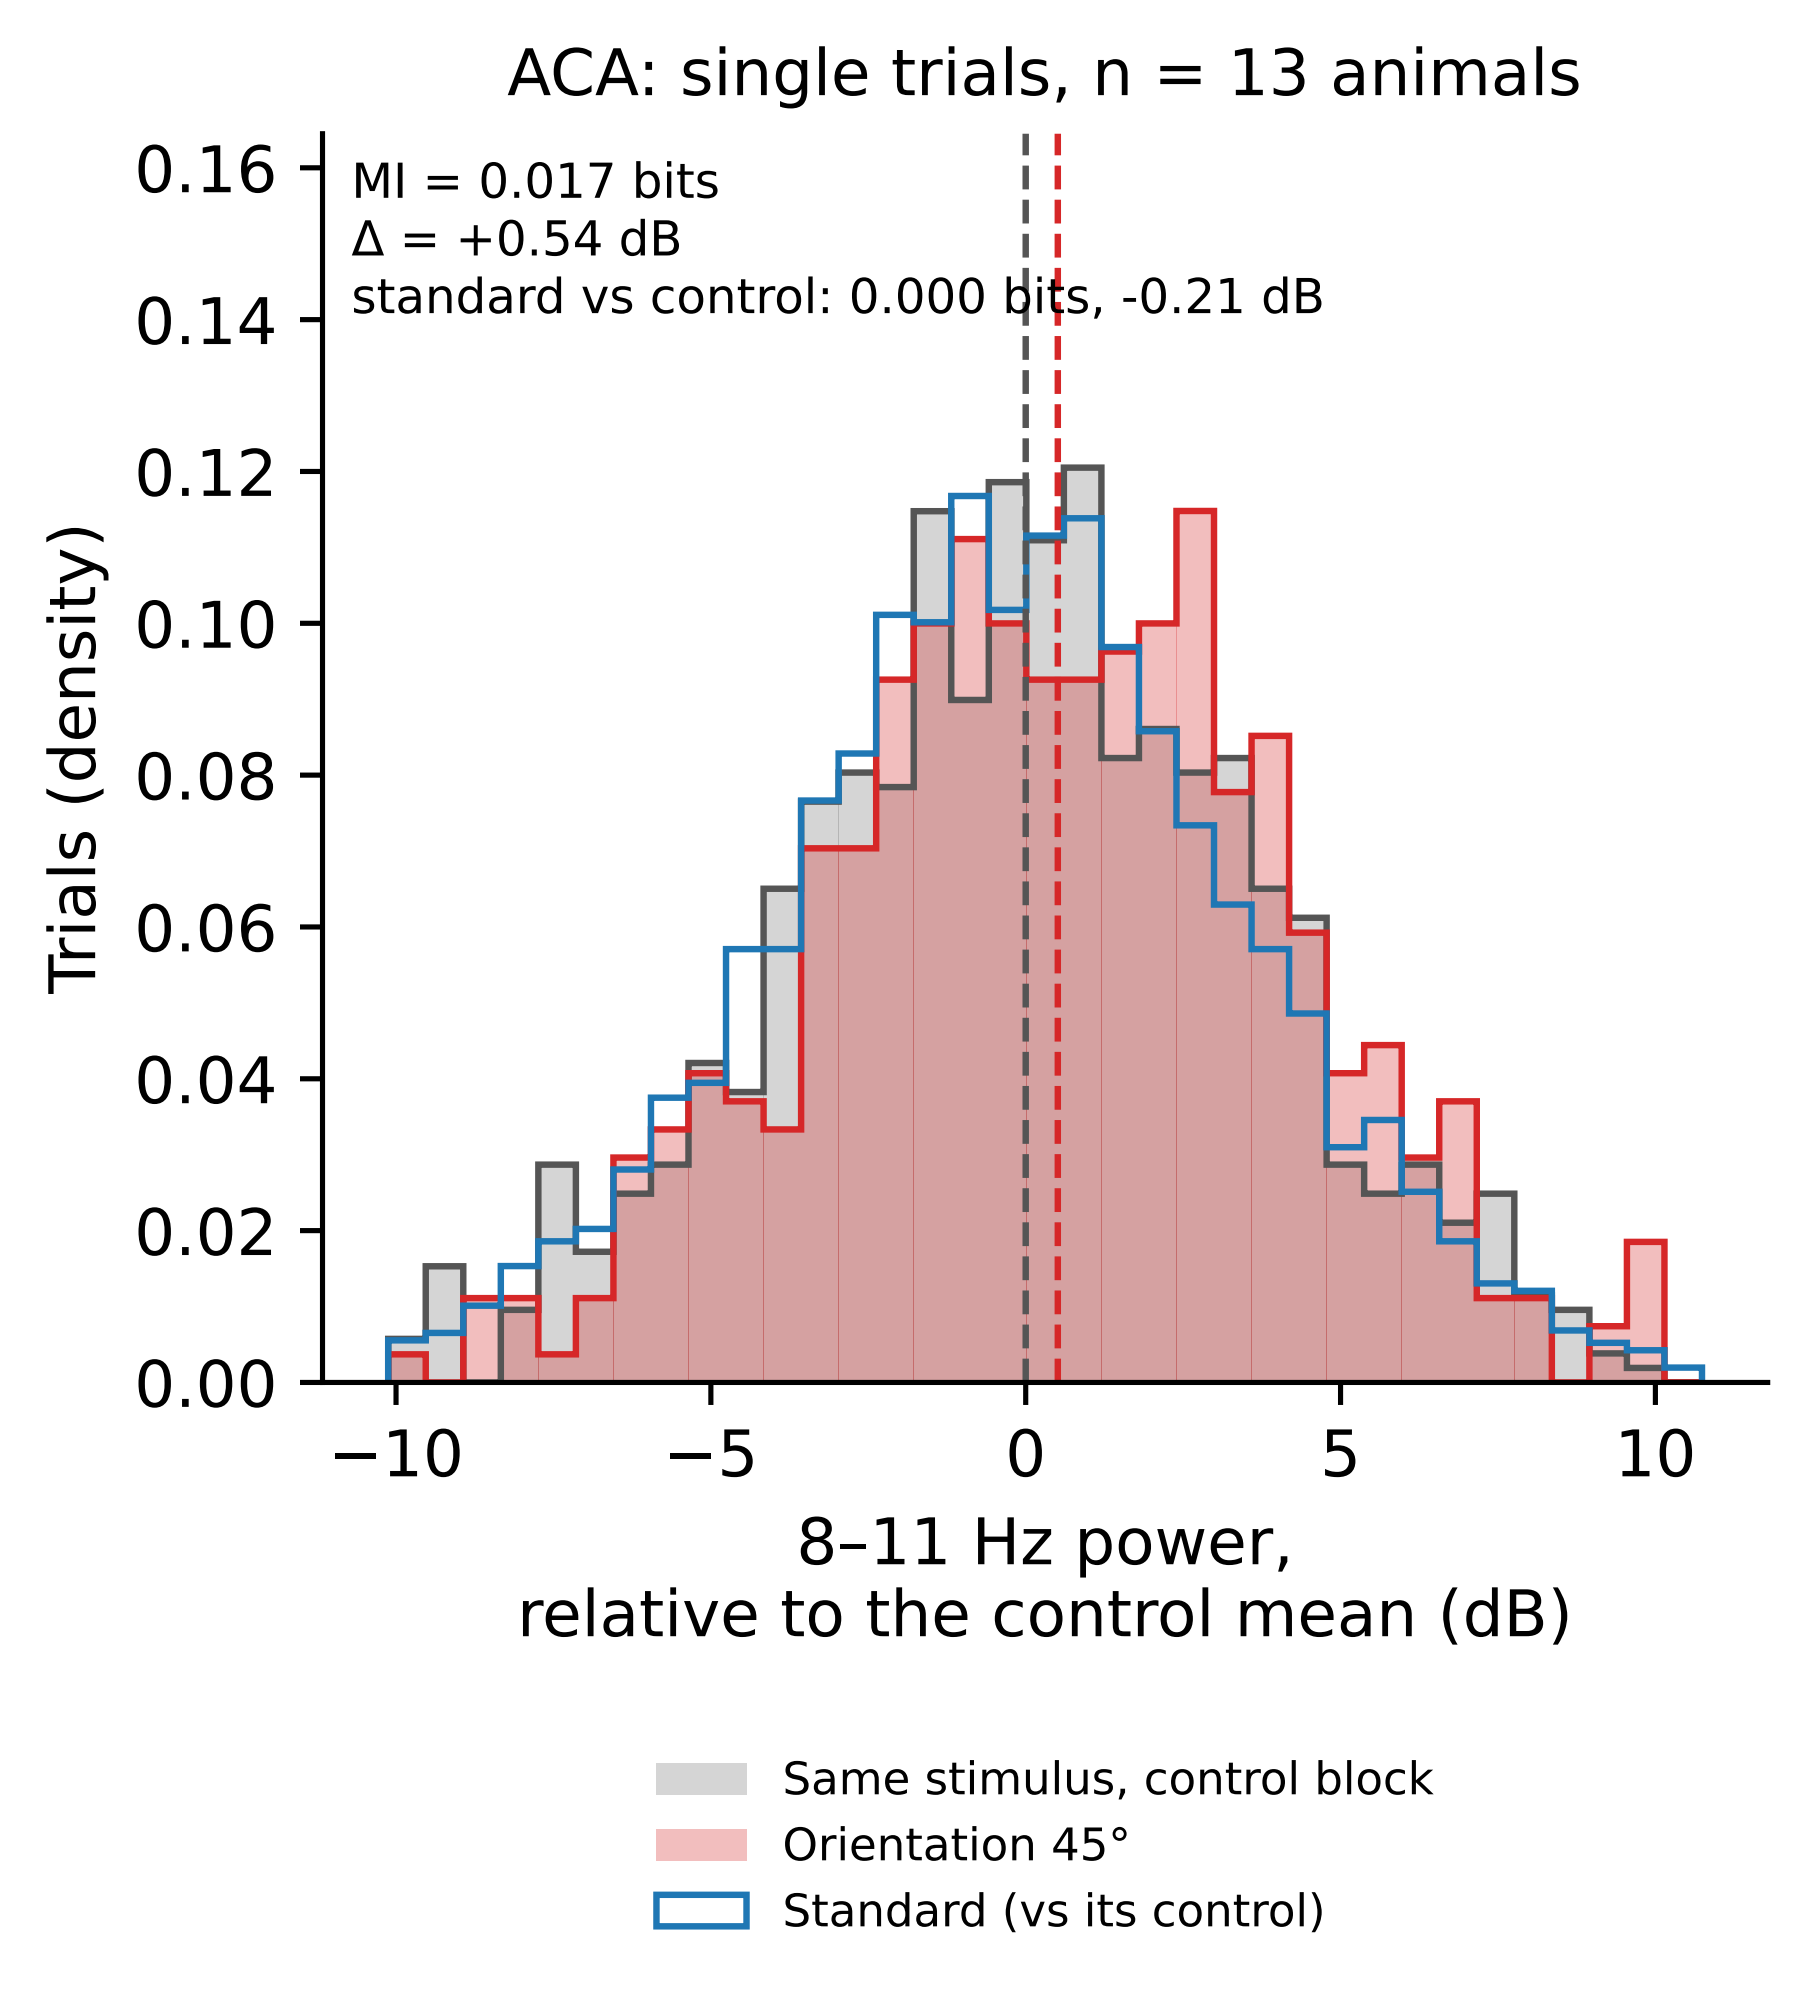
ACA: single trials, n = 13 animals
MI = 0.017 bits
Δ = +0.54 dB
standard vs control: 0.000 bits, -0.21 dB
Trials (density)
0.16
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
−10
−5
0
5
10
8–11 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 45°
Standard (vs its control)