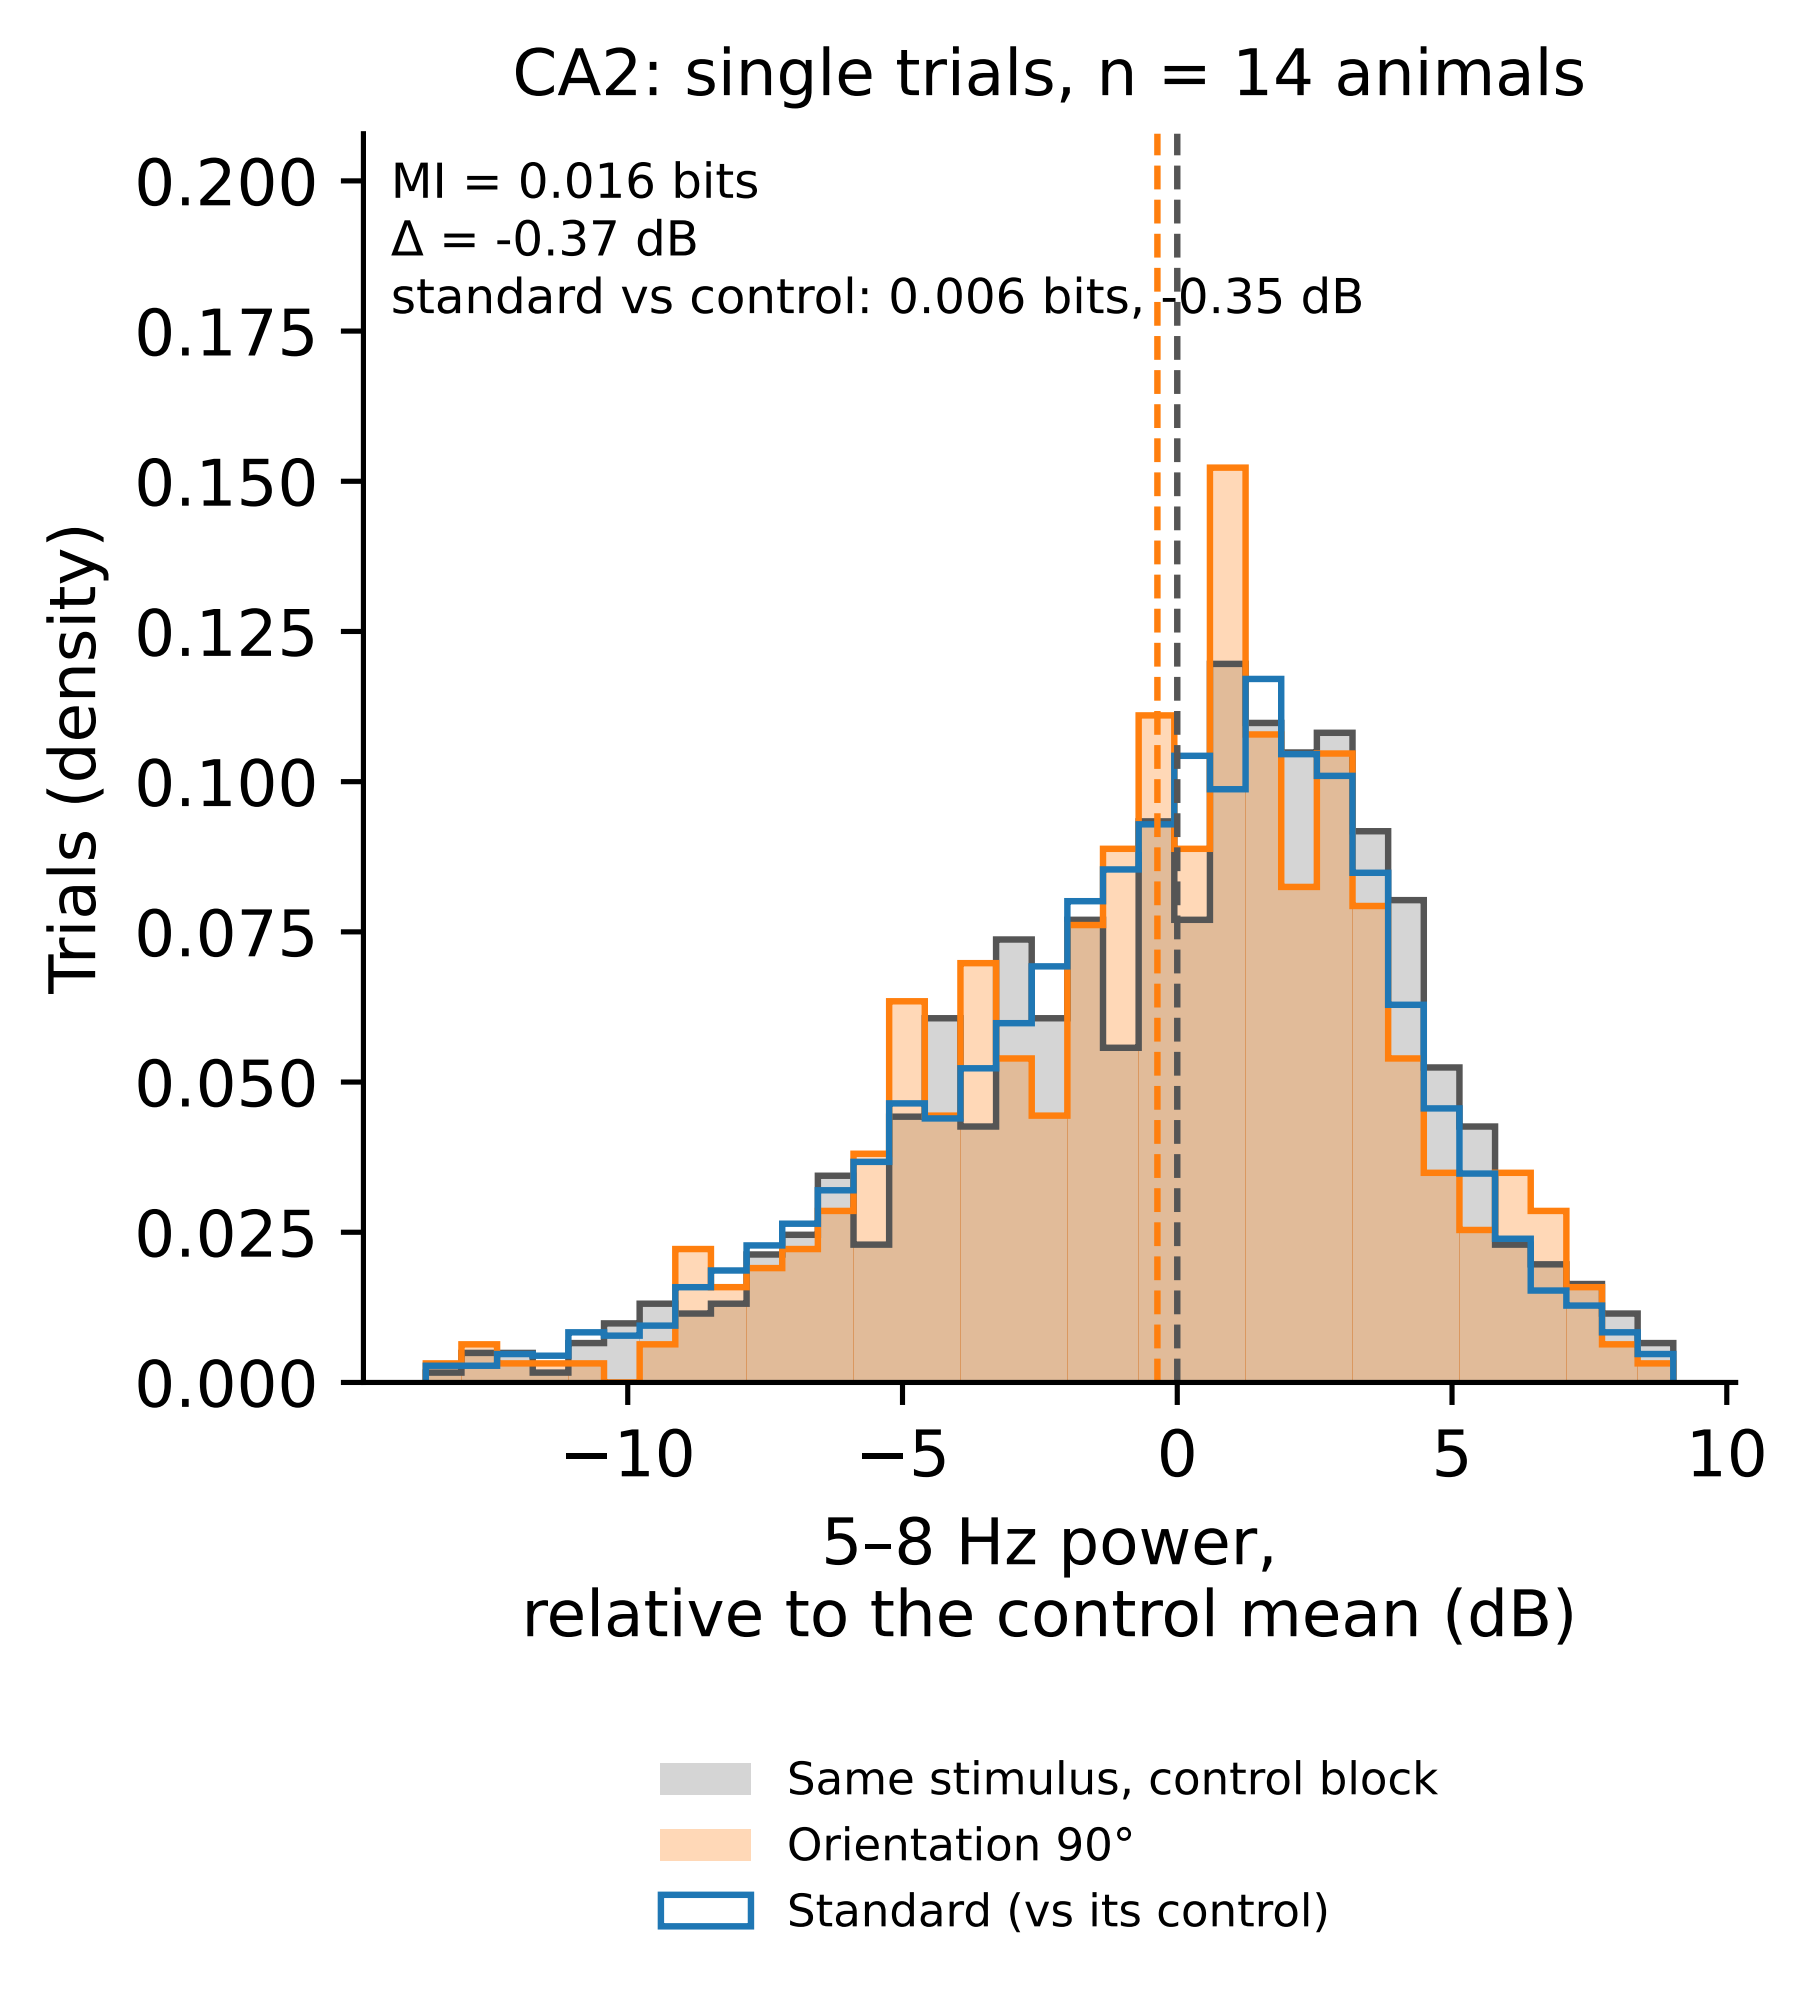
CA2: single trials, n = 14 animals
MI = 0.016 bits
Δ = -0.37 dB
standard vs control: 0.006 bits, -0.35 dB
Trials (density)
0.200
0.175
0.150
0.125
0.100
0.075
0.050
0.025
0.000
−10
−5
0
5
10
5–8 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 90°
Standard (vs its control)