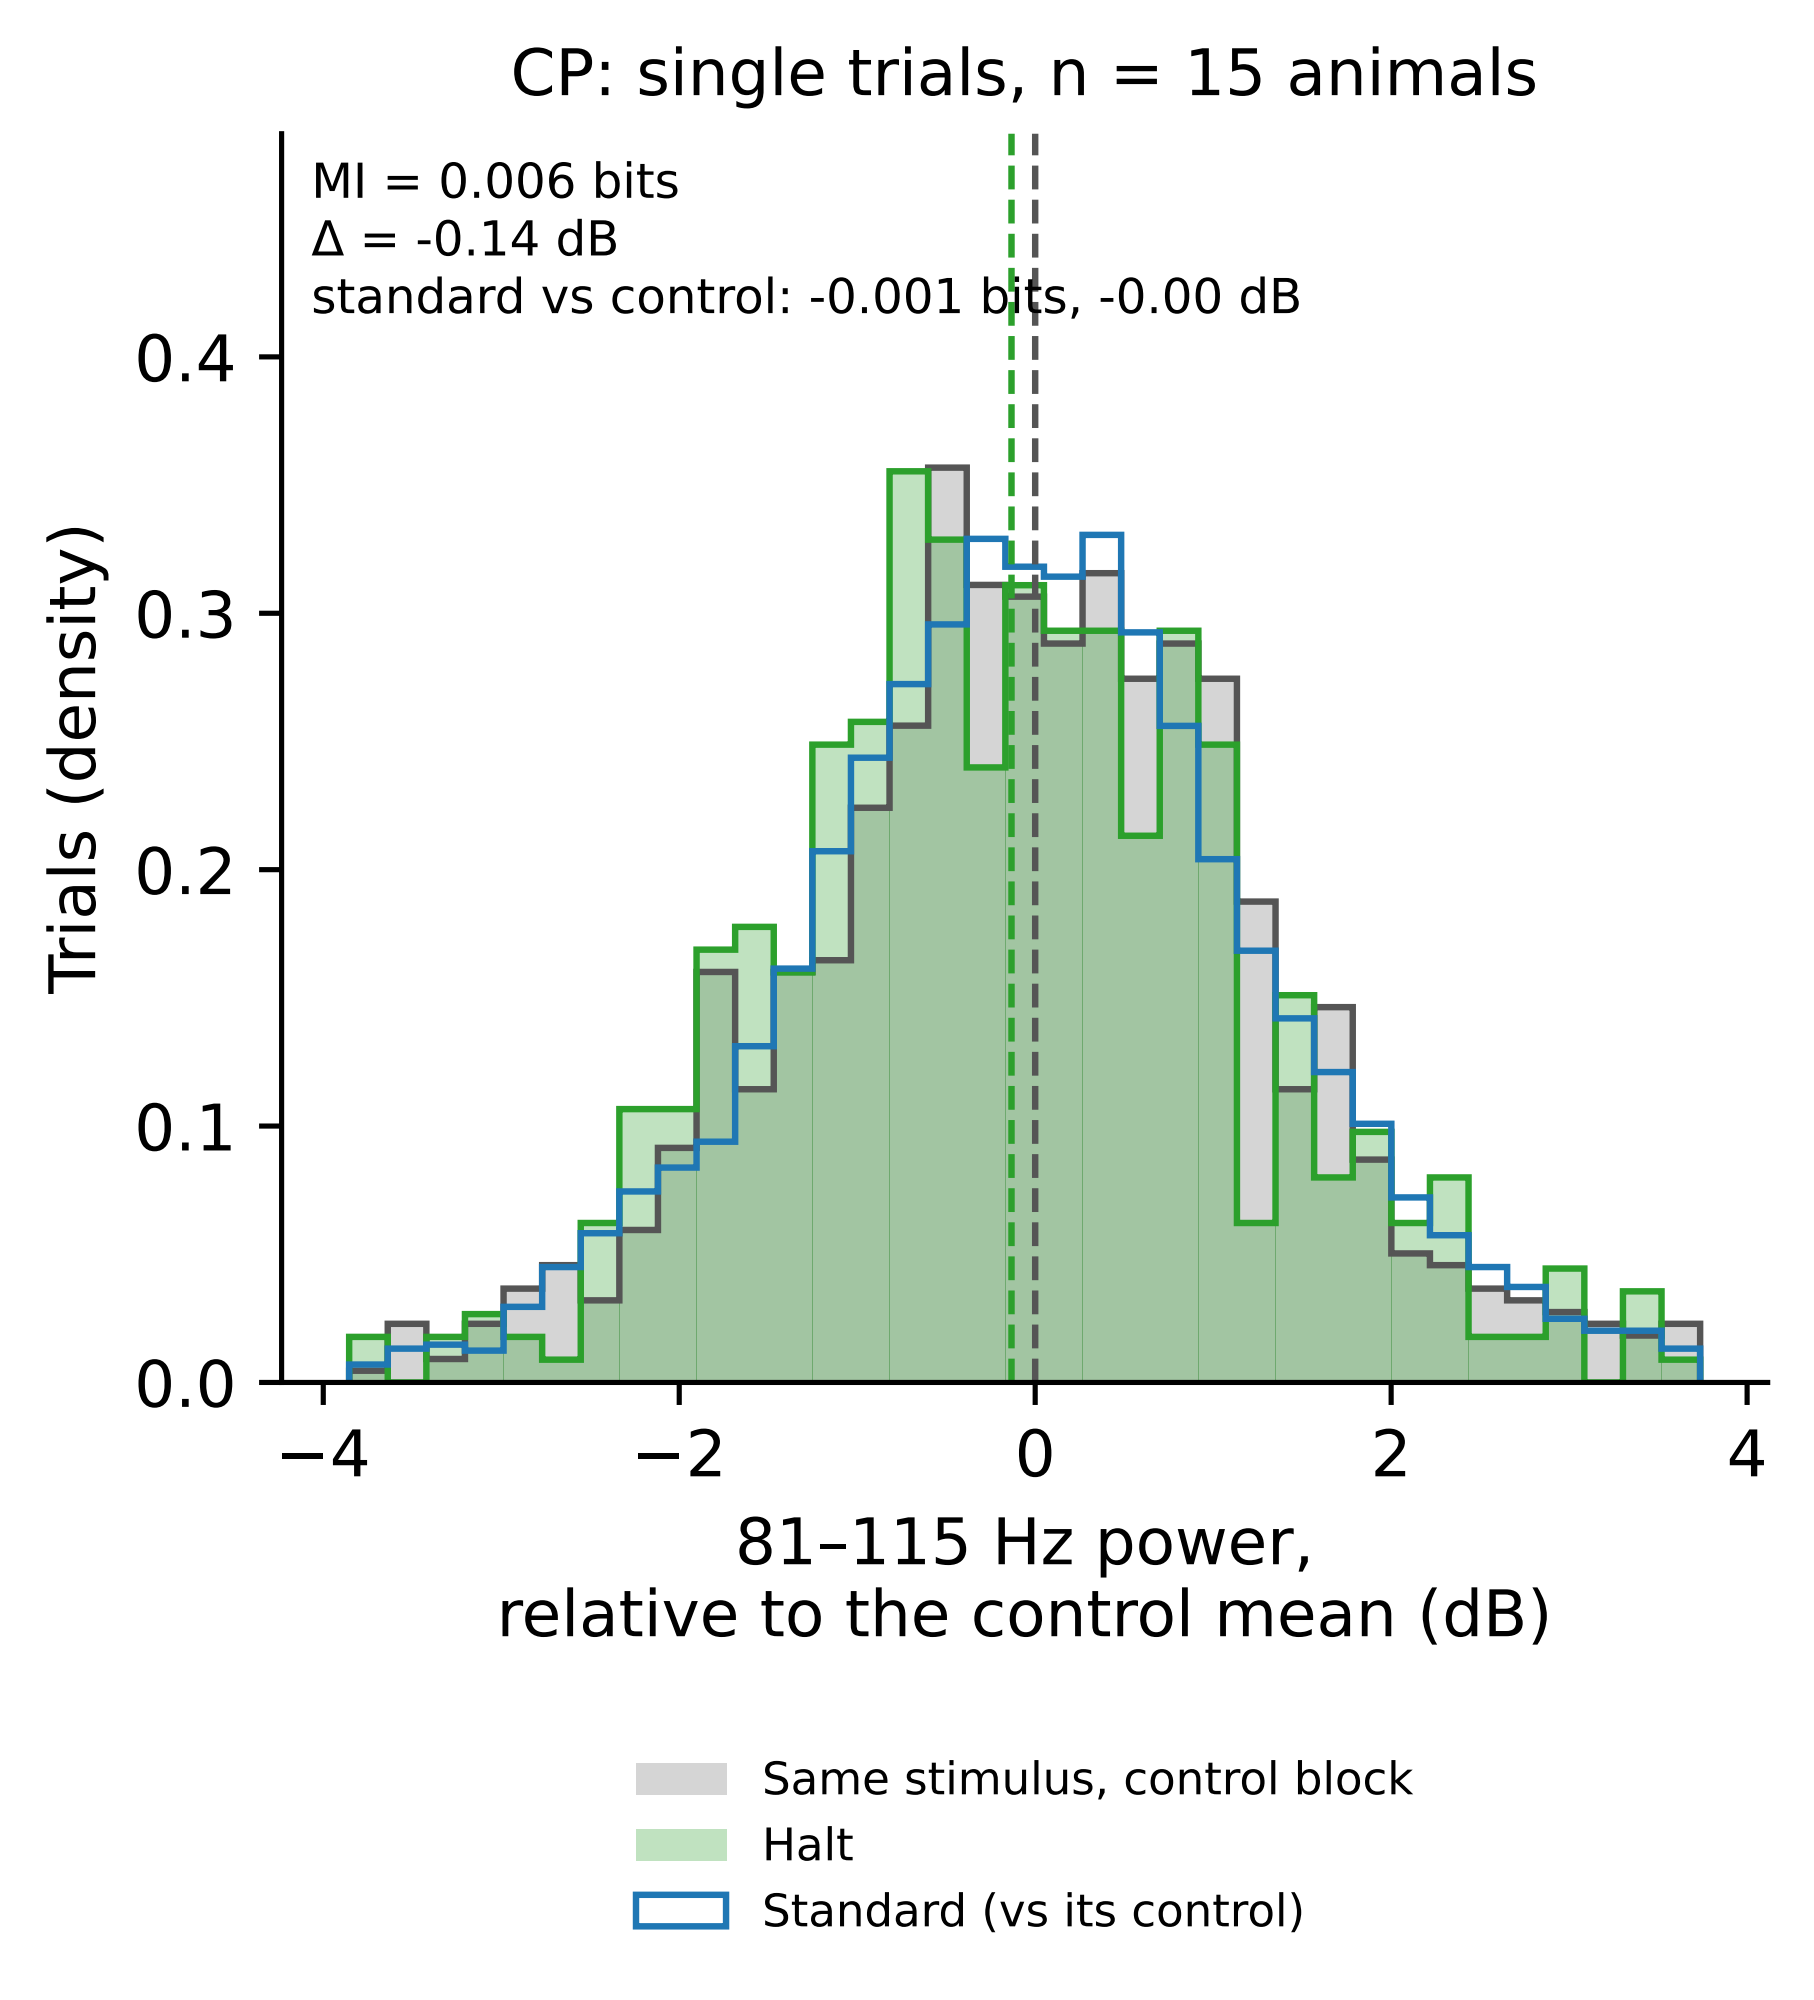
CP: single trials, n = 15 animals
MI = 0.006 bits
Δ = -0.14 dB
standard vs control: -0.001 bits, -0.00 dB
Trials (density)
0.0
0.1
0.2
0.3
0.4
−4
−2
0
2
4
81–115 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Halt
Standard (vs its control)