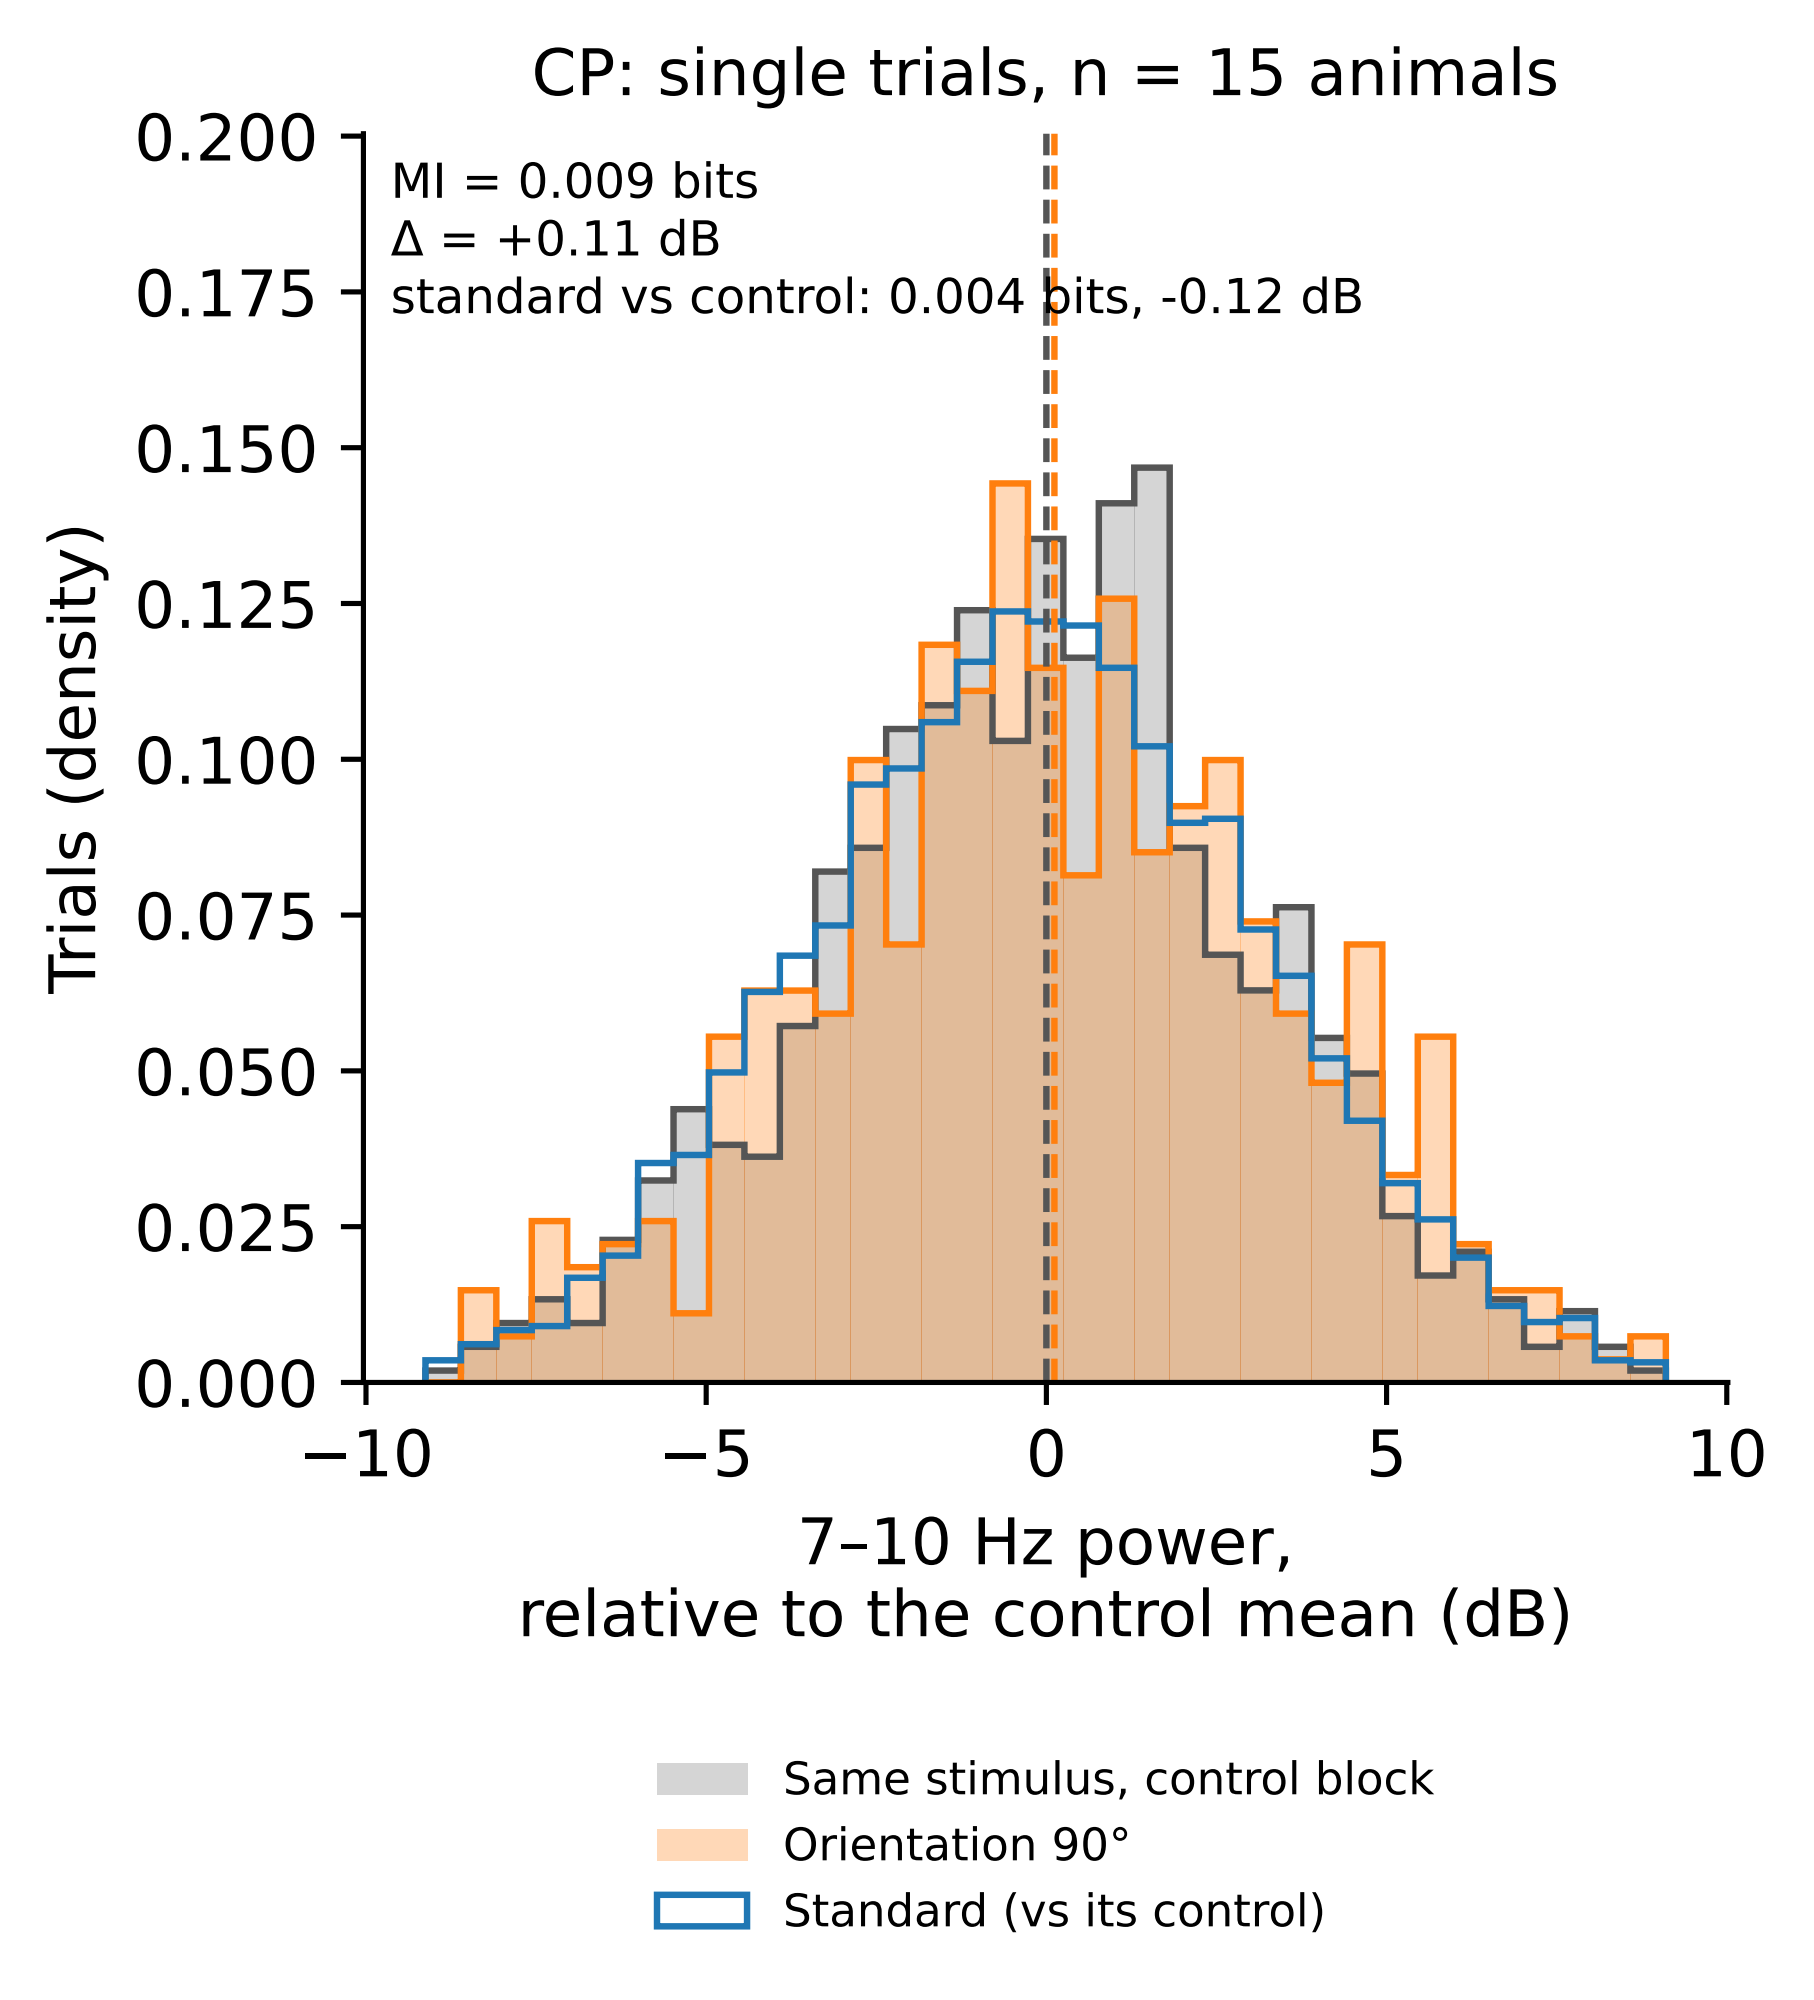
CP: single trials, n = 15 animals
MI = 0.009 bits
Δ = +0.11 dB
standard vs control: 0.004 bits, -0.12 dB
Trials (density)
0.200
0.175
0.150
0.125
0.100
0.075
0.050
0.025
0.000
−10
−5
0
5
10
7–10 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 90°
Standard (vs its control)