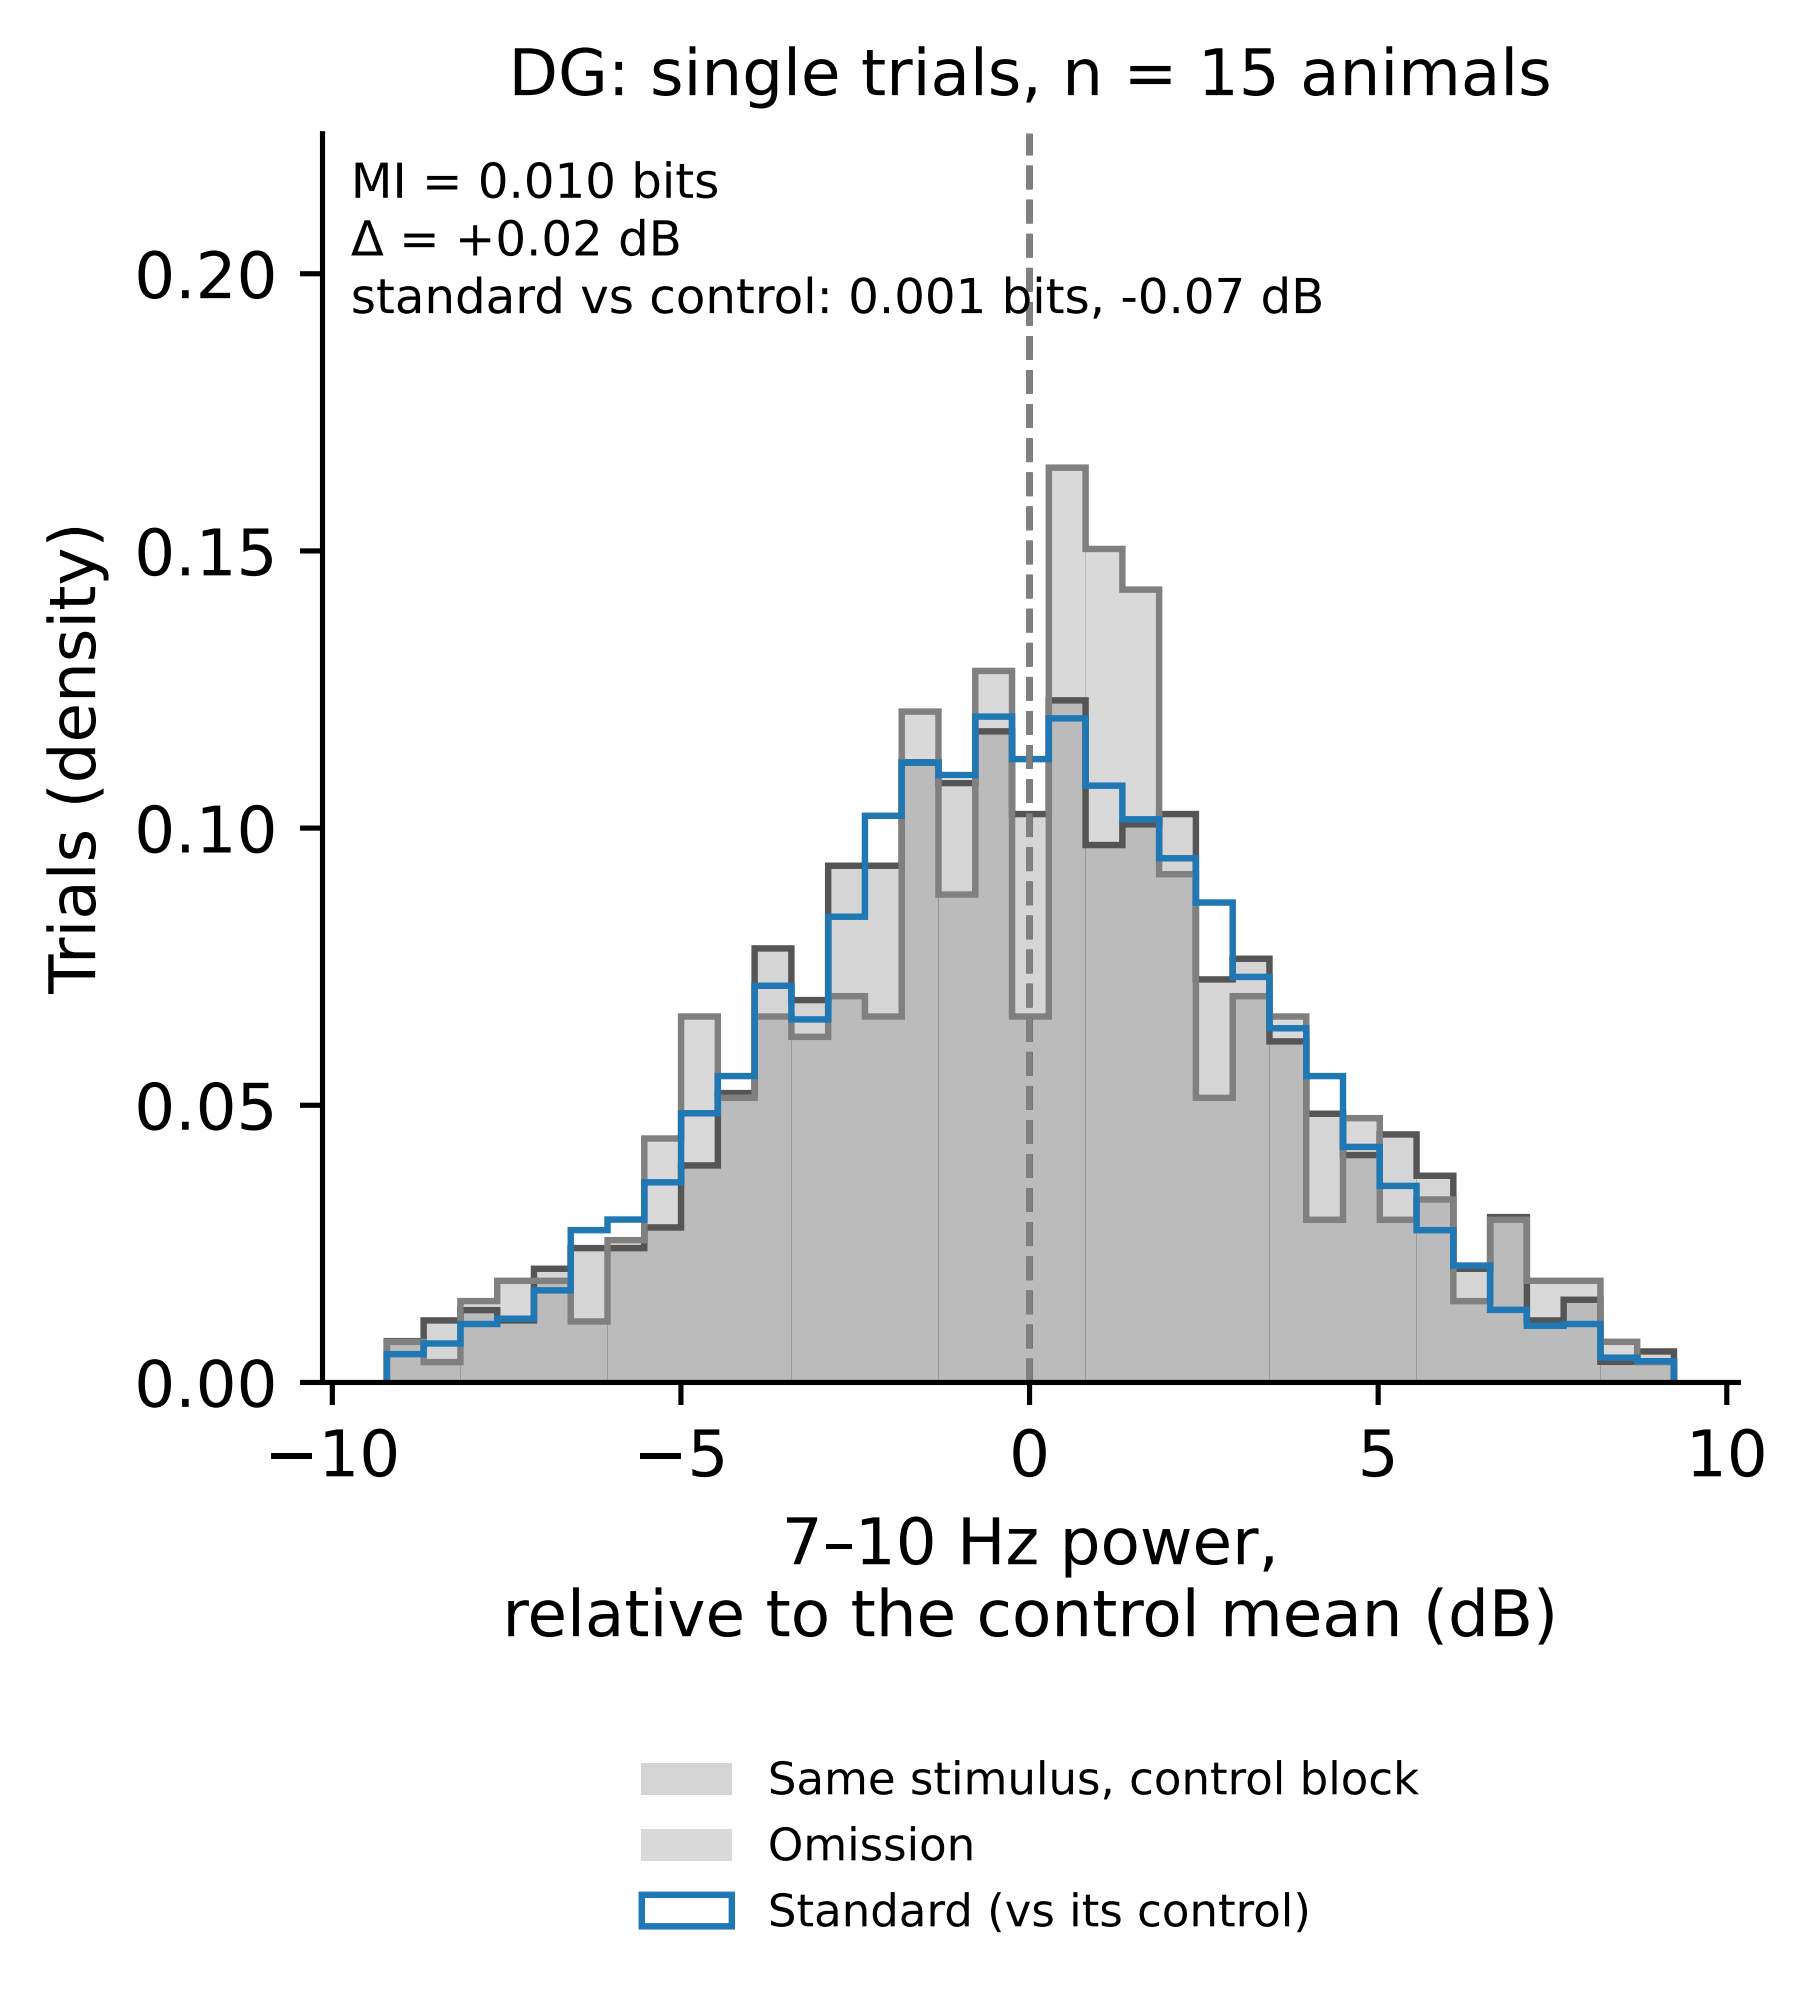
DG: single trials, n = 15 animals
MI = 0.010 bits
Δ = +0.02 dB
standard vs control: 0.001 bits, -0.07 dB
Trials (density)
0.00
0.05
0.10
0.15
0.20
−10
−5
0
5
10
7–10 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Omission
Standard (vs its control)