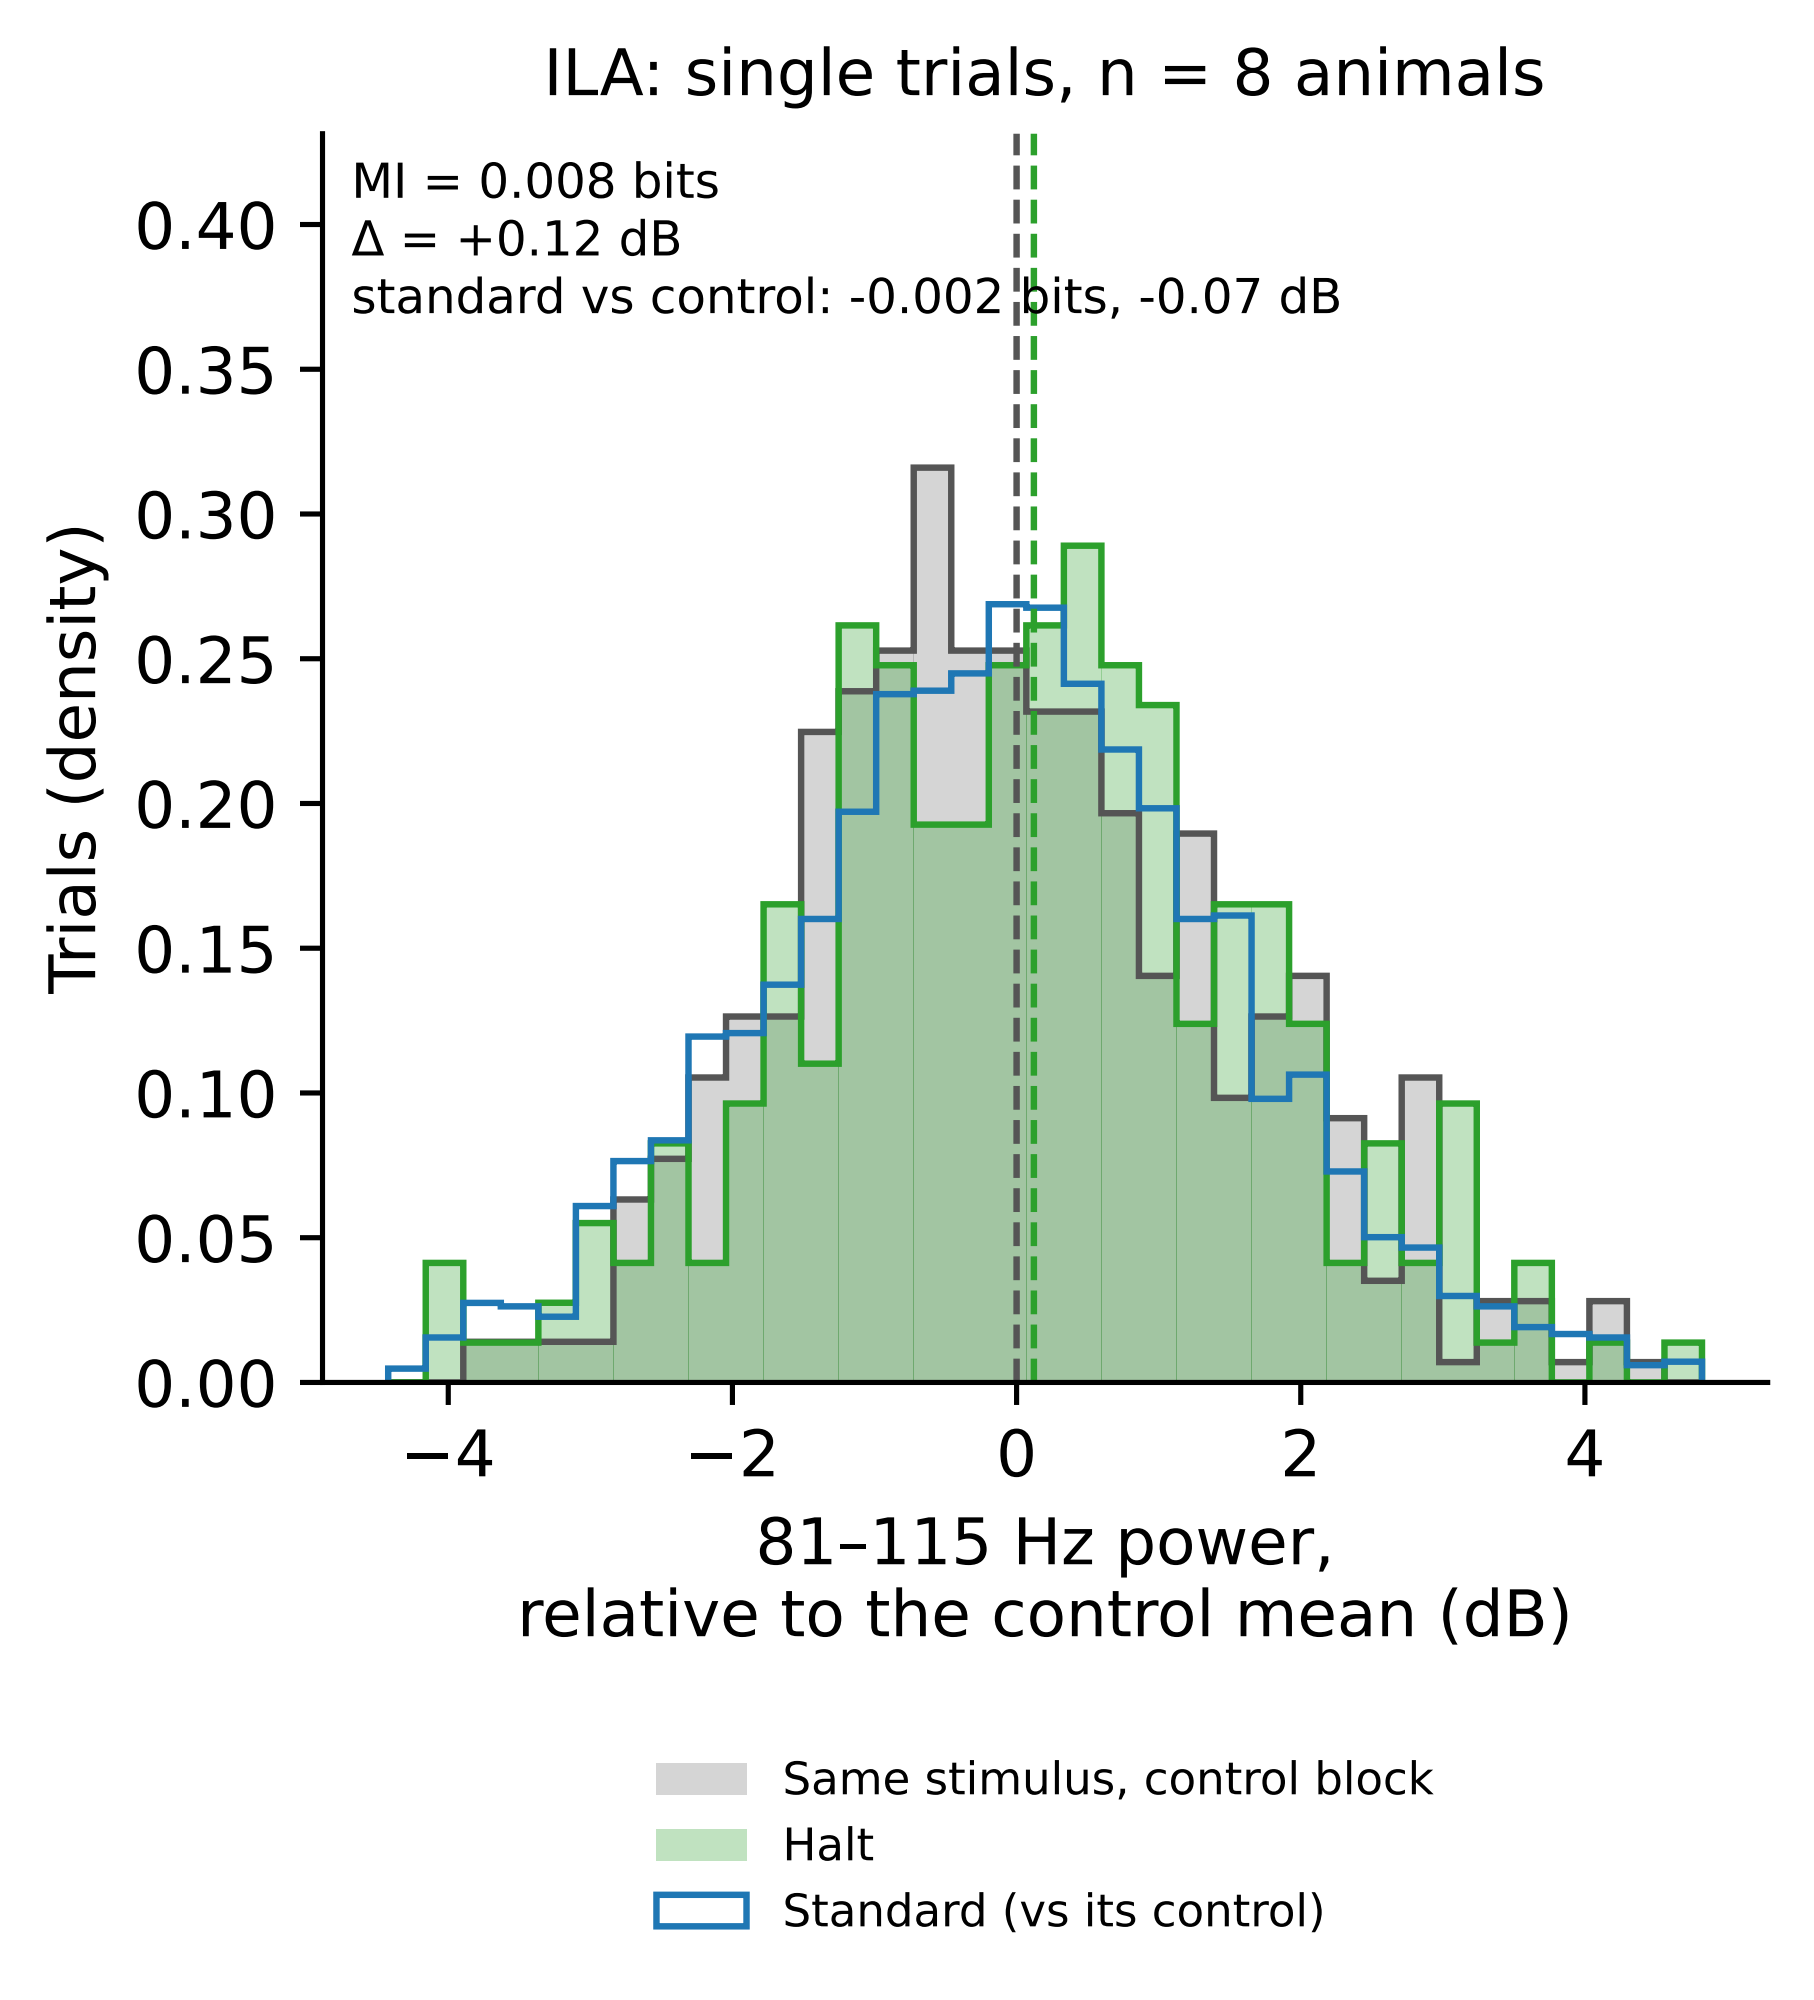
ILA: single trials, n = 8 animals
MI = 0.008 bits
Δ = +0.12 dB
standard vs control: -0.002 bits, -0.07 dB
Trials (density)
0.40
0.35
0.30
0.25
0.20
0.15
0.10
0.05
0.00
−4
−2
0
2
4
81–115 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Halt
Standard (vs its control)