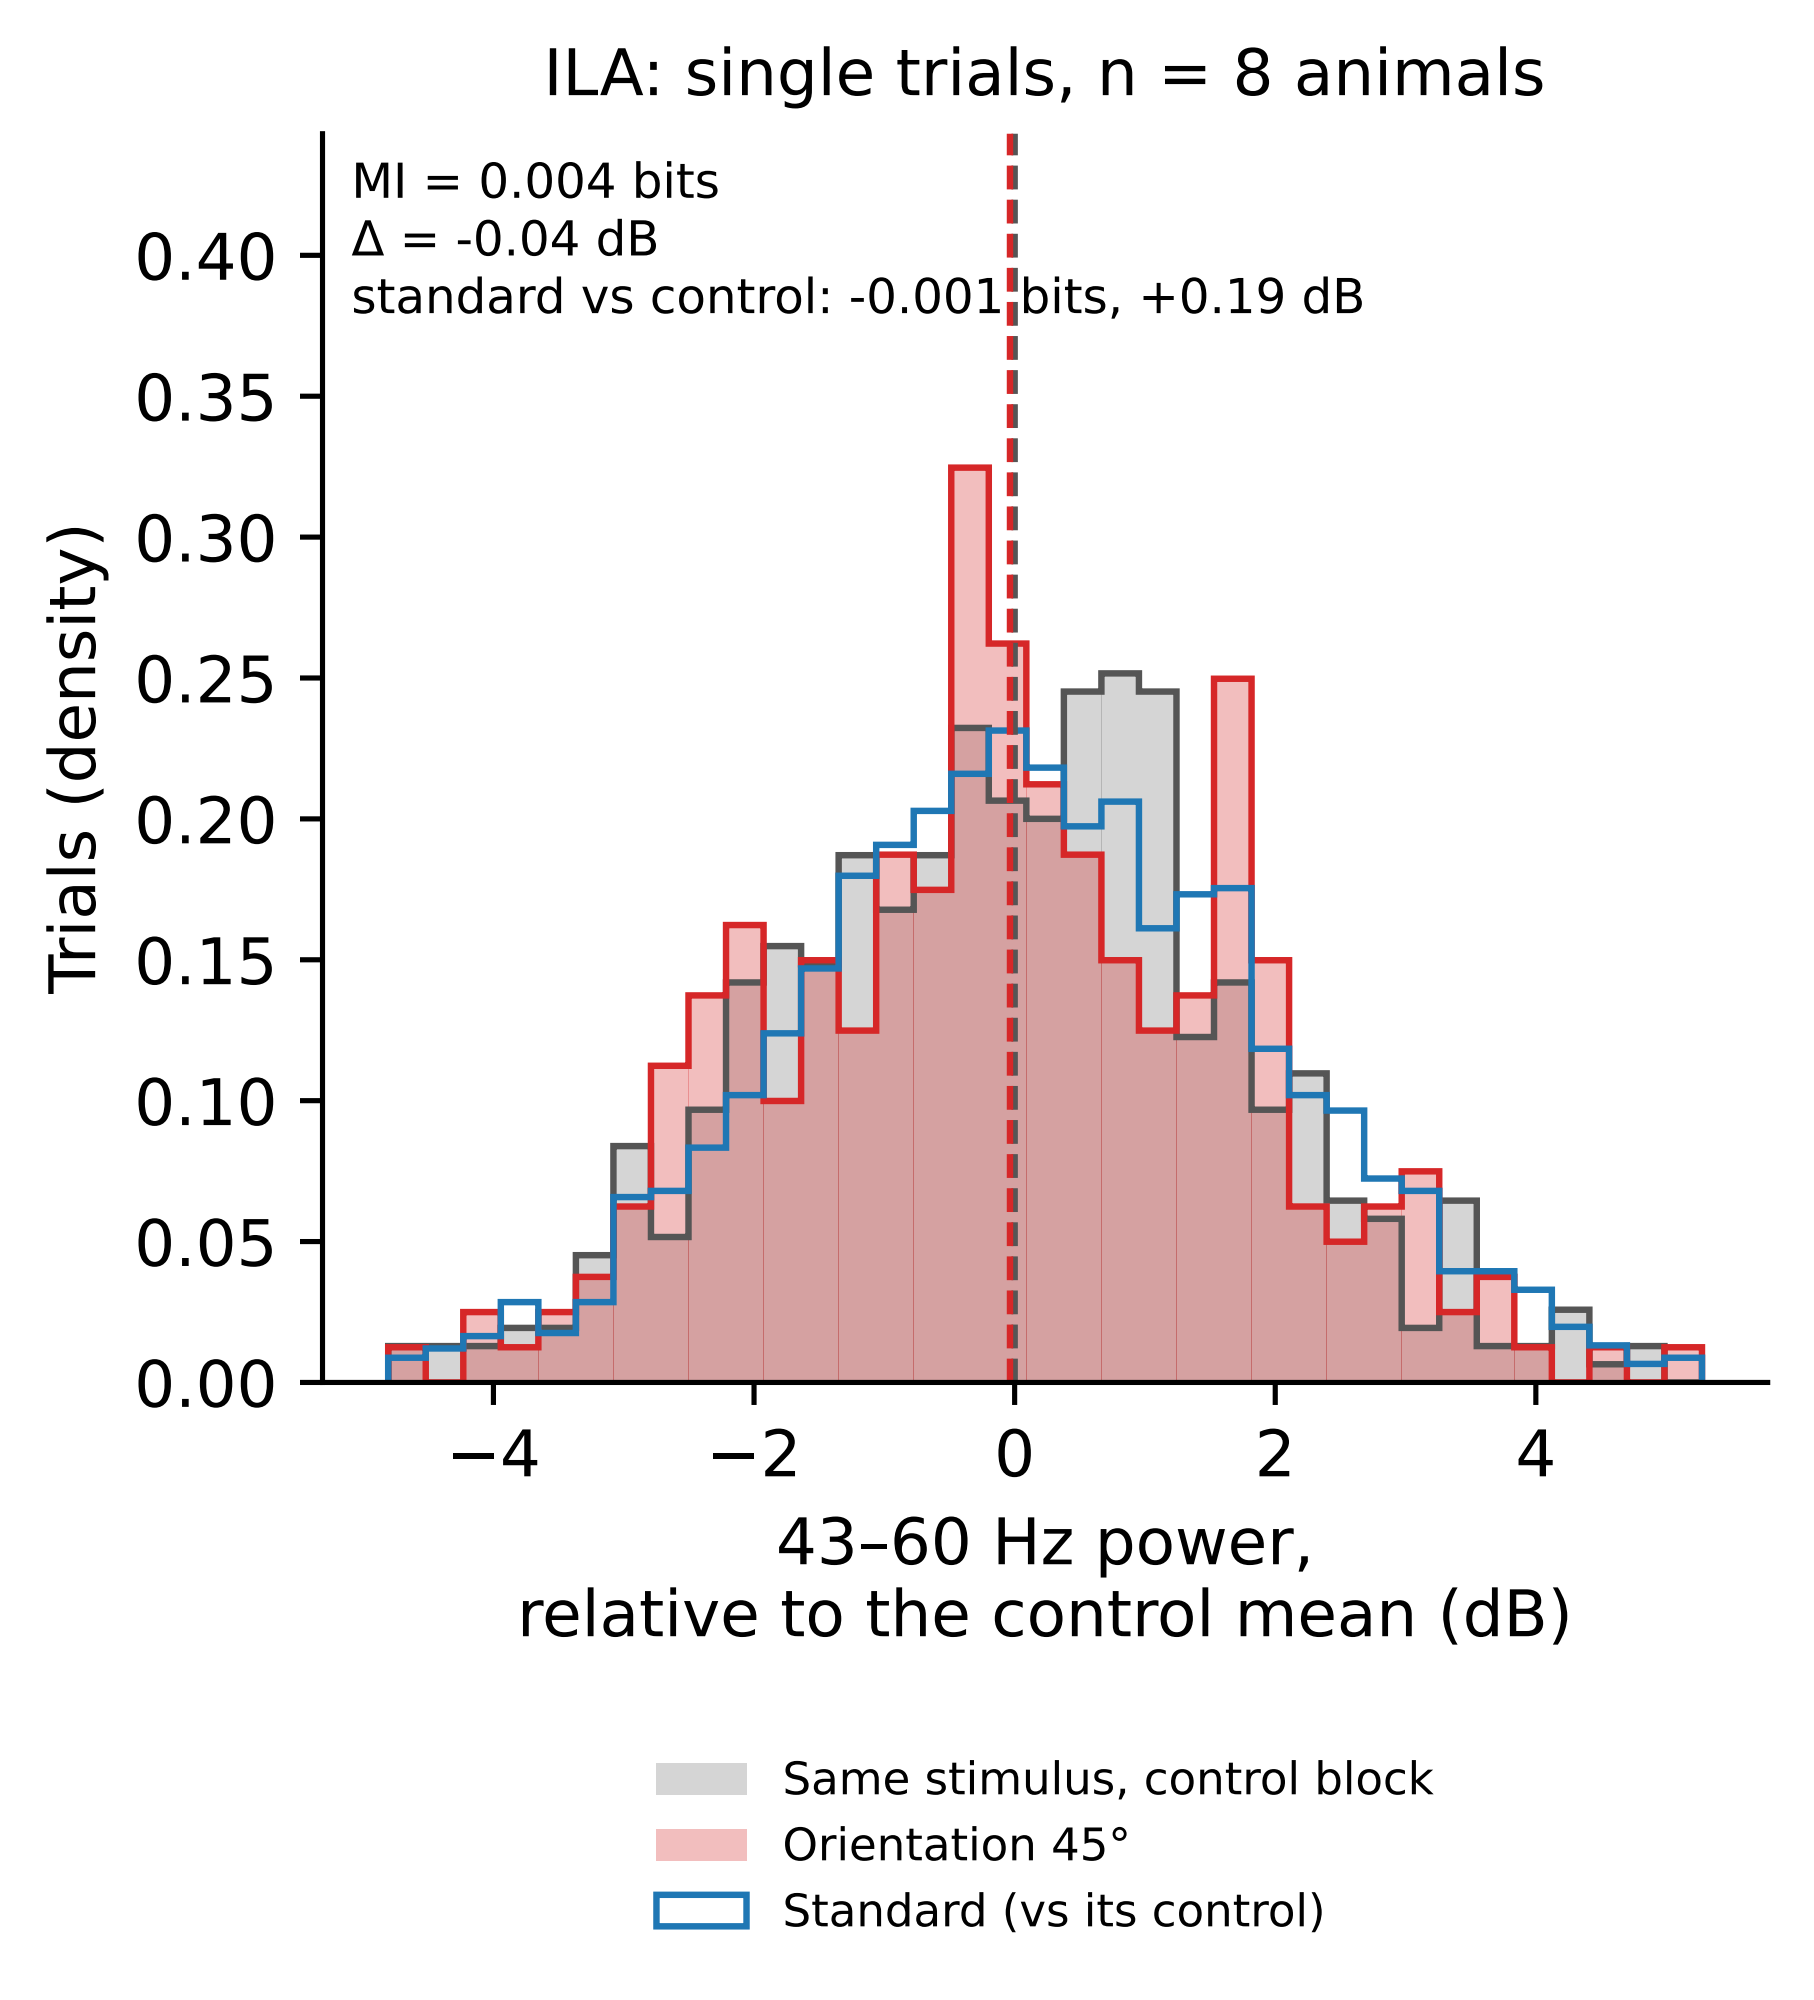
ILA: single trials, n = 8 animals
MI = 0.004 bits
Δ = -0.04 dB
standard vs control: -0.001 bits, +0.19 dB
Trials (density)
0.00
0.05
0.10
0.15
0.20
0.25
0.30
0.35
0.40
−4
−2
0
2
4
43–60 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 45°
Standard (vs its control)