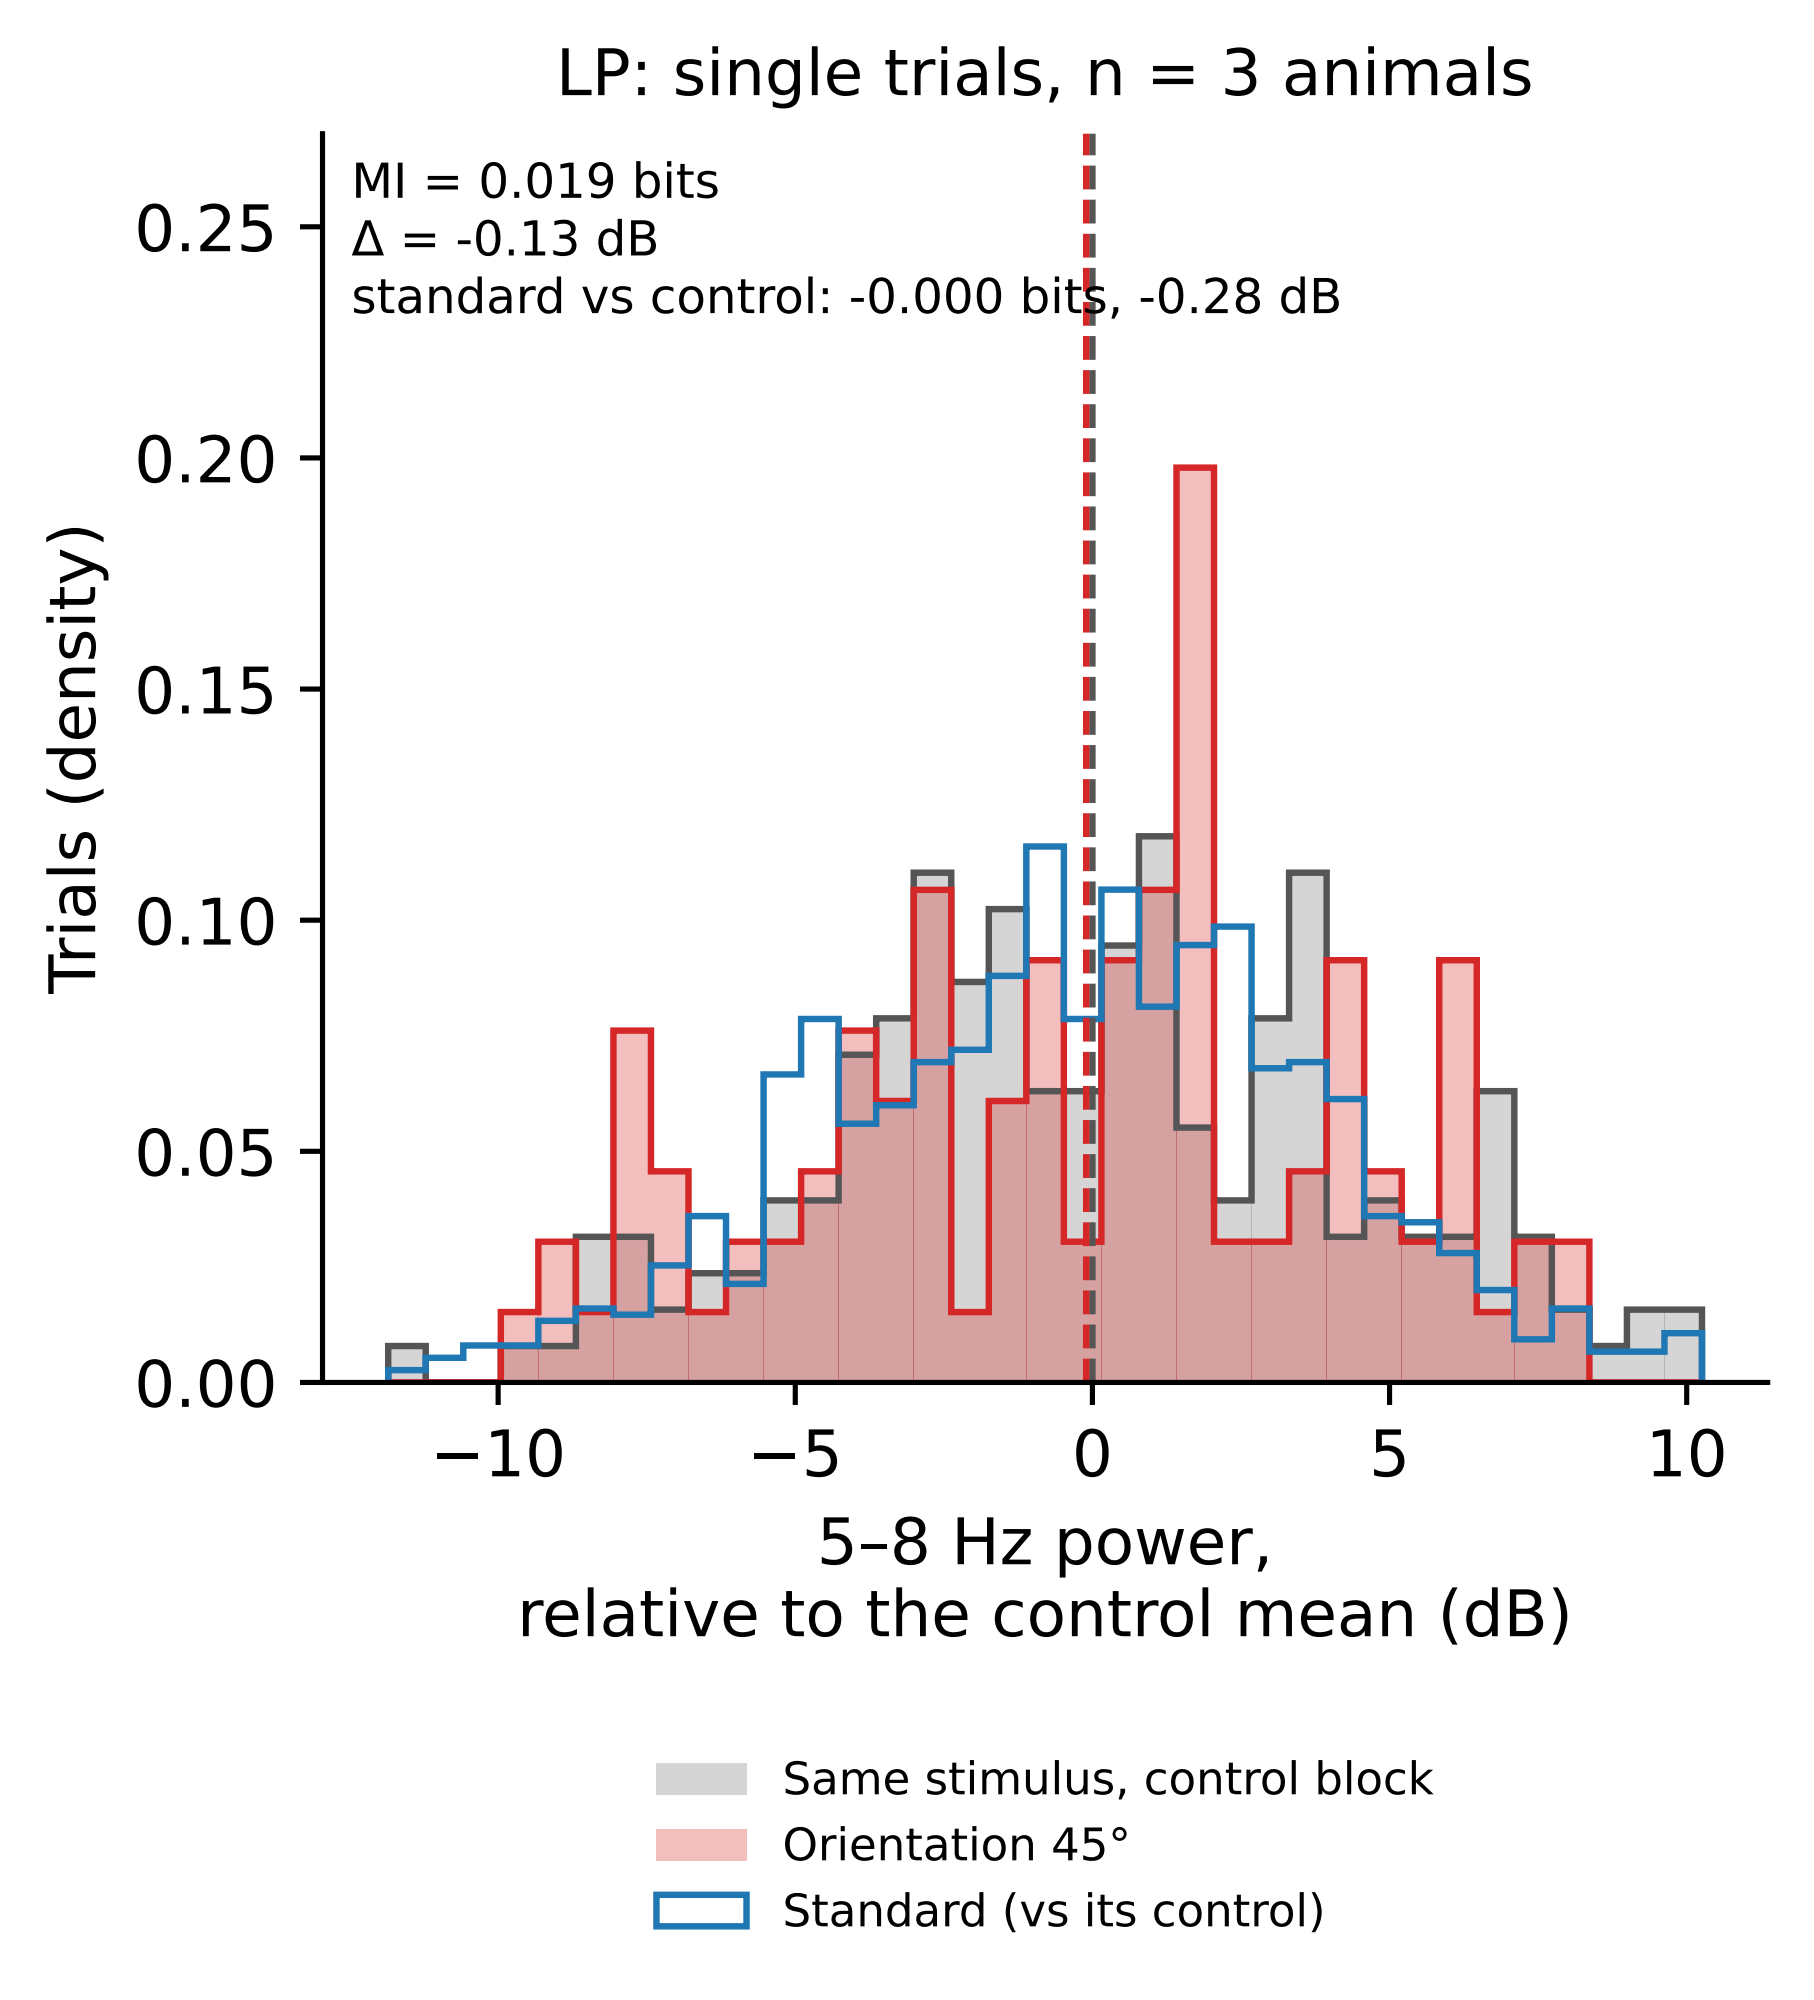
LP: single trials, n = 3 animals
MI = 0.019 bits
Δ = -0.13 dB
standard vs control: -0.000 bits, -0.28 dB
Trials (density)
0.25
0.20
0.15
0.10
0.05
0.00
−10
−5
0
5
10
5–8 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 45°
Standard (vs its control)