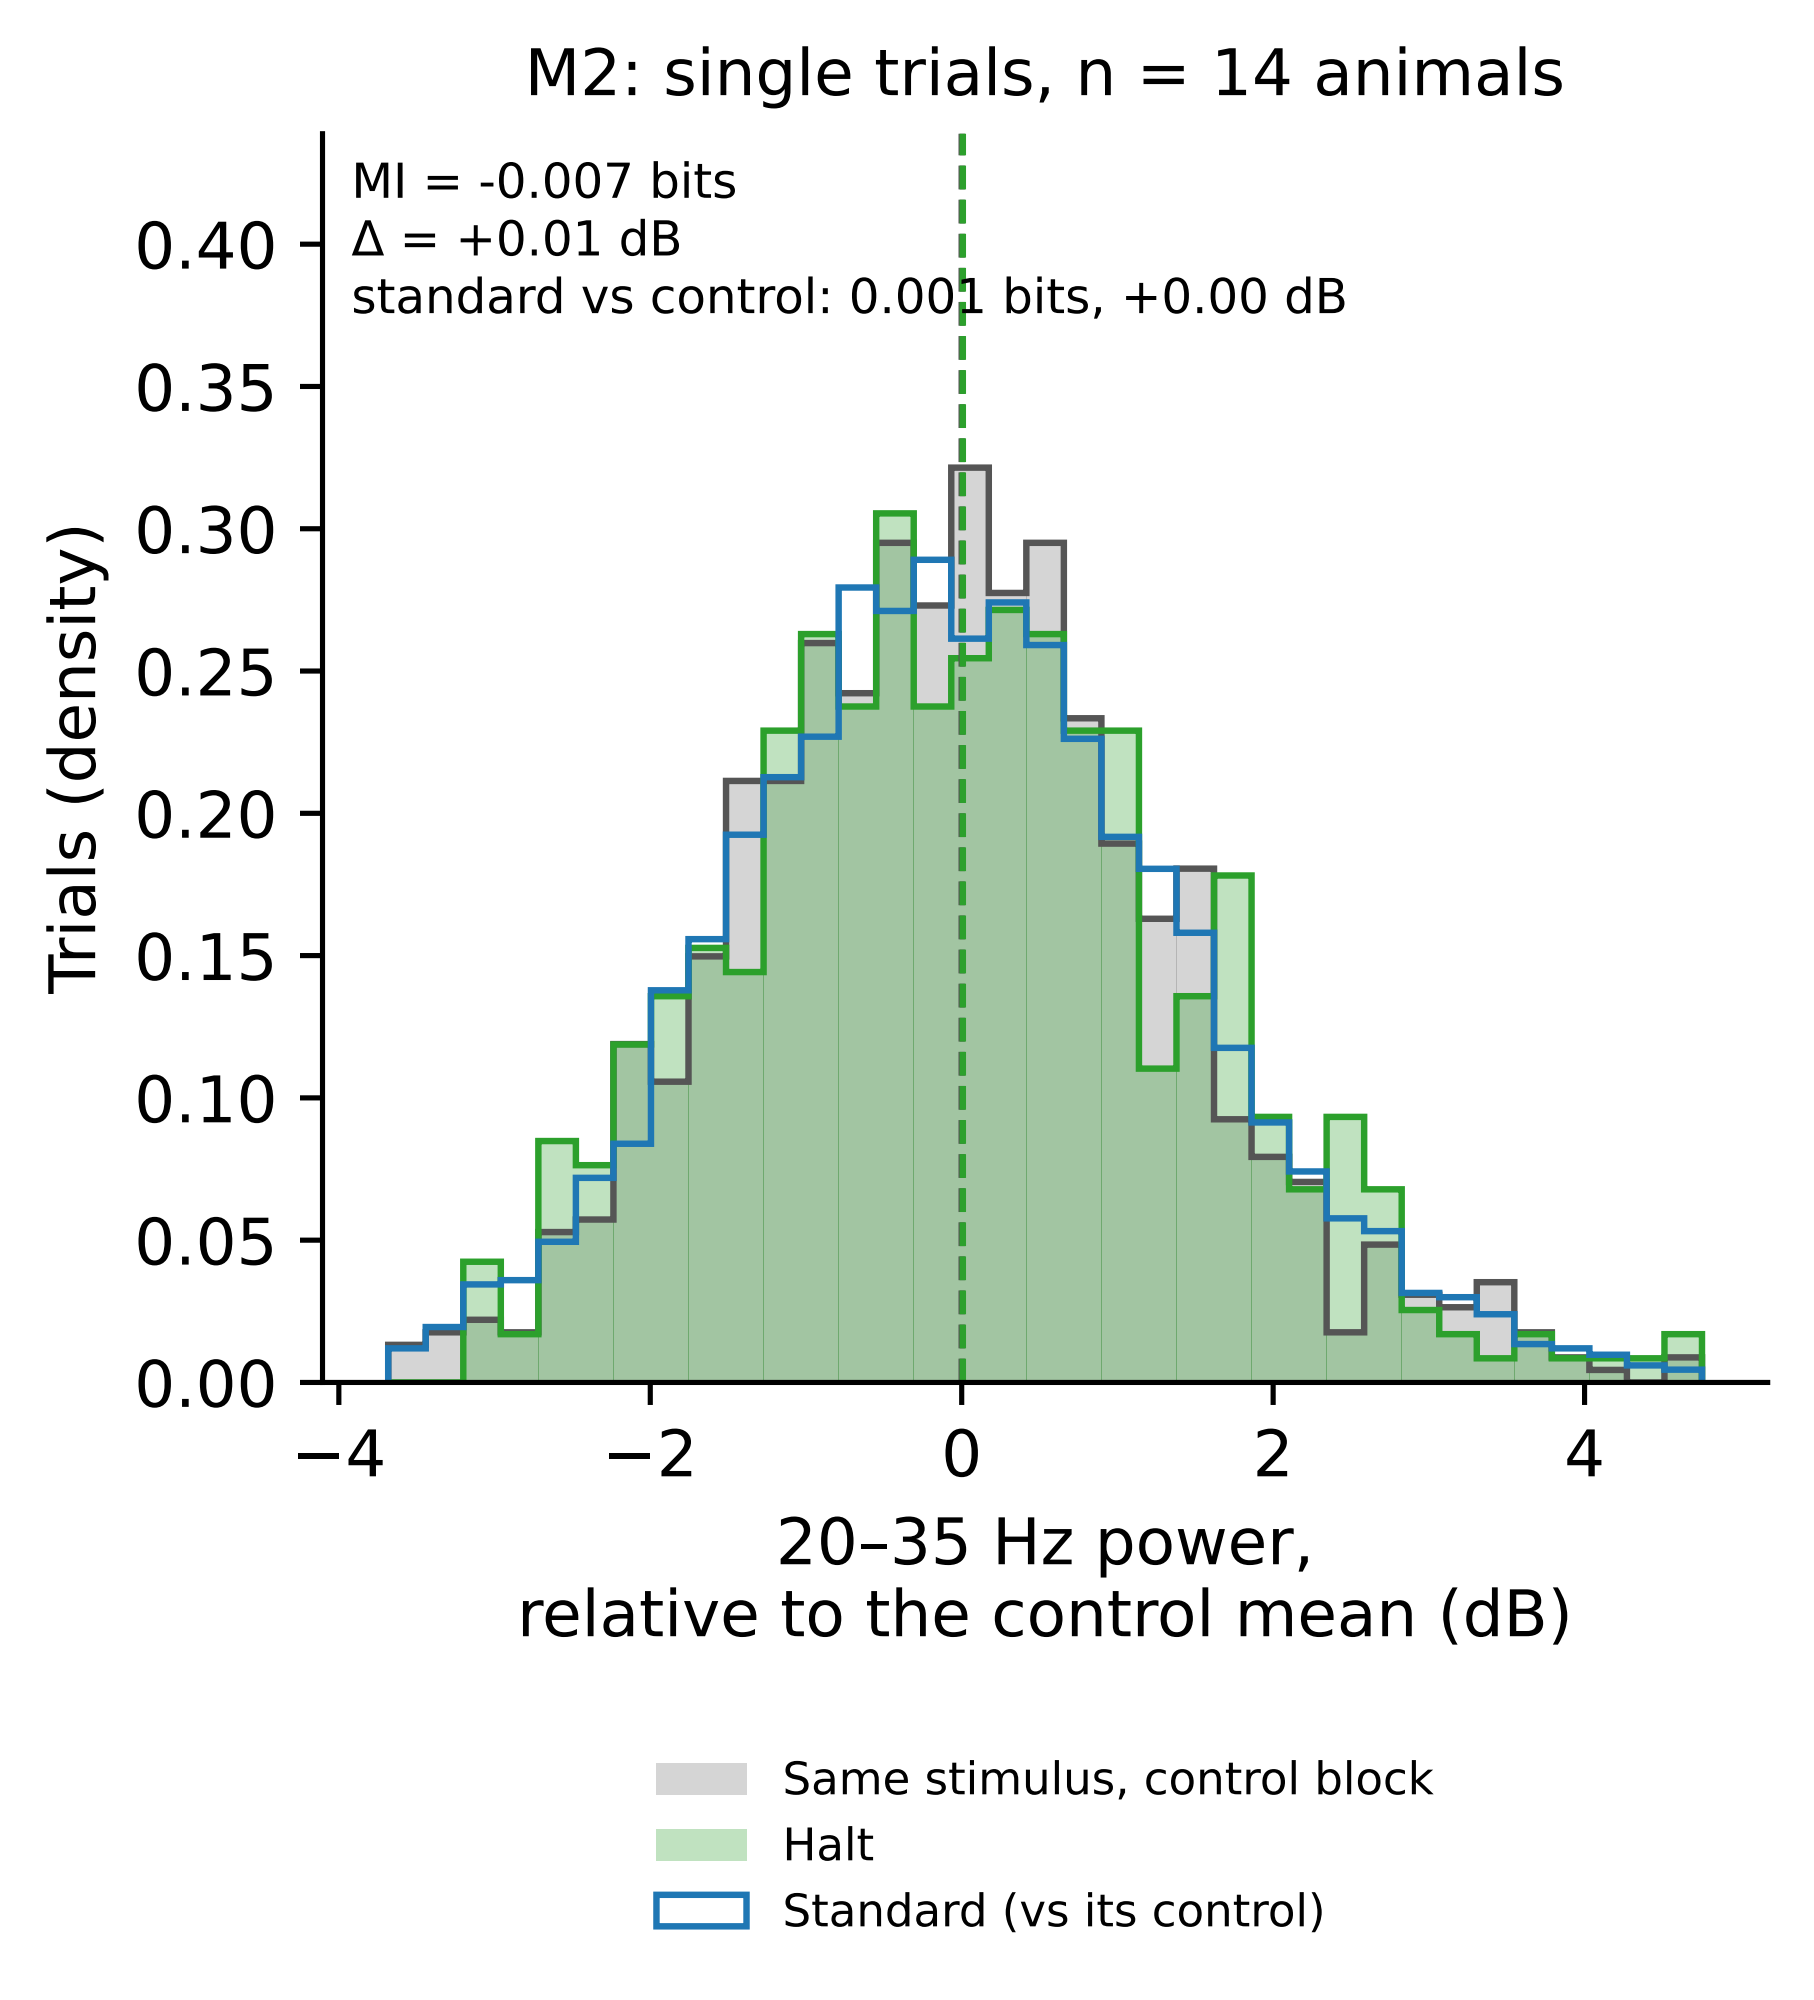
M2: single trials, n = 14 animals
MI = -0.007 bits
Δ = +0.01 dB
standard vs control: 0.001 bits, +0.00 dB
Trials (density)
0.00
0.05
0.10
0.15
0.20
0.25
0.30
0.35
0.40
−4
−2
0
2
4
20–35 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Halt
Standard (vs its control)