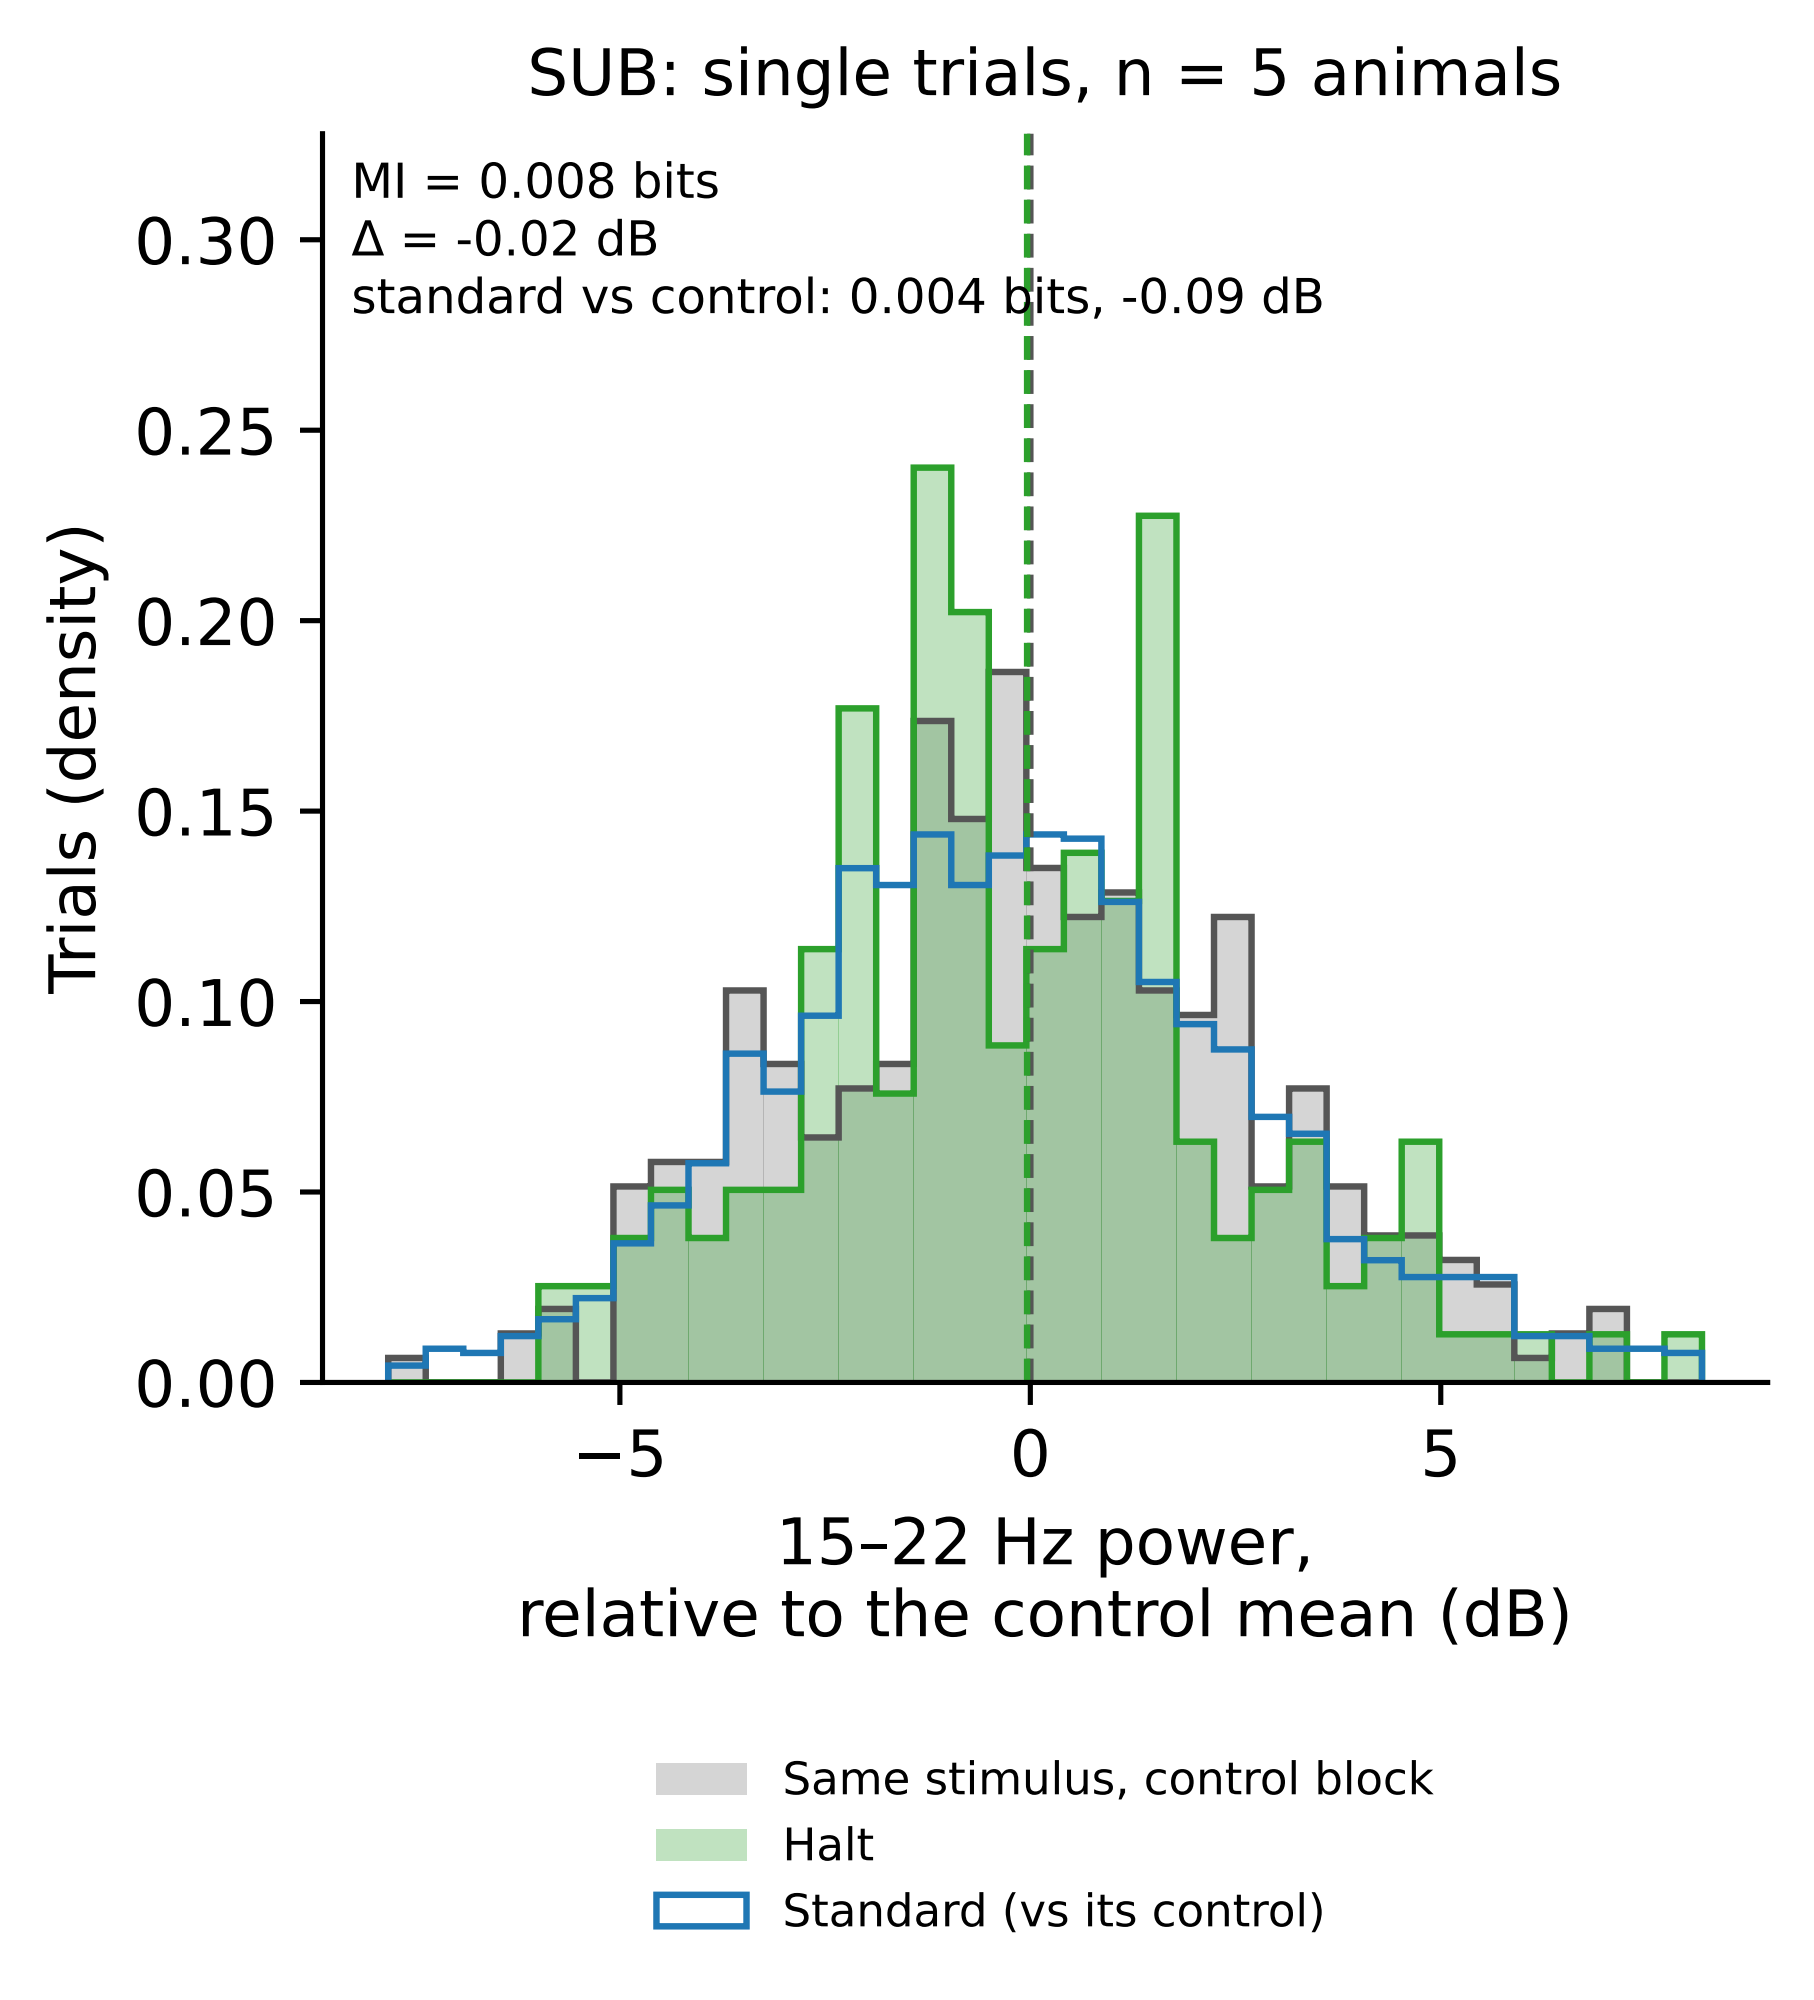
SUB: single trials, n = 5 animals
MI = 0.008 bits
Δ = -0.02 dB
standard vs control: 0.004 bits, -0.09 dB
Trials (density)
0.30
0.25
0.20
0.15
0.10
0.05
0.00
−5
0
5
15–22 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Halt
Standard (vs its control)