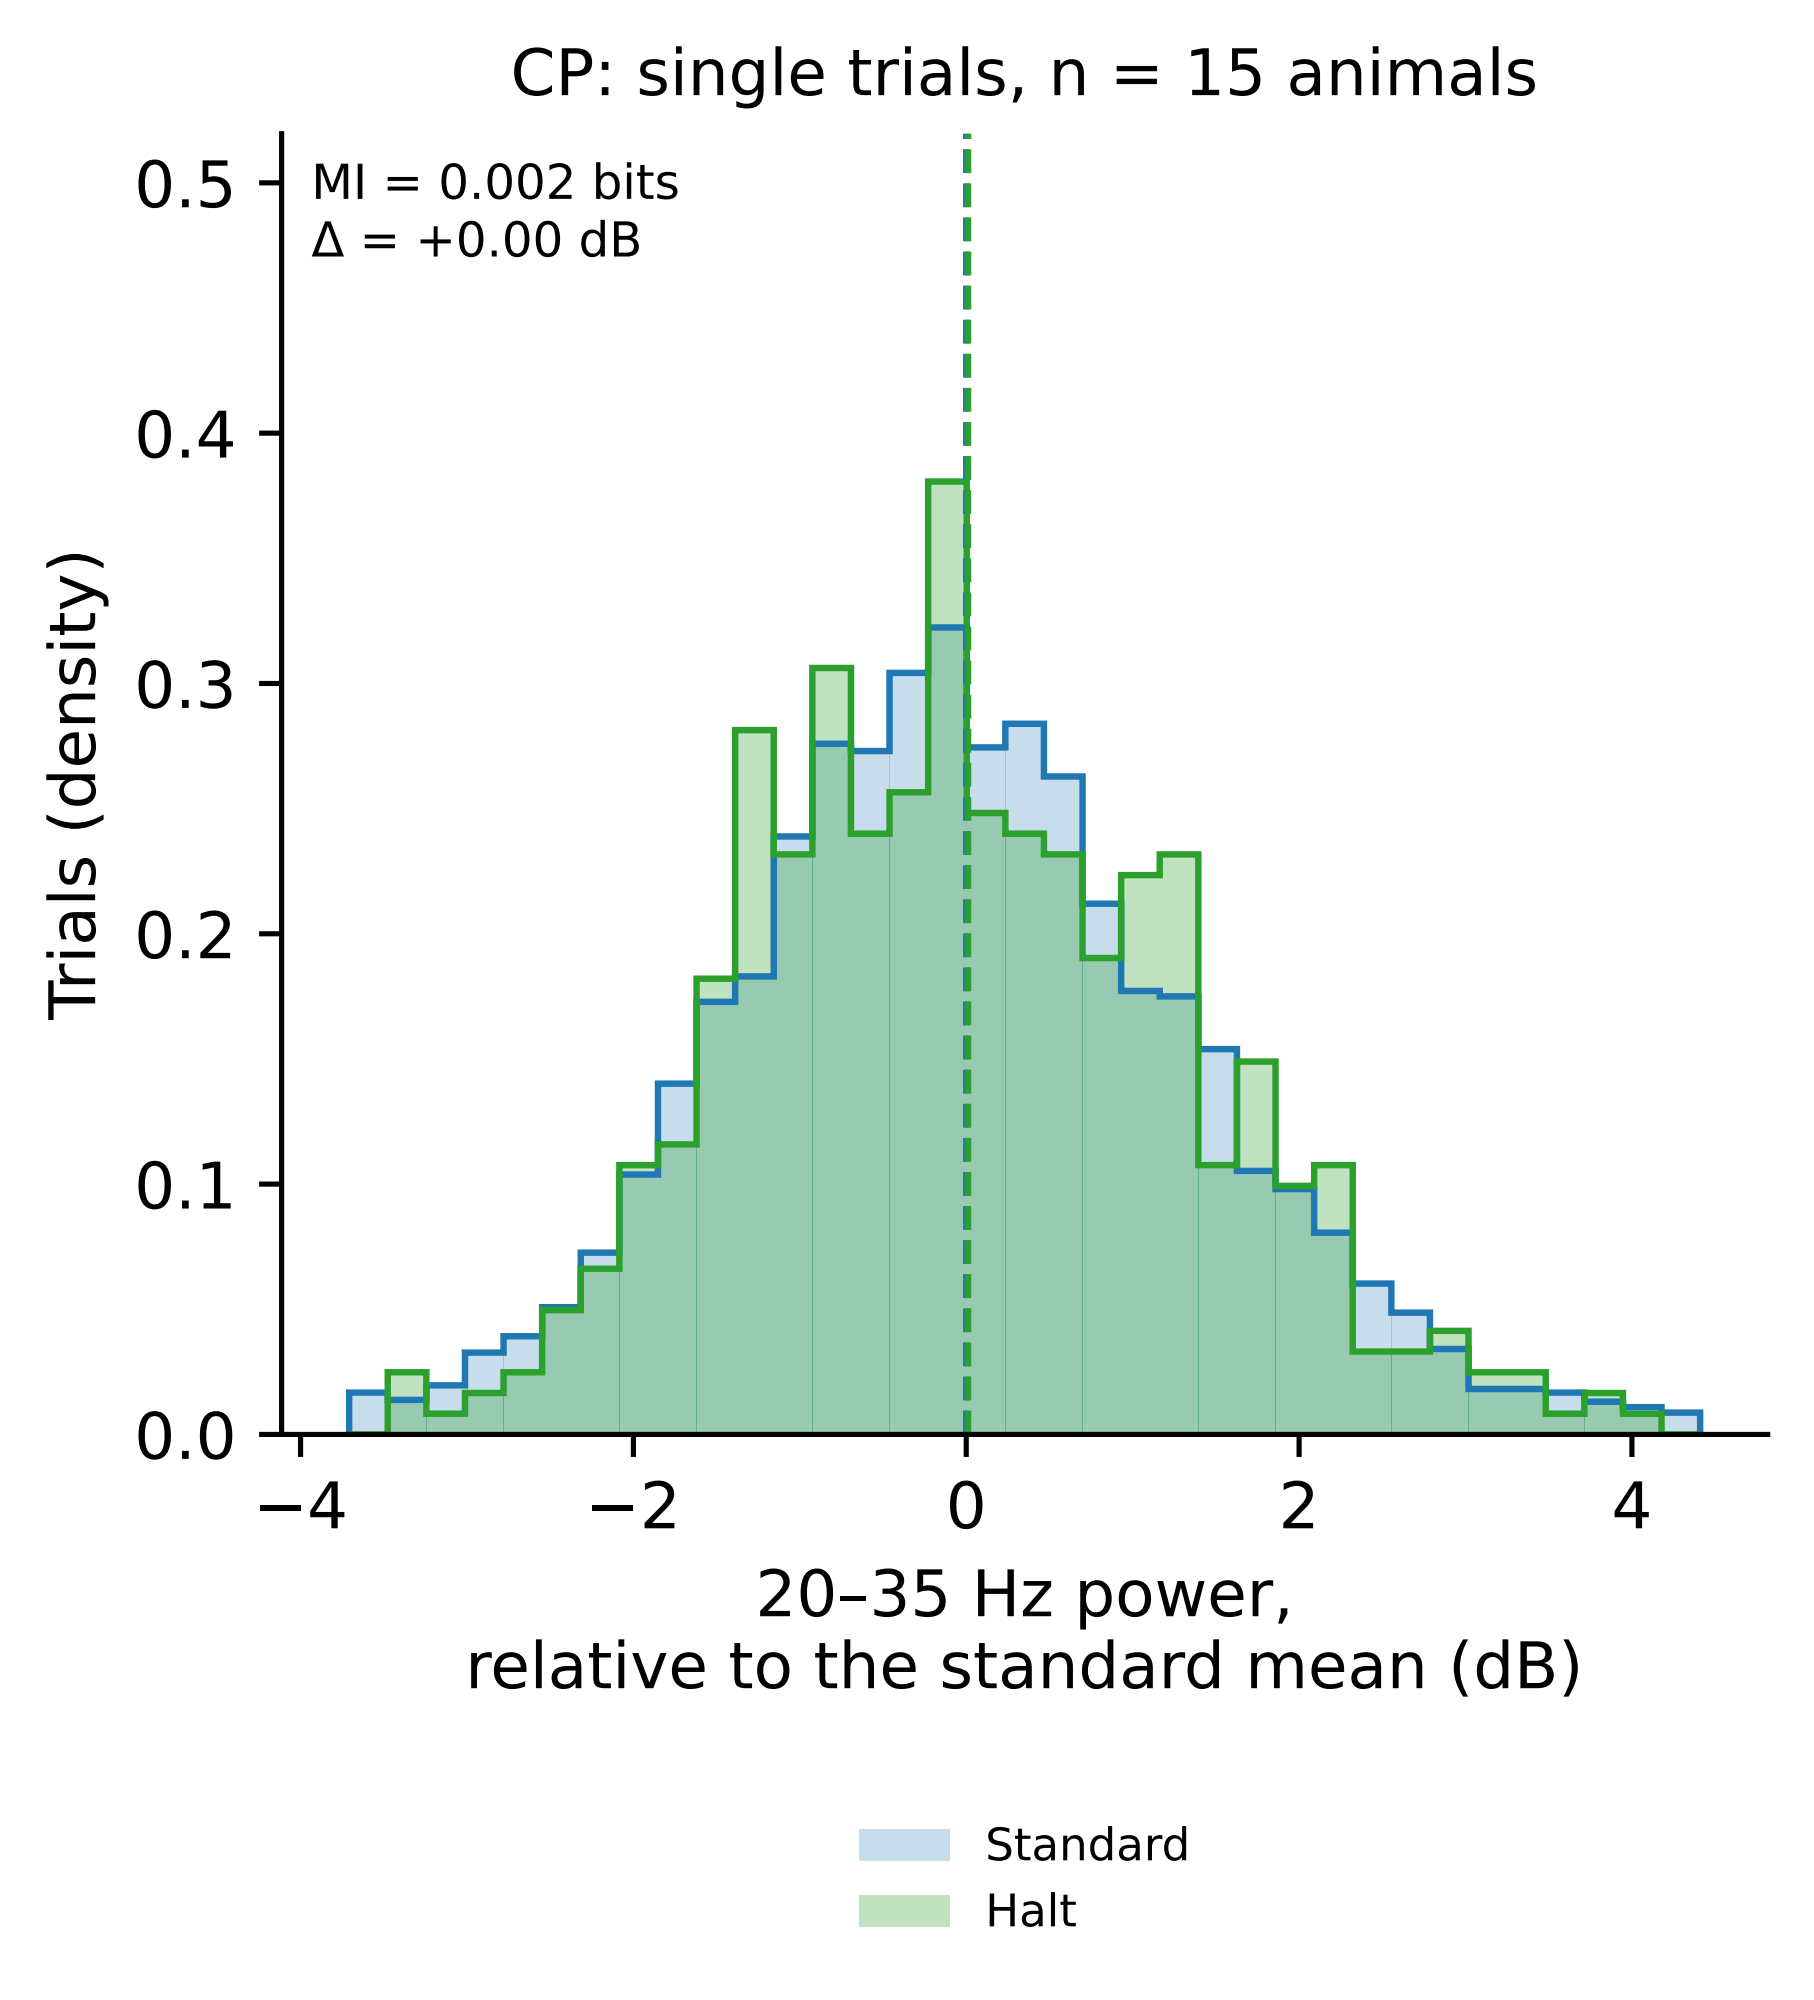
CP: single trials, n = 15 animals
MI = 0.002 bits
Δ = +0.00 dB
Trials (density)
0.0
0.1
0.2
0.3
0.4
0.5
−4
−2
0
2
4
20–35 Hz power,
relative to the standard mean (dB)
Standard
Halt