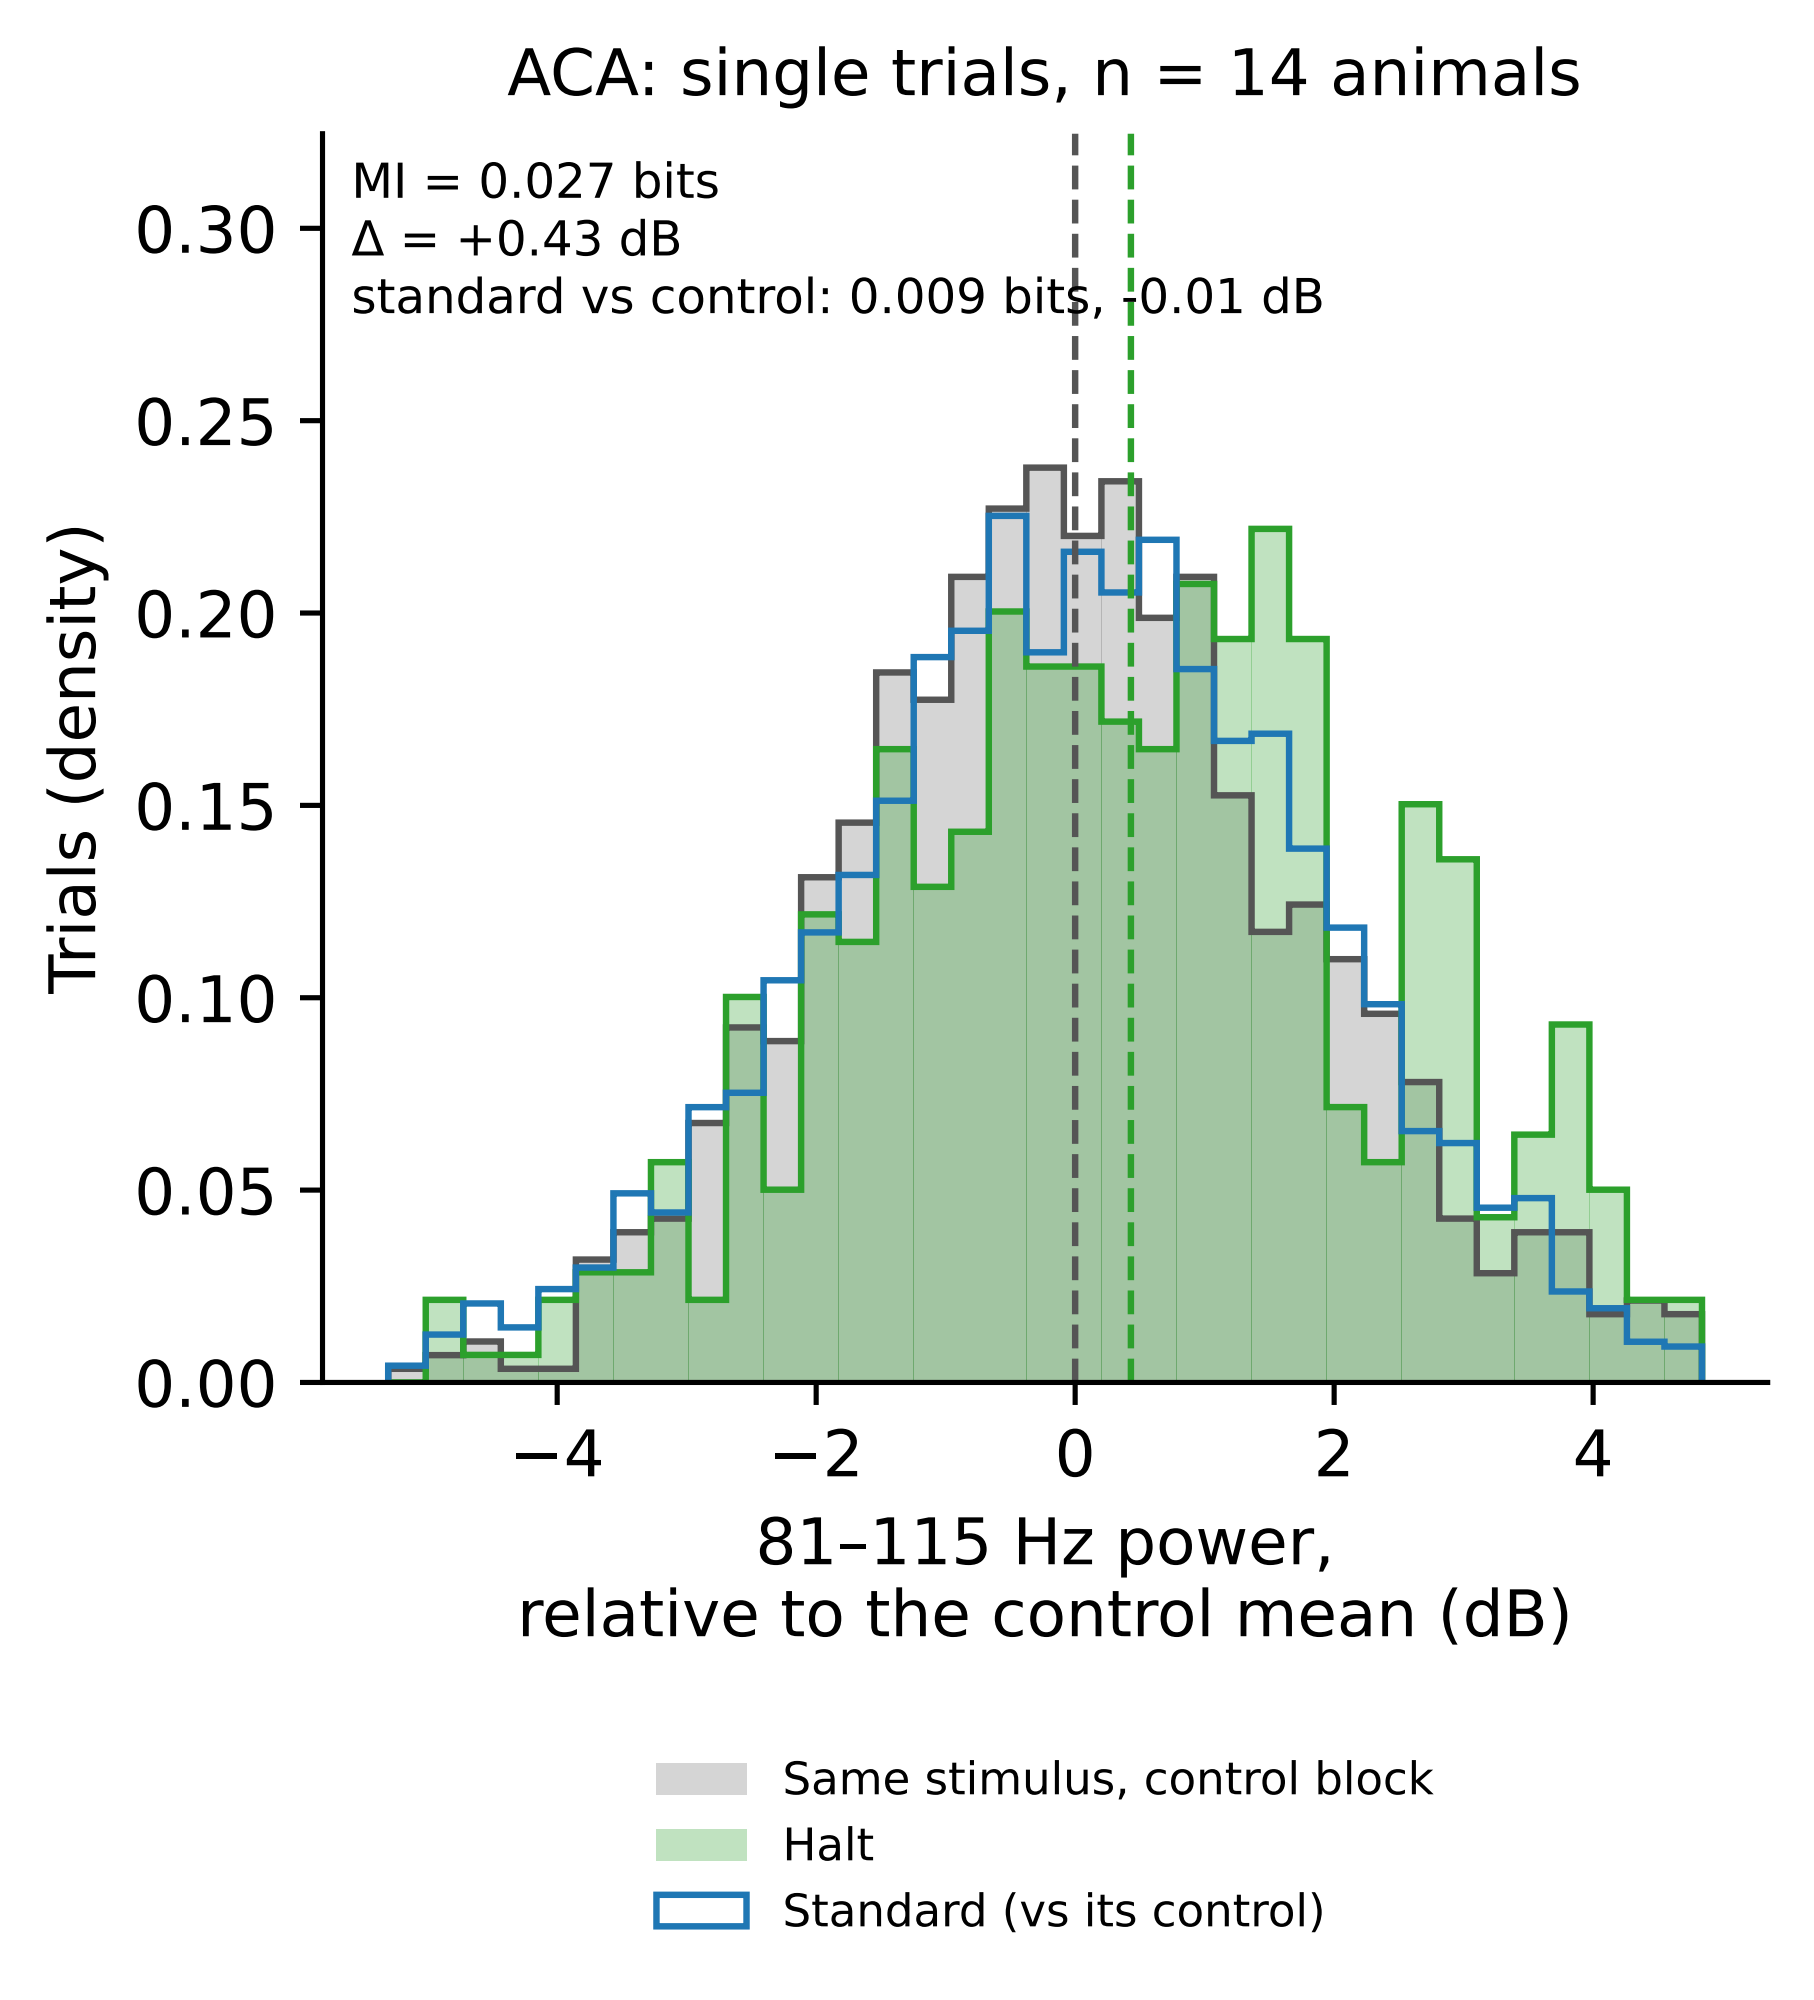
ACA: single trials, n = 14 animals
MI = 0.027 bits
Δ = +0.43 dB
standard vs control: 0.009 bits, -0.01 dB
Trials (density)
0.00
0.05
0.10
0.15
0.20
0.25
0.30
−4
−2
0
2
4
81–115 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Halt
Standard (vs its control)