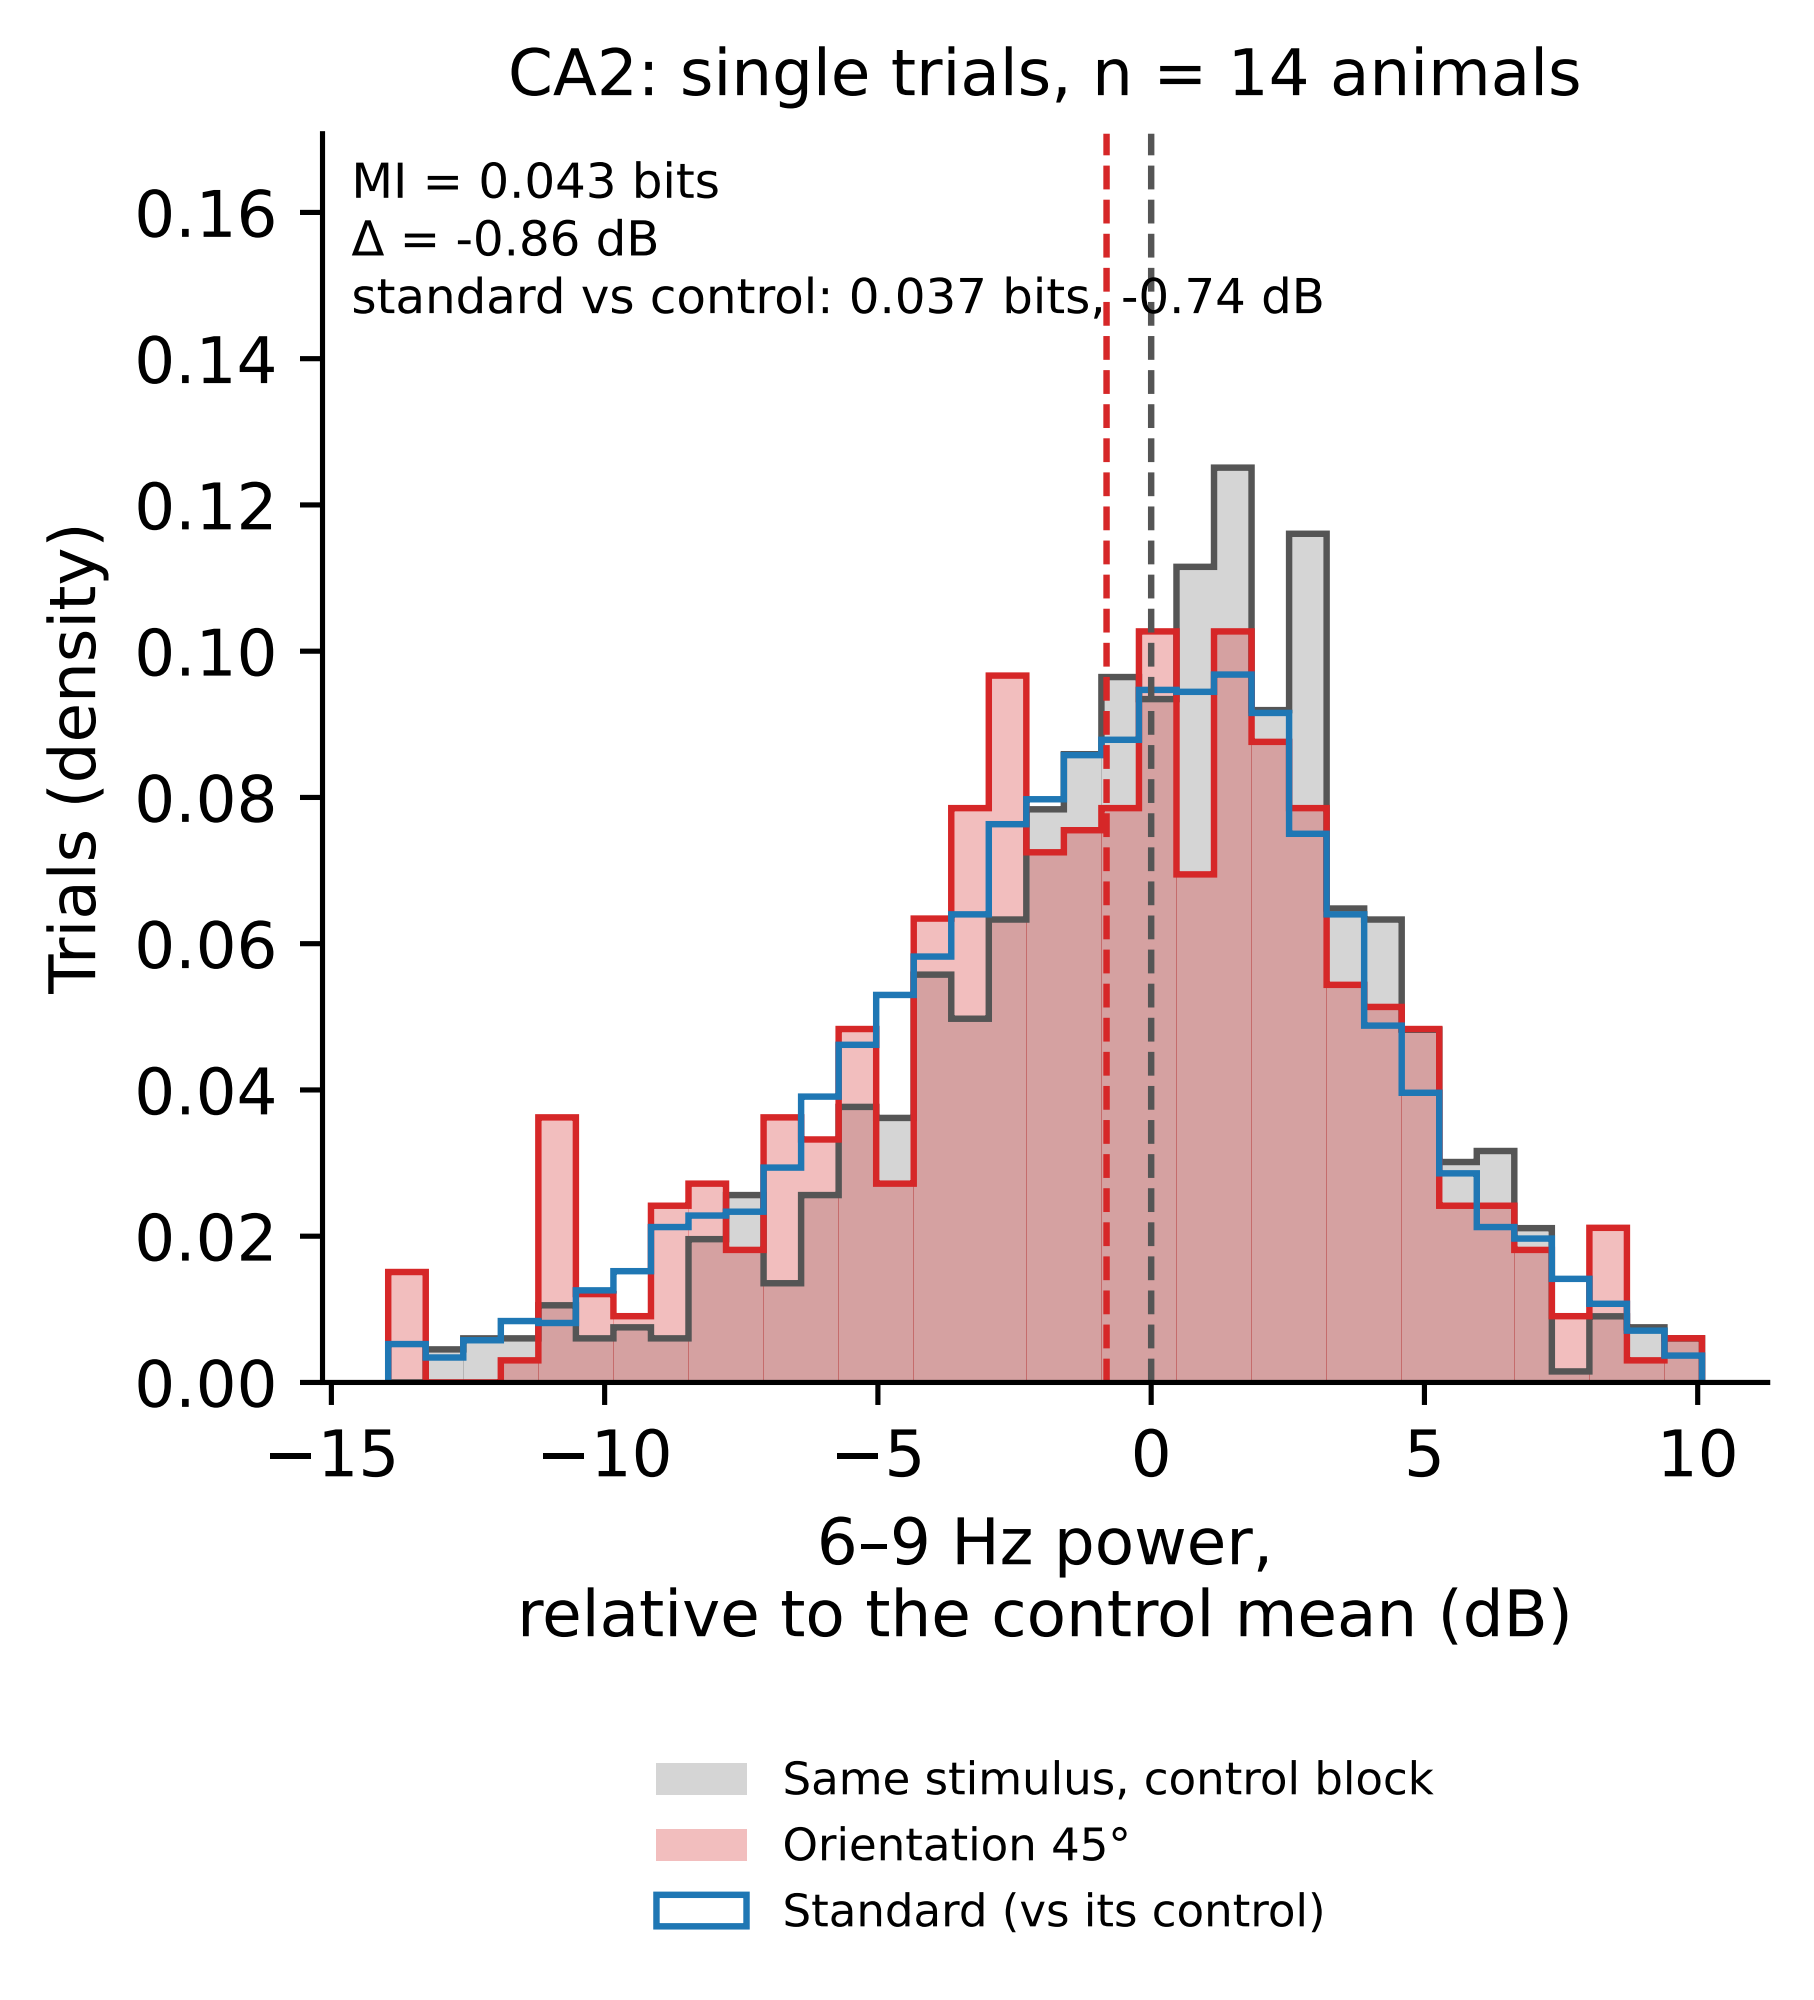
CA2: single trials, n = 14 animals
MI = 0.043 bits
Δ = -0.86 dB
standard vs control: 0.037 bits, -0.74 dB
Trials (density)
0.16
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
−15
−10
−5
0
5
10
6–9 Hz power,
relative to the control mean (dB)
Same stimulus, control block
Orientation 45°
Standard (vs its control)